



AVB32V03C
CM500 series
Commercial

HIGH RESOLUTION TOUCH SCREEN

Digital Thermostat with HumidityControl

Up to 3-heat & 2-cool



with
Wi-Fi

**Owner's Manual &
Installation Instructions**



CAUTION

Follow the Installation Instructions before proceeding. Set the thermostat mode to “OFF” prior to changing settings in setup or restoring Factory Defaults.

FCC Compliance Statement

This equipment has been tested and found to comply with the limits for an intentional radiator, pursuant to Part 15, subpart C of the FCC rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference in radio communications. However, there is no guarantee that the interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that of the receiver.
- Consult the dealer or an experienced radio or TV technician for help.

Notice: Only peripherals complying with FCC limits may be attached to this equipment. Operation with noncompliant peripherals or peripherals not recommended by ClimateMaster, is likely to result in interference to radio and TV reception. Changes or modifications to the product, not expressly approved by ClimateMaster could void the user's authority to operate the equipment.

FCC - INDOOR Mobile Radio Information:

To comply with FCC/IC RF exposure limits for general population / uncontrolled exposure, the antenna(s) used for this transmitter must be installed to provide a separation distance of at least 20 cm from all persons and must not be co-located or operating in conjunction with any other antenna or transmitter.

This Device complies with Industry Canada License-exempt RSS standard(s). Operation is subject to the following two conditions: 1) this device may not cause interference, and 2) this device must accept any interference, including interference that may cause undesired operation of the device.

Under Industry Canada regulations, this radio transmitter may only operate using an antenna of a type and maximum (or lesser) gain approved for the transmitter by Industry Canada. To reduce potential radio interference to other users, the antenna type and its gain should be so chosen that the equivalent isotropically radiated power (e.i.r.p.) is not more than that necessary for successful communication.

Cet appareil est conforme avec Industrie Canada, exempts de licence standard RSS(s). Son fonctionnement est soumis aux deux conditions suivantes: 1) ce dispositif ne doit pas causer d'interférences, et 2) ce dispositif doit accepter toute interférence, y compris les interférences qui peuvent causer un mauvais fonctionnement de l'appareil.

En vertu des règlements d'Industrie Canada, cet émetteur de radio ne peut fonctionner en utilisant une antenne d'un type et maximale (ou moins) Gain approuvé pour l'émetteur par Industrie Canada. Pour réduire les interférences radio potentielles aux autres utilisateurs, le type d'antenne et son gain doivent être choisis afin que la puissance isotrope rayonnée équivalente (PIRE) ne est pas plus de ce qui est nécessaire pour une communication réussie.

We, ClimateMaster, declare under our sole responsibility that the device to which this declaration relates: Complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

This color touchscreen has the ability to receive updates to its firmware. Periodically firmware updates are released by the manufacturer to add features and/or performance enhancements. This manual was produced reflecting the most current firmware/feature set at the time of publication, firmware rev. 5.10. Firmware releases after rev. 5.10 may not be adequately depicted in this manual. Please refer to the appropriate website or contact your place of purchase to learn about changes to the thermostat after firmware release 5.10.



Industry
Canada

Industrie
Canada

Glossary of Terms

Auto-Changeover: A mode in which the thermostat will turn on the heating or cooling based on room temperature demand.

Cool Setpoint: The warmest temperature that the space should rise to before cooling is turned on (without regard to deadband).

Deadband: The number of degrees the thermostat will wait, once a setpoint has been reached, before energizing heating or cooling.

Differential: The forced temperature difference between the *heat setpoint* and the *cool setpoint* in *Auto Mode*.

Heat Setpoint: The coolest temperature that the space should drop to before heating is turned on (without regard to deadband).

Icon: The word or symbol that appears on the thermostat display.

Mode: The current operating condition of the thermostat (i.e. Off, Heat, Cool, Auto).

Non-Programmable Thermostat: A thermostat that does not have the capability of running *Time Period Programming*.

Override: Changing the state from occupied to unoccupied, or from unoccupied to occupied settings.

Programmable Thermostat: A thermostat that has the capability of running *Time Period Programming*.

Temperature Swing: *Same as Deadband.*

Time Period Programming: A program that allows the thermostat to automatically adjust the *heat setpoint* and/or the *cool setpoint* based on the time of the day. *Same as Schedule.*

Table of Contents

GET TO KNOW YOUR THERMOSTAT

Home Screen	1
Menu Screens.....	1
Dropdown Dashboard	2
Care and Use of Your Thermostat	5

QUICK START

Selecting Your Desired Temperature and Mode	6
Using the Fan Button	6
Using the Override Button.....	7
Setting the Time & Date	8
Setting the Time.....	9
Setting the Date	10
Daylight Savings Setup	10
Connecting to Wi-Fi.....	11
WiFi Set up - Create a Skyport Account.....	13

MAIN MENU BUTTONS

SCHEDULE.....	14
View My Schedule.....	15
Edit My Schedule	15
Unoccupied Settings	16
FAN SETTINGS.....	17
Fan On/Off Auto	18
Occupied Fan State	18
Fan Purge	18
Fan Purge Timer.....	18
SCREENSAVER	19
Screensaver On/Off	20
Screensaver Setup	20
Screensaver Preview.....	20

Table of Contents

ALERTS	21
View Current Alerts.....	22
Reset Alerts	22
Set/Edit Reminders.....	22
Service Information (Who To Call For Service)	22
DISPLAY	23
Active Brightness	24
Idle Brightness	24
Night Dimmer	24
Maintenance.....	25
PREFERENCES	26
User Interface Themes	27
Custom Wallpaper	27
Heat/Cool Indicator	27
Sound Options	27
HUMIDITY	28
Humidification Settings	29
Dehumidification Settings	29
HOLIDAYS	30
Holiday Schedule On/Off.....	31
Edit Holidays.....	31
Preset Holidays.....	33
SECURITY	34
Auto Screenlock	35
Setpoint Limits	35
Maximum Override Time	35
INFORMATION	36
View Runtime Graphs	37
Who to Call for Service.....	37

Table of Contents

SETTINGS.....	38
Thermostat Name.....	42
Available Modes	42
SD Card (Import and Export).....	42
GENERAL SETUP	42
Units (F or C).....	42
Language	43
Smart Recovery On/Off.....	43
AUTOMATED DEMAND RESPONSE	44
INSTALLATION SETTINGS	58
Heat & Cool Stages.....	58
Heat & Cool Stages.....	58
Compressor Stages	58
Aux Heat Stages	58
Timers & Deadbands	58
D/H Output Settings.....	60
Fan Off Delay	62
Sensor Settings	62
Control Source	62
Wireless Sensors	62
Add a New Sensor	61
Remove Sensor	61
Wired Sensor	61
Calibrate Sensors.....	62
Test Outputs	62
Dealer Information	63
Upgrade Firmware	63
Delete Custom Images	63
Reset to Factory Default Settings.....	63
Restart Thermostat.....	63

Table of Contents


WI-FI	64
Enabled	65
Status.....	65
Setup	65
Local API	65
Secure API.....	66
SKYPORT	69
Account.....	69
EMERGENCY HEAT	70
INSTALLATION INSTRUCTIONS	71
Remove & Replace the Old Thermostat	71
Wire Connections.....	72
The Thermostat Backplate.....	73
Explanation Of the Thermostat Dip Switches.....	74
Sample Wiring Diagrams	75
TROUBLESHOOTING.....	79
WARRANTY	80

Get To Know Your Thermostat


Home Screen

Backlit ColorTouch Display


Connectivity Symbol Table	
	Not connected to Wi-Fi
	Connected to local access point w/IP address without Skyport enabled
	Connected to local access point w/IP address, but not yet connected to Skyport
	Connected to Skyport

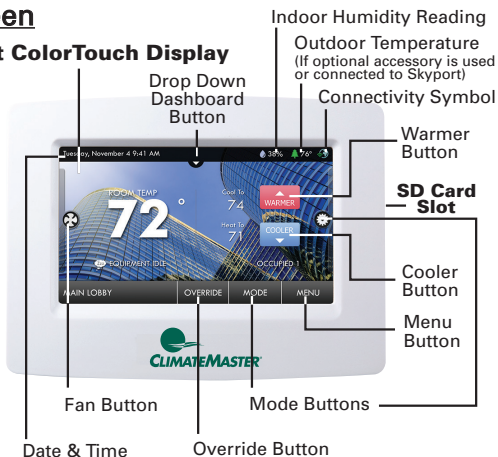

Main Menu Screen



Sub Menu Screen

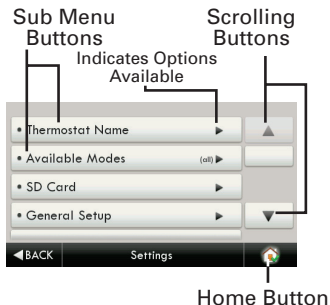

Get To Know Your Thermostat

Dropdown Dashboard *(The contents of your Dashboard may vary)*

The Dropdown Dashboard displays temperature, humidity, and other readings. It will also show the high and low readings of the day.




Connectivity Symbol Table

	Not connected to Wi-Fi
	Connected to local access point w/IP address without Skyport enabled
	Connected to local access point w/IP address, but not yet connected to Skyport
	Connected to Skyport

The dropdown dashboard will bring you into one of five screens. Icons at the bottom of each screen allow you to move between other screens to view (but not alter) various items within the thermostat.

These five screens are:

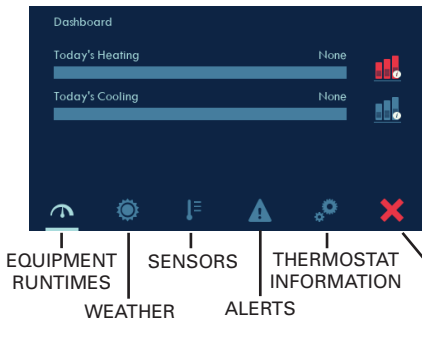


There is also a button to exit the dashboard and return to the home screen.

Get To Know Your Thermostat

Equipment Runtimes

This screen allows you to view daily heating and cooling runtimes and can show details about which stages were active. To view one week of runtime data, press menu > information > view runtime graphs

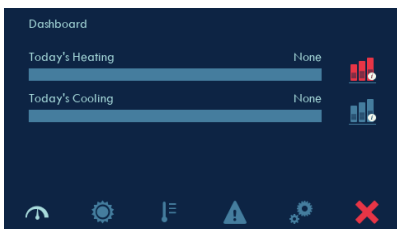

Weather

This screen only appears when the thermostat is communicating with Skyport. Current temperature/humidity and a 3 day forecast is shown based on the address details entered for the Skyport location that contains this thermostat.



Sensors


This screen shows values from the sensors inside of the thermostat, optional wired outdoor temperature sensor and paired wireless sensors. Daily min/max are also shown (resets at midnight).

Onboard	Sensor	Current	Day Range
	Room	70°	74°/64°
	Outdoor	84°	84°/72°
	Humidity	42%	24%-42%

Get To Know Your Thermostat




Alerts

This screen shows some information about any active alerts. More information about alerts as well as resetting active alerts can be found at menu > alerts.

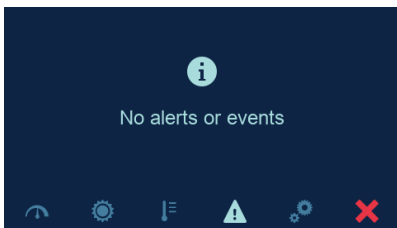

Thermostat Information


This section contains four different screens that allow easy viewing of the thermostat model number, firmware revision, wifi and Skyport status as well as DIP switch settings, active outputs and other items. Press on left side of screen to change between About, Equipment, Outputs and Service.

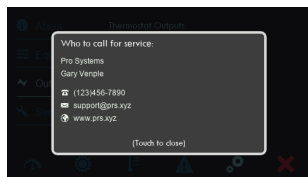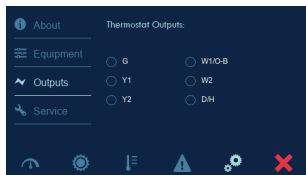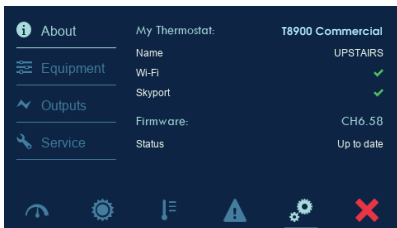

Get To Know Your Thermostat

Care and Use of Your Thermostat

Pencils, pens and other sharp objects should never be used on your thermostat; these may damage your touchscreen. Only use your finger tip to press the touchscreen buttons.

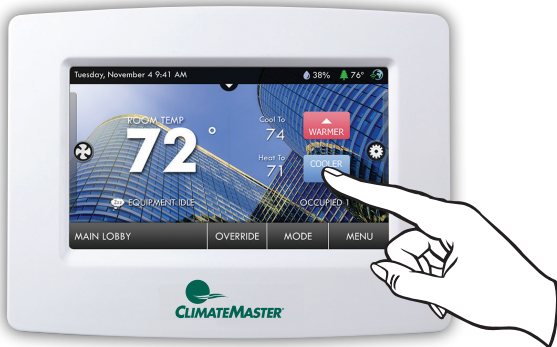

Use a soft, damp cloth to clean the screen.

DO NOT USE ABRASIVE CLEANERS OR CLEANERS THAT CONTAIN SOLVENTS. DO NOT SPRAY ANYTHING DIRECTLY ONTO THE THERMOSTAT.


Quick Start - Temperature, Modes & Fan

Selecting Your Desired Temperature and Mode

Press  or  to adjust temperature

The Heat or Cool Setpoint is the temperature the room has to reach before heating or cooling will turn on.

(Without regard to deadband)

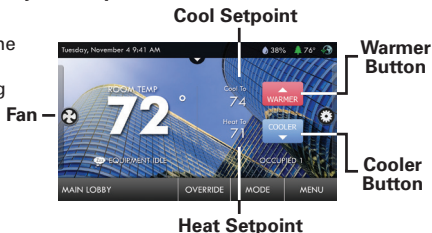

Press  or the **MODE Icon** 

HEAT will allow only heat operation.


COOL will allow only cool operation.

AUTO will allow both Heat and Cool operation.

OFF - heating and cooling systems are turned off.

AUTO-CHANGEOVER MODE - Pressing the WARMER or COOLER buttons in Auto mode will adjust both the heat and cool setpoints simultaneously. To adjust heat and cool setpoints individually, choose HEAT mode to adjust the heat setpoint and COOL mode to adjust the cool setpoint, then return to AUTO mode.

HEAT OR COOL MODE - Pressing the WARMER or COOLER buttons in Heat or Cool mode will adjust only the heat or cool setpoints.




Using the Fan Button

Press the **FAN Icon** 

FAN ON fan runs constantly except in OFF Mode.

FAN AUTO fan only runs with a heating or cooling demand.



Quick Start - Override

Using the Override Button

OVERRIDE

NOTE: Override may only be used when the thermostat is set to Program RUN or Holiday ON modes.



Unoccupied Operation - During programmed, unoccupied periods, pressing the **OVERRIDE** button will force the thermostat into Occupied 1 settings. When the **OVERRIDE** button is pressed, a timer screen will appear and allow the user to choose from 30 minutes to up to 4 hours of override time. To turn off the override timer, press the **OVERRIDE** button and when the timer screen appears, press **CANCEL OVERRIDE**.


Occupied Operation - During programmed, occupied periods, pressing the **OVERRIDE** button will force the thermostat into an unoccupied period for the rest of the day. During this forced unoccupied period the **OVERRIDE** button will operate as described above.

Holiday Operation - During Holiday Mode, pressing the **OVERRIDE** button will force the thermostat into Occupied 1 settings. When the **OVERRIDE** button is pressed, a timer screen will appear and allow the user to choose from 30 minutes to up to 4 hours of override time. To turn off the override timer, press the **OVERRIDE** button and when the timer screen appears, press **CANCEL OVERRIDE**.

Quick Start - Set Time & Date



NOTE: When the thermostat is connected to a Skyport account, the Time & Date are automatically synchronized to the Skyport Cloud, including automatic Daylight Savings adjustments. Your time zone is selected in the Skyport web application.

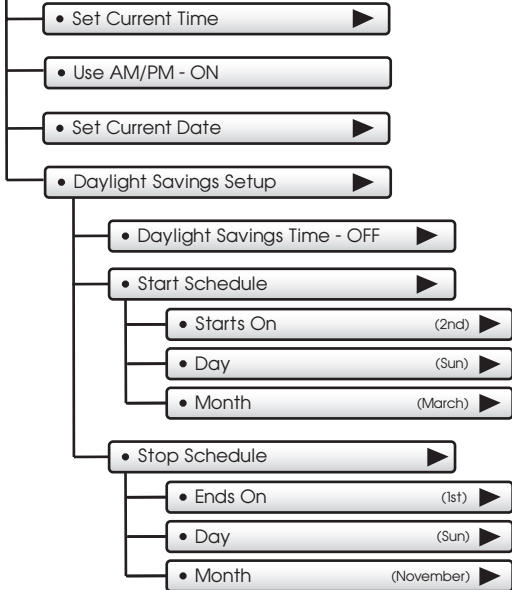

Quick Start - Set Time & Date

Setting the Time

Press **MENU** then **▼** to scroll down.

Press



Press



Press



and



to set the current time.



Press **◀ BACK** when finished.

Choose



For 12 hour AM/PM clock




For 24 hour clock

Press **◀ BACK** when finished.

Quick Start - Set Time & Date

Setting the Date

• Set Current Date 6/1/2013 ▶  Press

Press ◀ or ▶ to set the current month and year.

Press the day on the calendar

◀

Su	Mo	Tu	We	Th	Fr	Sa
27	28	29	30	1	2	3
4	5	6	7	8	9	10
11	12	13	14	15	16	17
18	19	20	21	22	23	24
25	26	27	28	29	30	31
1	2	3	4	5	6	7

▶

Press ◀ BACK when finished.

• Daylight Savings Setup ▶

Turn Daylight Savings Time on or off.

- Daylight Savings Time - OFF
- Daylight Savings Time - ON 

Adjust when Daylight Savings Time begins.

• Start Schedule

Adjust when Daylight Savings Time ends.

• Starts On (2nd) ▶

• Day (Sun) ▶

• Month (March) ▶

Press ◀ BACK

after making a change to a selection.

• Stop Schedule ▶

• Ends On (1st) ▶

• Day (Sun) ▶

• Month (November) ▶


Press ◀ BACK

or the Home button when finished.

Quick Start - Connect to Wi-Fi

Connect to Wi-Fi (from initial start up)

When power is connected to the thermostat and it has not been configured to connect to a Wi-Fi Access point, the following message appears:

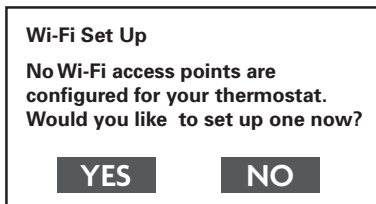

Press YES

Select the access point you wish to connect to from the list.



Enter the password for the Wi-Fi Access Point and press **NEXT**.



Select automatic setup and press **NEXT**.



When finished, a dialog box will appear confirming the successful connection to the local Wi-Fi Access Point.




Select **OK**, then the Wi-Fi status page will appear. Upon closing of the Wi-Fi status page, you will be asked to join the thermostat to a Skyport account.



Select **YES** and follow the onscreen instructions to create a new Skyport account or to add the thermostat to an existing account.

Quick Start - Connect to Wi-Fi (from menus)

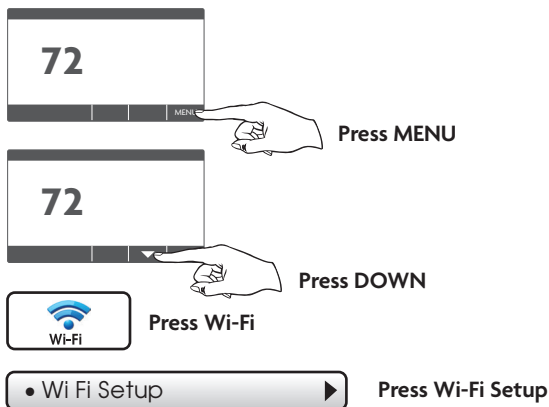

Select the access point from the list that you want to connect to.



Enter the password for the Wi-Fi Access Point and press **NEXT**.



Select automatic setup and press **NEXT**.



When finished, a dialog box will appear confirming the successful connection to the local Wi-Fi Access Point.



Select **OK**, then the Wi-Fi status page will appear. Upon closing of the Wi-Fi status page, you will be asked to join the thermostat to a Skyport account.



Select **YES** and follow the onscreen instructions to create a new Skyport account or to add the thermostat to an existing account.

Quick Start - Connect to Wi-Fi (from menus)

Although there is more than one way to create a Skyport account, the steps below illustrate creation from a browser.

If the thermostat is connected to the local Wi-Fi Access Point, but not yet joined to a Skyport account, you may join the thermostat to an account by doing the following:

Select **MENU** from the thermostat's home screen.



Scroll down



Select Skyport



Select Skyport Account and follow the onscreen instructions.




1. Open your browser to: <https://clm.skyportcloud.com>
2. Select "Create account now"



3. Follow on screen instructions to create an account and add a thermostat to the Skyport account.

Main Menu Buttons - Schedule

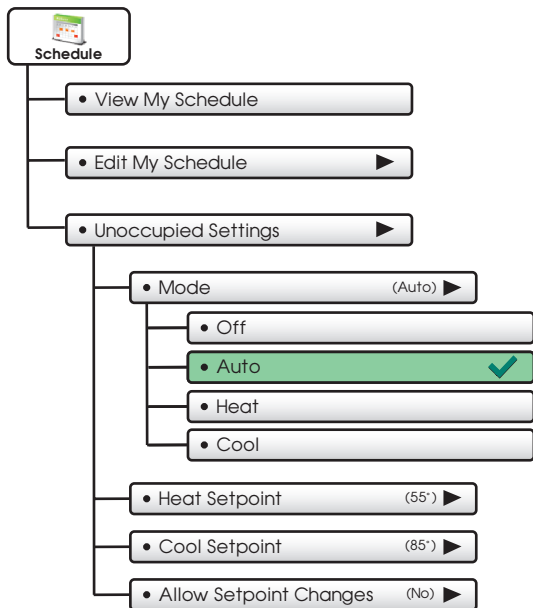

Main Menu Buttons - Schedule




Schedule

This thermostat features up to 3 Occupied time periods per 24 hour day.

• View My Schedule ▶

Press a day of the week to view its settings. This may be repeated for each day.




• Edit My Schedule ▶

Press and select day(s) to program

Select individual day(s)

or

Select groups of day(s)




Then press **NEXT**

Press and select a Time Period (Occupied 1, Occupied 2, or Occupied 3) to edit.

TIP:

Occupied 2 will override Occupied 1 and Occupied 3 will override Occupied 1 & 2.



Next


Continued ▶

Main Menu Buttons - Schedule

• Edit My Schedule ▶

(Continued)


Adjust Mode, StartTime, StopTime, and Heat and Cool Setpoints to desired settings. The Time Period May also be Enabled or Disabled. Un-check the enabled box for Time Periods you don't want to use. Press DONE when finished.

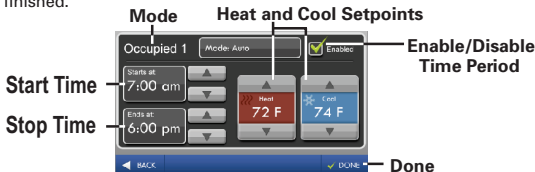

When you are finished editing the time periods press



Review your program.
Press **SAVE** to keep your program.
Press **EDIT** to make further changes.



Edit

Save

• Unoccupied Settings ▶

Choose your Mode and Heat and Cool setpoints for the Unoccupied period.

- Mode (Auto) ▶
- Heat Setpoint (55°) ▶
- Cool Setpoint (85°) ▶
- Allow Setpoint Changes (No) ▶


Press **MODE** or the MODE Icon



On the Home Screen to select to Run or Stop Schedule



Main Menu Buttons - Fan Settings

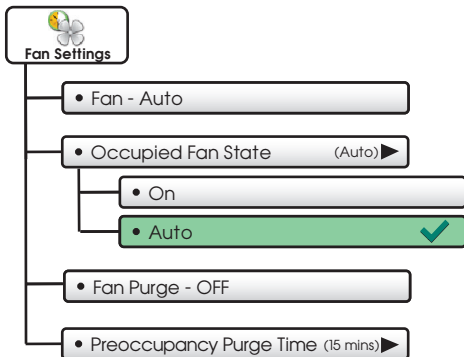

Main Menu Buttons - Fan Settings



Fan Settings

The fan may be set to run continuously during Heat, Cool, Auto, and Occupied modes. A Preoccupancy Fan Purge schedule may also be set.

Press to turn fan On to run continuously or Auto for fan to run only with heating or cooling.

• Fan - ON



• Fan - Auto

• Occupied fan state

(On) ►

Press to turn fan On to run continuously during Occupied mode or Auto for fan to run only with heating or cooling.

• Fan Purge - OFF




Press to turn on Preoccupancy Fan Purge. This feature allows the fan to run for a preset amount of time before Occupied 1 begins.

• Preoccupancy Purge Time (15 mins) ►

The Preoccupancy Fan Purge timer may be set from 15 minutes to 3 hours in 15 minute increments.

Main Menu Buttons - Screensaver

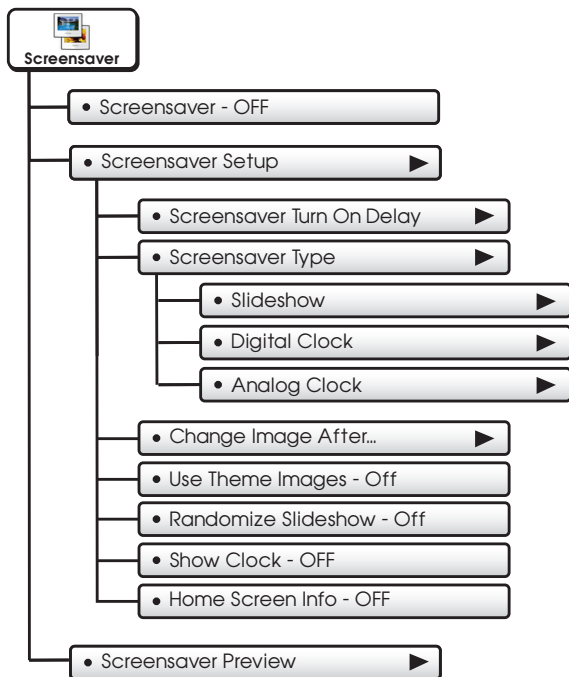

Main Menu Buttons - Screensaver



The Screensaver allows you to create custom slideshows.

• Screensaver - OFF

• Screensaver - ON



• Screensaver Setup ▶

• Screensaver Turn On Delay (5m) ▶

How long after a button press for the Screensaver to appear. 1, 3, 5, or 30 minutes

• Screensaver Type (Slideshow) ▶

Slideshow, Digital Clock, Analog Clock

• Change Image After... ▶

15, 30 seconds - 1, 5, or 10 minutes

• Use Theme Images - OFF ▶

Slideshow uses included Theme Images. Off or On

• Randomize Slideshow - OFF ▶

Shuffles slideshow photos in random order

• Show Clock - OFF ▶

Shows the time and date every 5 photos. Off or On

• Home Screen Info - OFF ▶


Shows the mode, setpoints, and temperature after every 10 photos. Off or On

• Screensaver Preview ▶

Press this button to preview your screensaver operation before returning to the Home Screen.

After the preview, press anywhere on the screen to return to the sub menu.

Main Menu Buttons - Alerts

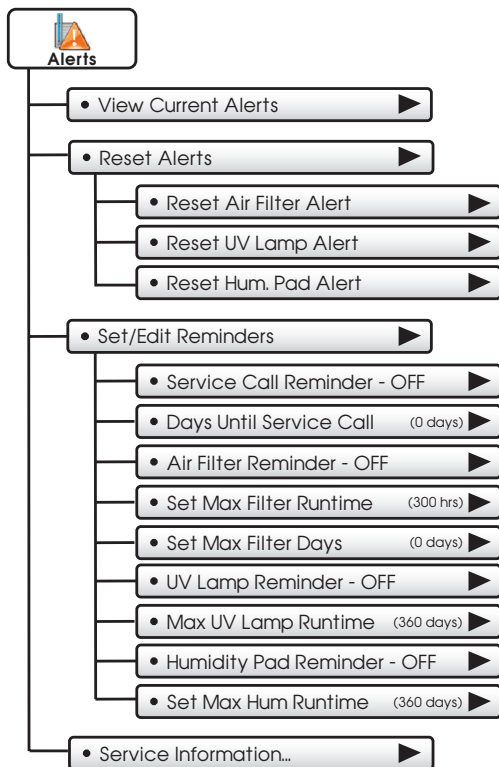


Main Menu Buttons - Alerts



The alerts let you know when your system needs service.

• View Current Alerts

View and reset current service alerts here.



Alerts will appear on the bottom bar of the Home Screen. Press to view and reset current alerts.



• Reset Alerts

Clear and reset current service alerts.

• Set/Edit Reminders

Set service alert runtimes and turn reminders on or off.

• Service Call Reminder - OFF

• Days Until Service Call (0 days)

• Air Filter Reminder - OFF

• Set Max Filter Runtime (500 hrs)

• Set Max Filter Days (300 days)

• UV Lamp Reminder - OFF


• Set Max UV Lamp Runtime (300 days)

• Humidity Pad Reminder - OFF


• Set Max Hum Runtime (300 days)

• Service Information...

View your service company's contact information.



Main Menu Buttons - Display

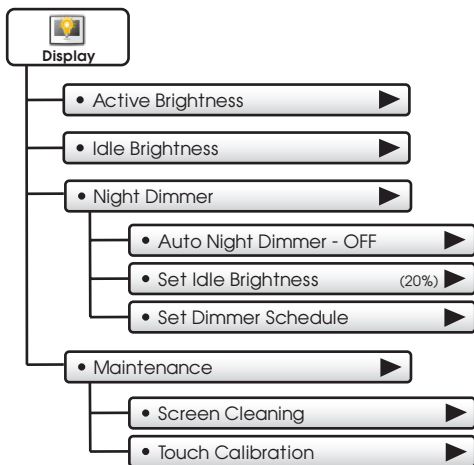

Main Menu Buttons - Display



Display

The display brightness options may be adjusted in this menu.

- Active Brightness (80%) ▶

You may select how bright the backlight is while the thermostat is active. The display is active for 3 minutes after last touch, it then goes Idle.

- Idle Brightness (30%) ▶

You may select how bright the backlight is while the thermostat is idle.

- Night Dimmer ▶

You may dim the brightness of the screen at night.

- Auto Night Dimmer - OFF

The screen can be set to dim automatically at night. Dimming the display can prolong the life of the backlight.

- Set Idle Brightness (20%) ▶

Set the screen brightness for the Night Dimmer. When Night Dimmer is On, the display will go idle 8 seconds after last touch.

- Set Dimmer Schedule ▶

Set the schedule for the Night Dimmer.

Main Menu Buttons - Display

• Maintenance ▶

Maintenance allows you to clean and calibrate the touch screen.

• Screen Cleaning ▶

Screen Cleaning Mode disables the touch feature for 15 seconds so the screen may be cleaned without altering any settings.




Use a soft cloth without solvents or abrasive cleaners

• Touch Calibration ▶

Under normal circumstances, the touchscreen should not need to be calibrated.


Touch and hold the center of the targets as they appear on the screen for 3 seconds.

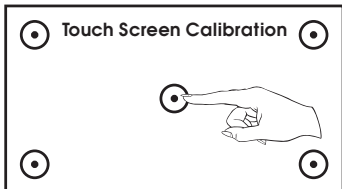

Press **FINISH** when done.

When calibration is complete, the thermostat will automatically restart and return to the Home Screen.

Main Menu Buttons - Preferences

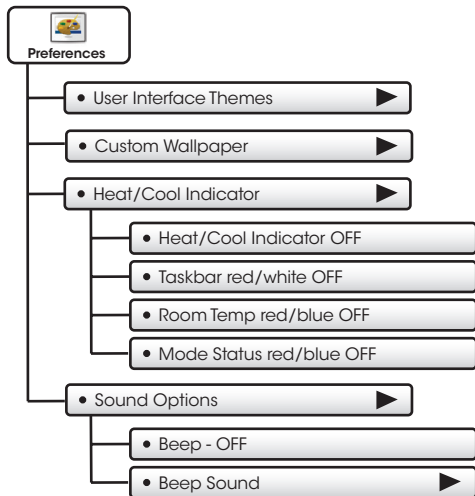

Main Menu Buttons - Preferences



Preferences

You may set the type of background that appears on the thermostat Home Screen.

• User Interface Themes (ocean) ▶

This thermostat has several high quality background themes to choose from.

NOTE: At 7pm, the background will change to an evening scene.

At 7am it will return to a daytime scene.

• Custom Wallpaper ▶

You may choose your own background image by selecting a photo that you have uploaded from an SD memory card.

• Heat/Cool Indicator ▶

You may choose an enhanced indicator of the current status of the HVAC equipment.

- Heat/Cool Indicator - ON/OFF
- Taskbar Red/White - ON/OFF
- Room Temp Red/Blue - ON/OFF
- Mode Status Red/Blue - ON/OFF

• Sound Options ▶

• Beep - ON



• Beep - OFF


Turn the beep sound on or off.

• Beep Sound

(Beep 1) ▶

Choose from different beep sounds.

Main Menu Buttons - Humidity

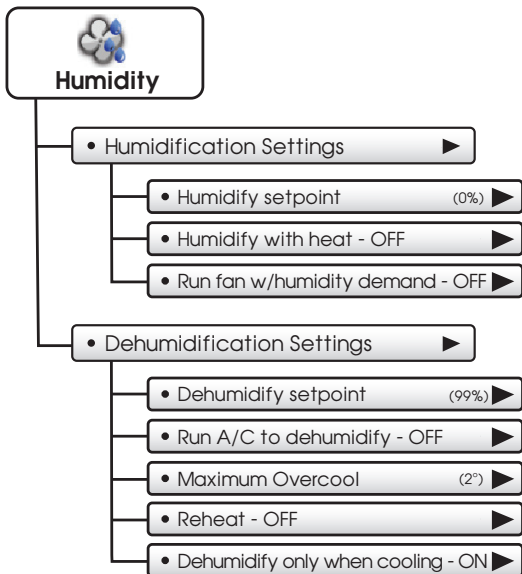

Main Menu Buttons - Humidity



The Humidity feature allows the thermostat to control a humidifier or use your air conditioner to dehumidify the space.

IMPORTANT: D/H Output Usage must be set for Hum or Dehum for these settings to take effect.

See: D/H Output Settings on page 61.

• Humidification Settings

- Humidify setpoint (0%) ▶

Adjust Humidify setpoint. (0% - 60%)

- Humidify with heat - OFF ▶

When this step is ON, Humidify will only run with a demand for heat.

- Run fan when humidifying - OFF ▶

When this step is ON, the fan will run with a call for Humidification.

• Dehumidification Settings

- Dehumidify setpoint (99%) ▶

Adjust Dehumidify setpoint. (25% - 99%)

- Run A/C to dehumidify - OFF ▶

When this step is ON, the A/C system will be used for Dehumidification.

- Maximum Overcool (2°) ▶

This specifies how many degrees the A/C system will run past the cool setpoint to satisfy a demand for Dehumidification. (0 - 20 degrees F)


- Reheat - OFF ▶

This turns on electric strip heat during an A/C to dehumidify demand to help maintain desired room temperatures. (Run A/C to dehumidify must be set to ON and the GAS ELEC Dip Switch must be set to ELEC - page 78 - to access this feature).

- Dehumidify only when cooling - ON ▶

Run dehumidification only when HVAC calls for A/C.

Main Menu Buttons - Holidays

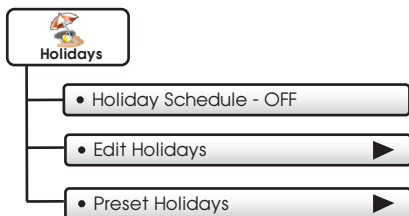

Main Menu Buttons - Holidays



Holidays

The Holiday Schedule allows the ColorTouch Screen to follow a fully customizable preset, weekly, monthly, and yearly holiday program. The thermostat will stay in Unoccupied settings while Holiday is active.

• Holiday Schedule - OFF

Press to turn Holiday Schedule **On** or **Off**.

• Edit Holidays

Start by selecting a Holiday.

You may continue to select more holidays or you can press the **Repeat** button for recurring holidays.


Pressing a selected holiday will deselect that holiday.



Using the Repeat Button

Choose to repeat the holiday every week, month or year. Or, press **CANCEL** to go back.

If you choose to repeat the holiday every week, you will be prompted to confirm the day of the week to be repeated.



Using the Info Button

Press the **Info** button to view how non-holidays, holidays, and exceptions to repeating holidays will appear on the Holiday calendar.

Continued ►

Main Menu Buttons - Holidays

• Edit Holidays



(Continued)

Deselecting Holidays

You may deselect a holiday simply by pressing on it.

Press **BACK** to save your changes and return to the Holiday menu.


If you choose to deselect a holiday that is part of a Custom Repeating Program, the screen below will appear.



Marking Non-Holidays

You will now be prompted to mark this day only as a non-holiday or edit **All** repeating holidays that affect this day.

Press **SAVE** to mark only this day as a non-holiday.



If you choose to edit repeating holidays that affect this day, press **NEXT** and the next screen will appear.


Editing Repeating Holidays

If, for example, you choose to repeat the holiday every month, the following screen will appear:

You may now choose to repeat the holiday:

- On the 25th of every month
- On the 4th Monday of every month
- On the last Monday of every month

Press **SAVE** to save your changes and return to Holiday programming.



Continued ►

Main Menu Buttons - Holidays


• Edit Holidays



(Continued)

Editing Repeating Holidays (continued)

You may now delete all repeating custom holidays in this group by pressing the **ON** box to uncheck your selection. Press **SAVE** to return to Holiday editing screens.



• Preset Holidays




You may choose from several standard preset holidays to observe. When the preset holidays are set to **ON**, they will be observed every year on that date.

Overriding Holiday Mode


You may override Holiday Mode by pressing the **OVERRIDE** button and choosing the amount of override time desired.

Turning Off Holiday Mode From The Homescreen

You may turn off Holiday Mode by pressing the **MODE** button and then pressing the Holiday **STOP** button.



Main Menu Buttons - Security

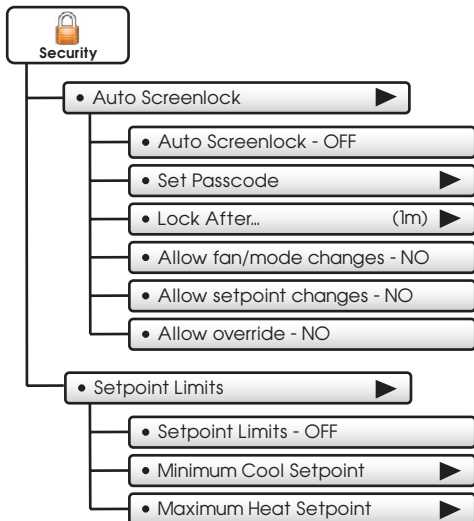

Main Menu Buttons - Security



Security settings may be set to limit or prevent changes to your thermostat.

• Auto Screenlock

• Auto Screenlock - OFF

• Auto Screenlock - ON

• Set Passcode

(code not set)

NOTE:

Code must be set before Auto Screenlock can be turned on.

Use keypad to enter and confirm passcode.



When the thermostat is locked, the bottom bar of the display will show:



Press **UNLOCK** then enter passcode to access thermostat settings.

• Lock After...

(1m)

Set the time the screen will automatically lock after the last button press.

• Allow fan/mode changes - NO

Choose to allow mode changes when Auto Screenlock is on.

• Allow setpoint changes - NO

Choose to allow setpoint changes when Auto Screenlock is on.

• Allow override - NO

Choose to allow use of the Override button when Auto Screenlock is on.


• Setpoint Limits

Limits how high or low heating and cooling may be adjusted.

• Maximum Override Time

Select the maximum amount of Override time that will appear as options after pressing the Override button from the home screen when running a schedule. Select times from 30 minutes to 4 hours in 30 minute increments.

Main Menu Buttons - Information

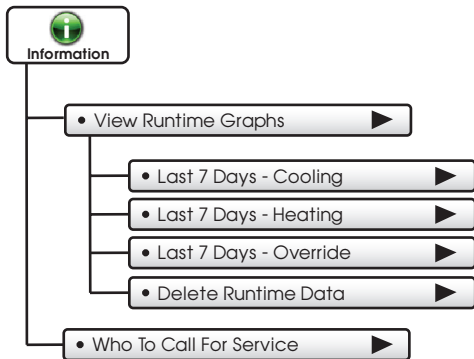

Main Menu Buttons - Information




Information

This button contains valuable service and system runtime information.

• View Runtime Graphs ▶

Track your system's runtime/energy usage.


• Last 7 Days - Cooling ▶



Press the information icon to learn more about each graph

*NOTE: The runtime graphs are updated at 12:00 AM each day.

• Last 7 Days - Heating ▶



Press anywhere on the screen to return to the submenu.

• Last 7 Days - Override ▶

Press to view a graph of override runtime information.

• Delete Runtime Data ▶


Press to delete your current equipment runtime information.

• Who To Call For Service ▶

Your service company's contact information is displayed here.




Main Menu Buttons - Settings

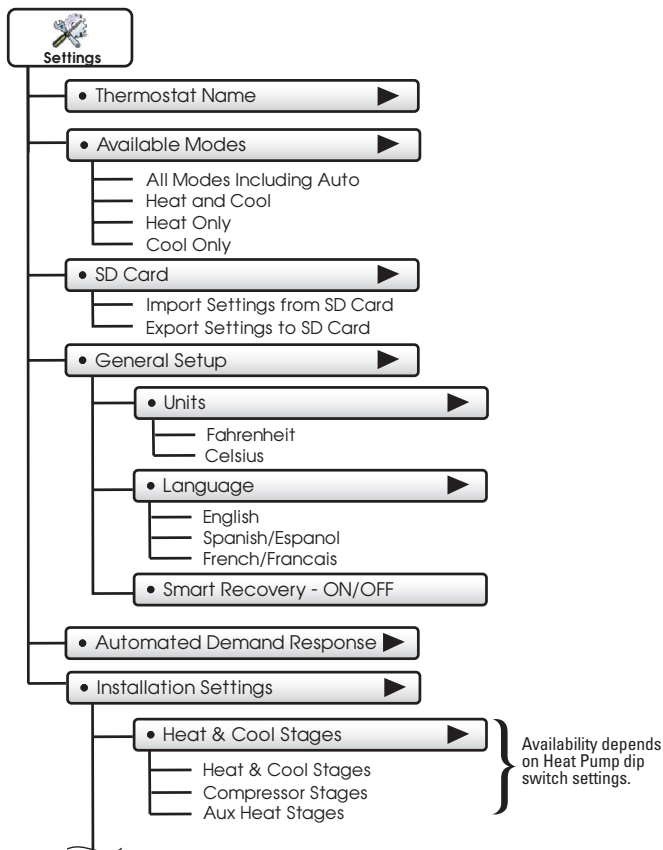


(Continued next page)

Main Menu Buttons - Settings

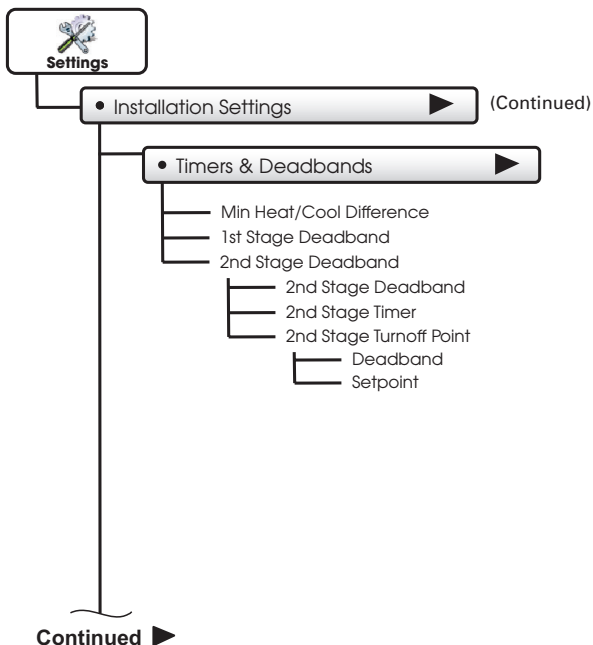


Main Menu Buttons - Settings

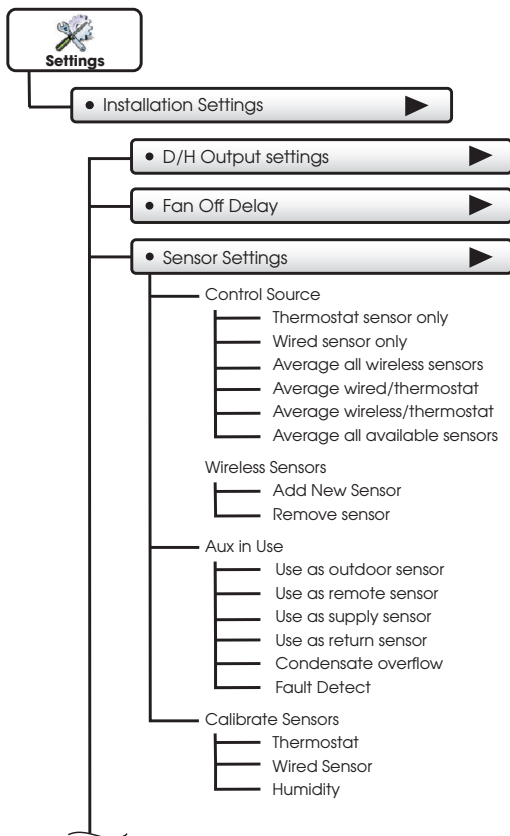

(Continued next page)

Main Menu Buttons - Settings

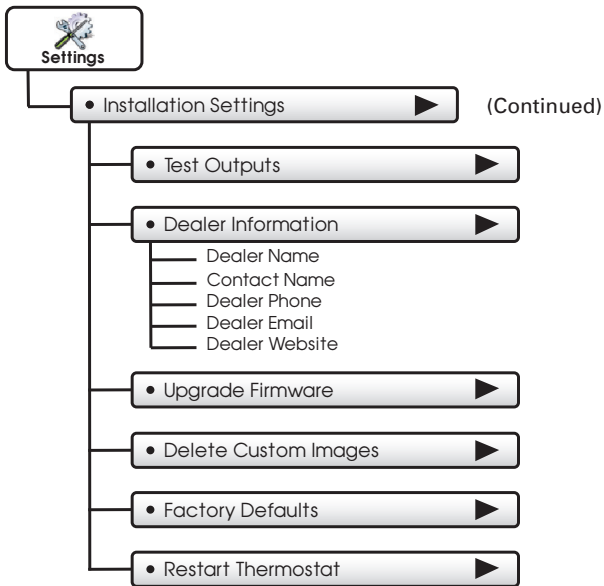

Main Menu Buttons - Settings




Thermostat heating and cooling options are found in this menu

• Thermostat Name ▶

Use keypad to name your thermostat. The name is displayed on the Home Screen.

(Up to 14 characters)

Name appears here



• Available Modes (all) ▶

Choose the desired modes the thermostat will use: Heat, Cool, Heat & Cool, or Auto (All). For example, if you only have a heater, choose Heat, and only Heat & Off modes will be available. This will simplify the operation for the user.

• SD Card ▶

Import and export files to and from the thermostat. See the **ColorTouch Assistant** instructions for further details.

• Import Settings from SD Card ▶

Upload files from ColorTouch Assistant or another thermostat.

• Export Settings to SD Card ▶

Export files from one thermostat and import them into others.

***NOTE:** A 2GB SD card is recommended. To import and export files, the SD card must contain the same version of the firmware as the thermostat. ColorTouch Assistant will keep the firmware current.

• General Setup ▶

• Units

(F) ▶

- Fahrenheit (F)
- Celsius (C)

Main Menu Buttons - Settings

• General Setup



(Continued)

• Language

(en)



- English
- Spanish/Español
- French/Français

• Smart Recovery - OFF

• Smart Recovery - ON



Smart Recovery turns on the heat or cool before the Occupied start time to bring the room temperature to the Occupied setpoint at the start of the Occupied time period. Please allow 4-8 days for Smart Recovery time to adjust. When used with a heat pump, electric strip heat will be disabled while Smart Recovery is active.

Main Menu Buttons - Settings

- Automated Demand Response




Overview

Touch Screen thermostats support the handling of specific signals from the utility provider. The utility generated signals carry pricing information and/or setback actions that alter the comfort settings of the thermostat in order to reduce energy usage on demand. This is known as **Automated Demand Response** or ADR for short. You must register to participate in a utility sponsored program, if offered by your local utility, to take advantage of this feature.

SKYPORT CLOUD SERVICES

From the web application the user will select **Thermostat Settings** from the left column. Then the **Demand Response** button is selected.

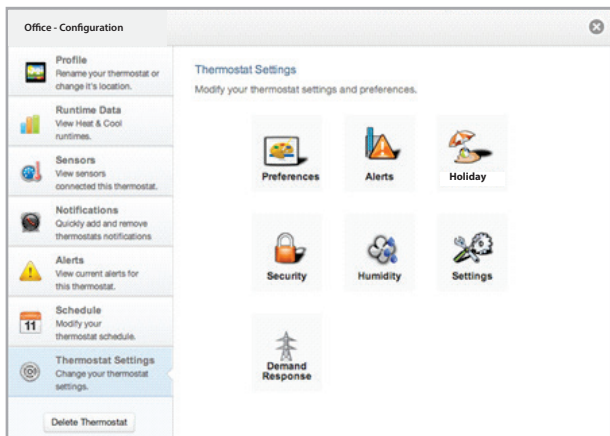



Main Menu Buttons - Settings


The Demand Response configuration page, shown below, is where the thermostat is configured to respond to the energy provider's signals. It also sets operational parameters for the thermostat.


The left column of the ADR configuration page allows or prevents access by the utility. Here communication with the utility and your thermostat may be turned On or Off.


Office - Configuration


**Profile**
Rename your thermostat or change its location.


**Runtime Data**
View Heat & Cool runtimes.

**Sensors**
View sensors connected to this thermostat.

**Notifications**
Quickly add and remove thermostats notifications

**Alerts**
View current alerts for this thermostat.

**Schedule**
Modify your thermostat schedule.


**Thermostat Settings**
Change your thermostat settings.

Delete Thermostat

Automated Demand Response

Configuration

Overview


Demand Response

ON OFF

What is Demand Response?

It is a way for energy suppliers to automatically reduce load during high energy use periods. This reduces the strain on the powergrid while offering incentives to individuals who participate in demand response events.

Min & Max Settings

Event Max Cool Setpoint:
89° F

Event Min Heat Setpoint:
83° F

Static Settings

Static Cool Setpoint:
77° F

Static Heat Setpoint:
83° F

Offset Settings

Cool Setpoint Offset:
+2

Heat Setpoint Offset:
-3

Price Settings

Price Trigger
\$ 0.5

Dependent Action
Observe Setpoint Offsets

Cancel

Save

Main Menu Buttons - Settings

The right column of the ADR configuration page is where the occupant adjusts the operational parameters for ADR. The utility may send up to 3 types of ADR signals to Skyport. These are:

1) Pricing for the cost of energy, **2) An Offset** to the occupants' comfort setpoints, and **3) a signal** to enforce discrete or Static setpoints.

The Maximum Cooling Setpoint and Minimum Heating Setpoints for ADR events are adjusted here.

The Static Settings are applied when the utility sends a signal to allow the occupant to enforce their own discrete temperature settings during an ADR event.

The Offset Settings allow the utility to modify the Cool or Heat setpoints by the value set here during an ADR event.

A Price Trigger setting allows the occupant to set the maximum cost of energy threshold. When this threshold is exceeded the Price dependent action is enforced. This Price Trigger and Dependent action is enforced independent of an ADR event, as long as the utility sends 'real-time' pricing.

The screenshot shows a software interface for configuring a thermostat. On the left is a sidebar with navigation options: Profile, Runtime Data, Sensors, Notifications, Alerts, Schedule, and Thermostat Settings. The main window is titled 'Office - Configuration' and contains a sub-panel for 'Automated Demand Response'. This sub-panel has two tabs: 'Configuration' (selected) and 'Overview'. The 'Configuration' tab displays a 'Demand Response' toggle switch set to 'ON', a 'What is Demand Response?' link, and several input fields for utility and account information. To the right of these fields are four sections of settings: 'Min & Max Settings' (Event Max Cool Setpoint: 80°F, Event Min Heat Setpoint: 65°F), 'Static Settings' (Static Cool Setpoint: 78°F, Static Heat Setpoint: 65°F), 'Offset Settings' (Cool Setpoint Offset: +2, Heat Setpoint Offset: -2), and 'Price Settings' (Price Trigger: 45, Price Dependent Action: Observe Setpoint Offsets). At the bottom of the sub-panel are 'Cancel' and 'Save' buttons.

Office - Configuration

Profile
Rename your thermostat or change its location.

Runtime Data
View Heat & Cool runtimes.

Sensors
View sensors connected to this thermostat.

Notifications
Quickly add and remove thermostat notifications

Alerts
View current alerts for this thermostat.

Schedule
Modify your thermostat schedule.

Thermostat Settings
Change your thermostat settings.

Delete Thermostat

Automated Demand Response

Configuration Overview

Demand Response
ON OFF
[What is Demand Response?](#)

Select Utility
LADWP

Program Id:
test-program

Account Id:
1234

Min & Max Settings
Event Max Cool Setpoint: 80°F
Event Min Heat Setpoint: 65°F

Static Settings
Static Cool Setpoint: 78°F
Static Heat Setpoint: 65°F

Offset Settings
Cool Setpoint Offset: +2
Heat Setpoint Offset: -2

Price Settings
Price Trigger: 45
Price Dependent Action: Observe Setpoint Offsets

Cancel Save

Main Menu Buttons - Settings

Selecting the Overview tab of the ADR page will cause a summary of ADR events to be displayed.

The screenshot shows a web application interface. On the left is a sidebar titled "Office - Configuration" with a close button (X) in the top right. The sidebar contains several menu items, each with an icon and a description:

- Profile**: Rename your thermostat or change its location.
- Runtime Data**: View Heat & Cool runtimes.
- Sensors**: View sensors connected this thermostat.
- Notifications**: Quickly add and remove thermostats notifications.
- Alerts**: View current alerts for this thermostat.
- Schedule**: Modify your thermostat schedule.
- Thermostat Settings**: Change your thermostat settings.

At the bottom of the sidebar is a "Delete Thermostat" button. The main content area on the right shows a modal window titled "Automated Demand Response" with a close button (X). It has two tabs: "Configuration" and "Overview" (which is selected). The "Overview" tab displays a table of ADR events:


Event Id	Event Type	Status	Start Time	Stop Time
1233407844	Price	Success	08/10/2014 1:00pm	08/10/2014 2:00pm
1233407844	Price	Success	08/15/2014 4:00pm	08/15/2014 5:00pm

Below the table are "Cancel" and "Save ✓" buttons. In the background, behind the modal, there are icons for "Security", "Humidity", "Settings", and "Demand Response" (which is highlighted).


Main Menu Buttons - Settings

- Automated Demand Response ►

Utility and Program setup must be done at the Skyport Cloud Services account. From the thermostat Home Screen, press the 'Menu' button, then select 'Settings'.

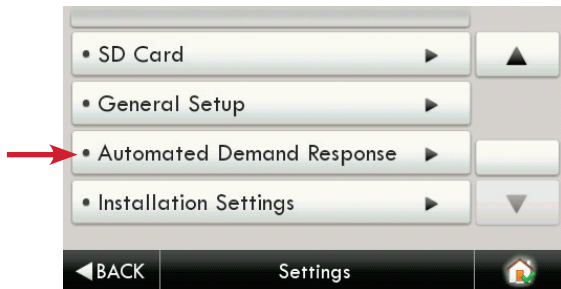


From the above screen the 'Automated Demand Response' button is pressed.

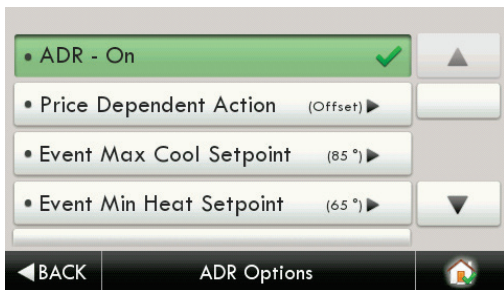


By selecting ADR – On, the user can participate in ADR events triggered by their utility, or price dependent events.

Main Menu Buttons - Settings

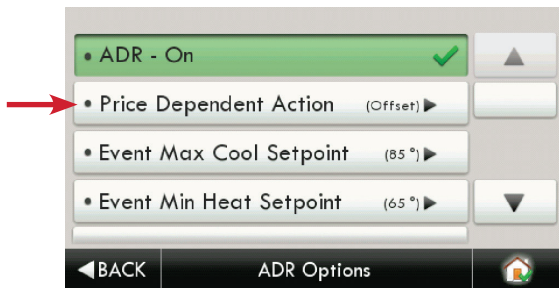

Selecting the 'Price Dependent Action' button allows the user to determine what action is taken when the price rises above the set threshold.

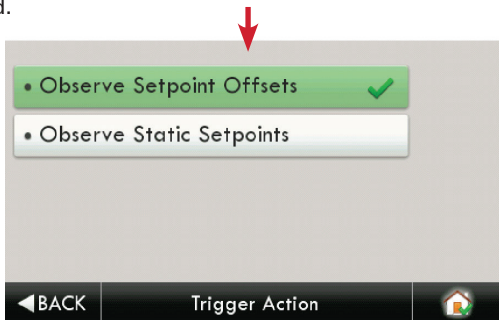


In the above example; if the price threshold is exceeded, the thermostat will invoke the 'Offset Setpoints' configured for an ADR event until the event is over.

Please note that the Threshold price may only be set in the Skyport Cloud Services account.

Selecting 'Skip Event' will take no action when the set price threshold is exceeded.


Main Menu Buttons - Settings

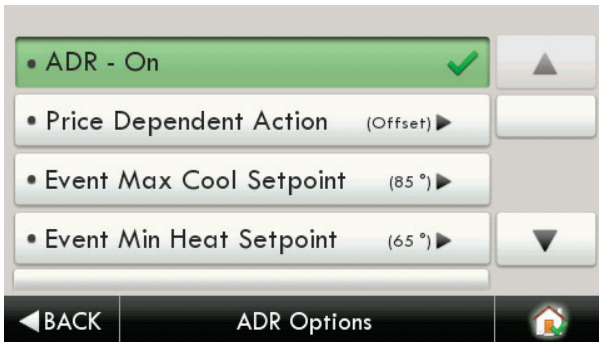


The user may limit the maximum Cooling Setpoint.




Main Menu Buttons - Settings

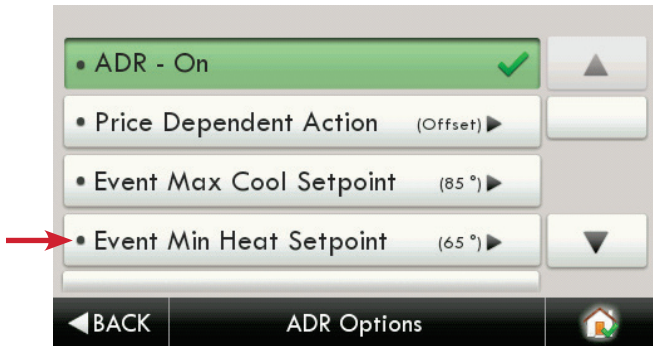


The user may limit the minimum Heating Setpoint.

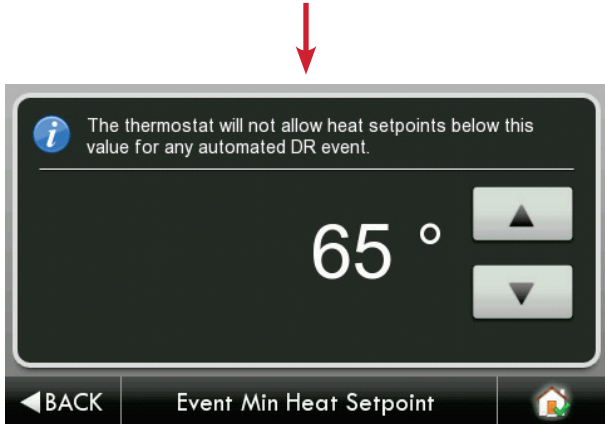


Main Menu Buttons - Settings

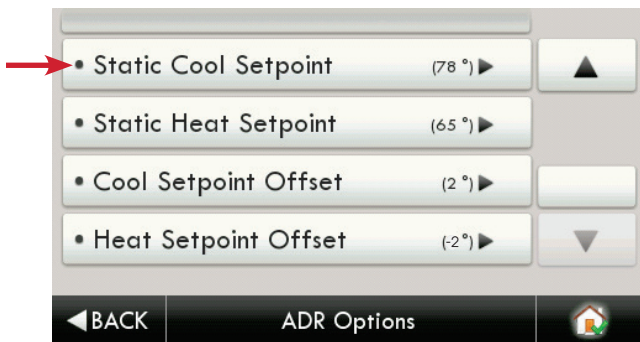


The user may adjust the ADR Cooling 'static' Setpoint.

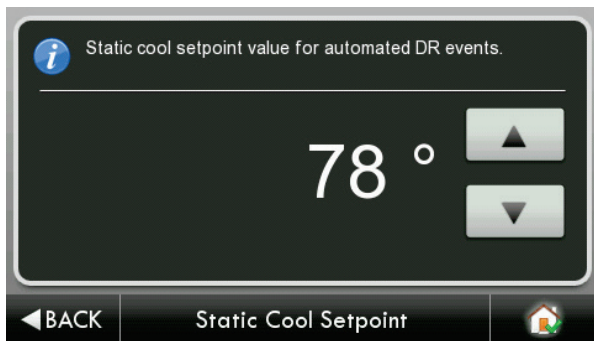


Main Menu Buttons - Settings

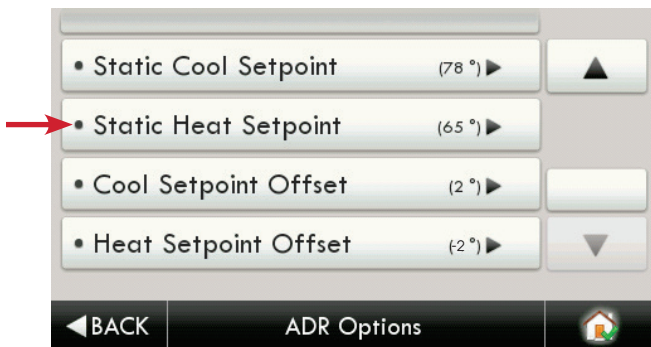


The user may adjust the ADR Heating 'static' Setpoint.

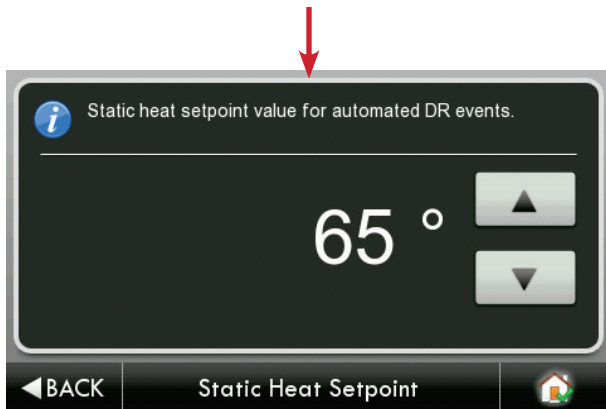


Main Menu Buttons - Settings

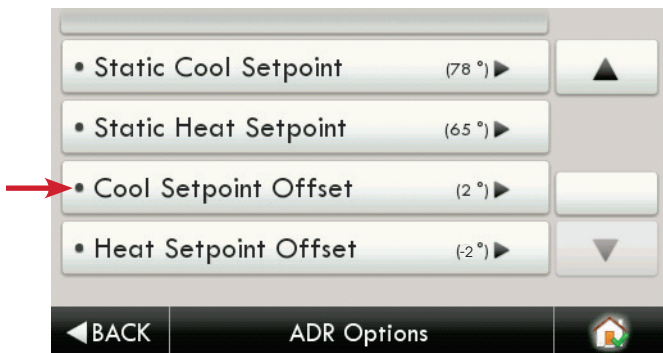

The user may adjust the ADR Cool offset. During an ADR event the cooling setpoint will be adjusted by the amount of degrees configured in this step.

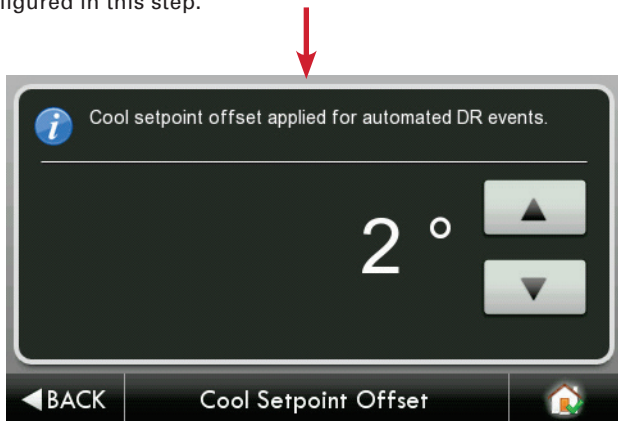

Main Menu Buttons - Settings

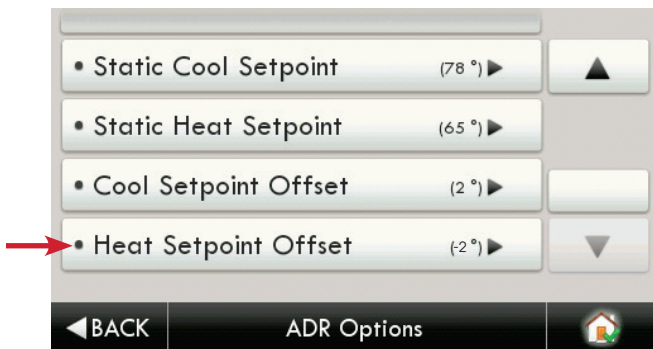


The user may adjust the ADR Heat offset. During an ADR event the heating setpoint will be adjusted by the amount of degrees configured in this step.




Main Menu Buttons - Settings

When an ADR event is pending, and hasn't started yet, there will be a yellow leaf on the top bar. This will be accompanied by associated text as shown below.

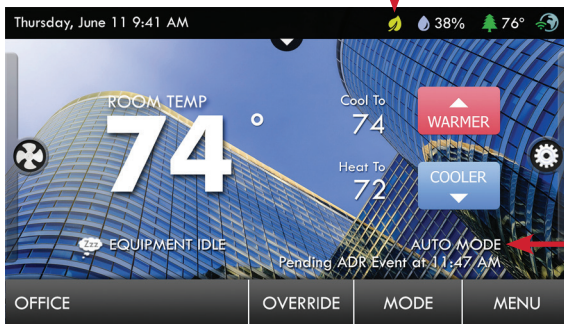


During an ADR event there will be a green leaf on the top bar. This will be accompanied by associated text as shown below.

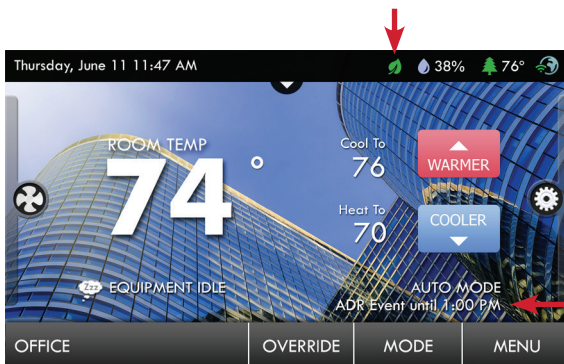


Main Menu Buttons - Settings

If a Warmer or Cooler button is pressed during an active ADR event, then the user is presented with this opt-out screen.

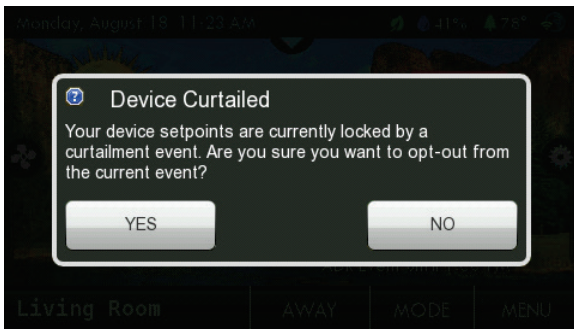

If a pricing triggered ADR event is enabled, there will be a green leaf on the top bar along with the actual cost of energy. This will be accompanied by associated text as shown below

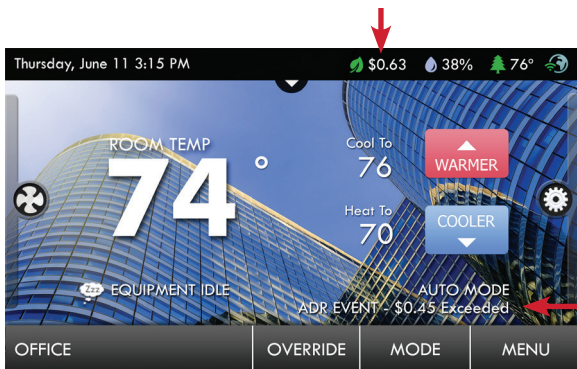

Main Menu Buttons - Settings

• Installation Settings ▶

• Heat & Cool Stages ▶

(1h1c) ▶

• Heat & Cool Stages ▶

(1h1c) ▶

Up to 2 Stages Cooling and 4 stages Heating.

• Compressor Stages ▶

(1h1c) ▶

Up to 2 compressors.

• Aux Heat Stages ▶

(1h1c) ▶

0 or 1 stages of Aux Heating.

} Only available when
dip switch is set for
Heat Pump operation.

• Timers & Deadbands ▶

• Min Heat/Cool Difference ▶

(2") ▶

The minimum gap between Heat and Cool setpoints. (0 - 6 deg. F)

Main Menu Buttons - Settings

• Installation Settings



(Continued)

• Timers & Deadbands



(Continued)

The Deadband is the number of degrees or minutes that the thermostat waits before it initiates the stages of heating or cooling.

1st Stage Deadband Specifies the minimum temperature difference between the room temperature and the desired setpoint before the first stage of heating or cooling is allowed to turn on. For example, if the heat setpoint is 68° and the 1st Stage deadband is set to 2 degrees, the room temperature will need to drop to **66 degrees** before the heat turns on.

• 1st Stage Deadband

(2°)



(1 - 6 deg. F)

• 2nd Stage Deadband



• 2nd Stage Deadband

(2°)



Number of degrees past 1st stage before 2nd stage turns on. (0 - 10 deg. F)

• 2nd Stage Timer

(2mins)



Number of minutes past 1st stage before 2nd stage turns on. (0 - 60 mins.)
(The 2nd stage deadband must also be met)

• 2nd Stage Turnoff Point (Deadband)



Deadband or Setpoint.

Main Menu Buttons - Settings

• Installation Settings ▶

(Continued)


• D/H Output Settings ▶

Allows the D/H output to be used for Humidification or Dehumidification.

• D/H output usage

(dehum) ▶

IMPORTANT: D/H Output Usage must be set for Hum or Dehum before any settings will take effect in the Humidity Main Menu.

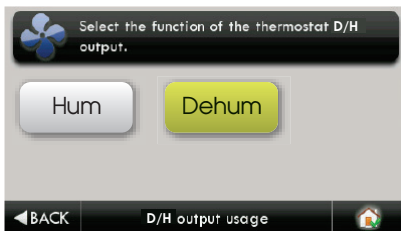

• D/H output polarity

(no.) ▶

The D/H Output polarity may be set for Normally Open or Normally Closed to accommodate different types of humidification and dehumidification equipment.

Main Menu Buttons - Settings

• Installation Settings ▶ (Continued)

• Fan Off Delay (0s) ▶

Runs the fan for a short time after Cooling or electric strip heat turns off to increase system efficiency. (0 - 120 Secs.)

• Sensor Settings ▶

• Control Source (thermostat) ▶

The thermostat allows multiple wired or wireless sensor accessories to be connected/paired to the thermostat. Use this step to select which individual sensor or average of multiple sensors to be used as the control temperature for the space.

- Thermostat sensor only
- Wired sensor only
- Average all wireless sensors
- Average wired/thermostat
- Average wireless/thermostat
- Average all available sensors

• Wireless Sensors ▶

You may pair multiple Wi-Fi remote sensors to the thermostat to be used for temperature monitor or control. The sensors **MUST** be on the same Wi-Fi network as the thermostat. Skyport connectivity is not required. Start the pairing process by pressing the LINK button on the Wi-Fi sensor. This will cause it to send a message to the Wi-Fi router that will in turn broadcast that message. Any thermostat on the network should hear that broadcast and store information about the sensor. Use this section to Add New Sensor for use by the thermostat (pair) or Remove sensor to quit listening to a sensor (unpair). Multiple thermostats can pair to the same sensor (handy for outdoor sensor use) or pair to a group of sensors (average multiple sensors in a large space served by multiple units).

• Add New Sensor ▶

• Remove Sensor ▶

Main Menu Buttons - Settings

• Installation Settings

(Continued)

• Aux In Use

(remote)

The wired sensor may be used as follows:

- Use as outdoor sensor
- Use as return sensor
- Use as remote sensor
- Condensate overflow
- Use as supply sensor
- Fault Detect

The first four options allow you to connect a 10K thermistor to the SENSOR terminals to be used to monitor a temperature (outdoor, supply, return) or control to a temperature (remote). The last two options allow you to connect a dry contact signal that will simply short the two SENSOR terminals to detect a Condensate overflow switch or a fault/alarm signal. Note that on ClimateMaster equipment, the condensate overflow sensor is connected to the control board such that an actual condensate overflow event causes the control board to lock out and generate a fault condition that can be detected by the thermostat. In this case, set AUX IN use to the Fault Detect setting.

• Calibrate Sensors


(0°)

The thermostat and wired sensor may be calibrated -7 to +7 degrees F. The integral humidity sensor may be calibrated -20% to +20% RH

- Thermostat
- Wired Sensor
- Humidity

• Test Outputs

The installer or service technician can use this feature to test the functions without any time delays of the thermostat.

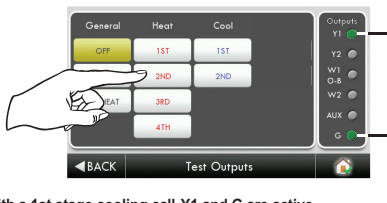

With a 1st stage cooling call, Y1 and G are active


Main Menu Buttons - Settings

• Dealer Information ▶

A Dealer may enter their company contact information for the customer to use when they need service. This will appear when the “Who To Call For Service” button is pressed in the Information Menu.

Use the keyboard to enter your information.

- Dealer Name
- Contact Name
- Dealer Phone
- Dealer Email
- Dealer Website

A screenshot of a software interface for entering dealer information. It features a dark background with a light gray box on the left containing the text "Dealer's Logo here". To the right, the text "Your Dealer:" is followed by input fields for "Email: -" and "Website: -", each preceded by a small circular icon. An "OK" button is located in the bottom right corner.

• Upgrade Firmware ▶

Press to upgrade the thermostat firmware. The SD Card must be in the thermostat SD Card reader and contain the valid firmware. If an error message appears, confirm with the ColorTouch Desktop APP that firmware is up to date or simply try reinserting the SD card.

If you are connected to Skyport Wi-Fi, any firmware upgrades should be sent to your thermostat and installed automatically. This will keep your thermostat up to date with all feature enhancements and fixes.

• Delete Custom Images ▶

Press to delete the custom photos you uploaded to the thermostat.


• Factory Defaults ▶

Press to reset the thermostat back to the factory settings.

• Restart Thermostat ▶

If needed, press here to restart the thermostat.

Main Menu Buttons - Wi-Fi

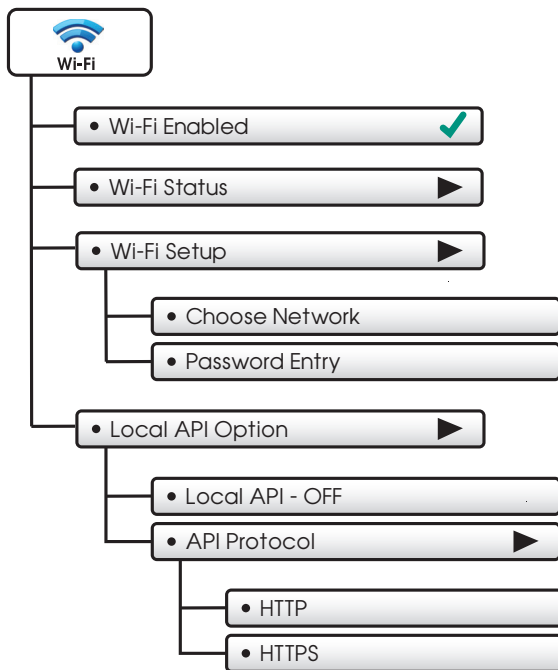

Main Menu Buttons - Wi-Fi




- Wi-Fi Enabled

Press to enable/disable Wi-Fi connectivity


- Wi-Fi Status


It is here that you will find helpful information regarding the connectivity status of your thermostat, including the thermostat's ID.

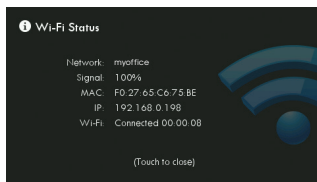

- Wi-Fi Setup

Choose your network from the list and enter the network password.

 If your network does not appear in the list, hit the refresh button.

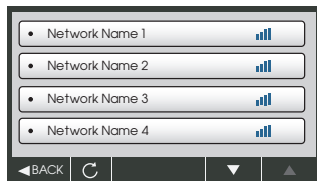

- Local API Option

Turning on the local API allows 3rd party software to interface with your thermostat, such as a home automation system.

Main Menu Buttons - Wi-Fi

This is the default with the local API OFF.

- Local API - OFF

- API Protocol (http) ▶

To turn on the HTTP Local API select **Local API**

- Local API - ON ✓

- API Protocol (http)

Press **BACK** to return to previous screen.

If a Secure API is required, then select **API Protocol**

- Local API - OFF

- API Protocol (http) ▶

Upon pressing **API Protocol**, the following screen will appear.

- HTTP ✓

- HTTPS


Then select **HTTPS** and press **BACK**

- HTTP


- HTTPS ✓

Main Menu Buttons - Wi-Fi


Upon pressing **BACK**, the screen will look like this.

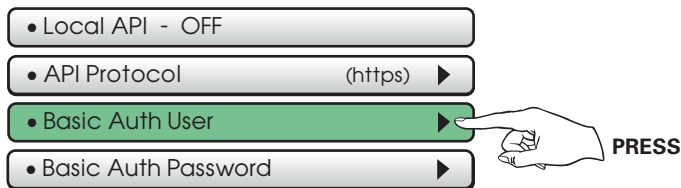

Select **Basic Auth User**, and enter the appropriate information on the screen below and press **DONE** to save.

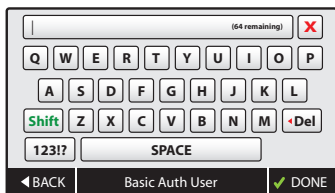

Select **Basic Auth Password** as the next step.

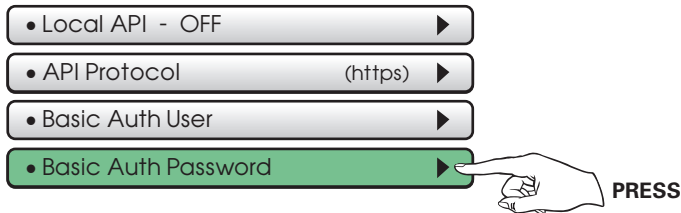

Main Menu Buttons - Wi-Fi

• Basic Auth Password ▶

Select **Basic Auth Password** and enter the appropriate information on the screen below and press **DONE** to save.



The last step is to turn the **Local API** on as shown below.


• Local API - ON ✓

• API Protocol (https)

• Basic Auth User ▶

• Basic Auth Password ▶

Main Menu Buttons - Skyport

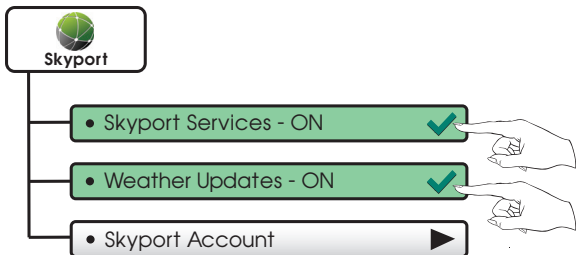


Pressing this button will let you know if you are paired with a Skyport account. If not, then you may follow prompt and instructions to create an account and add the thermostat to the account.

Main Menu Buttons - Emergency Heat



The Emergency Heat function is only available if your thermostat is set to control a Heat Pump.

To initiate the Emergency Heat feature, Press the Emergency Heat button. During Emergency Heat operation the thermostat will turn on the fan and auxiliary stages of heat when there is a demand for heat. The 1st stage of heating and all stages of cooling will be unavailable. To exit Emergency Heat, press the Emergency Heat button.

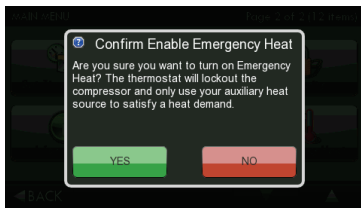


Installation Instructions

Remove and Replace the old thermostat

To install the thermostat properly, please follow these step by step instructions. If you are unsure about any of these steps, call a qualified technician for assistance.

- Assemble tools: Flat blade screwdriver, wire cutters and wire strippers.



- Make sure your Heater/Air Conditioner is working properly before beginning installation of the thermostat.
- Carefully unpack the thermostat. Save the screws, any brackets, and instructions.
- Turn off the power to the Heating/Air Conditioning system at the main fuse panel. Most systems have a separate breaker for disconnecting power to the furnace.
- Remove the cover of the old thermostat. If it does not come off easily, check for screws.
- Loosen the screws holding the thermostat base or subbase to the wall and lift away.
- If you have a smart phone handy, take a photo of the wiring for future reference.
- Disconnect the wires from the old thermostat. Tape the ends of the wires as you disconnect them, and mark them with the letter of the terminal for easy reconnection to the new thermostat.
- Keep the old thermostat for reference purposes, until your new thermostat is functioning properly.

Installation Instructions

Wire Connections

If the terminal designations on your old thermostat do not match those on the new thermostat, **refer to the chart below or the wiring diagrams that follow.**

Wire from the old thermostat terminal possibly marked	Function (Heatpump)	Function (Gas/Electric)	Install on the new thermostat connector marked
G,F	Fan	Fan	G
Y,Y1	1st stage heating/cooling	1st stage cooling	Y1
Y2	2nd stage heating/cooling	2nd stage cooling	Y2
W,W1		1st stage heating	O
W2		2nd stage heating	W
W (on CLM products)	3rd stage heating emergency heat		W
O	reversing valve		O
	humidifier	humidifier	D/H (note 1)
H (on CLM products)	ClimaDry		D/H (note 2)
	dehumidifier	dehumidifier	D/H (note 2)
AL1, AL2	fault	condensate	sensor (note 3)
R,Rh,M,Vr,A	power	power	R
C	common	common	C


Note 1 : set the D/H USE to humidifier. Also, set the HUM WITH HEAT ONLY as required

Note 2 : set the D/H USE to dehumidifier. Also, set the DEHUM WITH COOL ONLY as required

Note 3 : for equipment lockout caused by internal issue or condensate overflow, bring signals AL1 and AL2 to the two SENSOR terminals on the backplate and remove jumper JW1

Installation Instructions

The TouchScreen thermostat backplate

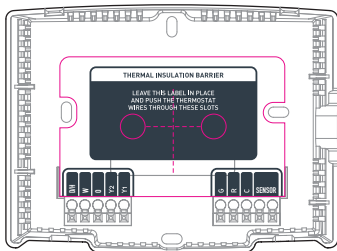


NOTE:


The backplate does not fully cover a full size vertical junction box. The ACC-WPLWH ClimateMaster Wallplate or a single-gang, horizontally mounted junction box would be needed for that type of installation

To remove the thermostat backplate:

Using the Finger Pull Areas, pull the front housing away from the backplate.



Look for these tabs to locate the pull areas



Pull out with thumbs in these areas


WIRE TERMINAL FUNCTIONS

The table on page 70 shows how to wire to either a heatpump or conventional system and explains the function of each terminal. Note that the use of the O and W terminals vary depending on equipment type. The O terminal drives the reversing valve for a heatpump but since that function isn't applicable for a conventional system, O becomes the first stage of gas or electric heat. Similarly, W drives a single stage of strip heat in a heatpump system but is used as second stage of gas or electric heat in a conventional system.

Installation Instructions


Explanation of Thermostat Dip Switches

Dip switches are located on the back of the thermostat

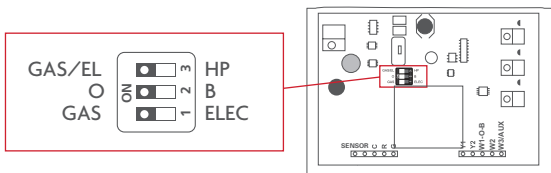

This dip switch configures the thermostat to control a conventional gas/electric system or a heat pump. If your system is anything other than a heat pump, leave this switch set for GAS/EL.*

*For some commercial heat pumps, this switch may need to be set for GAS/EL. Consult the commercial heat pump literature.



This switch (O or B) is not used in this thermostat. The thermostat only controls a type O reversing valve (power to cool).



1. When **GAS/EL or HP** is set for **GAS/EL**:


This switch (GAS or ELEC) controls how the thermostat will control the Fan (G) terminal in heating mode. When **GAS** is chosen, the thermostat **will not** energize the Fan (G) terminal in heating. When **ELEC** is chosen the thermostat **will** energize the fan in heating.

2. When **GAS/EL or HP** is set for **HP**:

This switch (GAS or ELEC) defines the Aux Heat type. When **GAS** is chosen, the auxiliary heat will not be allowed to run during heat pump operation. When using a Dual Fuel system, set this switch for **GAS**. When **ELEC** is chosen, up to two stages of auxiliary strip heat will be allowed to run.

Installation Instructions - Sample Wiring Diagrams


Single Stage Heat Pump with AUX Heat

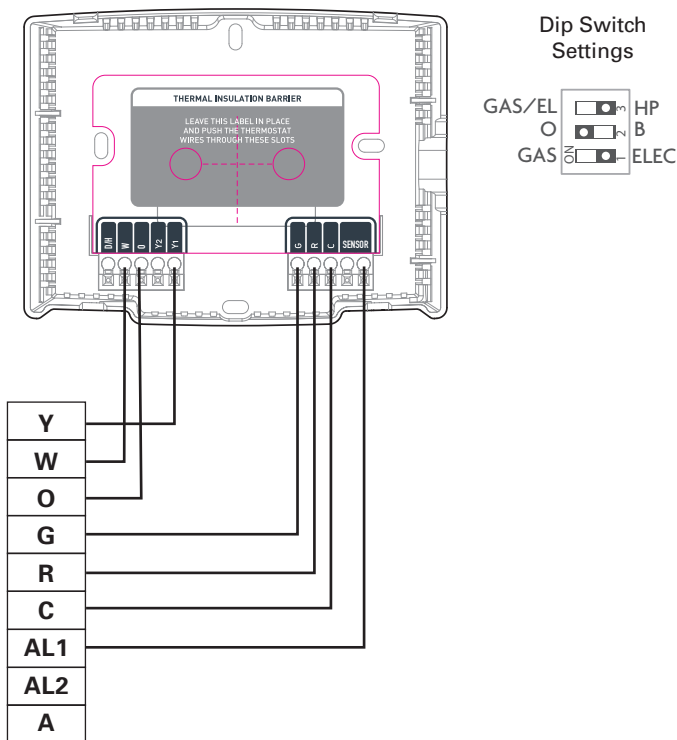

Note: Do not clip jumper JW1 on CXM board


Installation Instructions - Sample Wiring Diagrams

Dual Stage Heat Pump with AUX Heat and ClimaDry

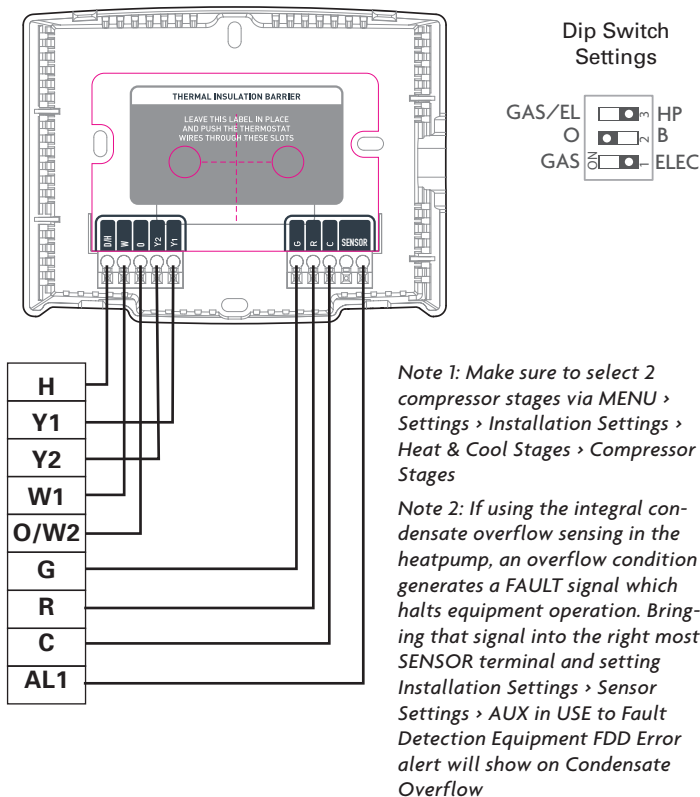

Installation Instructions - Sample Wiring Diagrams

1 Stage Heat, 1 Stage Cool (with wired remote sensor)

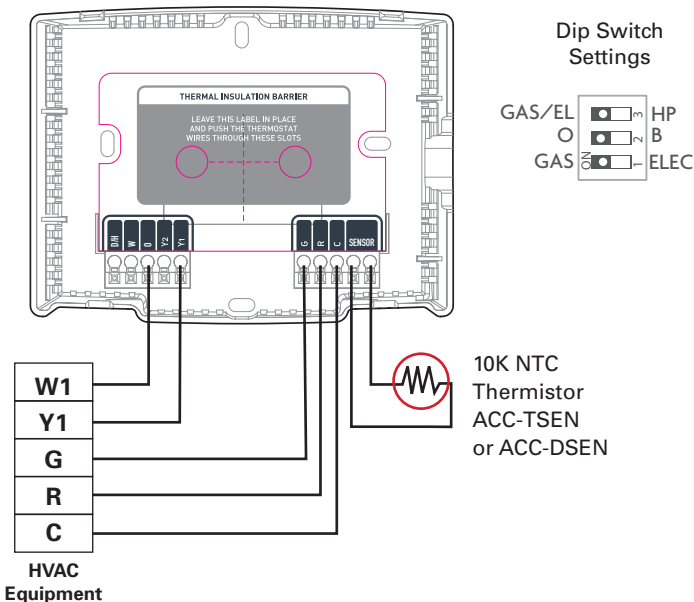


Notes:

1) Connect the two wires from the sensor to the two SENSOR terminals. To enable the function, set MENU > Settings > Installation Settings > AUX IN use to "Use as remote sensor" if you wish to control to the temperature from the sensor or "Use as supply sensor" or "Use as return sensor" to simply monitor the temperature

Installation Instructions - Sample Wiring Diagrams

2 Stage Heat, 2 Stage Cool (with condensate overflow)

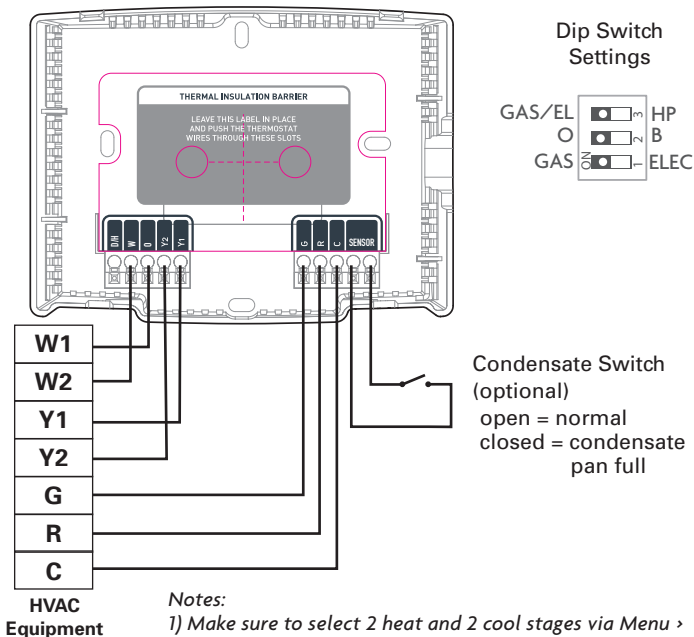

Troubleshooting

- **SYMPTOM:** The thermostat touchscreen buttons are not responsive.
CAUSE: The touchscreen is out of calibration.
REMEDY: Remove the thermostat from the backplate. Push the thermostat back onto the backplate, while keeping your finger pressed firmly against the center of the touchscreen, until the Calibration screen appears. Re-calibrate the touchscreen. *See Touch Calibration section of full user's manual (page 25).*
- **SYMPTOM:** The display is blank.
CAUSE: Lack of proper power.
REMEDY: Make sure the power is on to the HVAC and that you have 24vac between **R & C**.
- **SYMPTOM:** The air conditioning does not attempt to turn on.
CAUSE: The cooling setpoint is set too high.
REMEDY: Lower the cooling setpoint or lower the cooling set-point limit. *See Setpoint Limits (page 35).*
- **SYMPTOM:** The heating does not attempt to turn on.
CAUSE: The heating setpoint is set too low.
REMEDY: Raise the heating setpoint or raise the heating set-point limit. *See Setpoint Limits (page 35).*
- **SYMPTOM:** When controlling a residential heat pump, and asking for cooling, the heat comes on.
CAUSE: The thermostat reversing valve dip switch is set for **"B"**.
REMEDY: Set the reversing valve jumper for **"O"**.
- **SYMPTOM:** When calling for cooling, both the heat and cool come on.
CAUSE: The thermostat equipment dip switch is configured for **"HP"** and the HVAC unit is a Gas/Electric.
REMEDY: Set the equipment dip switch for **"Gas"**.
- **SYMPTOM:** Air handler control board fuse blows when thermostat is attached to backplate with power on, but does not blow until the thermostat is placed onto the backplate.
CAUSE: The Outdoor sensor and/or sensor wiring is shorted.
REMEDY: Check/replace Outdoor sensor and/or sensor wiring.

Warranty

One-Year Warranty - This Product is warranted to be free from defects in material and workmanship. If it appears within one year from the date of original installation, whether or not actual use begins on that date, that the product does not meet this warranty, a new or remanufactured part, at the manufacturer's sole option to replace any defective part, will be provided without charge for the part itself provided the defective part is returned to the distributor through a qualified servicing dealer.

THIS WARRANTY DOES NOT INCLUDE LABOR OR OTHER COSTS incurred for diagnosing, repairing, removing, installing, shipping, servicing or handling of either defective parts or replacement parts. Such costs may be covered by a separate warranty provided by the installer.

THIS WARRANTY APPLIES ONLY TO PRODUCTS IN THEIR ORIGINAL INSTALLATION LOCATION AND BECOMES VOID UPON REINSTALLATION.

LIMITATIONS OF WARRANTIES – ALL IMPLIED WARRANTIES (INCLUDING IMPLIED WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE AND MERCHANTABILITY) ARE HEREBY LIMITED IN DURATION TO THE PERIOD FOR WHICH THE LIMITED WARRANTY IS GIVEN. SOME STATES DO NOT ALLOW LIMITATIONS ON HOW LONG AN IMPLIED WARRANTY LASTS, SO THE ABOVE MAY NOT APPLY TO YOU. THE EXPRESSED WARRANTIES MADE IN THIS WARRANTY ARE EXCLUSIVE AND MAY NOT BE ALTERED, ENLARGED, OR CHANGED BY ANY DISTRIBUTOR, DEALER, OR OTHER PERSON WHATSOEVER.

ALL WORK UNDER THE TERMS OF THIS WARRANTY SHALL BE PERFORMED DURING NORMAL WORKING HOURS. ALL REPLACEMENT PARTS, WHETHER NEW OR REMANUFACTURED, ASSUME AS THEIR WARRANTY PERIOD ONLY THE REMAINING TIME PERIOD OF THIS WARRANTY.

THE MANUFACTURER WILL NOT BE RESPONSIBLE FOR:

1. Normal maintenance as outlined in the installation and servicing instructions or owner's manual, including filter cleaning and/or replacement and lubrication.
2. Damage or repairs required as a consequence of faulty installation, misapplication, abuse, improper servicing, unauthorized alteration or improper operation.
3. Failure to start due to voltage conditions, blown fuses, open circuit breakers or other damages due to the inadequacy or interruption of electrical service.
4. Damage as a result of floods, winds, fires, lightning, accidents, corrosive environments or other conditions beyond the control of the Manufacturer.
5. Parts not supplied or designated by the Manufacturer, or damages resulting from their use.
6. Manufacturer products installed outside the continental U.S.A., Alaska, Hawaii, and Canada.
7. Electricity or fuel costs or increases in electricity or fuel costs for any reason whatsoever including additional or unusual use of supplemental electric heat.
8. ANY SPECIAL INDIRECT OR CONSEQUENTIAL PROPERTY OR COMMERCIAL DAMAGE OF ANY NATURE WHATSOEVER. Some states do not allow the exclusion of incidental or consequential damages, so the above may not apply to you.

This warranty gives you specific legal rights and you may also have other rights which may vary from state to state.

Patents Issued & Pending

P/N 88-1359 Rev. 01 03/30/20

