

Tranquility[®] 22 Digital High Efficiency (TZ) Series

Submittal Data

Models TZH/V024-060, 60Hz - HFC-410A



 LC984

Rev.: January 24, 2023


CLIMATEMASTER[®]
A NIBE GROUP MEMBER

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Table of Contents

TZ Ultra High Efficiency Series

Introduction	3
Features, Options and Accessories	4
iGate® 2 Communicating Controls Powered by DXM2.5	5
vFlow® Internal Variable Water Flow Control	9
Selection Procedure	10
TZ Series Nomenclature	12
Performance Data AHRI/ASHRAE/ISO 13256-1	13
Performance Data – TZ H/V 024 (Part Load) with Modulating Valve or Variable Speed Pump	14
Performance Data – TZ H/V 024 (Full Load) with Modulating Valve or Variable Speed Pump	15
Performance Data – TZ H/V 030 (Part Load) with Modulating Valve or Variable Speed Pump	16
Performance Data – TZ H/V 030 (Full Load) with Modulating Valve or Variable Speed Pump	17
Performance Data – TZ H/V 036 (Part Load) with Modulating Valve or Variable Speed Pump	18
Performance Data – TZ H/V 036 (Full Load) with Modulating Valve or Variable Speed Pump	19
Performance Data – TZ H/V 042 (Part Load) with Modulating Valve or Variable Speed Pump	20
Performance Data – TZ H/V 042 (Full Load) with Modulating Valve or Variable Speed Pump	21
Performance Data – TZ H/V 048 (Part Load) with Modulating Valve or Variable Speed Pump	22
Performance Data – TZ H/V 048 (Full Load) with Modulating Valve or Variable Speed Pump	23
Performance Data – TZ H/V 060 (Part Load) with Modulating Valve or Variable Speed Pump	24
Performance Data – TZ H/V 060 (Full Load) with Modulating Valve or Variable Speed Pump	25
Part Load Performance Data – Correction Tables	26
Full Load Performance Data – Correction Tables	27
High Head Variable Pump Performance	28
Antifreeze Correction Table	29
Water Pressure Drop Adder for Options – Correction Tables	31
Blower Performance Data	32
Physical Data	33
TZ - Horizontal Dimensional Data	34
TZ - Vertical Upflow Dimensional Data	36
Corner Weights	38
Electrical Data	39
TZ Series Wiring Diagram Matrix	41
Engineering Specifications	42
Performance Sheet	51
Revision History	52

Document page number is shown next to part number (e.g. LC984 - 3 = page 3). Since not all pages are typically used in the submittals process, the page number in the lower right corner can still be used (page ____ of ____).

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Introduction

THE TRANQUILITY® (TZ) COMPACT TWO STAGE SERIES

The TZ Series includes the superb efficiency ratings, quiet operation, and application flexibility that is synonymous with the ClimateMaster Tranquility® family. Tranquility TZ units are available in capacities of 24, 30, 36, 42, 48, and 60 Mbtuh in vertical upflow and horizontal configurations. Other features include the next generation Copeland UltraTech™ two-stage scroll compressor, variable speed ECM fan motor, and digital communicating controls. It also has one of the industry's smallest footprints, making it suitable for installation in tight places and retrofit projects.

Available in sizes 2 tons (7.0 kW) through 5 tons (17.6 kW) with multiple cabinet options (vertical upflow and horizontal) the Tranquility TZ offers a wide range of units for most any installation. The Tranquility TZ has an extended range refrigerant circuit, capable of ground loop (geothermal) applications as well as water loop (boiler-tower) applications. Some of the features of the innovative Tranquility TZ series include: Copeland UltraTech two-stage unloading scroll compressor, ECM variable fan motor, microprocessor controls, galvanized steel cabinet, non-corrosive polymer drain pan, and acoustic type fiber insulation.

ClimateMaster's exclusive double isolation compressor mounting system makes the Tranquility TZ one of the quietest units on the market. Compressors are mounted on specially engineered sound tested EPDM grommets to a heavy gauge mounting plate, which is then isolated from the cabinet base with rubber grommets for maximized vibration/sound attenuation. Multiple removable access panels and an easily accessible control box make installation and maintenance user friendly. Options such as coated air coil, DDC controls, internal variable speed pumps, modulating water valves, and high efficiency MERV rated air filters allow for customizable design solutions.

iGate® 2 technology is the next generation in intelligent control that uses two-way communication to provide a gateway into the system. The iGate® 2 control system allows end-users and contractors to monitor the performance of the unit, custom tailor its operation, and diagnose any issues, right from the thermostat.

iGate® 2 technology provides technicians an interface into the operation of the system in real time without the need for hard tooling. On board advanced controls communicate the key operating system temperatures allowing technicians to start-up, commission, and service the equipment remotely by smart phone or website via the cloud. Communication can also be done at the unit via a communicating thermostat or handheld service tool. Not only does iGate 2 monitor current performance, it also allows the functionality to make system adjustments and captures operating conditions at time of fault. All this information is displayed in an easy to read format maximizing the usability of the experience.

vFlow® is ClimateMaster's variable water flow technology. It represents a major advancement in geothermal system performance - made possible through the iGate® 2 system. vFlow not only builds the major water circulation components into the unit for a clean installation, it also intelligently varies the water flow to minimize pump energy consumption and improve system reliability.

The heart of vFlow is either a variable-speed pump or modulating water valve directly linked to the iGate® 2 system. Water flow is automatically varied based on changes in unit capacity level (stage) and source water temperature to maintain optimum system performance. vFlow allows the use of direct return piping, while eliminating external two-way valves and automaticflow regulators - making vFlow systems inherently self-balancing.

vFlow systems provide reduced water pumping power compared to traditional fixed-speed pumping systems. They also protect the unit against extreme operating conditions, thus extending the life of the compressor and air coil. Since vFlow is built inside the unit, it also saves on installation time and makes for a very clean and compact installation. The Tranquility TZ Series water-source heat pumps are designed to meet the challenges of today's HVAC demands with one of the most innovative products available on the market.

Features, Options and Accessories

FEATURES

- All sizes 024 (2 ton, 7.0 kW) through 060 (5 tons, 17.6 kW) exceed ASHRAE 90.1 efficiencies
- EarthPure® (HFC-410A) refrigerant
- Copeland UltraTech™ two-stage unloading scroll compressors
- Intelligent variable speed CV ECM fan motors for precise airflow control and soft start feature
- Part load operation significantly lowers annual operating costs
- Galvanized steel construction
- Cabinet lined with acoustic type fiber insulation
- Unique double isolation compressor mounting with vibration isolation for quiet operation
- Insulated divider and separate compressor/air handler compartments
- TXV metering device
- iGate® 2 Communicating Controls Powered by DXM2.5
 - Multiple communication pathways,
 - o Cloud-based connectivity via iGate 2 Wi-Fi communicating color touch screen thermostat for remote monitoring, access, and diagnosis. Including the new functionality for contractors/building engineers to monitor and make mass changes on multi-unit systems
 - o Connect directly to the system with use of a handheld service tool
 - Provides real-time unit operating conditions
 - Reduces start-up, commissioning, and service time by removing the need for hard tooling to take temperature measurements
 - Captures operating conditions in the event of a safety shutdown
- 7 temperature sensor inputs for system protection and control
- Anti-short cycle and over/under voltage protection
- High pressure, loss of charge, and condensate overflow protection
- LED fault and status indication at controller
- Service tool port for optional setup and diagnostics at unit
- Field convertible supply air arrangement (horizontal configurations only)
- Easy access control box
- Flush securely-mounted corner post water connections and electrical service disconnects. (no backup wrench required)
- Unit Performance Sentinel performance monitoring system
- Eight Safeties Standard
- Non-corrosive polymer drain pan

OPTIONS


- Extended range insulation for geothermal applications
- BACnet, Modbus and Johnson N2 compatibility options for DDC controls
- Wide variety of options including ultra quiet sound insulation, extended range insulation, return air filter frames, variable and fixed speed circulating pumps, modulating motorized valves, hot water generator, and cupro-nickel water coil
- Unit integrated power disconnect
- Easy to clean rust prohibitive stainless steel drain pans

ACCESSORIES

- Wi-Fi communicating color touch screen thermostat
- Wide variety of thermostat options to meet your application needs
- Various length braided hose kits with optional water valves, PT plugs, blowdown valve, flow limiting, and strainer options
- Externally mounted manual and motorized water valves
- 1" Merv 8 filter
- 2" Merv 8 or 13 filters
- Architecturally pleasing wall sensors for connection to DDC (MPC) controls
- Electric emergency duct heaters

iGate® 2 Communicating Controls Powered by DXM2.5

iGate® 2 Communication – Cloud connected, web-enabled information gateway to monitor, control, and diagnose your system



Tranquility (TZ) Compact Two Stage Series is equipped with industry-first, iGate® 2 communication information gateway that allows users to interact with their water-source system in easy to read clear language AND delivers improved reliability/efficiency by precisely controlling smart components.

Monitor/Configure – Installers can configure from the myUplink PRO website, mobile app, iGate 2 Communicating AWC Thermostat, or diagnostic tool, including: Airflow, unit family, size, accessory configuration, and demand reduction (optional, to limit unit operation during peak times). Users can look up the current system status: temperature sensor readings and operational status of the blower.


Precise Control – The new DXM2.5 board enables intelligent, 2-way communication between the DXM2.5 board and smart components like the communicating thermostat/diagnostic tool and constant volume (CV) EC fan motor. The advanced DXM2.5 board uses information received from the smart components and temperature sensors to precisely control operation of the variable speed CV EC fan to deliver higher efficiency, reliability and increased comfort.

Diagnostics – iGate 2 takes diagnosing water source heat pump units to a next level of simplicity, by providing a dashboard of system and fault information, in clear language, on the AWC Communicating Thermostat, handheld service tool and the web portal/mobile app on the internet.

iGate 2 Thermostat Service Warnings notify the homeowner and contractor of a fault and displays fault descriptions by app notifications/email with possible causes. Additionally, the current system status can be viewed graphically on the web portal and mobile app.

In iGate 2 Service Mode, the service personnel can access fault description, possible causes and most importantly, the conditions (temp, flow, i/o conditions, configuration) at the time of the fault. Manual Operation mode allows the service personnel to manually command operation for any of the thermostat outputs, blower speed, to help troubleshoot specific components. This operation can either be conducted at the unit with a communicating thermostat/diagnostic tool or remotely with mobile app/website when the AWC Communicating Thermostat controls are used.


With an iGate 2 communicating system, users and contractors have a web-enabled gateway to system information never before available and exclusive to ClimateMaster products.

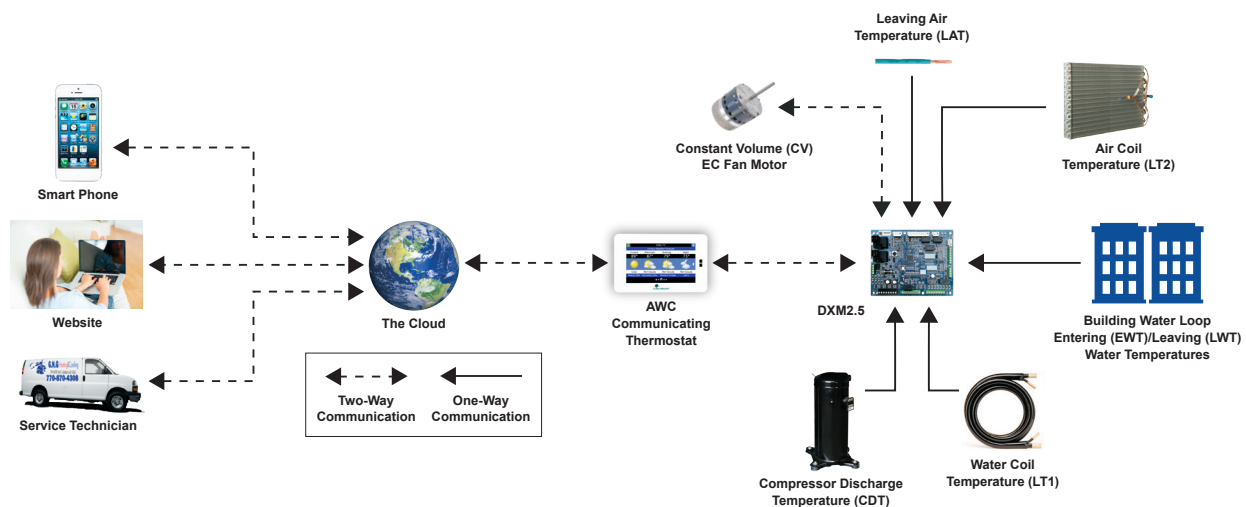

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

iGate® 2 Communicating (AWC)Thermostat

iGate® 2 Communication – Cloud connected, web-enabled information gateway to monitor, control, and diagnose your system

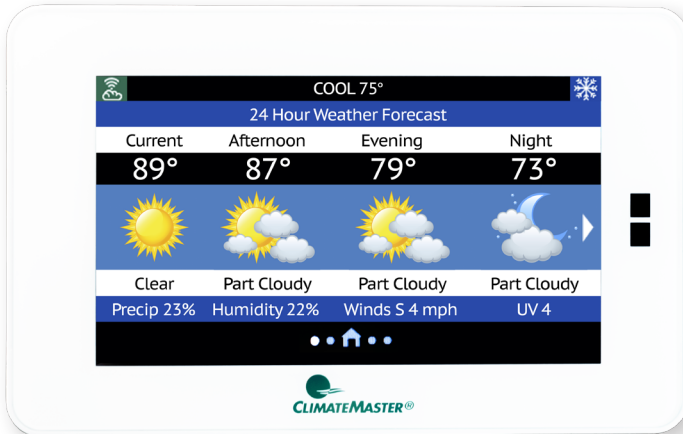

The iGate® 2 Communicating (AWC) Thermostat is innovating the future of comfort technology, one building at a time. The inspired design of the touch screen interface allows you to see real-time data for the efficiency and health of your system, with early warnings for potential system faults. The cloud based information gateway allows technicians to remotely diagnose system issues before occupants even know there is a problem. Control and monitor the system in your home or business from anywhere in the world with an easy to use app on your phone.

Features with Efficiency in Mind



Touch Screen Interface

A brilliantly customizable touch screen monitor for simple control.



Seamless Integration

Between your iGate® 2 Communicating (AWC) Thermostat and Tranquility comfort system.



(Mobile) Remote System Control

Control temperature and schedule from anywhere in the world.



Early Fault Warnings

Alerts you and your contractor of potential system faults in the future.



Remote Diagnostics

Enable the contractor to remotely diagnose system issues, adjust system settings, and reset faults.



Real-Time Operations Data & System Schematics

Access simply via the myUplink Pro Account and web portal to view system diagrams with current operating temperatures.




Revenue Stream

HVAC professionals can offer owners service contracts with remote monitoring and diagnosis capabilities without the large expense of a building management system.



HVAC Professional | User Experience

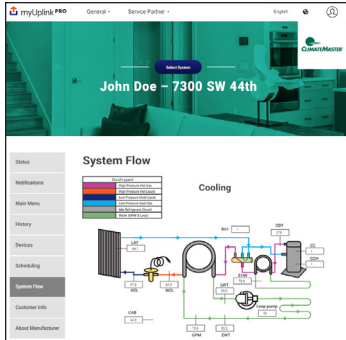


The iGate® 2 is more than just a smart thermostat for your residential or commercial customer, it's a business opportunity. Our new thermostat works with your customers' Tranquility comfort systems to provide the most efficient link between their system and your services. The customization of monitoring from the myUplink PRO web portal or phone app account allows for continuous system monitoring, analysis, repair recognition, and early warnings for potential system faults that are sent to you and your customer.



Benefits

- Remote login from anywhere, anytime from any internet connected device
- View system fault history with possible root causes
- Information is available for contractors to troubleshoot and diagnosis systems remotely
- Secure internet connection keeps homeowner information private
- Access thermostat(s) through Android and iPhone mobile apps

Homeowner | User Experience

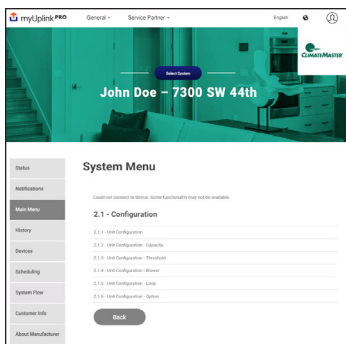

The iGate® 2 combines a Wi-Fi thermostat and advanced unit controls to communicate the systems operation information to the cloud. From any internet connected device or smart phone, homeowners can control and monitor their systems from anywhere in the world. iGate 2 offers homeowners peace of mind their systems are operating at peak performance with advanced operational performance issue notifications. HVAC professionals get notifications when systems are operating out of range. They can log in remotely to check system faults, review current operating conditions, and diagnosis issues remotely. This gives the HVAC technician the upper hand when showing up to perform service, saving time which in turn saves money.



Benefits

- Communicates personal settings and reminders through the iGate 2 communication system
- Easy-to-use, full-color, high-resolution interface
- Sleek, intuitive button control
- Secure internet connection keeps your information private
- Contains unit model, serial number and your HVAC professionals contact information
- System monitoring automatically contacts HVAC system providers when service is needed

Constant Volume (CV) ECM

The Intelligent Constant Volume (CV) ECM blower motor provides unmatched functionality that saves installing and service technicians time while also providing increased comfort levels to occupants.

CV ECM's are programed to maintain a constant CFM across a wide range of external static pressures (ESP). This functionality differs from traditional PSC or even Constant Torque (CT) ECM's. With traditional PSC and CT ECM fan motors, as ESP is increased CFM is reduced. To increase or decrease the speed of the fan motor requires a fan motor switch or a technician to wire into a different motor tap. CT ECM's provide increased efficiency over PSC motors but with no additional functionality. With a CV ECM, as changes in ESP occur the fan motor will adjust its speed to deliver the desired CFM (within its operating range). This ensures the system is delivering the airflow and capacity it was designed for.

A major benefit of the CV ECM over other fan motor types its ability to adjust airflow remotely through the iGate® 2 web portal/mobile app or directly at the unit with a communicating diagnostic service tool or thermostat. Airflow levels can be adjusted in increments of 25 CFM from the units minimum and maximum CFM range (see CV ECM configuration table for details). This functionality allows technicians to dial in airflow during start-up and commissioning via an easy to use service tool. During operation occupants may have a desire for airflow adjustments. Reducing CFM can reduce airflow sound levels and increase cooling dehumidification (latent capacity). Technicians can easily make these adjustments without making wiring changes reducing service time with minimal disruption to the occupants.

The fan motor operating modes include:

- First Stage Cooling (Y1 & O)
- Second Stage Cooling (Y1, Y2, & O)
- First Stage Heating (Y1)
- Second Stage Heating (Y1 & Y2)
- Fan (G with no Y1, Y2, or W)

The CV ECM motor includes **“soft start”** and **“ramp down”** features. The soft start feature gently increases the motors rpm at blower start up resulting quieter blower start cycles. Likewise, the ramp down feature allows the blower to slowly decrease rpm to a full stop resulting in a quieter end to each blower cycle. The ramp down feature (also known as the heating or cooling “Off Delay”) also has the functionality to be field selected by the technician in the allowable range of 0 to 255 seconds.



Airflow Configuration Screen on Mobile App

vFlow® Internal Variable Water Flow Control

vFlow® Internal Variable Water Flow

Industry-first, Built-in vFlow® replaces a traditionally inefficient, external component of the system (water circulation) with an ultra-high-efficient, variable speed, internal water flow system. This saves 70-80% on operating water circulator vs traditional single speed pump systems. It saves installers time and labor by avoiding installing bulky external pumps or flow regulators. Multi-unit installations are also much simpler with vFlow systems, as the units automatically adjust water flow across the system.

vFlow is enabled by iGate® 2, which facilitates intelligent communication between the thermostat, DXM2.5 control, sensors, and internal water pump/valve to make true variable water flow a reality.

vFlow® is available in four variations:

1. Low System Pressure Drop Modulating Valve – High CV motorized valve for central pumping. (Standard Unit).
2. High System Pressure Drop Modulating Valve – Motorized valve for higher pressure water system such as water well pumps. (Optional).
3. Standard Head Variable Pump – multi unit/central pumping. (Optional).
4. High Head Variable Pump – multi/individual unit pumping. (Optional).

vFlow® delivers three main benefits:


1. Easier and quicker unit installation as the flow control is built in to the unit.
2. Superior reliability by varying the water flow to deliver more stable operation.
3. Increased cost savings by varying the flow (and pump watt consumption) to match the unit's mode of operation.

Internal components

Tranquility® 22 can be installed more easily and compactly than its predecessors because water-flow components are internal to the unit. It also saves installing contractors labor and time by eliminating the need for an external flow regulator or a bulky external pumping module.

Variable flow

vFlow technology enables variable water flow through the unit, with the DXM2.5 control adjusting the pump speed to maintain an installer-set loop delta T. By controlling the water flow, the system is able to operate at its optimal capacity and efficiency. vFlow provides a lower flow rate for part load where units typically operate 80% of the time and a higher, more normal flow rate for full load operation.

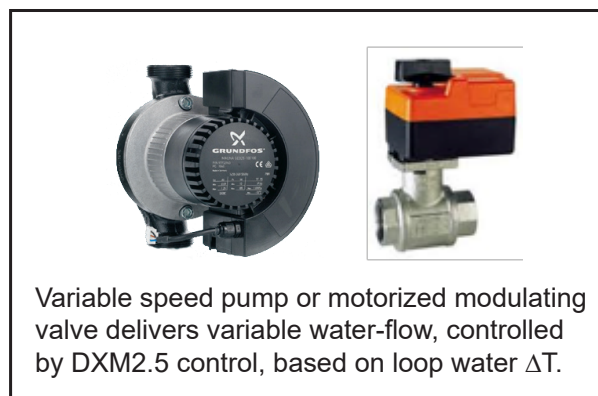


Energy Savings with water circulation control

Units with vFlow deliver greater operating cost savings by varying the water flow to match the unit's operation (ex: lower water flow when unit is in part load operation). Lowering the flow results in lower energy consumption by the water pump (=greater cost savings) in vFlow units (whether internal or external pump).

In applications using vFlow® with internal variable speed (ECM) pump, the ECM pump uses fewer watts than a fixed speed (PSC) pump, even at full load. The ECM pump excels in energy savings in part load, saving 70-80% watts compared to fixed speed pumps (see chart). The ECM pump can operate with independent flow rates for both heating and cooling operations allowing for more energy savings.

In loop applications, when the motorized modulating valve slows down the water flow during part load operation, the external pump consumes fewer watts, thus saving more energy.

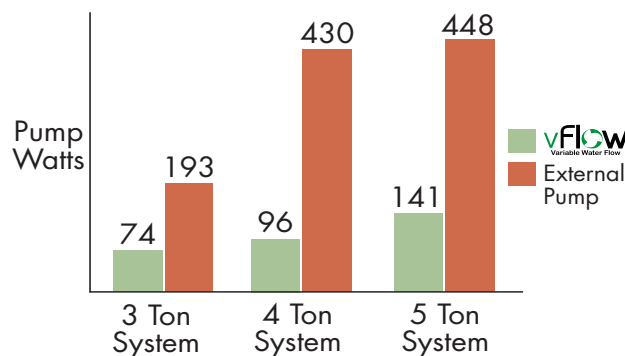

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Selection Procedure

Reference Calculations

HEATING	
$LWT = EWT - \frac{HE}{GPM \times Constant}$	
$LAT = EAT + \frac{HC}{CFM \times 1.08}$	

COOLING	
$LWT = EWT + \frac{HR}{GPM \times Constant}$	$LC = TC - SC$
$LAT (DB) = EAT (DB) - \frac{SC}{CFM \times 1.08}$	$S/T = \frac{SC}{TC}$

Constant = 500 for water, 485 for antifreeze

Conversion Table - to convert inch-pound (English) to S-I (Metric)

Airflow	Water Flow	Est Static Pressure	Water Pressure Drop
Airflow (L/s) = CFM x 0.472	Water Flow (L/s) = gpm x 0.0631	ESP (Pa) = ESP (in of wg) x 249	PD (kPa) = PD (ft of hd) x 2.99

Legend and Glossary of Abbreviations

Abbreviations	Descriptions
BTUH	BTU (British Thermal Unit) per hour
CDT	Compressor discharge temperature
CFM	Airflow, cubic feet per minute
COP	Coefficient of performance = BTUH output/BTUH input
CT ECM	Electronic commutated constant torque fan motor
CV ECM	Electronic commutated constant volume fan motor
DB	Dry bulb temperature, °F
EAT	Entering air temperature
EER	Energy efficient ratio = BTUH output/Watt input
ESP	External static pressure, inches w.g.
EWT	Entering water temperature
FPT	Female pipe thread
GPM	Water flow in U.S., gallons per minute
HC	Air heating capacity, BTUH
HE	Total heat of extraction, BTUH
HR	Total heat of rejection, BTUH
HWC	Hot water generator (desuperheater) capacity, Mbtuh
KW	Total power unit input, kilowatts
LAT	Leaving air temperature, °F
LC	Latent cooling capacity, BTUH
LOC	Loss of charge
LWT	Leaving water temperature, °F
MBTUH	1,000 BTU per hour
MPT	Male pipe thread
MWV	Motorized water valve
PSC	Permanent split capacitor
SC	Sensible cooling capacity, BTUH
S/T	Sensible to total cooling ratio
TC	Total cooling capacity, BTUH
TD or delta T	Temperature differential
VFD	Variable frequency drive
WB	Wet bulb temperature, °F
WPD	Waterside pressure drop, psi or feet of head
WSE	Waterside economizer

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Selection Procedure

- Step 1** Determine the actual heating and cooling loads at the desired dry bulb and wet bulb conditions.
- Step 2** Obtain the following design parameters: Entering water temperature, water flow rate in GPM, air flow in CFM, water flow pressure drop and design wet and dry bulb temperatures. Air flow CFM should be between 300 and 450 CFM per ton. Unit water pressure drop should be kept as close as possible to each other to make water balancing easier. Go to the appropriate tables and find the proper indicated water flow and water temperature.
- Step 3** Select a unit based on total and sensible cooling conditions. Select a unit which is closest to, but no larger than, the actual cooling load.
- Step 4** Enter tables at the design water flow and water temperature. Read the total and sensible cooling capacities (Note: interpolation is permissible, extrapolation is not).
- Step 5** Read the heating capacity. If it exceeds the design criteria it is acceptable. It is quite normal for Water-Source Heat Pumps to be selected on cooling capacity only since the heating output is usually greater than the cooling capacity.
- Step 6** Determine the correction factors associated with the variable factors of dry bulb and wet bulb.

 Corrected Total Cooling =
 tabulated total cooling x wet bulb correction.

 Corrected Sensible Cooling =
 tabulated sensible cooling x wet/dry bulb correction.
- Step 7** Compare the corrected capacities to the load requirements. Normally if the capacities are within 10% of the loads, the equipment is acceptable. It is better to undersize than oversize, as undersizing improves humidity control, reduces sound levels and extends the life of the equipment.
- Step 8** When completed, calculate water temperature rise and assess the selection. If the units selected are not within 10% of the load calculations, then review what effect changing the GPM, water temperature and/or air flow and air temperature would have on the corrected capacities. If the desired capacity cannot be achieved, select the next larger or smaller unit and repeat the procedure. Remember, when in doubt, undersize slightly for best performance.

Example Equipment Selection For Cooling Step 1 Load Determination:

Assume we have determined that the appropriate cooling load at the desired dry bulb 80°F and wet bulb 65°F conditions is as follows:

Total Cooling22,000 BTUH
 Sensible Cooling.....18,200 BTUH
 Entering Air Temp.....80°F Dry Bulb / 65°F Wet Bulb

Step 2 Design Conditions:

Similarly, we have also obtained the following design parameters:

Entering Water Temp.....90°F
 Water Flow (Based upon 10°F rise in temp.)4.5 GPM
 Air Flow.....600 CFM

Steps 3, 4, & 5 HP Selection:

After making our preliminary selection (TZH024 - Full Load), we enter the tables at design water flow and water temperature and read Total Cooling, Sens. Cooling and Heat of Rej. capacities:

Total Cooling.....22,500 BTUH
 Sensible Cooling.....16,500 BTUH
 Heat of Rejection.....28,800 BTUH

Steps 6 & 7 Entering Air and Airflow Corrections:

Next, we determine our correction factors.

Table Ent Air Air Flow Corrected

Corrected Total Cooling = 22,500 x 0.976 x 0.967 = 21,235
 Corrected Sens Cooling = 16,500 x 0.919 x 1.089 = 16,513
 Corrected Heat of Reject = 28,800 x 0.969 x 0.972 = 27,126

Step 8 Water Temperature Rise Calculation and Assessment:

Actual Temperature Rise.....12.1°F

When we compare the Corrected Total Cooling and Corrected Sensible Cooling figures with our load requirements stated in Step 1, we discover that our selection is within +/- 10% of our sensible load requirement. Furthermore, we see that our Corrected Total Cooling figure is within 1,000 Btuh of the actual indicated load.

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

TZ Series Nomenclature

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15

TZ
V
024
D
G
D
3
5
B
P
T
S

SERIES
TZ = Tranquility® 22

CONFIGURATION
V = Vertical Up
H = Horizontal

UNIT SIZE
024
030
036
042
048
060

REVISION LEVEL
D = Current Revision

VOLTAGE
G = 208/230/60/1
E = 265/60/1
F = 460/60/3
H = 208/230/60/3

CONTROLS
D = DXM2.5
P = DXM2.5 w/MPC

w/DISCONNECT {
B = DXM2.5
S = DXM2.5 w/MPC

STANDARD
S = Standard

SUPPLY AIR FLOW & MOTOR CONFIGURATION

	Supply	Configuration	Motor
K	Top	TZV	ECM
P	Back	TZH	ECM
W	Straight	TZH	ECM

RETURN AIR FLOW CONFIGURATION
P = Left Return
C = Right Return
S = Left Return, Stainless Steel Drain Pan
T = Right Return, Stainless Steel Drain Pan

HEAT EXCHANGER OPTIONS

	Non Coated Air Coil		Tin Plated Air Coil	
	Copper	Cupro-Nickel	Copper	Cupro-Nickel
Standard	C	N	A	J
HWG (Coil Only)	T	V	U	W

WATER CIRCUIT OPTIONS
3 = Internal Pump Standard Head (Variable w/ check valve)
C = Internal Pump Standard Head (Variable w/o check valve)
4 = Internal Pump High Head (Variable w/ check valve)
D = Internal Pump High Head (Variable w/o check valve)
5 = Motorized Valve (Modulating) Closed Loop Applications, Low System Pressure Drop
6 = Motorized Valve (Modulating) Open Loop Applications, High System Pressure Drop
7 = Internal Secondary Pump

CABINET

OPTION	RANGE	ULTRA QUIET	1" FILTER RACK	2" FILTER RACK	1" FILTER FRAME	2" FILTER FRAME
1	EXTENDED RANGE	NO	YES	NO		
A				NO	YES	NO
J			NO	YES	NO	
K			NO	YES	YES	NO
2	EXTENDED RANGE	YES	YES	NO		
C				NO	YES	NO
L			NO	YES	NO	
M			NO	YES	YES	NO
3	STANDARD RANGE	NO	YES	NO		
E				NO	YES	NO
N			NO	YES	NO	
P			NO	YES	YES	NO
4		YES	YES	NO		
G				NO	YES	YES
R			NO	YES	NO	
S			NO	YES	YES	NO

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Performance Data – AHRI/ASHRAE/ISO 13256-1

ASHRAE/AHRI/ISO 13256-1. English (I-P) Units

Model	Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
	Cooling 86°F		Heating 68°F		Cooling 59°F		Heating 50°F		Full Cool 77°F Part Cool 68°F		Full Heat 32°F Part Heat 41°F	
	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP
TZ*024 Part	18,100	16.1	20,600	5.2	20,300	27.2	16,700	4.4	19,400	22.2	14,700	4.0
TZ*024 Full	23,700	14.3	28,000	4.6	26,500	21.7	23,000	4.1	24,600	16.0	17,800	3.6
TZ*030 Part	21,900	15.2	26,300	5.0	24,900	24.8	22,000	4.3	24,200	20.9	19,400	3.9
TZ*030 Full	28,500	14.0	35,800	4.6	32,300	20.7	30,000	4.2	29,900	15.7	23,800	3.6
TZ*036 Part	25,800	17.2	29,900	5.3	29,000	29.4	24,900	4.6	27,300	23.4	21,500	4.0
TZ*036 Full	34,300	15.1	42,000	4.6	38,200	22.3	35,100	4.3	35,200	16.7	27,300	3.6
TZ*042 Part	31,000	15.8	36,800	5.1	35,200	26.4	30,500	4.3	34,000	22.0	26,900	3.8
TZ*042 Full	41,100	14.3	50,200	4.6	46,300	21.3	42,300	4.1	43,100	16.1	33,300	3.4
TZ*048 Part	34,100	15.2	39,500	5.5	39,200	26.8	32,600	4.6	37,600	21.2	29,200	4.1
TZ*048 Full	45,900	14.0	53,800	4.9	51,800	20.9	45,000	4.4	48,100	15.5	35,600	3.7
TZ*060 Part	45,500	17.7	49,000	5.3	50,400	28.9	39,800	4.5	48,600	23.7	34,800	4.0
TZ*060 Full	61,700	15.7	67,500	4.8	68,000	22.7	55,400	4.3	63,200	17.3	43,700	3.6

Cooling capacities based upon 80.6°F DB, 66.2°F WB entering air temperature
 Heating capacities based upon 68°F DB, 59°F WB entering air temperature
 Ground Loop Heat Pump ratings based on 15% antifreeze solution
 All ratings based upon operation at lower voltage of dual voltage rated models

ASHRAE/AHRI/ISO 13256-1. English (I-P) Units

Model	Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
	Cooling 30°C		Heating 20°C		Cooling 15°C		Heating 10°C		Full Cool 25°C Part Cool 20°C		Full Heat 0°C Part Heat 5°C	
	Capacity kW	EER Btuh/W	Capacity kW	COP	Capacity kW	EER Btuh/W	Capacity kW	COP	Capacity kW	EER Btuh/W	Capacity kW	COP
TZ*024 Part	5.30	4.7	6.04	5.2	5.95	8.0	4.89	4.4	5.68	6.5	4.31	4.0
TZ*024 Full	6.94	4.2	8.20	4.6	7.76	6.4	6.74	4.1	7.21	4.7	5.22	3.6
TZ*030 Part	6.42	4.5	7.71	5.0	7.30	7.3	6.45	4.3	7.09	6.1	5.69	3.9
TZ*030 Full	8.35	4.1	10.49	4.6	9.47	6.1	8.79	4.2	8.76	4.6	6.98	3.6
TZ*036 Part	7.56	5.0	8.76	5.3	8.50	8.6	7.30	4.6	8.00	6.9	6.30	4.0
TZ*036 Full	10.05	4.4	12.31	4.6	11.19	6.5	10.28	4.3	10.31	4.9	8.00	3.6
TZ*042 Part	9.09	4.6	10.79	5.1	10.32	7.7	8.94	4.3	9.96	6.4	7.88	3.8
TZ*042 Full	12.05	4.2	14.71	4.6	13.57	6.2	12.40	4.1	12.63	4.7	9.76	3.4
TZ*048 Part	9.99	4.5	11.58	5.5	11.49	7.9	9.55	4.6	11.02	6.2	8.56	4.1
TZ*048 Full	13.45	4.1	15.77	4.9	15.18	6.1	13.19	4.4	14.10	4.5	10.43	3.7
TZ*060 Part	13.3	5.2	14.36	5.3	14.77	8.5	11.66	4.5	14.24	6.9	10.20	4.0
TZ*060 Full	18.1	4.6	19.78	4.8	19.93	6.7	16.24	4.3	18.52	5.1	12.80	3.6

Cooling capacities based upon 27°C DB, 19°C WB entering air temperature
 Heating capacities based upon 20°C DB, 15°C WB entering air temperature
 Ground Loop Heat Pump ratings based on 15% antifreeze solution
 All ratings based upon operation at lower voltage of dual voltage rated models

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Performance Data – TZ H/V 024 (Part Load) with Modulating Valve or Variable Speed Pump

600 CFM Nominal (Rated) Airflow Cooling, 600 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btuh

EWT °F	GPM	WPD			COOLING - EAT 80/67°F							GPM	WPD			HEATING - EAT 70°F						
		PSI	FT		TC	SC	kW	HR	EER	LWT	HWC Cap		PSI	FT		HC	kW	HE	COP	LAT	LWT	HWC Cap
20	1.2	0.3	0.7		22.4	15.2	0.71	24.9	31.6	60.0	0.9	4.5	3.1	7.2		10.8	1.12	7.0	2.8	84.6	16.9	1.9
	1.7	0.3	0.6		22.4	15.2	0.71	24.9	31.6	60.0	0.9	2.3	0.6	1.5		12.3	1.14	8.4	3.2	86.9	22.6	1.9
	1.7	0.3	0.6		22.4	15.2	0.71	24.9	31.6	60.0	0.9	3.4	1.5	3.4		12.9	1.15	9.0	3.3	87.8	24.7	1.9
30	1.7	0.3	0.6		22.4	15.2	0.71	24.9	31.6	60.0	0.9	4.5	2.4	5.6		13.2	1.15	9.3	3.4	88.3	25.9	2.0
	2.5	0.5	1.2		22.4	15.2	0.71	24.9	31.6	60.0	0.9	2.3	0.4	0.8		14.5	1.16	10.6	3.7	90.4	30.6	2.0
	2.5	0.5	1.2		22.4	15.2	0.71	24.9	31.6	60.0	0.9	3.4	1.1	2.5		15.3	1.17	11.3	3.8	91.6	33.3	2.1
40	2.5	0.5	1.2		22.4	15.2	0.71	24.9	31.6	60.0	0.9	4.5	1.9	4.5		15.8	1.18	11.7	3.9	92.3	34.8	2.1
	2.3	0.2	0.5		21.5	14.7	0.82	24.3	26.2	71.6	1.2	2.3	0.2	0.5		16.9	1.19	12.8	4.2	94.0	38.6	2.1
	3.4	0.8	2.0		22.1	15.0	0.75	24.7	29.5	64.5	1.0	3.4	0.8	2.0		17.8	1.20	13.7	4.4	95.5	41.9	2.2
50	4.5	1.6	3.7		22.4	15.2	0.72	24.8	31.0	61.0	0.9	4.5	1.6	3.7		18.4	1.21	14.2	4.5	96.3	43.7	2.2
	2.3	0.1	0.3		20.7	14.3	0.94	23.9	21.9	81.2	1.7	2.3	0.1	0.3		19.2	1.22	15.0	4.6	97.5	46.6	2.3
	3.4	0.7	1.6		21.3	14.6	0.85	24.2	25.0	74.2	1.3	3.4	0.7	1.6		20.2	1.23	16.0	4.8	99.2	50.6	2.4
60	4.5	1.4	3.2		21.6	14.8	0.81	24.4	26.5	70.8	1.2	4.5	1.4	3.2		20.8	1.24	16.6	4.9	100.0	52.6	2.5
	2.3	0.1	0.3		19.6	13.8	1.09	23.4	18.0	90.8	2.3	2.3	0.1	0.3		21.3	1.25	17.1	5.0	100.8	54.8	2.5
	3.4	0.7	1.5		20.4	14.1	0.98	23.7	20.7	84.0	1.8	3.4	0.7	1.5		22.4	1.26	18.1	5.2	102.4	59.4	2.6
70	4.5	1.2	2.9		20.7	14.3	0.94	23.9	22.1	80.6	1.6	4.5	1.2	2.9		22.9	1.27	18.5	5.3	103.2	61.8	2.7
	2.3	0.2	0.4		18.5	13.3	1.26	22.8	14.6	100.3	3.2	2.3	0.2	0.4		23.2	1.27	18.8	5.3	103.7	63.3	2.8
	3.4	0.6	1.5		19.3	13.6	1.14	23.2	16.9	93.6	2.6	3.4	0.6	1.5		24.0	1.29	19.6	5.4	105.0	68.5	2.9
80	4.5	1.2	2.7		19.7	13.8	1.08	23.4	18.1	90.4	2.3	4.0	0.9	2.1		24.3	1.30	19.8	5.5	105.4	70.0	3.0
	2.3	0.2	0.5		17.2	12.8	1.46	22.2	11.7	109.7	4.2	2.0	0.2	0.5		24.3	1.30	19.8	5.5	105.4	70.0	3.0
	3.4	0.7	1.5		18.1	13.1	1.33	22.6	13.6	103.3	3.5	2.0	0.2	0.5		24.3	1.30	19.8	5.5	105.4	70.0	3.0
90	4.5	1.2	2.7		18.5	13.3	1.26	22.8	14.6	100.1	3.2	2.0	0.2	0.5		24.3	1.30	19.8	5.5	105.4	70.0	3.0
	2.3	0.2	0.5		15.7	12.3	1.69	21.5	9.3	119.1	5.4	1.3	0.2	0.5		24.3	1.30	19.8	5.5	105.4	70.0	3.0
	3.4	0.7	1.5		16.7	12.6	1.54	21.9	10.8	112.9	4.6	1.3	0.2	0.5		24.3	1.30	19.8	5.5	105.4	70.0	3.0
100	4.5	1.1	2.7		17.1	12.8	1.47	22.1	11.7	109.8	4.2	1.3	0.2	0.5		24.3	1.30	19.8	5.5	105.4	70.0	3.0
	2.3	0.2	0.4		14.1	11.8	1.94	20.7	7.3	128.4	6.8	1.0	0.1	0.2		24.3	1.30	19.8	5.5	105.4	70.0	3.0
	3.4	0.6	1.4		15.1	12.1	1.78	21.2	8.5	122.5	5.9	1.0	0.1	0.2		24.3	1.30	19.8	5.5	105.4	70.0	3.0
110	4.5	1.1	2.6		15.6	12.3	1.70	21.4	9.2	119.5	5.5	1.0	0.1	0.2		24.3	1.30	19.8	5.5	105.4	70.0	3.0
	2.3	0.0	0.1		12.3	11.1	2.22	19.8	5.5	137.6	8.3	0.8	0.1	0.2		24.3	1.30	19.8	5.5	105.4	70.0	3.0
	3.4	0.5	1.1		13.4	11.5	2.04	20.4	6.6	132.0	7.4	0.8	0.1	0.2		24.3	1.30	19.8	5.5	105.4	70.0	3.0
120	4.5	1.0	2.3		13.9	11.7	1.96	20.6	7.1	129.2	6.9	0.8	0.1	0.2		24.3	1.30	19.8	5.5	105.4	70.0	3.0

Interpolation is permissible; extrapolation is not.

All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.

AHRI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.

Table does not reflect fan or pump power corrections for AHRI/ISO conditions.

All performance is based upon the lower voltage of dual voltage rated units.

Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.

Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.

Operation below 60°F EWT requires optional insulated water/refrigerant circuit.

See performance correction tables for operating conditions other than those listed above.

See Performance Data Selection Notes for operation in the shaded areas.

For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection.

JW3 should never be clipped for standard range equipment or systems without antifreeze.

Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 024 (Full Load) with Modulating Valve or Variable Speed Pump

750 CFM Nominal (Rated) Airflow Cooling, 750 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btu/h

EWT °F	GPM	WPD		COOLING - EAT 80/67°F							GPM	WPD		HEATING - EAT 70°F							
		PSI	FT	TC	SC	kW	HR	EER	LWT	HWC Cap		PSI	FT	HC	kW	HE	COP	LAT	LWT	HWC Cap	
20	1.7	0.7	1.5	29.3	19.2	1.18	33.3	24.9	60.0	1.3	6.0	4.8	11.1	15.7	1.49	10.6	3.1	87.3	16.5	2.3	
	30	2.2	0.6	1.4	29.3	19.2	1.18	33.3	24.9	60.0	1.3	3.0	1.2	2.7	17.4	1.53	12.2	3.3	89.5	21.9	2.4
		2.2	0.6	1.4	29.3	19.2	1.18	33.3	24.9	60.0	1.3	4.5	2.4	5.6	18.2	1.56	12.9	3.4	90.5	24.3	2.5
40	2.2	0.6	1.4	29.3	19.2	1.18	33.3	24.9	60.0	1.3	6.0	3.9	9.1	18.7	1.57	13.3	3.5	91.0	25.6	2.5	
	40	3.0	0.8	1.9	29.1	19.1	1.20	33.2	24.2	62.1	1.4	3.0	0.8	1.9	20.3	1.61	14.8	3.7	93.0	30.1	2.6
		3.3	1.0	2.4	29.3	19.2	1.18	33.3	24.9	60.0	1.3	4.5	1.9	4.5	21.4	1.63	15.8	3.8	94.4	33.0	2.7
50	3.3	1.0	2.4	29.3	19.2	1.18	33.3	24.9	60.0	1.3	6.0	3.3	7.6	22.0	1.65	16.4	3.9	95.1	34.5	2.8	
	50	3.0	0.6	1.4	28.1	18.7	1.32	32.6	21.3	71.7	1.8	3.0	0.6	1.4	23.4	1.68	17.6	4.1	96.8	38.2	2.9
		4.5	1.6	3.7	28.8	19.0	1.23	33.0	23.4	64.7	1.5	4.5	1.6	3.7	24.6	1.71	18.8	4.2	98.3	41.6	3.0
60	6.0	2.8	6.5	29.2	19.1	1.19	33.2	24.5	61.1	1.3	6.0	2.8	6.5	25.3	1.73	19.4	4.3	99.2	43.5	3.1	
	60	3.0	0.5	1.2	27.0	18.2	1.45	32.0	18.6	81.3	2.4	3.0	0.5	1.2	26.4	1.75	20.4	4.4	100.5	46.4	3.2
		4.5	1.4	3.2	27.8	18.5	1.35	32.4	20.5	74.4	2.0	4.5	1.4	3.2	27.7	1.79	21.6	4.5	102.2	50.4	3.4
70	6.0	2.5	5.7	28.2	18.7	1.31	32.6	21.5	70.9	1.8	6.0	2.5	5.7	28.5	1.81	22.3	4.6	103.1	52.6	3.4	
	70	3.0	0.5	1.1	25.8	17.7	1.62	31.3	16.0	90.9	3.1	3.0	0.5	1.1	29.1	1.83	22.9	4.7	103.9	54.7	3.5
		4.5	1.2	2.9	26.7	18.0	1.50	31.8	17.8	84.1	2.6	4.5	1.2	2.9	30.5	1.88	24.1	4.8	105.5	59.3	3.7
80	6.0	2.2	5.2	27.1	18.2	1.44	32.0	18.8	80.7	2.4	6.0	2.2	5.2	31.1	1.90	24.6	4.8	106.3	61.8	3.8	
	80	3.0	0.5	1.1	24.5	17.1	1.83	30.7	13.4	100.5	4.0	3.0	0.5	1.1	31.5	1.91	25.0	4.8	106.8	63.4	3.9
		4.5	1.2	2.7	25.4	17.5	1.68	31.2	15.2	93.8	3.4	4.5	1.2	2.7	32.5	1.97	25.8	4.8	108.1	68.5	4.2
90	6.0	2.1	4.9	25.9	17.7	1.61	31.4	16.1	90.5	3.1	5.2	1.6	3.7	32.8	1.98	26.0	4.8	108.3	70.0	4.2	
	90	3.0	0.5	1.1	22.9	16.6	2.12	30.1	10.8	110.1	5.0	2.6	0.3	0.8	32.8	1.98	26.0	4.8	108.3	70.0	4.2
		4.5	1.2	2.7	24.0	17.0	1.92	30.5	12.5	103.6	4.3	2.6	0.3	0.8	32.8	1.98	26.0	4.8	108.3	70.0	4.2
100	6.0	2.0	4.7	24.5	17.2	1.83	30.8	13.4	100.3	3.9	2.6	0.3	0.8	32.8	1.98	26.0	4.8	108.3	70.0	4.2	
	100	3.0	0.5	1.1	21.0	16.0	2.49	29.5	8.4	119.7	6.1	1.7	0.2	0.5	32.8	1.98	26.0	4.8	108.3	70.0	4.2
		4.5	1.2	2.7	22.3	16.4	2.23	29.9	10.0	113.3	5.3	1.7	0.2	0.5	32.8	1.98	26.0	4.8	108.3	70.0	4.2
110	6.0	2.0	4.6	22.9	16.6	2.12	30.1	10.8	110.0	5.0	1.7	0.2	0.5	32.8	1.98	26.0	4.8	108.3	70.0	4.2	
	110	3.0	0.5	1.0	18.8	15.2	2.97	28.9	6.3	129.3	7.4	1.3	0.1	0.2	32.8	1.98	26.0	4.8	108.3	70.0	4.2
		4.5	1.1	2.6	20.3	15.7	2.65	29.3	7.7	123.0	6.5	1.3	0.1	0.2	32.8	1.98	26.0	4.8	108.3	70.0	4.2
120	6.0	1.9	4.4	21.0	16.0	2.50	29.5	8.4	119.8	6.1	1.3	0.1	0.2	32.8	1.98	26.0	4.8	108.3	70.0	4.2	
	120	3.0	0.3	0.8	16.2	14.1	3.58	28.4	4.5	138.9	8.8	1.0	0.1	0.2	32.8	1.98	26.0	4.8	108.3	70.0	4.2
		4.5	1.0	2.3	17.9	14.9	3.17	28.7	5.6	132.8	7.9	1.0	0.1	0.2	32.8	1.98	26.0	4.8	108.3	70.0	4.2
	6.0	1.8	4.2	18.7	15.2	2.99	28.9	6.3	129.6	7.4	1.0	0.1	0.2	32.8	1.98	26.0	4.8	108.3	70.0	4.2	

Interpolation is permissible; extrapolation is not.

All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.

AHR/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.

Table does not reflect fan or pump power corrections for AHR/ISO conditions.

All performance is based upon the lower voltage of dual voltage rated units.

Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.

Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.

Operation below 60°F EWT requires optional insulated water/refrigerant circuit.

See performance correction tables for operating conditions other than those listed above.

See Performance Data Selection Notes for operation in the shaded areas.

For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.

Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 030 (Part Load) with Modulating Valve or Variable Speed Pump

750 CFM Nominal (Rated) Airflow Cooling, 750 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btu/h

EWT °F	GPM	WPD			COOLING - EAT 80/67°F							GPM	WPD			HEATING - EAT 70°F						
		PSI	FT	TC	SC	kW	HR	EER	LWT	HWC Cap	PSI		FT	HC	kW	HE	COP	LAT	LWT	HWC Cap		
20	1.5	1.2	2.8	26.5	17.4	0.96	29.8	27.6	60.0	1.0	6.0	4.3	9.9	15.7	1.49	10.6	3.1	87.3	16.5	2.1		
	2.0	1.0	2.4	26.5	17.4	0.96	29.8	27.6	60.0	1.0	3.0	1.7	4.0	17.2	1.51	12.0	3.3	89.1	22.0	2.1		
30	2.0	1.0	2.4	26.5	17.4	0.96	29.8	27.6	60.0	1.0	4.5	2.7	6.3	17.8	1.52	12.6	3.4	89.9	24.4	2.2		
	2.0	1.0	2.4	26.5	17.4	0.96	29.8	27.6	60.0	1.0	6.0	3.8	8.9	18.2	1.52	13.0	3.5	90.4	25.7	2.2		
40	3.0	1.2	2.8	26.5	17.4	0.96	29.8	27.6	60.0	1.0	3.0	1.3	3.0	19.5	1.55	14.2	3.7	92.0	30.5	2.3		
	3.0	1.2	2.8	26.5	17.4	0.96	29.8	27.6	60.0	1.0	4.5	2.2	5.0	20.3	1.56	14.9	3.8	92.9	33.4	2.3		
	3.0	1.2	2.8	26.5	17.4	0.96	29.8	27.6	60.0	1.0	6.0	3.1	7.3	20.7	1.56	15.3	3.9	93.5	34.9	2.4		
50	3.0	0.9	2.0	25.7	17.1	1.09	29.4	23.6	69.6	1.3	3.0	0.9	2.0	21.8	1.58	16.4	4.0	94.9	39.1	2.4		
	4.5	1.6	3.6	26.3	17.3	1.00	29.7	26.3	63.2	1.1	4.5	1.6	3.6	22.7	1.60	17.3	4.2	96.0	42.3	2.5		
	6.0	2.4	5.6	26.5	17.4	0.96	29.8	27.6	60.0	1.0	6.0	2.4	5.6	23.2	1.61	17.7	4.2	96.6	44.1	2.6		
60	3.0	0.8	1.9	24.6	16.6	1.23	28.8	19.9	79.2	1.8	3.0	0.8	1.9	24.2	1.62	18.6	4.4	97.8	47.6	2.6		
	4.5	1.5	3.4	25.3	16.9	1.14	29.2	22.3	73.0	1.5	4.5	1.5	3.4	25.2	1.64	19.6	4.5	99.1	51.3	2.7		
	6.0	2.3	5.3	25.6	17.1	1.09	29.4	23.6	69.8	1.3	6.0	2.3	5.3	25.8	1.65	20.2	4.6	99.8	53.3	2.8		
70	3.0	0.8	1.8	23.4	16.1	1.40	28.2	16.7	88.8	2.5	3.0	0.8	1.8	26.6	1.66	20.9	4.7	100.7	56.1	2.9		
	4.5	1.4	3.2	24.2	16.4	1.29	28.6	18.7	82.7	2.0	4.5	1.4	3.2	27.7	1.68	22.0	4.8	102.2	60.2	3.0		
	6.0	2.2	5.0	24.5	16.6	1.24	28.8	19.8	79.6	1.8	6.0	2.2	5.0	28.4	1.69	22.6	4.9	102.9	62.5	3.0		
80	3.0	0.8	1.8	22.1	15.5	1.59	27.5	13.9	98.3	3.3	3.0	0.8	1.8	29.0	1.70	23.2	5.0	103.7	64.6	3.1		
	4.5	1.4	3.2	22.9	15.9	1.47	27.9	15.5	92.4	2.8	4.5	1.4	3.2	30.2	1.72	24.4	5.2	105.3	69.2	3.2		
	6.0	2.1	4.9	23.3	16.1	1.41	28.1	16.5	89.4	2.5	4.9	1.6	3.6	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
90	3.0	0.8	1.8	20.7	14.9	1.80	26.8	11.5	107.9	4.3	2.5	0.6	1.5	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
	4.5	1.4	3.2	21.5	15.3	1.67	27.2	12.9	102.1	3.7	2.5	0.6	1.5	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
	6.0	2.1	4.8	21.9	15.5	1.61	27.4	13.6	99.1	3.4	2.5	0.6	1.5	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
100	3.0	0.7	1.7	19.3	14.3	2.03	26.3	9.5	117.5	5.5	1.6	0.4	0.9	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
	4.5	1.3	3.0	20.1	14.7	1.89	26.6	10.6	111.8	4.8	1.6	0.4	0.9	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
	6.0	2.0	4.6	20.5	14.8	1.83	26.8	11.3	108.9	4.4	1.6	0.4	0.9	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
110	3.0	0.7	1.5	18.0	13.7	2.29	25.8	7.9	127.2	6.8	1.2	0.2	0.6	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
	4.5	1.2	2.8	18.8	14.0	2.14	26.1	8.8	121.6	6.0	1.2	0.2	0.6	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
	6.0	1.9	4.4	19.2	14.2	2.06	26.2	9.3	118.7	5.6	1.2	0.2	0.6	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
120	3.0	0.6	1.4	Operation Not Recommended							1.0	0.1	0.2	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
	4.5	1.1	2.6	17.5	13.5	2.40	25.7	7.3	131.4	7.5	1.0	0.1	0.2	30.5	1.72	24.6	5.2	105.5	70.0	3.2		
	6.0	1.8	4.1	17.9	13.6	2.32	25.8	7.7	128.6	7.0	1.0	0.1	0.2	30.5	1.72	24.6	5.2	105.5	70.0	3.2		

Interpolation is permissible; extrapolation is not.

All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.

AHR/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.

Table does not reflect fan or pump power corrections for AHR/ISO conditions.

All performance is based upon the lower voltage of dual voltage rated units.

Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.

Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.

Operation below 60°F EWT requires optional insulated water/refrigerant circuit.

See performance correction tables for operating conditions other than those listed above.

See Performance Data Selection Notes for operation in the shaded areas.

For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.

Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 030 (Full Load) with Modulating Valve or Variable Speed Pump

900 CFM Nominal (Rated) Airflow Cooling, 900 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btuh

EWT °F	GPM	WPD		COOLING - EAT 80/67°F								GPM	WPD		HEATING - EAT 70°F							
		PSI	FT	TC	SC	kW	HR	EER	LWT	HWC Cap	PSI		FT	HC	kW	HE	COP	LAT	LWT	HWC Cap		
20	2.0	1.5	3.4	34.7	21.5	1.51	39.8	23.0	60.0	1.7	7.5	5.7	13.3	21.8	1.93	15.2	3.3	90.3	16.0	2.7		
	2.7	1.4	3.2	34.7	21.5	1.51	39.8	23.0	60.0	1.7	3.8	2.3	5.2	23.5	1.99	16.7	3.5	92.1	21.1	2.8		
	2.7	1.4	3.2	34.7	21.5	1.51	39.8	23.0	60.0	1.7	5.6	3.5	8.1	24.5	2.02	17.6	3.6	93.1	23.7	2.9		
30	2.7	1.4	3.2	34.7	21.5	1.51	39.8	23.0	60.0	1.7	7.5	5.1	11.8	25.0	2.03	18.0	3.6	93.6	25.2	2.9		
	3.8	1.7	4.0	34.5	21.5	1.53	39.7	22.6	61.2	1.7	3.8	1.7	4.0	26.6	2.08	19.5	3.7	95.3	29.6	3.0		
	4.0	1.8	4.2	34.7	21.5	1.51	39.8	23.0	60.0	1.7	5.6	2.9	6.6	27.7	2.11	20.5	3.8	98.4	32.7	3.1		
40	4.0	1.8	4.2	34.7	21.5	1.51	39.8	23.0	60.0	1.7	7.5	4.3	10.0	28.3	2.13	21.0	3.9	97.1	34.4	3.2		
	3.8	1.2	2.8	33.5	21.0	1.67	39.2	20.0	70.9	2.2	3.8	1.2	2.8	29.7	2.17	22.3	4.0	98.5	38.1	3.3		
	5.6	2.2	5.1	34.2	21.4	1.57	39.6	21.8	64.1	1.8	5.6	2.2	5.1	31.0	2.21	23.5	4.1	99.8	41.7	3.5		
50	7.5	3.5	8.1	34.6	21.5	1.52	39.8	22.8	60.6	1.7	7.5	3.5	8.1	31.7	2.23	24.1	4.2	100.6	43.6	3.5		
	3.8	1.2	2.7	32.1	20.5	1.84	38.4	17.5	80.5	2.9	3.8	1.2	2.7	32.9	2.27	25.1	4.2	101.7	46.6	3.7		
	5.6	2.0	4.6	33.1	20.9	1.72	38.9	19.2	73.8	2.4	5.6	2.0	4.6	34.4	2.31	26.5	4.4	103.3	50.6	3.9		
60	7.5	3.3	7.6	33.5	21.1	1.67	39.2	20.1	70.5	2.2	7.5	3.3	7.6	35.2	2.34	27.2	4.4	104.1	52.8	4.0		
	3.8	1.1	2.5	30.7	19.9	2.03	37.6	15.1	90.0	3.7	3.8	1.1	2.5	36.0	2.36	28.0	4.5	105.0	55.1	4.1		
	5.6	1.9	4.5	31.7	20.3	1.90	38.1	16.7	83.6	3.1	5.6	1.9	4.5	37.7	2.41	29.4	4.6	106.7	59.5	4.4		
70	7.5	3.1	7.2	32.2	20.5	1.83	38.4	17.6	80.2	2.9	7.5	3.1	7.2	38.6	2.44	30.2	4.6	107.6	61.9	4.5		
	3.8	1.1	2.5	29.0	19.2	2.24	36.7	13.0	99.6	4.6	3.8	1.1	2.5	39.2	2.46	30.8	4.7	108.2	63.6	4.6		
	5.6	1.9	4.4	30.1	19.7	2.09	37.3	14.4	93.2	3.9	5.6	1.9	4.4	40.9	2.52	32.4	4.8	110.0	68.5	4.9		
80	7.5	3.0	7.0	30.7	19.9	2.02	37.6	15.1	90.0	3.7	6.6	2.4	5.5	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
	3.8	1.1	2.5	27.3	18.5	2.49	35.8	11.0	109.1	5.6	3.3	0.9	2.0	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
	5.6	1.9	4.3	28.4	19.0	2.32	36.4	12.2	102.9	4.9	3.3	0.9	2.0	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
90	7.5	2.9	6.8	29.0	19.2	2.25	36.7	12.9	99.8	4.6	3.3	0.9	2.0	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
	3.8	1.0	2.3	25.6	17.7	2.77	35.0	9.2	118.7	6.7	2.2	0.5	1.2	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
	5.6	1.8	4.1	26.7	18.2	2.59	35.5	10.3	112.6	6.0	2.2	0.5	1.2	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
100	7.5	2.8	6.5	27.2	18.4	2.50	35.8	10.9	109.5	5.6	2.2	0.5	1.2	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
	3.8	0.9	2.2	23.8	16.9	3.10	34.4	7.7	128.3	8.0	1.6	0.3	0.8	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
	5.6	1.7	3.9	24.9	17.4	2.89	34.8	8.6	122.4	7.2	1.6	0.3	0.8	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
110	7.5	2.7	6.2	25.5	17.6	2.79	35.0	9.1	119.3	6.8	1.6	0.3	0.8	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
	3.8	0.9	2.0	Operation Not Recommended							1.3	0.1	0.2	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
	5.6	1.6	3.7	23.1	16.5	3.24	34.2	7.1	132.2	8.5	1.3	0.1	0.2	41.5	2.54	32.8	4.8	110.6	70.0	5.1		
120	7.5	2.6	6.0	23.7	16.8	3.13	34.4	7.6	129.2	8.1	1.3	0.1	0.2	41.5	2.54	32.8	4.8	110.6	70.0	5.1		

Interpolation is permissible; extrapolation is not.

All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.

AHRI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.

Table does not reflect fan or pump power corrections for AHRI/ISO conditions.

All performance is based upon the lower voltage of dual voltage rated units.

Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.

Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.

Operation below 60°F EWT requires optional insulated water/refrigerant circuit.

See performance correction tables for operating conditions other than those listed above.

See Performance Data Selection Notes for operation in the shaded areas.

For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.

Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 036 (Part Load) with Modulating Valve or Variable Speed Pump

950 CFM Nominal (Rated) Airflow Cooling, 950 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btuh

EWT °F	GPM	WPD		COOLING - EAT 80/67°F							GPM	WPD		HEATING - EAT 70°F						
		PSI	FT	TC	SC	kW	HR	EER	LWT	HWC Cap		PSI	FT	HC	kW	HE	COP	LAT	LWT	HWC Cap
20	1.7	0.1	0.2	31.1	22.0	0.98	34.5	31.6	60.0	1.2	6.0	2.4	5.5	17.0	1.66	11.3	3.0	84.5	16.2	2.5
	2.3	0.1	0.2	31.1	22.0	0.98	34.5	31.6	60.0	1.2	3.0	0.1	0.3	18.5	1.66	12.8	3.3	86.0	21.5	2.6
	2.3	0.1	0.2	31.1	22.0	0.98	34.5	31.6	60.0	1.2	4.5	0.8	1.8	19.3	1.67	13.6	3.4	86.8	24.0	2.7
30	2.3	0.1	0.2	31.1	22.0	0.98	34.5	31.6	60.0	1.2	6.0	1.8	4.0	19.8	1.67	14.1	3.5	87.2	25.3	2.7
	3.5	0.1	0.2	31.1	22.0	0.98	34.5	31.6	60.0	1.2	3.0	0.1	0.2	21.3	1.69	15.6	3.7	88.7	29.6	2.8
	3.5	0.1	0.2	31.1	22.0	0.98	34.5	31.6	60.0	1.2	4.5	0.5	1.1	22.5	1.70	16.7	3.9	89.8	32.6	2.9
40	3.5	0.1	0.2	31.1	22.0	0.98	34.5	31.6	60.0	1.2	6.0	1.3	3.0	23.1	1.70	17.3	4.0	90.5	34.2	2.9
	3.0	0.1	0.2	29.7	21.8	1.16	33.7	25.6	72.5	1.7	3.0	0.1	0.2	24.4	1.71	18.6	4.2	91.7	37.6	3.0
	4.5	0.3	0.6	30.6	22.0	1.05	34.1	29.0	65.2	1.4	4.5	0.3	0.6	25.8	1.73	19.9	4.4	93.1	41.2	3.1
50	6.0	1.0	2.3	31.0	22.0	1.00	34.4	30.9	61.5	1.2	6.0	1.0	2.3	26.6	1.74	20.7	4.5	93.8	43.1	3.1
	3.0	0.1	0.2	28.6	21.4	1.33	33.1	21.5	82.1	2.3	3.0	0.1	0.2	27.5	1.75	21.6	4.6	94.8	45.6	3.2
	4.5	0.2	0.4	29.4	21.7	1.20	33.5	24.5	74.9	1.8	4.5	0.2	0.4	29.1	1.76	23.1	4.8	96.3	49.8	3.3
60	6.0	0.8	1.9	29.9	21.9	1.14	33.8	26.1	71.3	1.6	6.0	0.8	1.9	29.9	1.77	23.8	4.9	97.1	52.1	3.4
	3.0	0.1	0.2	27.4	20.7	1.53	32.6	17.8	91.7	3.0	3.0	0.1	0.2	30.5	1.78	24.4	5.0	97.6	53.7	3.4
	4.5	0.2	0.4	28.3	21.2	1.38	33.0	20.4	84.7	2.5	4.5	0.2	0.4	31.9	1.80	25.8	5.2	99.1	58.5	3.6
70	6.0	0.7	1.7	28.7	21.4	1.31	33.2	21.9	81.1	2.2	6.0	0.7	1.7	32.6	1.81	26.5	5.3	99.7	61.2	3.7
	3.0	0.1	0.2	26.0	20.0	1.77	32.0	14.7	101.4	3.9	3.0	0.1	0.2	32.9	1.81	26.7	5.3	100.0	62.2	3.7
	4.5	0.2	0.4	27.0	20.5	1.60	32.4	16.9	94.4	3.3	4.5	0.2	0.4	34.0	1.82	27.8	5.5	101.1	67.6	3.9
80	6.0	0.7	1.6	27.5	20.8	1.51	32.6	18.1	90.9	3.0	5.6	0.5	1.3	34.3	1.82	28.1	5.5	101.4	70.0	4.0
	3.0	0.1	0.2	24.5	19.2	2.03	31.4	12.1	110.9	5.0	2.8	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
	4.5	0.2	0.4	25.6	19.7	1.84	31.8	13.9	104.2	4.2	2.8	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
90	6.0	0.7	1.6	26.1	20.0	1.75	32.1	14.9	100.7	3.9	2.8	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
	3.0	0.1	0.2	22.7	18.5	2.32	30.6	9.8	120.4	6.2	1.9	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
	4.5	0.2	0.4	23.9	19.0	2.12	31.2	11.3	113.9	5.4	1.9	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
100	6.0	0.7	1.6	24.5	19.2	2.02	31.4	12.2	110.5	4.9	1.9	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
	3.0	0.1	0.2	20.7	17.7	2.64	29.7	7.8	129.8	7.5	1.4	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
	4.5	0.2	0.4	22.1	18.2	2.42	30.3	9.1	123.5	6.6	1.4	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
110	6.0	0.7	1.6	22.7	18.5	2.31	30.6	9.8	120.2	6.2	1.4	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
	3.0	0.1	0.2	18.4	16.9	2.99	28.6	6.1	139.1	9.0	1.1	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
	4.5	0.2	0.4	19.9	17.5	2.76	29.3	7.2	133.0	8.0	1.1	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0
120	6.0	0.6	1.5	20.7	17.7	2.65	29.7	7.8	129.9	7.6	1.1	0.1	0.2	34.3	1.82	28.1	5.5	101.4	70.0	4.0

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 AHRI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for AHRI/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.
 For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.
 Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 036 (Full Load) with Modulating Valve or Variable Speed Pump

1,150 CFM Nominal (Rated) Airflow Cooling, 1,150 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btuh

EWT °F	GPM	WPD		COOLING - EAT 80/67°F							GPM	WPD		HEATING - EAT 70°F						
		PSI	FT	TC	SC	kW	HR	EER	LWT	HWC Cap		PSI	FT	HC	kW	HE	COP	LAT	LWT	HWC Cap
20	2.3	0.2	0.4	40.8	27.6	1.69	46.6	24.1	60.0	1.8	9.0	4.9	11.4	25.1	2.31	17.3	3.2	88.2	16.2	3.3
	3.1	0.1	0.3	40.8	27.6	1.69	46.6	24.1	60.0	1.8	4.5	0.8	1.9	27.3	2.36	19.2	3.4	89.9	21.5	3.4
	3.1	0.1	0.3	40.8	27.6	1.69	46.6	24.1	60.0	1.8	6.8	2.3	5.4	28.4	2.38	20.3	3.5	90.8	24.0	3.5
30	3.1	0.1	0.3	40.8	27.6	1.69	46.6	24.1	60.0	1.8	9.0	4.0	9.3	29.0	2.40	20.9	3.6	91.3	25.4	3.5
	4.5	0.5	1.1	40.8	27.6	1.70	46.6	24.0	60.7	1.8	4.5	0.5	1.1	31.1	2.44	22.8	3.7	93.0	29.9	3.7
	4.7	0.6	1.3	40.8	27.6	1.69	46.6	24.1	60.0	1.8	6.8	1.8	4.2	32.6	2.47	24.2	3.9	94.2	32.8	3.8
40	4.7	0.6	1.3	40.8	27.6	1.69	46.6	24.1	60.0	1.8	9.0	3.4	7.8	33.4	2.49	24.9	3.9	94.8	34.5	3.9
	4.5	0.2	0.5	40.0	27.4	1.84	46.3	21.7	70.6	2.4	4.5	0.2	0.5	35.2	2.53	26.6	4.1	96.3	38.2	4.1
	6.8	1.5	3.4	40.6	27.5	1.74	46.5	23.3	63.8	2.0	6.8	1.5	3.4	37.0	2.56	28.2	4.2	97.7	41.6	4.2
50	9.0	2.9	6.7	40.8	27.6	1.70	46.6	24.1	60.4	1.8	9.0	2.9	6.7	37.9	2.59	29.1	4.3	98.4	43.5	4.3
	4.5	0.1	0.3	38.8	26.9	2.02	45.7	19.1	80.3	3.2	4.5	0.1	0.3	39.3	2.62	30.4	4.4	99.6	46.5	4.5
	6.8	1.2	2.9	39.6	27.2	1.90	46.1	20.9	73.7	2.6	6.8	1.2	2.9	41.2	2.68	32.1	4.5	101.1	50.5	4.8
60	9.0	2.6	5.9	40.0	27.4	1.84	46.3	21.7	70.3	2.4	9.0	2.6	5.9	42.2	2.71	33.0	4.6	101.9	52.7	4.9
	4.5	0.1	0.3	37.3	26.3	2.24	44.9	16.6	90.0	4.2	4.5	0.1	0.3	43.2	2.75	33.8	4.6	102.7	55.0	5.0
	6.8	1.1	2.6	38.3	26.7	2.09	45.4	18.3	83.5	3.5	6.8	1.1	2.6	45.1	2.83	35.4	4.7	104.2	59.5	5.4
70	9.0	2.4	5.5	38.8	26.9	2.02	45.7	19.2	80.2	3.1	9.0	2.4	5.5	46.0	2.87	36.2	4.7	105.0	62.0	5.5
	4.5	0.1	0.3	35.5	25.5	2.51	44.1	14.2	99.6	5.4	4.5	0.1	0.3	46.6	2.91	36.7	4.7	105.5	63.7	5.7
	6.8	1.1	2.5	36.7	26.0	2.33	44.6	15.8	93.2	4.6	6.8	1.1	2.5	48.2	3.02	37.9	4.7	106.7	68.8	6.1
80	9.0	2.3	5.3	37.3	26.3	2.24	44.9	16.6	90.0	4.2	7.6	1.5	3.5	48.5	3.05	38.1	4.7	107.0	70.0	6.2
	4.5	0.2	0.4	33.5	24.6	2.82	43.1	11.9	109.2	6.8	3.8	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
	6.8	1.1	2.5	34.8	25.2	2.61	43.7	13.3	103.0	5.9	3.8	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
90	9.0	2.3	5.2	35.5	25.5	2.51	44.0	14.1	99.8	5.4	3.8	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
	4.5	0.2	0.5	31.4	23.7	3.18	42.2	9.9	118.8	8.5	2.5	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
	6.8	1.1	2.5	32.8	24.3	2.94	42.8	11.1	112.7	7.4	2.5	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
100	9.0	2.3	5.2	33.4	24.6	2.83	43.1	11.8	109.6	6.9	2.5	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
	4.5	0.2	0.4	29.1	22.8	3.60	41.4	8.1	128.4	10.4	1.9	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
	6.8	1.1	2.5	30.5	23.4	3.33	41.9	9.2	122.4	9.2	1.9	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
110	9.0	2.3	5.2	31.2	23.7	3.21	42.2	9.7	119.4	8.6	1.9	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
	4.5	0.1	0.2	26.8	21.8	4.09	40.7	6.5	138.1	12.6	1.5	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
	6.8	1.0	2.3	28.2	22.4	3.79	41.1	7.5	132.2	11.2	1.5	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2
120	9.0	2.2	5.1	28.9	22.7	3.64	41.4	7.9	129.2	10.6	1.5	0.1	0.2	48.5	3.05	38.1	4.7	107.0	70.0	6.2

Interpolation is permissible; extrapolation is not.

All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.

AHRI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.

Table does not reflect fan or pump power corrections for AHRI/ISO conditions.

All performance is based upon the lower voltage of dual voltage rated units.

Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.

Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.

Operation below 60°F EWT requires optional insulated water/refrigerant circuit.

See performance correction tables for operating conditions other than those listed above.

See Performance Data Selection Notes for operation in the shaded areas.

For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.

Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 042 (Part Load) with Modulating Valve or Variable Speed Pump

1,100 CFM Nominal (Rated) Airflow Cooling, 1,100 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btuh

EWT °F	GPM	WPD			COOLING - EAT 80/67°F							GPM	WPD			HEATING - EAT 70°F						
		PSI	FT		TC	SC	kW	HR	EER	LWT	HWC Cap		PSI	FT		HC	kW	HE	COP	LAT	LWT	HWC Cap
20	2.1	1.1	2.6		37.6	28.3	1.26	41.9	29.8	60.0	1.2	7.5	5.0	11.7		19.8	2.09	12.7	2.8	16.6	16.6	2.5
	2.8	1.1	2.5		37.6	28.3	1.26	41.9	29.8	60.0	1.2	3.8	1.7	3.9		22.1	2.12	14.9	3.1	22.1	22.1	2.6
	2.8	1.1	2.5		37.6	28.3	1.26	41.9	29.8	60.0	1.2	5.6	2.9	6.7		23.1	2.13	15.8	3.2	24.4	24.4	2.7
30	2.8	1.1	2.5		37.6	28.3	1.26	41.9	29.8	60.0	1.2	7.5	4.5	10.3		23.7	2.14	16.4	3.2	25.6	25.6	2.7
	3.8	1.4	3.2		37.4	28.5	1.31	41.8	28.6	62.3	1.2	3.8	1.4	3.2		25.6	2.16	18.3	3.5	30.3	30.3	2.8
	4.2	1.6	3.7		37.6	28.3	1.26	41.9	29.8	60.0	1.2	5.6	2.4	5.6		26.8	2.17	19.4	3.6	33.1	33.1	2.9
40	4.2	1.6	3.7		37.6	28.3	1.26	41.9	29.8	60.0	1.2	7.5	3.8	8.8		27.5	2.18	20.1	3.7	34.6	34.6	2.9
	3.8	1.0	2.4		36.3	27.9	1.49	41.4	24.3	72.1	1.6	3.8	1.0	2.4		29.1	2.19	21.6	3.9	38.5	38.5	3.0
	5.6	2.0	4.5		37.1	28.4	1.35	41.7	27.5	64.8	1.3	5.6	2.0	4.5		30.5	2.20	23.0	4.1	41.8	41.8	3.1
50	7.5	3.1	7.2		37.5	28.6	1.29	41.9	29.2	61.2	1.2	7.5	3.1	7.2		31.3	2.21	23.8	4.2	43.7	43.7	3.1
	3.8	1.0	2.3		34.8	27.1	1.71	40.7	20.4	81.7	2.2	3.8	1.0	2.3		32.5	2.22	25.0	4.3	46.7	46.7	3.2
	5.6	1.8	4.2		35.9	27.7	1.55	41.2	23.2	74.6	1.8	5.6	1.8	4.2		34.1	2.23	26.5	4.5	50.6	50.6	3.4
60	7.5	3.0	6.9		36.4	28.0	1.47	41.4	24.7	71.0	1.6	7.5	3.0	6.9		35.0	2.24	27.3	4.6	52.7	52.7	3.4
	3.8	0.9	2.1		33.1	26.2	1.95	39.8	16.9	91.2	3.0	3.8	0.9	2.1		35.9	2.25	28.2	4.7	54.9	54.9	3.5
	5.6	1.7	4.0		34.4	26.8	1.78	40.4	19.3	84.4	2.4	5.6	1.7	4.0		37.6	2.26	29.9	4.9	59.4	59.4	3.6
70	7.5	2.8	6.5		35.0	27.2	1.69	40.7	20.7	80.9	2.2	7.5	2.8	6.5		38.6	2.27	30.8	5.0	61.8	61.8	3.7
	3.8	0.9	2.1		31.1	25.3	2.22	38.7	14.0	100.7	4.0	3.8	0.9	2.1		39.1	2.27	31.4	5.1	63.3	63.3	3.8
	5.6	1.7	3.9		32.5	25.9	2.03	39.5	16.0	94.0	3.3	5.6	1.7	3.9		41.0	2.28	33.2	5.3	68.2	68.2	4.0
80	7.5	2.7	6.3		33.2	26.2	1.94	39.8	17.1	90.6	3.0	6.8	2.2	5.2		41.6	2.29	33.8	5.3	102.9	70.0	4.1
	3.8	0.9	2.0		29.0	24.4	2.51	37.6	11.5	110.1	5.2	3.4	0.9	2.0		41.6	2.29	33.8	5.3	102.9	70.0	4.1
	5.6	1.6	3.8		30.5	25.0	2.31	38.4	13.2	103.6	4.4	3.4	0.9	2.0		41.6	2.29	33.8	5.3	102.9	70.0	4.1
90	7.5	2.6	6.1		31.2	25.3	2.21	38.8	14.1	100.3	4.0	3.4	0.9	2.0		41.6	2.29	33.8	5.3	102.9	70.0	4.1
	3.8	0.9	2.0		26.8	23.5	2.83	36.4	9.5	119.4	6.5	2.3	0.6	1.5		41.6	2.29	33.8	5.3	102.9	70.0	4.1
	5.6	1.6	3.6		28.3	24.1	2.62	37.2	10.8	113.2	5.6	2.3	0.6	1.5		41.6	2.29	33.8	5.3	102.9	70.0	4.1
100	7.5	2.6	5.9		29.0	24.4	2.51	37.6	11.5	110.0	5.2	2.3	0.6	1.5		41.6	2.29	33.8	5.3	102.9	70.0	4.1
	3.8	0.8	1.9		24.5	22.7	3.16	35.3	7.7	128.8	8.1	1.7	0.5	1.2		41.6	2.29	33.8	5.3	102.9	70.0	4.1
	5.6	1.5	3.5		26.0	23.2	2.94	36.0	8.8	122.8	7.1	1.7	0.5	1.2		41.6	2.29	33.8	5.3	102.9	70.0	4.1
110	7.5	2.5	5.7		26.7	23.5	2.84	36.4	9.4	119.7	6.6	1.7	0.5	1.2		41.6	2.29	33.8	5.3	102.9	70.0	4.1
	3.8	0.8	1.8		Operation Not Recommended							1.4	0.3	0.7		41.6	2.29	33.8	5.3	102.9	70.0	4.1
	5.6	1.5	3.4		23.6	22.4	3.29	34.8	7.2	132.4	8.7	1.4	0.3	0.7		41.6	2.29	33.8	5.3	102.9	70.0	4.1
120	7.5	2.4	5.5		24.3	22.7	3.18	35.2	7.6	129.4	8.2	1.4	0.3	0.7		41.6	2.29	33.8	5.3	102.9	70.0	4.1

Interpolation is permissible; extrapolation is not.

All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.

AHRI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.

Table does not reflect fan or pump power corrections for AHRI/ISO conditions.

All performance is based upon the lower voltage of dual voltage rated units.

Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.

Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.

Operation below 60°F EWT requires optional insulated water/refrigerant circuit.

See performance correction tables for operating conditions other than those listed above.

See Performance Data Selection Notes for operation in the shaded areas.

For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.

Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 042 (Full Load) with Modulating Valve or Variable Speed Pump

1,300 CFM Nominal (Rated) Airflow Cooling, 1,300 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btuh

EWT °F	GPM	WPD		COOLING - EAT 80/67°F							GPM	WPD		HEATING - EAT 70°F						
		PSI	FT	TC	SC	kW	HR	EER	LWT	HWC Cap		PSI	FT	HC	kW	HE	COP	LAT	LWT	HWC Cap
20	2.8	1.5	3.4	49.4	36.1	2.09	56.6	23.6	60.0	1.7	10.5	8.4	19.4	29.6	2.83	19.9	3.1	89.0	16.2	3.3
	3.8	1.6	3.6	49.4	36.1	2.09	56.6	23.6	60.0	1.7	5.3	2.7	6.2	32.4	2.89	22.5	3.3	91.0	21.4	3.4
	3.8	1.6	3.6	49.4	36.1	2.09	56.6	23.6	60.0	1.7	7.9	4.8	11.1	33.7	2.93	23.7	3.4	92.0	24.0	3.5
30	3.8	1.6	3.6	49.4	36.1	2.09	56.6	23.6	60.0	1.7	10.5	7.4	17.0	34.4	2.94	24.4	3.4	92.5	25.4	3.6
	5.3	1.8	4.1	49.2	35.9	2.12	56.4	23.2	61.5	1.8	5.3	1.8	4.1	36.9	3.00	26.6	3.6	94.2	29.9	3.7
	5.7	2.2	5.1	49.4	36.1	2.09	56.6	23.6	60.0	1.7	7.9	4.1	9.5	38.5	3.04	28.1	3.7	95.3	32.9	3.8
40	5.7	2.2	5.1	49.4	36.1	2.09	56.6	23.6	60.0	1.7	10.5	6.4	14.7	39.3	3.06	28.9	3.8	95.9	34.5	3.9
	5.3	1.8	4.1	47.8	35.0	2.32	55.7	20.6	71.2	2.3	5.3	1.8	4.1	41.3	3.11	30.7	3.9	97.4	38.3	4.1
	7.9	3.4	7.9	48.8	35.7	2.17	56.2	22.5	64.3	1.9	7.9	3.4	7.9	43.2	3.15	32.4	4.0	98.7	41.8	4.2
50	10.5	5.4	12.5	49.3	36.0	2.11	56.5	23.4	60.8	1.7	10.5	5.4	12.5	44.1	3.18	33.3	4.1	99.4	43.7	4.3
	5.3	1.7	3.9	46.1	34.1	2.55	54.7	18.1	80.9	3.0	5.3	1.7	3.9	45.8	3.22	34.8	4.2	100.5	46.7	4.5
	7.9	3.2	7.5	47.3	34.8	2.38	55.4	19.8	74.1	2.5	7.9	3.2	7.5	47.8	3.27	36.6	4.3	102.0	50.7	4.7
60	10.5	5.2	11.9	47.9	35.1	2.31	55.7	20.7	70.6	2.3	10.5	5.2	11.9	48.9	3.30	37.6	4.3	102.8	52.8	4.9
	5.3	1.6	3.6	44.1	33.1	2.81	53.7	15.7	90.5	3.8	5.3	1.6	3.6	50.1	3.33	38.8	4.4	103.6	55.2	5.0
	7.9	3.1	7.1	45.5	33.8	2.62	54.4	17.3	83.8	3.2	7.9	3.1	7.1	52.4	3.39	40.8	4.5	105.2	59.6	5.3
70	10.5	4.9	11.3	46.1	34.1	2.54	54.8	18.2	80.4	3.0	10.5	4.9	11.3	53.5	3.42	41.9	4.6	106.0	62.0	5.5
	5.3	1.5	3.5	42.0	32.2	3.10	52.6	13.5	100.0	4.7	5.3	1.5	3.5	54.4	3.45	42.6	4.6	106.7	63.8	5.6
	7.9	3.0	6.9	43.5	32.8	2.90	53.3	15.0	93.5	4.1	7.9	3.0	6.9	56.8	3.52	44.8	4.7	108.3	68.6	6.0
80	10.5	4.8	11.0	44.2	33.1	2.80	53.7	15.8	90.2	3.8	9.1	3.7	8.5	57.4	3.53	45.4	4.8	108.8	70.0	6.1
	5.3	1.5	3.4	39.6	31.3	3.44	51.4	11.5	109.6	5.8	4.5	1.2	2.8	57.4	3.53	45.4	4.8	108.8	70.0	6.1
	7.9	2.9	6.6	41.2	31.8	3.21	52.2	12.8	103.3	5.1	4.5	1.2	2.8	57.4	3.53	45.4	4.8	108.8	70.0	6.1
90	10.5	4.7	10.7	42.0	32.2	3.10	52.6	13.5	100.0	4.7	4.5	1.2	2.8	57.4	3.53	45.4	4.8	108.8	70.0	6.1
	5.3	1.4	3.3	37.1	30.4	3.82	50.2	9.7	119.1	6.9	3.0	0.8	1.8	57.4	3.53	45.4	4.8	108.8	70.0	6.1
	7.9	2.8	6.4	38.8	31.0	3.57	51.0	10.9	112.9	6.2	3.0	0.8	1.8	57.4	3.53	45.4	4.8	108.8	70.0	6.1
100	10.5	4.5	10.4	39.6	31.2	3.45	51.4	11.5	109.8	5.8	3.0	0.8	1.8	57.4	3.53	45.4	4.8	108.8	70.0	6.1
	5.3	1.4	3.2	34.5	29.6	4.26	49.0	8.1	128.7	8.2	2.3	0.6	1.3	57.4	3.53	45.4	4.8	108.8	70.0	6.1
	7.9	2.7	6.2	36.2	30.1	3.98	49.7	9.1	122.6	7.4	2.3	0.6	1.3	57.4	3.53	45.4	4.8	108.8	70.0	6.1
110	10.5	4.4	10.1	37.0	30.4	3.84	50.1	9.6	119.5	7.0	2.3	0.6	1.3	57.4	3.53	45.4	4.8	108.8	70.0	6.1
	5.3	1.3	3.1	Operation Not Recommended							1.8	0.3	0.8	57.4	3.53	45.4	4.8	108.8	70.0	6.1
	7.9	2.6	6.0	33.4	29.3	4.44	48.5	7.5	132.3	8.8	1.8	0.3	0.8	57.4	3.53	45.4	4.8	108.8	70.0	6.1
120	10.5	4.2	9.8	34.3	29.6	4.29	48.9	8.0	129.3	8.3	1.8	0.3	0.8	57.4	3.53	45.4	4.8	108.8	70.0	6.1

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 AHR/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for AHR/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.
 For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.
 Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 048 (Part Load) with Modulating Valve or Variable Speed Pump

1,250 CFM Nominal (Rated) Airflow Cooling, 1,250 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btuh

EWT °F	GPM	WPD		COOLING - EAT 80/67°F							GPM	WPD		HEATING - EAT 70°F						
		PSI	FT	TC	SC	kW	HR	EER	LWT	HWC Cap		PSI	FT	HC	kW	HE	COP	LAT	LWT	HWC Cap
20	2.3	0.7	1.6	41.2	28.3	1.50	46.3	27.5	60.0	1.5	9.0	5.2	12.1	23.0	2.18	15.6	3.1	85.0	16.5	3.0
	3.1	0.7	1.7	41.2	28.3	1.50	46.3	27.5	60.0	1.5	4.5	1.4	3.2	25.3	2.20	17.8	3.4	86.7	22.1	3.0
	3.1	0.7	1.7	41.2	28.3	1.50	46.3	27.5	60.0	1.5	6.8	2.5	5.7	26.3	2.20	18.8	3.5	87.4	24.4	3.1
30	3.1	0.7	1.7	41.2	28.3	1.50	46.3	27.5	60.0	1.5	9.0	4.0	9.2	26.8	2.21	19.3	3.6	87.8	25.7	3.1
	4.5	1.2	2.8	41.1	28.3	1.51	46.3	27.3	60.6	1.5	4.5	1.2	2.8	28.8	2.22	21.3	3.8	89.3	30.5	3.1
	4.6	1.3	2.9	41.2	28.3	1.50	46.3	27.5	60.0	1.5	6.8	2.4	5.5	30.0	2.22	22.4	4.0	90.2	33.4	3.2
40	4.6	1.3	2.9	41.2	28.3	1.50	46.3	27.5	60.0	1.5	9.0	3.8	8.7	30.7	2.23	23.1	4.0	90.7	34.9	3.2
	4.5	1.1	2.5	39.9	27.8	1.72	45.7	23.3	70.3	2.1	4.5	1.1	2.5	32.4	2.24	24.8	4.3	92.0	39.0	3.3
	6.8	2.1	4.9	40.8	28.2	1.57	46.1	26.0	63.7	1.7	6.8	2.1	4.9	33.8	2.24	26.2	4.4	93.0	42.2	3.4
50	9.0	3.4	7.9	41.2	28.3	1.50	46.3	27.4	60.3	1.5	9.0	3.4	7.9	34.6	2.25	26.9	4.5	93.6	44.0	3.4
	4.5	1.0	2.3	38.3	27.2	1.98	45.1	19.4	80.0	2.9	4.5	1.0	2.3	36.1	2.25	28.4	4.7	94.6	47.4	3.5
	6.8	2.0	4.6	39.4	27.6	1.79	45.5	22.0	73.5	2.4	6.8	2.0	4.6	37.7	2.26	29.9	4.9	95.8	51.1	3.6
60	9.0	3.2	7.5	39.9	27.9	1.71	45.8	23.3	70.2	2.1	9.0	3.2	7.5	38.5	2.26	30.8	5.0	96.5	53.2	3.7
	4.5	0.9	2.0	36.5	26.3	2.28	44.2	16.0	89.7	3.9	4.5	0.9	2.0	39.7	2.27	31.9	5.1	97.3	55.8	3.7
	6.8	1.8	4.2	37.7	26.9	2.07	44.8	18.2	83.3	3.2	6.8	1.8	4.2	41.4	2.28	33.7	5.3	98.6	60.0	3.9
70	9.0	3.0	6.9	38.3	27.2	1.97	45.1	19.4	80.0	2.9	9.0	3.0	6.9	42.4	2.28	34.6	5.4	99.3	62.3	4.0
	4.5	0.9	2.0	34.4	25.4	2.63	43.3	13.1	99.3	5.1	4.5	0.9	2.0	43.2	2.28	35.4	5.5	99.9	64.3	4.0
	6.8	1.8	4.0	35.8	26.0	2.40	43.9	14.9	93.0	4.3	6.8	1.8	4.0	45.1	2.29	37.3	5.8	101.3	68.9	4.2
80	9.0	2.9	6.7	36.4	26.3	2.29	44.2	15.9	89.8	3.9	7.5	2.1	4.8	45.5	2.29	37.7	5.8	101.7	70.0	4.3
	4.5	0.8	1.8	32.1	24.5	3.01	42.4	10.7	108.8	6.4	3.8	0.7	1.6	45.5	2.29	37.7	5.8	101.7	70.0	4.3
	6.8	1.7	3.9	33.6	25.1	2.76	43.0	12.2	102.7	5.5	3.8	0.7	1.6	45.5	2.29	37.7	5.8	101.7	70.0	4.3
90	9.0	2.8	6.5	34.3	25.4	2.64	43.3	13.0	99.6	5.1	3.8	0.7	1.6	45.5	2.29	37.7	5.8	101.7	70.0	4.3
	4.5	0.8	1.8	29.7	23.5	3.42	41.4	8.7	118.4	8.0	2.5	0.4	1.0	45.5	2.29	37.7	5.8	101.7	70.0	4.3
	6.8	1.6	3.7	31.2	24.1	3.16	42.0	9.9	112.4	7.0	2.5	0.4	1.0	45.5	2.29	37.7	5.8	101.7	70.0	4.3
100	9.0	2.7	6.1	32.0	24.4	3.03	42.3	10.5	109.4	6.5	2.5	0.4	1.0	45.5	2.29	37.7	5.8	101.7	70.0	4.3
	4.5	0.7	1.7	27.3	22.6	3.86	40.4	7.1	128.0	9.8	1.9	0.3	0.7	45.5	2.29	37.7	5.8	101.7	70.0	4.3
	6.8	1.5	3.5	28.8	23.2	3.59	41.0	8.0	122.2	8.7	1.9	0.3	0.7	45.5	2.29	37.7	5.8	101.7	70.0	4.3
110	9.0	2.6	5.9	29.5	23.4	3.46	41.3	8.5	119.2	8.2	1.9	0.3	0.7	45.5	2.29	37.7	5.8	101.7	70.0	4.3
	4.5	0.7	1.7	24.8	21.8	4.32	39.5	5.8	137.6	11.8	1.5	0.1	0.3	45.5	2.29	37.7	5.8	101.7	70.0	4.3
	6.8	1.5	3.5	26.3	22.3	4.04	40.1	6.5	131.9	10.6	1.5	0.1	0.3	45.5	2.29	37.7	5.8	101.7	70.0	4.3
120	9.0	2.5	5.9	27.0	22.5	3.90	40.4	6.9	129.0	10.0	1.5	0.1	0.3	45.5	2.29	37.7	5.8	101.7	70.0	4.3

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 AHR/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for AHR/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.
 For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.
 Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 048 (Full Load) with Modulating Valve or Variable Speed Pump

1,500 CFM Nominal (Rated) Airflow Cooling, 1,500 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btuh

EWT °F	WPD			COOLING - EAT 80/67°F							WPD			HEATING - EAT 70°F							
	GPM	PSI	FT	TC	SC	kW	HR	EER	LWT	HWC Cap	GPM	PSI	FT	HC	kW	HE	COP	LAT	LWT	HWC Cap	
20	3.1	1.1	2.5	54.1	36.1	2.36	62.2	23.0	60.0	2.5	12.0	7.7	17.8	32.4	2.88	22.6	3.3	88.0	16.2	3.5	
	30	4.1	1.2	2.8	54.1	36.1	2.36	62.2	23.0	60.0	2.5	6.0	2.0	4.6	35.2	2.93	25.1	3.5	89.6	21.6	3.6
		4.1	1.2	2.8	54.1	36.1	2.36	62.2	23.0	60.0	2.5	9.0	4.0	9.2	36.5	2.96	26.4	3.6	90.5	24.1	3.7
40	6.0	1.9	4.4	54.1	36.1	2.37	62.2	22.8	60.7	2.5	6.0	1.9	4.4	39.7	3.02	29.4	3.9	92.5	30.2	3.9	
	6.2	2.0	4.7	54.1	36.1	2.36	62.2	23.0	60.0	2.5	9.0	3.8	8.7	41.4	3.05	30.9	4.0	93.5	33.1	4.0	
	6.2	2.0	4.7	54.1	36.1	2.36	62.2	23.0	60.0	2.5	12.0	6.0	13.9	42.3	3.07	31.8	4.0	94.0	34.7	4.1	
50	6.0	1.7	4.0	53.0	35.6	2.58	61.8	20.5	70.6	3.2	6.0	1.7	4.0	44.6	3.12	33.9	4.2	95.4	38.7	4.2	
	9.0	3.4	7.9	53.8	36.0	2.43	62.1	22.2	63.8	2.7	9.0	3.4	7.9	46.5	3.16	35.7	4.3	96.6	42.1	4.4	
	12.0	5.5	12.7	54.1	36.1	2.36	62.2	22.9	60.4	2.5	12.0	5.5	12.7	47.6	3.18	36.7	4.4	97.3	43.9	4.5	
60	6.0	1.6	3.7	51.3	34.9	2.86	61.0	17.9	80.3	4.0	6.0	1.6	3.7	49.5	3.22	38.5	4.5	98.5	47.2	4.6	
	9.0	3.2	7.5	52.5	35.4	2.66	61.6	19.7	73.7	3.4	9.0	3.2	7.5	51.8	3.26	40.7	4.7	99.9	51.0	4.8	
	12.0	5.3	12.2	53.0	35.6	2.57	61.8	20.6	70.3	3.1	12.0	5.3	12.2	53.0	3.29	41.8	4.7	100.7	53.0	4.9	
70	6.0	1.4	3.3	49.1	34.0	3.21	60.0	15.3	90.0	5.0	6.0	1.4	3.3	54.6	3.32	43.2	4.8	101.6	55.6	5.0	
	9.0	3.0	6.9	50.6	34.7	2.96	60.7	17.1	83.5	4.3	9.0	3.0	6.9	57.2	3.38	45.6	5.0	103.2	59.9	5.3	
	12.0	4.9	11.3	51.3	34.9	2.85	61.0	18.0	80.2	4.0	12.0	4.9	11.3	58.6	3.41	46.9	5.0	104.1	62.2	5.4	
80	6.0	1.4	3.3	46.5	33.0	3.62	58.9	12.8	99.6	6.2	6.0	1.4	3.3	59.7	3.44	47.9	5.1	104.7	64.0	5.5	
	9.0	2.9	6.7	48.2	33.7	3.34	59.6	14.4	93.2	5.4	9.0	2.9	6.7	62.5	3.50	50.5	5.2	106.5	68.8	5.8	
	12.0	4.8	11.1	49.1	34.0	3.21	60.0	15.3	90.0	5.0	10.2	3.6	8.3	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
90	6.0	1.3	3.1	43.8	31.9	4.11	57.8	10.7	109.3	7.6	5.1	1.1	2.5	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
	9.0	2.8	6.5	45.6	32.6	3.79	58.5	12.0	103.0	6.6	5.1	1.1	2.5	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
	12.0	4.7	10.9	46.5	33.0	3.63	58.9	12.8	99.8	6.2	5.1	1.1	2.5	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
100	6.0	1.3	3.0	41.0	30.7	4.67	57.0	8.8	119.0	9.2	3.4	0.6	1.4	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
	9.0	2.7	6.1	42.8	31.5	4.31	57.5	9.9	112.8	8.1	3.4	0.6	1.4	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
	12.0	4.5	10.4	43.7	31.8	4.13	57.8	10.6	109.6	7.6	3.4	0.6	1.4	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
110	6.0	1.2	2.8	38.3	29.5	5.32	56.5	7.2	128.8	11.0	2.6	0.4	0.9	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
	9.0	2.6	5.9	40.0	30.3	4.90	56.7	8.2	122.6	9.8	2.6	0.4	0.9	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
	12.0	4.4	10.1	40.9	30.6	4.70	56.9	8.7	119.5	9.2	2.6	0.4	0.9	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
120	6.0	1.2	2.8	Operation Not Recommended							2.0	0.2	0.4	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
	9.0	2.6	5.9	Operation Not Recommended							2.0	0.2	0.4	63.2	3.52	51.2	5.3	106.9	70.0	5.9	
	12.0	4.3	10.0	38.2	29.5	5.36	56.4	7.1	129.4	11.1	2.0	0.2	0.4	63.2	3.52	51.2	5.3	106.9	70.0	5.9	

Interpolation is permissible; extrapolation is not.

All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.

AHR/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.

Table does not reflect fan or pump power corrections for AHR/ISO conditions.

All performance is based upon the lower voltage of dual voltage rated units.

Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.

Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.

Operation below 60°F EWT requires optional insulated water/refrigerant circuit.

See performance correction tables for operating conditions other than those listed above.

See Performance Data Selection Notes for operation in the shaded areas.

For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.

Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 060 (Part Load) with Modulating Valve or Variable Speed Pump

1,600 CFM Nominal (Rated) Airflow Cooling, 1,600 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btuh

EWT °F	GPM	WPD		COOLING - EAT 80/67°F							GPM	WPD		HEATING - EAT 70°F						
		PSI	FT	TC	SC	kW	HR	EER	LWT	HWC Cap		PSI	FT	HC	kW	HE	COP	LAT	LWT	HWC Cap
20	3.0	0.1	0.1	53.7	36.4	1.66	59.3	32.3	60.0	1.5	12.0	6.0	13.8	27.4	2.69	18.2	3.0	86.1	17.0	3.7
	4.0	0.2	0.5	53.7	36.4	1.66	59.3	32.3	60.0	1.5	6.0	1.2	2.8	30.4	2.72	21.1	3.3	88.1	23.0	3.8
	4.0	0.2	0.5	53.7	36.4	1.66	59.3	32.3	60.0	1.5	9.0	3.1	7.1	31.5	2.74	22.2	3.4	88.8	25.1	3.8
30	4.0	0.2	0.5	53.7	36.4	1.66	59.3	32.3	60.0	1.5	12.0	5.4	12.5	32.1	2.74	22.8	3.4	89.2	26.2	3.8
	5.9	1.0	2.2	53.7	36.4	1.66	59.3	32.3	60.0	1.5	6.0	1.0	2.3	35.0	2.78	25.5	3.7	91.1	31.5	3.9
	5.9	1.0	2.2	53.7	36.4	1.66	59.3	32.3	60.0	1.5	9.0	2.8	6.4	36.4	2.79	26.8	3.8	92.0	34.0	4.0
40	5.9	1.0	2.2	53.7	36.4	1.66	59.3	32.3	60.0	1.5	12.0	4.9	11.4	37.1	2.80	27.6	3.9	92.5	35.4	4.0
	6.0	0.9	2.1	52.1	35.7	1.91	58.6	27.2	69.5	2.0	6.0	0.9	2.1	39.6	2.82	30.0	4.1	94.1	39.9	4.1
	9.0	2.5	5.9	53.2	36.2	1.74	59.1	30.5	63.1	1.6	9.0	2.5	5.9	41.3	2.84	31.6	4.3	95.3	42.9	4.2
50	12.0	4.6	10.6	53.7	36.4	1.66	59.3	32.3	60.0	1.5	12.0	4.6	10.6	42.2	2.85	32.5	4.3	95.9	44.5	4.2
	6.0	0.8	1.9	50.3	35.0	2.18	57.8	23.0	79.3	2.7	6.0	0.8	1.9	44.5	2.88	34.7	4.5	97.4	48.4	4.4
	9.0	2.4	5.5	51.5	35.5	2.00	58.3	25.7	73.0	2.2	9.0	2.4	5.5	46.5	2.90	36.6	4.7	98.7	51.9	4.5
60	12.0	4.3	10.0	52.0	35.7	1.92	58.6	27.1	69.8	2.0	12.0	4.3	10.0	47.5	2.91	37.6	4.8	99.4	53.7	4.5
	6.0	0.8	1.9	48.3	34.3	2.49	56.8	19.4	88.9	3.6	6.0	0.8	1.9	49.4	2.93	39.4	4.9	100.6	56.9	4.7
	9.0	2.3	5.3	49.6	34.8	2.29	57.4	21.7	82.8	3.0	9.0	2.3	5.3	51.7	2.95	41.6	5.1	102.1	60.8	4.8
70	12.0	4.2	9.6	50.2	35.0	2.19	57.7	22.9	79.6	2.8	12.0	4.2	9.6	52.9	2.97	42.8	5.2	102.9	62.9	4.9
	6.0	0.8	1.8	45.9	33.4	2.83	55.6	16.2	98.5	4.8	6.0	0.8	1.8	54.3	2.98	44.1	5.3	103.8	65.3	5.0
	9.0	2.2	5.1	47.5	34.0	2.61	56.4	18.2	92.5	4.1	9.0	2.2	5.1	56.9	3.01	46.6	5.5	105.5	69.6	5.3
80	12.0	4.0	9.3	48.2	34.2	2.50	56.7	19.3	89.5	3.7	9.4	2.4	5.6	57.1	3.01	46.8	5.6	105.7	70.0	5.3
	6.0	0.8	1.7	43.1	32.4	3.23	54.1	13.4	108.0	6.1	4.7	0.3	0.7	57.1	3.01	46.8	5.6	105.7	70.0	5.3
	9.0	2.2	5.0	44.9	33.1	2.98	55.0	15.1	102.2	5.3	4.7	0.3	0.7	57.1	3.01	46.8	5.6	105.7	70.0	5.3
90	12.0	3.9	9.1	45.7	33.4	2.86	55.5	16.0	99.2	4.9	4.7	0.3	0.7	57.1	3.01	46.8	5.6	105.7	70.0	5.3
	6.0	0.7	1.6	39.7	31.1	3.68	52.3	10.8	117.4	7.6	3.1	0.1	0.2	57.1	3.01	46.8	5.6	105.7	70.0	5.3
	9.0	2.1	4.8	41.8	31.9	3.40	53.4	12.3	111.9	6.7	3.1	0.1	0.2	57.1	3.01	46.8	5.6	105.7	70.0	5.3
100	12.0	3.9	8.9	42.8	32.3	3.27	53.9	13.1	109.0	6.3	3.1	0.1	0.2	57.1	3.01	46.8	5.6	105.7	70.0	5.3
	6.0	0.6	1.4	35.7	29.4	4.22	50.1	8.5	126.7	9.3	2.3	0.1	0.2	57.1	3.01	46.8	5.6	105.7	70.0	5.3
	9.0	2.0	4.6	38.1	30.5	3.90	51.4	9.8	121.4	8.3	2.3	0.1	0.2	57.1	3.01	46.8	5.6	105.7	70.0	5.3
110	12.0	3.8	8.7	39.2	30.9	3.75	52.0	10.5	118.7	7.8	2.3	0.1	0.2	57.1	3.01	46.8	5.6	105.7	70.0	5.3
	6.0	0.4	1.0	31.0	27.1	4.83	47.5	6.4	135.8	11.3	1.9	0.1	0.2	57.1	3.01	46.8	5.6	105.7	70.0	5.3
	9.0	1.9	4.3	33.7	28.5	4.48	49.0	7.5	130.9	10.2	1.9	0.1	0.2	57.1	3.01	46.8	5.6	105.7	70.0	5.3
120	12.0	3.7	8.4	35.0	29.1	4.31	49.7	8.1	128.3	9.6	1.9	0.1	0.2	57.1	3.01	46.8	5.6	105.7	70.0	5.3

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 AHR/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for AHR/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.
 For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.
 Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Performance Data – TZ H/V 060 (Full Load) with Modulating Valve or Variable Speed Pump

1,900 CFM Nominal (Rated) Airflow Cooling, 1,900 CFM Nominal (Rated) Airflow Heating

Performance capacities shown in thousands of Btuh

EWT °F	GPM	WPD		COOLING - EAT 80/67°F							WPD			HEATING - EAT 70°F						
		PSI	FT	TC	SC	kW	HR	EER	LWT	HWC Cap	GPM	PSI	FT	HC	kW	HE	COP	LAT	LWT	HWC Cap
20	4.1	0.5	1.1	72.0	47.3	2.89	81.9	24.9	60.0	2.5	14.0	7.9	18.2	39.9	3.66	27.5	3.2	87.4	16.1	4.5
	5.5	0.9	2.2	72.0	47.3	2.89	81.9	24.9	60.0	2.5	7.0	1.8	4.1	43.0	3.72	30.4	3.4	88.9	21.3	4.7
		0.9	2.2	72.0	47.3	2.89	81.9	24.9	60.0	2.5	10.5	4.2	9.7	44.7	3.75	31.9	3.5	89.7	23.9	4.8
30	5.5	0.9	2.2	72.0	47.3	2.89	81.9	24.9	60.0	2.5	14.0	7.2	16.5	45.6	3.77	32.7	3.5	90.2	25.3	4.8
	7.0	1.6	3.6	71.4	47.0	2.98	81.5	23.9	63.3	2.6	7.0	1.5	3.6	48.6	3.84	35.5	3.7	91.6	29.8	5.0
		2.3	5.2	72.0	47.3	2.89	81.9	24.9	60.0	2.5	10.5	3.8	8.8	50.7	3.88	37.5	3.8	92.7	32.9	5.2
40	8.2	2.3	5.2	72.0	47.3	2.89	81.9	24.9	60.0	2.5	14.0	6.6	15.2	51.9	3.91	38.6	3.9	93.2	34.5	5.2
	7.0	1.4	3.2	69.5	46.3	3.26	80.6	21.3	73.0	3.3	7.0	1.4	3.2	54.7	3.97	41.1	4.0	94.6	38.3	5.4
		3.5	8.1	70.9	46.8	3.05	81.3	23.3	65.5	2.8	10.5	3.5	8.1	57.3	4.04	43.5	4.2	95.8	41.7	5.6
50	14.0	6.2	14.2	71.7	47.1	2.94	81.7	24.4	61.7	2.6	14.0	6.2	14.3	58.7	4.07	44.8	4.2	96.5	43.6	5.7
	7.0	1.3	3.0	67.5	45.5	3.56	79.6	19.0	82.7	4.1	7.0	1.3	3.0	61.0	4.13	46.9	4.3	97.7	46.6	5.9
		3.3	7.6	69.0	46.1	3.33	80.4	20.7	75.3	3.5	10.5	3.3	7.6	64.0	4.20	49.7	4.5	99.1	50.5	6.1
60	14.0	5.9	13.5	69.8	46.4	3.22	80.7	21.7	71.5	3.2	14.0	5.8	13.5	65.7	4.25	51.2	4.5	99.9	52.7	6.3
	7.0	1.2	2.9	65.2	44.6	3.89	78.5	16.7	92.4	5.2	7.0	1.2	2.9	67.4	4.29	52.8	4.6	100.8	54.9	6.4
		3.2	7.3	67.0	45.3	3.63	79.4	18.4	85.1	4.4	10.5	3.2	7.3	70.8	4.38	55.9	4.7	102.4	59.4	6.7
70	14.0	5.6	13.0	67.8	45.6	3.51	79.8	19.3	81.4	4.1	14.0	5.6	13.0	72.7	4.43	57.6	4.8	103.3	61.8	6.9
	7.0	1.2	2.8	62.6	43.6	4.29	77.2	14.6	102.1	6.4	7.0	1.2	2.8	73.8	4.46	58.6	4.8	103.9	63.3	7.0
		3.1	7.1	64.6	44.4	3.99	78.2	16.2	94.9	5.5	10.5	3.1	7.1	77.5	4.57	61.9	5.0	105.7	68.2	7.4
80	14.0	5.4	12.6	65.5	44.7	3.85	78.6	17.0	91.2	5.1	14.0	5.4	12.6	78.8	4.60	63.1	5.0	106.3	70.0	7.5
	7.0	1.2	2.7	59.4	42.4	4.77	75.6	12.4	111.6	7.8	6.3	0.9	2.0	78.8	4.60	63.1	5.0	106.3	70.0	7.5
		3.0	6.9	61.8	43.3	4.41	76.8	14.0	104.6	6.8	6.3	0.9	2.0	78.8	4.60	63.1	5.0	106.3	70.0	7.5
90	14.0	5.3	12.3	62.9	43.7	4.25	77.4	14.8	101.0	6.3	6.3	0.9	2.0	78.8	4.60	63.1	5.0	106.3	70.0	7.5
	7.0	1.1	2.6	55.5	40.9	5.35	73.8	10.4	121.1	9.4	4.2	0.1	0.1	78.8	4.60	63.1	5.0	106.3	70.0	7.5
		2.9	6.8	58.3	42.0	4.92	75.1	11.8	114.3	8.3	4.2	0.1	0.1	78.8	4.60	63.1	5.0	106.3	70.0	7.5
100	14.0	5.2	12.1	59.7	42.5	4.73	75.8	12.6	110.8	7.7	4.2	0.1	0.1	78.8	4.60	63.1	5.0	106.3	70.0	7.5
	7.0	1.0	2.4	50.9	39.0	6.04	71.5	8.4	130.4	11.2	3.2	0.1	0.1	78.8	4.60	63.1	5.0	106.3	70.0	7.5
		2.8	6.6	54.2	40.4	5.55	73.1	9.8	123.9	10.0	3.2	0.1	0.1	78.8	4.60	63.1	5.0	106.3	70.0	7.5
110	14.0	5.1	11.9	55.8	41.0	5.31	73.9	10.5	120.6	9.4	3.2	0.1	0.1	78.8	4.60	63.1	5.0	106.3	70.0	7.5
	7.0	0.9	2.0	45.4	36.5	6.86	68.8	6.6	139.7	13.2	2.5	0.1	0.1	78.8	4.60	63.1	5.0	106.3	70.0	7.5
		2.7	6.3	49.2	38.3	6.29	70.7	7.8	133.5	11.9	2.5	0.1	0.1	78.8	4.60	63.1	5.0	106.3	70.0	7.5
120	14.0	5.0	11.6	51.0	39.1	6.02	71.6	8.5	130.2	11.2	2.5	0.1	0.1	78.8	4.60	63.1	5.0	106.3	70.0	7.5

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 AHR/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for AHR/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% methanol antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.
 For unit operation in the shaded area when LWT is below 40°F (4.4°C) antifreeze must be used and the JW3 jumper on the DXM2.5 should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F (0°C) with 40°F (4.4°C) LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.
 Flow is controlled to maintain minimum LWT 60°F in cooling and maximum LWT 70°F in heating.

Part Load Performance Data – Correction Tables

Airflow Correction Table

Airflow	Heating			Cooling				
	% of Rated	Heating Capacity	Power	Heat of Extraction	Total Capacity	Sensible Capacity	S/T	Power
80	0.979	1.035	0.965	0.980	0.917	0.936	0.955	0.975
85	0.984	1.021	0.975	0.986	0.939	0.953	0.964	0.982
90	0.990	1.011	0.984	0.992	0.961	0.969	0.975	0.988
95	0.995	1.004	0.993	0.996	0.981	0.985	0.986	0.994
100	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000
105	1.006	1.002	1.007	1.003	1.017	1.014	1.016	1.005
110	1.011	1.006	1.012	1.004	1.031	1.027	1.033	1.010

Entering Air Correction Table

EAT Heating Corrections			
Ent Air DB °F	Heating Capacity	Power	Heat of Extraction
50	1.023	0.773	1.084
55	1.021	0.827	1.068
60	1.016	0.882	1.049
65	1.009	0.940	1.026
70	1.000	1.000	1.000
75	0.989	1.063	0.971
80	0.978	1.128	0.941

* = Sensible capacity equals total capacity
 AHR/ISO/ASHRAE 13256-1 uses entering air conditions of Cooling - 80.6°F DB/66.2°F WB, 1 and Heating - 68°F DB/59°F WB entering air temperature

Ent Air WB °F	Total Capacity	Cooling								Power	Heat of Rejection
		Sensible Cooling Capacity Multipliers - Entering DB °F									
		65	70	75	80	85	90	95	100		
45	0.628	*	*	*	*	*	*	*	*	1.010	0.698
50	0.712	*	*	*	*	*	*	*	*	1.008	0.767
55	0.797	1.026	*	*	*	*	*	*	*	1.006	0.835
60	0.882	0.669	0.894	1.111	*	*	*	*	*	1.003	0.904
65	0.966		0.693	0.890	1.092	1.298	*	*	*	1.001	0.973
67	1.000		0.640	0.810	1.000	1.202	*	*	*	1.000	1.000
70	1.051			0.706	0.862	1.060	1.298	*	*	0.999	1.041
75	1.135				0.633	0.860	1.087	1.314	1.541	0.996	1.110

Full Load Performance Data – Correction Tables

Airflow Correction Table

Airflow	Heating			Cooling				
	Heating Capacity	Power	Heat of Extraction	Total Capacity	Sensible Capacity	S/T	Power	Heat of Rejection
80	0.983	1.040	0.967	0.976	0.919	0.941	0.939	0.969
85	0.987	1.018	0.978	0.984	0.941	0.957	0.953	0.977
90	0.991	1.004	0.988	0.990	0.962	0.972	0.968	0.986
95	0.996	0.998	0.995	0.996	0.982	0.986	0.983	0.993
100	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000
105	1.005	1.010	1.003	1.003	1.017	1.014	1.018	1.006
110	1.009	1.028	1.004	1.005	1.032	1.027	1.036	1.012

Entering Air Correction Table


EAT Heating Corrections			
Ent Air DB °F	Heating Capacity	Power	Heat of Extraction
50	1.030	0.808	1.092
55	1.026	0.858	1.073
60	1.020	0.905	1.052
65	1.011	0.951	1.027
70	1.000	1.000	1.000
75	0.989	1.054	0.971
80	0.978	1.114	0.940

* = Sensible capacity equals total capacity
 AHR/ISO/ASHRAE 13256-1 uses entering air conditions of Cooling - 80.6°F DB/66.2°F WB, 1 and Heating - 68°F DB/59°F WB entering air temperature


Cooling											
Ent Air WB °F	Total Capacity	Sensible Cooling Capacity Multipliers - Entering DB °F								Power	Heat of Rejection
		65	70	75	80	85	90	95	100		
45	0.638	*	*	*	*	*	*	*	*	0.914	0.694
50	0.720	*	*	*	*	*	*	*	*	0.934	0.763
55	0.803	1.044	*	*	*	*	*	*	*	0.953	0.833
60	0.885	0.751	0.927	1.114	*	*	*	*	*	0.973	0.903
65	0.967		0.693	0.886	1.089	1.300	*	*	*	0.992	0.972
67	1.000		0.607	0.798	1.000	1.211	1.432	*	*	1.000	1.000
70	1.049			0.669	0.866	1.076	1.299	*	*	1.012	1.042
75	1.132				0.644	0.848	1.077	1.329	1.605	1.031	1.111

High Head and Standard Variable Pump Performance

Standard Head Variable Pump Performance

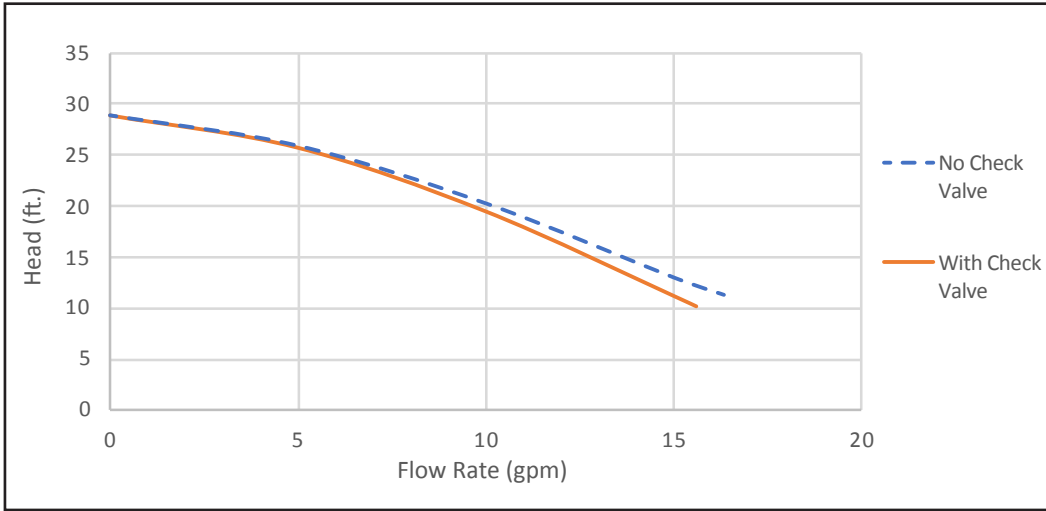

High Head Variable Pump Performance

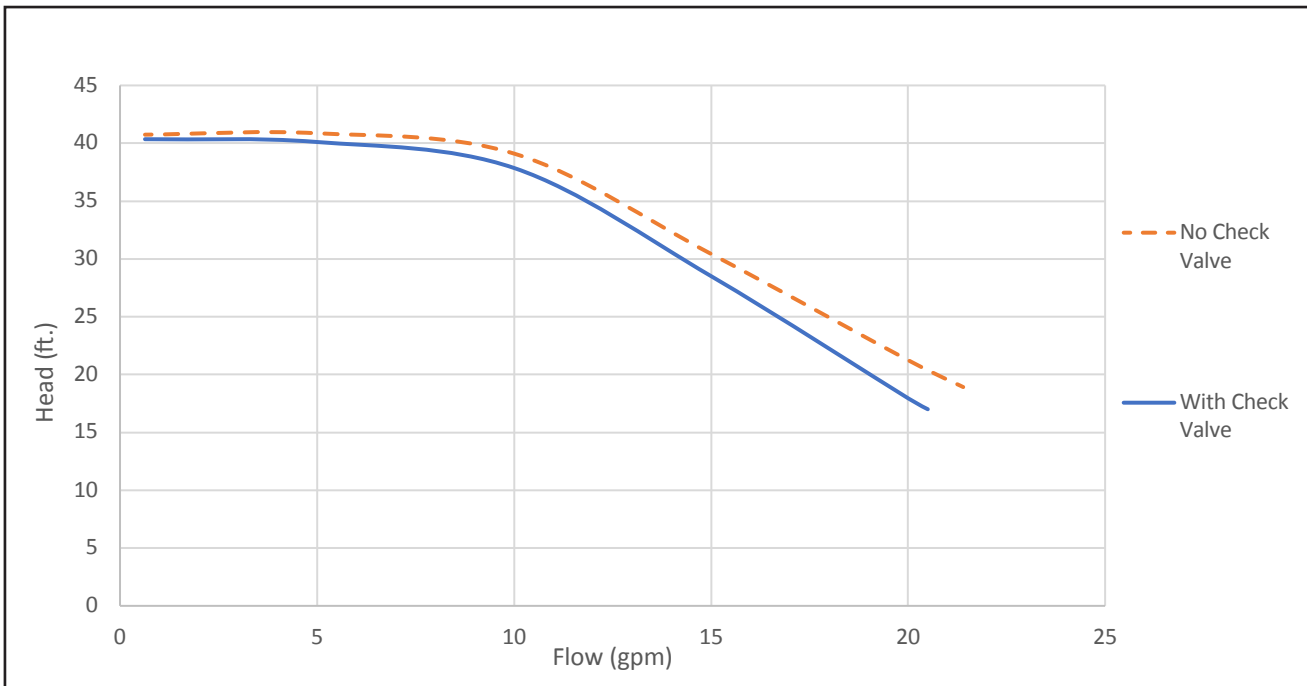

Antifreeze Correction Table

EWT	Antifreeze Type	Antifreeze %	Cooling			Heating		WPD
			Total Cap	Sensible Cap	Watts	Total Cap	Watts	
90	Water	0%	1.000	1.000	1.000	1.000	1.000	1.000
	Ethanol	5%	0.998	0.998	1.002	0.996	0.999	1.025
		10%	0.996	0.996	1.003	0.991	0.997	1.048
		15%	0.994	0.994	1.005	0.987	0.996	1.098
		20%	0.991	0.991	1.006	0.982	0.994	1.142
		25%	0.986	0.986	1.009	0.972	0.991	1.207
		30%	0.981	0.981	1.012	0.962	0.988	1.265
		35%	0.977	0.977	1.015	0.953	0.985	1.312
		40%	0.972	0.972	1.018	0.943	0.982	1.370
		45%	0.966	0.966	1.023	0.931	0.978	1.431
		50%	0.959	0.959	1.027	0.918	0.974	1.494
	Ethylene Glycol	5%	0.998	0.998	1.002	0.996	0.999	1.021
		10%	0.996	0.996	1.003	0.991	0.997	1.040
		15%	0.994	0.994	1.004	0.987	0.996	1.079
		20%	0.991	0.991	1.005	0.982	0.995	1.114
		25%	0.988	0.988	1.008	0.976	0.993	1.146
		30%	0.985	0.985	1.010	0.969	0.990	1.175
		35%	0.982	0.982	1.012	0.963	0.988	1.208
		40%	0.979	0.979	1.014	0.956	0.986	1.243
		45%	0.976	0.976	1.016	0.950	0.984	1.278
		50%	0.972	0.972	1.018	0.943	0.982	1.314
	Methanol	5%	0.997	0.997	1.002	0.993	0.998	1.039
		10%	0.993	0.993	1.004	0.986	0.996	1.075
		15%	0.990	0.990	1.007	0.979	0.994	1.116
		20%	0.986	0.986	1.009	0.972	0.991	1.154
		25%	0.982	0.982	1.012	0.964	0.989	1.189
		30%	0.978	0.978	1.014	0.955	0.986	1.221
		35%	0.974	0.974	1.017	0.947	0.984	1.267
		40%	0.970	0.970	1.020	0.939	0.981	1.310
		45%	0.966	0.966	1.023	0.930	0.978	1.353
		50%	0.961	0.961	1.026	0.920	0.975	1.398
	Propylene Glycol	5%	0.995	0.995	1.003	0.990	0.997	1.065
		10%	0.990	0.990	1.006	0.980	0.994	1.119
		15%	0.986	0.986	1.009	0.971	0.991	1.152
		20%	0.981	0.981	1.012	0.962	0.988	1.182
		25%	0.978	0.978	1.014	0.956	0.986	1.227
		30%	0.975	0.975	1.016	0.950	0.984	1.267
		35%	0.972	0.972	1.018	0.944	0.982	1.312
		40%	0.969	0.969	1.020	0.938	0.980	1.356
		45%	0.965	0.965	1.023	0.929	0.977	1.402
		50%	0.960	0.960	1.026	0.919	0.974	1.450

Table Continued on Next Page

Antifreeze Correction Table, Cont'd.

Table Continued from Previous Page

EWT	Antifreeze Type	Antifreeze %	Cooling			Heating		WPD
			Total Cap	Sensible Cap	Watts	Total Cap	Watts	
30	Water	0%	1.000	1.000	1.000	1.000	1.000	1.000
	Ethanol	5%	0.991	0.991	1.006	0.981	0.994	1.140
		10%	0.981	0.981	1.012	0.961	0.988	1.242
		15%	0.973	0.973	1.018	0.944	0.983	1.295
		20%	0.964	0.964	1.024	0.927	0.977	1.343
		25%	0.959	0.959	1.028	0.917	0.974	1.363
		30%	0.954	0.954	1.031	0.907	0.970	1.383
		35%	0.949	0.949	1.035	0.897	0.967	1.468
		40%	0.944	0.944	1.038	0.887	0.964	1.523
		45%	0.940	0.940	1.041	0.880	0.962	1.580
	50%	0.936	0.936	1.043	0.872	0.959	1.639	
	Ethylene Glycol	5%	0.997	0.997	1.002	0.993	0.998	1.040
		10%	0.993	0.993	1.004	0.986	0.996	1.075
		15%	0.990	0.990	1.006	0.980	0.994	1.122
		20%	0.987	0.987	1.008	0.973	0.992	1.163
		25%	0.983	0.983	1.011	0.966	0.990	1.195
		30%	0.979	0.979	1.013	0.958	0.987	1.225
		35%	0.976	0.976	1.016	0.951	0.985	1.279
		40%	0.972	0.972	1.018	0.943	0.982	1.324
		45%	0.969	0.969	1.021	0.937	0.980	1.371
	50%	0.966	0.966	1.023	0.930	0.978	1.419	
	Methanol	5%	0.995	0.995	1.004	0.989	0.997	1.069
		10%	0.989	0.989	1.007	0.978	0.993	1.127
		15%	0.984	0.984	1.011	0.968	0.990	1.164
		20%	0.979	0.979	1.014	0.957	0.986	1.197
		25%	0.975	0.975	1.017	0.949	0.984	1.216
		30%	0.971	0.971	1.019	0.941	0.981	1.235
		35%	0.967	0.967	1.022	0.933	0.979	1.286
		40%	0.963	0.963	1.025	0.924	0.976	1.323
		45%	0.959	0.959	1.028	0.917	0.974	1.360
	50%	0.955	0.955	1.030	0.910	0.971	1.399	
	Propylene Glycol	5%	0.995	0.995	1.004	0.989	0.997	1.071
		10%	0.989	0.989	1.007	0.978	0.993	1.130
		15%	0.985	0.985	1.010	0.968	0.990	1.206
		20%	0.980	0.980	1.013	0.958	0.987	1.270
		25%	0.974	0.974	1.017	0.947	0.983	1.359
		30%	0.968	0.968	1.021	0.935	0.979	1.433
		35%	0.963	0.963	1.025	0.924	0.976	1.522
		40%	0.957	0.957	1.029	0.913	0.972	1.614
45%		0.949	0.949	1.034	0.898	0.967	1.712	
50%	0.941	0.941	1.039	0.882	0.962	1.816		

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Water Pressure Drop Adder for Options – Correction Tables

Modulating Water Valve Corrections

High System Pressure Drop Valve

Model	CV	MOPD	WPD Adders		
			GPM	PSI	FT
024	4.7	200	3.0	0.41	0.94
	4.7	200	4.5	0.92	2.12
	4.7	200	6.0	1.63	3.76
030	4.7	200	3.8	0.65	1.51
	4.7	200	5.6	1.42	3.28
	4.7	200	7.5	2.55	5.88
036	4.7	200	4.5	0.92	2.12
	4.7	200	6.8	2.09	4.84
	4.7	200	9.0	3.67	8.47
042	4.7	200	5.3	1.27	2.94
	4.7	200	7.9	2.83	6.53
	4.7	200	10.5	4.99	11.53
048	4.7	200	6.0	1.63	3.76
	4.7	200	9.0	3.67	8.47
	4.7	200	12.0	6.52	15.06
060	7.4	200	7.0	.89	2.06
	7.4	200	10.5	2.01	4.64
	7.4	200	14.0	3.58	8.26

Low System Pressure Drop Valve

Model	CV	MOPD	WPD Adders		
			GPM	PSI	FT
024	4.7	200	3.0	0.41	0.94
	4.7	200	4.5	0.92	2.12
	4.7	200	6.0	1.63	3.76
030	7.4	200	3.8	0.26	0.61
	7.4	200	5.6	0.57	1.32
	7.4	200	7.5	1.03	2.37
036	7.4	200	4.5	0.37	0.85
	7.4	200	6.8	0.84	1.95
	7.4	200	9.0	1.48	3.42
042	10.0	200	5.3	0.28	0.65
	10.0	200	7.9	0.62	1.44
	10.0	200	10.5	1.10	2.55
048	10.0	200	6.0	0.36	0.83
	10.0	200	9.0	0.81	1.87
	10.0	200	12.0	1.44	3.33
060	19.0	200	7.0	0.14	0.31
	19.0	200	10.5	0.31	0.70
	19.0	200	14.0	0.54	1.25

Blower Performance Data

Model	Max ESP (in wg)	Fan Motor (hp)	Range	Cooling Mode		Dehumid Mode		Heating Mode		Fan Only Mode	Aux Emerg Mode
				Stg 2	Stg 1	Stg 2	Stg 1	Stg 2	Stg 1		
024	0.75	1/2	Default	750	575	650	500	750	575	350	750
			Maximum	850	650	800	600	850	850	850	850
			Minimum	600	450	600	450	600	450	300	650
030	0.5	1/2	Default	950	650	800	575	950	650	450	950
			Maximum	1100	750	1000	700	1100	1100	1100	1100
			Minimum	750	525	750	525	750	525	375	750
036	0.6	1/2	Default	1125	750	975	650	1125	750	525	1125
			Maximum	1250	950	1200	800	1250	1250	1250	1250
			Minimum	900	600	900	600	900	600	450	900
042	0.6	3/4	Default	1300	925	1125	825	1300	925	600	1300
			Maximum	1475	1100	1400	1000	1475	1475	1475	1475
			Minimum	1050	750	1050	750	1050	750	525	1050
048	0.75	3/4	Default	1500	1125	1300	975	1500	1125	700	1500
			Maximum	1700	1300	1600	1200	1700	1700	1700	1700
			Minimum	1200	900	1200	900	1200	900	600	1350
060	0.75	1	Default	1875	1500	1625	1300	1875	1500	875	1875
			Maximum	2100	1700	2000	1600	2100	2100	2100	2100
			Minimum	1500	1200	1500	1200	1500	1200	750	1500

Airflow is controlled within 5% up to the Max ESP shown with wet coil.
Performance shown is with wet coil and factory air filters.

Physical Data

Model	024	030	036	042	048	060
Compressor (1 Each)	Scroll					
Factory Charge HFC-410A (oz)	51	48	54	70	80	80
ECM Fan Motor & Blower						
Fan Motor (hp)	1/2	1/2	1/2	3/4	3/4	1
Blower Wheel Size (dia x w) - (in)	9X7	9X7	9X8	9X8	10X10	11X10
Water Connection Size						
FPT(in)	3/4"	3/4"	3/4"	3/4"	1"	1"
Coax Volume (gallons)	0.323	0.323	0.738	0.89	0.738	0.939
HWG Connection Size						
FPT(in)	1/2"					
Vertical Upflow						
Air Coil Dimensions (h x w) - (in)	20 X 17.25	20 X 17.25	24 X 21.75	24 X 21.75	28.75 X 24	28.75 X 24
Standard Filter - 1" [25.4mm] Throwaway, qty (in)	20x20	20x20	24x24	24x24	28x28	28x28
Weight - Operating, (lbs)	216	224	249	260	315	330
Weight - Packaged, (lbs)	221	229	255	266	322	337
Horizontal						
Air Coil Dimensions (h x w) - (in)	16 X 22	16 X 22	20 X 25	20 X 25	20 X 35	20 X 35
Standard Filter - 1" [25.4mm] Throwaway, qty (in)	18x25	18x25	20x28 or 2-20x14	20x28 or 2-20x14	1-20x24, 1-20x14	1-20x24, 1-20x14
Weight - Operating, (lbs)	208	208	233	244	299	314
Weight - Packaged, (lbs)	213	213	239	250	306	321

NOTE: All units have TXV expansion device and 1/2" & 3/4" electrical knockouts.

Unit Maximum Water Working Pressure	
Options	Max Pressure PSIG [kPa]
Internal Pump	145 [999]
Internal Modulating Water Valve (MWV)	300 [2,068]

TZ – Horizontal Dimensional Data

Horizontal Model		Overall Cabinet		
		A Width	B Length	C Height
024 - 030	in	22.4	48.3	18.3
	cm	56.9	122.7	46.5
036 - 042	in	22.4	53.1	21.0
	cm	56.9	134.9	53.3
048 - 060	in	25.4	68.0	21.0
	cm	64.5	172.7	53.3

Horizontal Model		Water Connections										
		①		②		③		④		⑤		Loop In/Out FPT
		Loop In D	Loop In E	Loop Out F	Loop Out E	AA	BB	HWG In 1/2" FPT		HWG Out 1/2" FPT		
								DD	EE	FF	EE	
024 - 030	in	3.7	1.4	9.7	1.4	3.3	0.7	12.4	1.4	15.7	1.4	3/4"
	cm	9.4	3.6	24.6	3.6	8.4	1.8	31.5	3.6	39.9	3.6	
036 - 042	in	3.7	1.4	12.7	1.4	3.3	0.7	15.2	1.4	18.4	1.4	3/4"
	cm	9.4	3.6	32.3	3.6	8.4	1.8	38.6	3.6	46.7	3.6	
048 - 060	in	3.7	1.4	12.7	1.4	3.3	0.7	15.2	1.4	18.4	1.4	1"
	cm	9.4	3.6	32.3	3.6	8.4	1.8	38.6	3.6	46.7	3.6	

Horizontal Model		Electrical Knockouts	
		J 1/2"	K 3/4"
		Low Voltage	Power Supply
024-060	in	7.0	10.0
	cm	18.8	25.4

Notes:

- While clear access to all removable panels is not required, installer should take care to comply with all building codes and allow adequate clearance for future field service.
- Horizontal units shipped with filter bracket only. This bracket should be removed for return duct connection.
- Discharge flange and hanger brackets are factory installed.
- Condensate is rubber coupling that couples to 3/4" schedule 40/80 PVC.
- Blower service panel requires 2' service access.
- Blower service access is through back panel on straight discharge units or through panel opposite air coil on back discharge units.
- Water connections for optional hot water generator are 1/2" FPT.

Legend:

- CAP = Control Access Panel
- BSP = Blower Service Panel
- CSP = Compressor Access Panel
- ASP = Alternative Service Panel (Optional Access, Not Required)

TZ – Vertical Upflow Dimensional Data


Vertical Upflow Model		Overall Cabinet		
		A Width	B Depth	C Height
024 - 030	in	22.4	22.4	40.0
	cm	56.9	56.9	101.6
036 - 042	in	22.4	25.4	45.0
	cm	56.9	64.5	114.3
048 - 060	in	25.4	29.1	50.5
	cm	64.5	73.9	128.3

Vertical Model		Electrical Knockouts	
		K 1/2"	L 3/4"
		Low Voltage	Power Supply
024 - 060	in	7.0	10.0
	cm	17.8	25.4

Vertical Upflow Model		Water Connections - Standard Units										
		1		2		3		4		5		Loop In/ Out FPT
		Loop In D	Loop In E	Loop Out F	Loop Out E	H	I	HWG In 1/2" FPT		HWG In 1/2" FPT		
								DD	EE	FF	EE	
024 - 030	in	3.7	1.4	9.7	1.4	19.7	1.4	13.2	1.4	15.7	1.4	3/4"
	cm	9.4	3.6	24.6	3.6	50.0	3.6	33.5	3.6	39.9	3.6	
036 - 042	in	3.8	1.4	9.8	1.4	20.6	1.4	13.5	1.4	16.0	1.4	3/4"
	cm	9.7	3.6	24.9	3.6	52.3	3.6	34.3	3.6	40.6	3.6	
048 - 060	in	3.7	1.4	9.8	1.4	22.1	1.4	16.0	1.4	18.5	1.4	1"
	cm	9.4	3.6	24.9	3.6	56.1	3.6	40.6	3.6	47.0	3.6	

Recommended Minimum Installation Clearances for Vertical Units*	
1"	Back of unit
	Side opposite return air
6"	Front if hard piped
Return Air Side	
1"	Ducted return
	- ‡ *Add for duct width
	- † Add 2" for 1" filter frame/rail or 3" for 2" filter frame/rail
Free (open) return - calculate required dimension for a maximum velocity of 600 fpm	

*Field installed accessories (hoses, air cleaners, etc.) and factory WSE option will require additional space. Top supply air is shown, the same clearances apply to bottom supply air units.

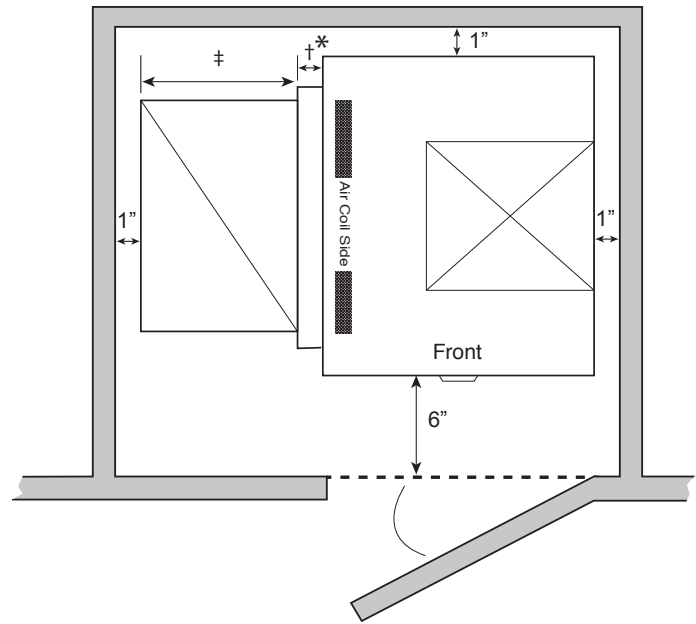

Notes:

- While clear access to all removable panels is not required, installer should take care to comply with all building codes and allow adequate clearance for future field service.
- Front & Side access is preferred for service access. However, all components may be serviced from the front access panel if side access is not available.
- Discharge flange is field installed.
- Condensate is rubber coupling that couples to 3/4" schedule 40/80 PVC.
- Water connections for optional hot water generator are 1/2" FPT.
- Units shipped with filter rails. These rails should be removed for return duct connection. See Aff---- for accessory air filter frame with duct collar.

Legend:


- CAP = Control Access Panel
- BSP = Blower Service Panel
- CSP = Compressor Access Panel
- ASP = Alternative Service Panel (Optional Access, Not Required)

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

TZ – Vertical Upflow Dimensional Data

Vertical Model		Discharge Connection Duct Flange Installed (+/- 0.10 in, +/- 2.5mm)					Return Connection Using Return Air Opening			
		M	N	O Supply Width	P Supply Depth	Q	R	S Return Depth	T Return Height	U
024 - 030	in	7.2	4.2	14.0	14.0	6.7	2.2	18.4	20.3	1.1
	cm	18.3	10.7	35.6	35.6	17.0	5.6	46.7	51.6	2.8
036 - 042	in	7.2	6.0	14.0	14.0	6.5	2.1	22.9	24.3	1.1
	cm	18.3	15.2	35.6	35.6	16.5	5.3	58.2	61.7	2.8
048 - 060	in	8.2	5.7	16.0	18.0	7.3	2.1	26.2	28.3	1.1
	cm	20.8	14.5	40.6	45.7	18.5	5.3	66.5	71.9	2.8

All dimensions are +/- 0.20 in, (+/-5.1 mm).

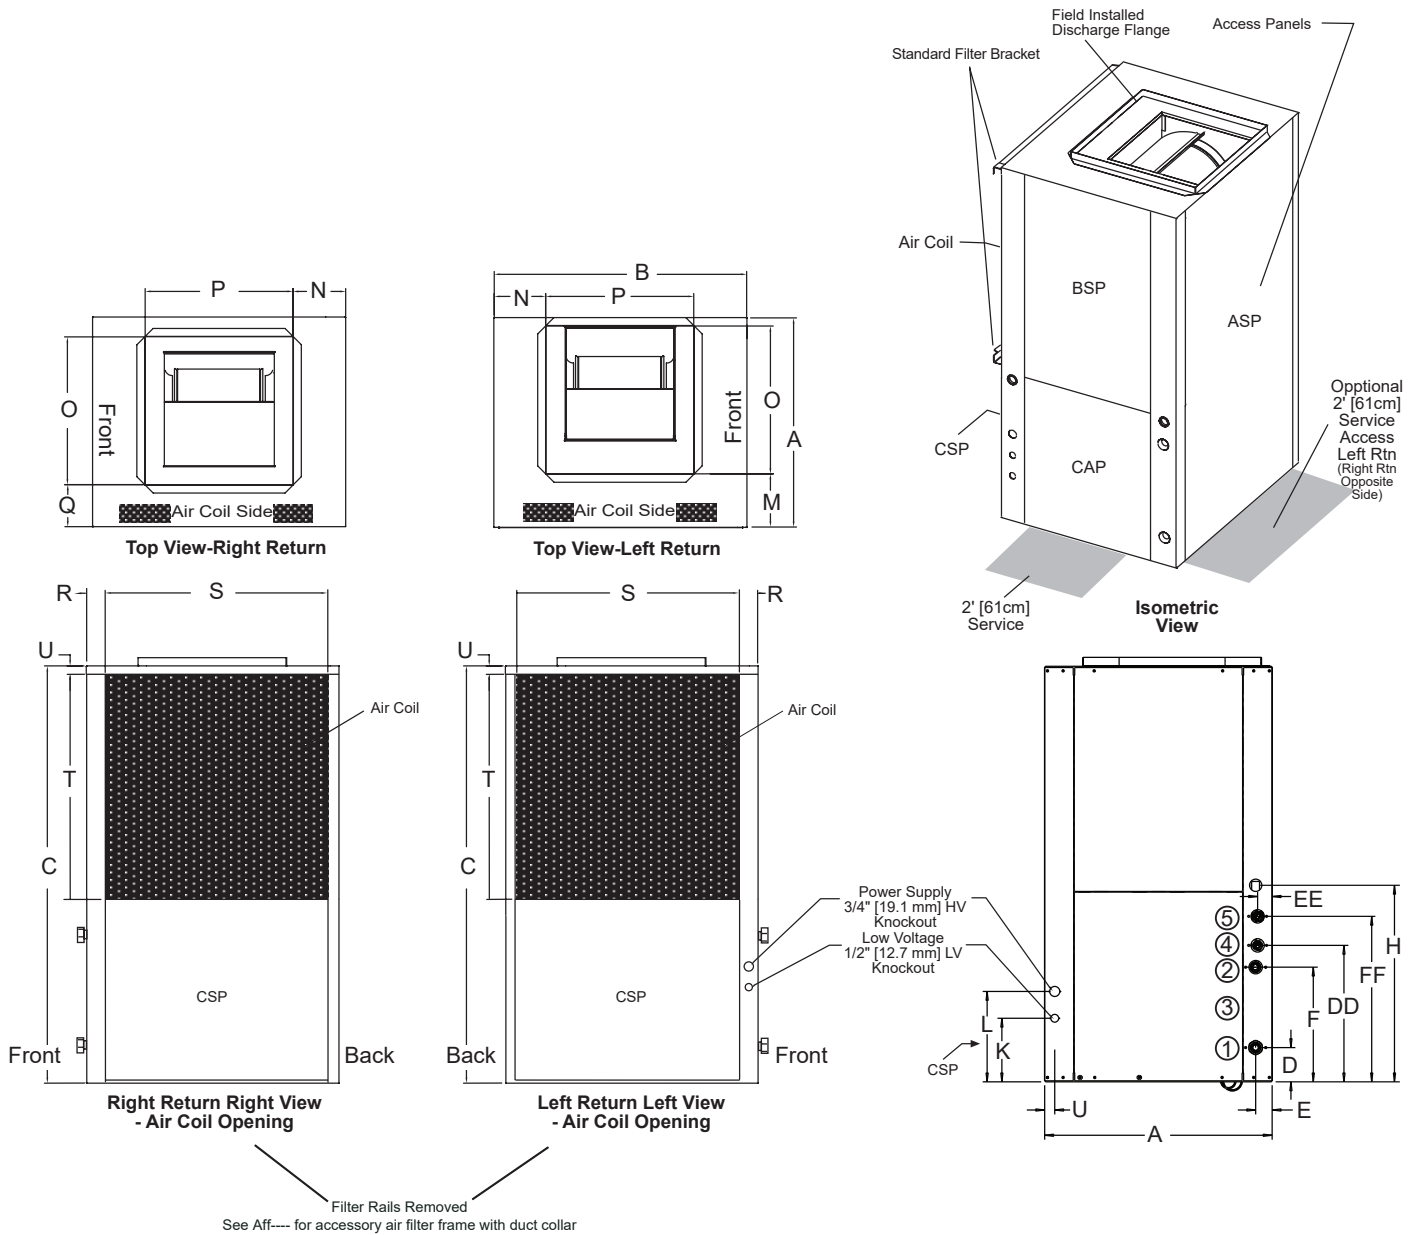

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Corner Weights

Corner Weights for TZ Series Horizontal Units

Model		Total	Left-Front*	Right-Front*	Left-Back*	Right-Back*
024	Lbs	208	68	56	42	42
	kg	94	31	25	19	19
030	Lbs	208	68	56	42	42
	kg	94	31	25	19	19
036	Lbs	233	76	63	47	47
	kg	106	35	29	21	21
042	Lbs	244	80	66	49	49
	kg	111	37	30	22	22
048	Lbs	299	98	81	60	60
	kg	136	45	37	27	27
060	Lbs	314	103	85	63	63
	kg	142	46	38	29	29

*Front is control box end.

Electrical Data

Units with Modulating Motorized Valve

Model	Voltage Code	Voltage	Min/Max Voltage	Compressor			Fan Motor FLA	Total Unit FLA	Min Circ Amp	Max Fuse/HACR
				RLA	LRA	Qty				
024	G	208/230/60/1	197/252	11.7	58.3	1	3.9	15.6	18.5	30
	E	265/60/1	239/292	9.1	54.0	1	3.2	12.3	14.6	20
	H	208/230/60/3	197/252	6.5	55.4	1	3.9	10.4	12.0	15
	F*	460/60/3*	414/506	3.5	28.0	1	3.2	6.7	7.6	15
030	G	208/230/60/1	197/252	13.1	73.0	1	3.9	17.0	20.3	30
	E	265/60/1	239/292	10.2	60.0	1	3.2	13.4	16.0	25
	H	208/230/60/3	197/252	8.7	58.0	1	3.9	12.6	14.8	20
	F*	460/60/3*	414/506	4.3	28.0	1	3.2	7.5	8.6	15
036	G	208/230/60/1	197/252	15.3	83.0	1	3.9	19.2	23.0	35
	E	265/60/1	239/292	13.0	72.0	1	3.2	16.2	19.5	30
	H	208/230/60/3	197/252	11.6	73.0	1	3.9	15.5	18.4	30
	F*	460/60/3*	414/506	5.7	38.0	1	3.2	8.9	10.3	15
042	G	208/230/60/1	197/252	17.9	96.0	1	5.2	23.1	27.6	45
	H	208/230/60/3	197/252	14.2	88.0	1	5.2	19.4	23.0	35
	F*	460/60/3*	414/506	6.2	44.0	1	4.7	10.9	12.5	15
048	G	208/230/60/1	197/252	21.2	104.0	1	5.2	26.4	31.7	50
	E	265/60/1	239/292	16.0	109.7	1	4.7	20.7	24.7	40
	H	208/230/60/3	197/252	14.0	83.1	1	5.2	19.2	22.7	35
	F*	460/60/3*	414/506	6.4	41.0	1	4.7	11.1	12.7	15
060	G	208/230/60/1	197/252	27.1	152.9	1	6.9	34.0	40.8	60
	E	265/60/1	239/292	22.4	130.0	1	6.0	28.4	34.0	50
	H	208/230/60/3	197/252	16.5	110.0	1	6.9	23.4	27.5	40
	F*	460/60/3*	414/506	7.2	52.0	1	6.0	13.2	15.0	20

Wire length based on one way measurement with 2% voltage drop
 Wire size based on 60°C copper conductor
 All fuses Class RK-5

* NEUTRAL CONNECTION REQUIRED! All F Voltage (460 vac) units require a four wire power supply with neutral. ECM motor is rated 265 vac and is wired between one hot leg and neutral.

Units with Internal Secondary Pump

Model	Voltage Code	Voltage	Min/Max Voltage	Compressor			Pump Motor FLA	Fan Motor FLA	Total Unit FLA	Min Circ Amp	Max Fuse/HACR
				RLA	LRA	Qty					
024	G	208/230/60/1	197/252	11.7	58.3	1	0.8	3.9	16.4	19.3	30
	E	265/60/1	239/292	9.1	54.0	1	0.7	3.2	13.0	15.3	20
	H	208/230/60/3	197/252	6.5	55.4	1	0.8	3.9	11.2	12.8	15
	F*	460/60/3*	414/506	3.5	28.0	1	0.7	3.2	7.4	8.3	15
030	G	208/230/60/1	197/252	13.1	73.0	1	0.8	3.9	17.8	21.1	30
	E	265/60/1	239/292	10.2	60.0	1	0.7	3.2	14.1	16.7	25
	H	208/230/60/3	197/252	8.7	58.0	1	0.8	3.9	13.4	15.6	20
	F*	460/60/3*	414/506	4.3	28.0	1	0.7	3.2	8.2	9.3	15
036	G	208/230/60/1	197/252	15.3	83.0	1	0.8	3.9	20.0	23.8	35
	E	265/60/1	239/292	13.0	72.0	1	0.7	3.2	16.9	20.2	30
	H	208/230/60/3	197/252	11.6	73.0	1	0.8	3.9	16.3	19.2	30
	F*	460/60/3*	414/506	5.7	38.0	1	0.7	3.2	9.6	11.0	15
042	G	208/230/60/1	197/252	17.9	96.0	1	0.8	5.2	23.9	28.4	45
	H	208/230/60/3	197/252	14.2	88.0	1	0.8	5.2	20.2	23.8	35
	F*	460/60/3*	414/506	6.2	44.0	1	0.7	4.7	11.6	13.2	15
048	G	208/230/60/1	197/252	21.2	104.0	1	1.1	5.2	27.5	32.8	50
	E	265/60/1	239/292	16.0	109.7	1	1.1	4.7	21.8	25.8	40
	H	208/230/60/3	197/252	14.0	83.1	1	1.1	5.2	20.3	23.8	35
	F*	460/60/3*	414/506	6.4	41.0	1	1.1	4.7	12.2	13.8	20
060	G	208/230/60/1	197/252	27.1	152.9	1	1.1	6.9	35.1	41.9	60
	E	265/60/1	239/292	22.4	130.0	1	1.1	6.0	29.5	35.1	50
	H	208/230/60/3	197/252	16.5	110.0	1	1.1	6.9	24.5	28.6	45
	F*	460/60/3*	414/506	7.2	52.0	1	1.1	6.0	14.3	16.1	20

Wire length based on one way measurement with 2% voltage drop
 Wire size based on 60°C copper conductor
 All fuses Class RK-5

* NEUTRAL CONNECTION REQUIRED! All F Voltage (460 vac) units require a four wire power supply with neutral. ECM motor and optional circulating pumps are rated 265 vac and are wired between one hot leg and neutral.

Electrical Data

Units with High Head Variable Pump

Model	Voltage Code	Voltage	Min/Max Voltage	Compressor			Pump Motor FLA	Fan Motor FLA	Total Unit FLA	Min Circ Amp	Max Fuse/HACR
				RLA	LRA	Qty					
024	G	208/230/60/1	197/252	11.7	58.3	1	1.44	3.9	17.0	20.0	30
	H	208/230/60/3	197/252	6.5	55.4	1	1.44	3.9	11.8	13.5	20
030	G	208/230/60/1	197/252	14.7	73	1	1.44	3.9	18.4	21.7	35
	H	208/230/60/3	197/252	8.7	58	1	1.44	3.9	14.0	16.2	25
036	G	208/230/60/1	197/252	18	83	1	1.44	3.9	20.6	24.5	40
	H	208/230/60/3	197/252	11.6	73	1	1.44	3.9	16.9	19.8	30
042	G	208/230/60/1	197/252	21.8	96	1	1.44	5.2	24.5	29.0	45
	H	208/230/60/3	197/252	14.2	88	1	1.44	5.2	20.8	24.4	35
048	G	208/230/60/1	197/252	21.2	104	1	1.44	5.2	27.8	33.1	50
	H	208/230/60/3	197/252	14	83.1	1	1.44	5.2	20.6	24.1	35
060	G	208/230/60/1	197/252	28.9	152.9	1	1.44	6.9	35.4	42.2	60
	H	208/230/60/3	197/252	16.5	110	1	1.44	6.9	24.8	29.0	45

Wire length based on one way measurement with 2% voltage drop
 Wire size based on 60°C copper conductor
 All fuses Class RK-5

Units with Low Head Variable Pump

Model	Voltage Code	Voltage	Voltage Min/Max	Compressor			Pump Motor FLA	Fan Motor FLA	Total Unit FLA	Min Circ Amp	Max Fuse/HACR
				RLA	LRA	Qty					
024	G	208/230/60/1	197/252	11.7	58.3	1	0.7	3.9	16.3	19.2	30
	H	208/230/60/3	197/252	6.5	55.4	1	0.7	3.9	11.1	12.7	15
030	G	208/230/60/1	197/252	14.7	73.0	1	0.7	3.9	17.7	21.0	30
	H	208/230/60/3	197/252	8.7	58.0	1	0.7	3.9	13.3	15.5	20
036	G	208/230/60/1	197/252	18.0	83.0	1	0.7	3.9	19.9	23.7	35
	H	208/230/60/3	197/252	11.6	73.0	1	0.7	3.9	16.2	19.1	30
042	G	208/230/60/1	197/252	21.8	96.0	1	0.7	5.2	23.8	28.3	45
	H	208/230/60/3	197/252	14.2	88.0	1	0.7	5.2	20.1	23.6	35
048	G	208/230/60/1	197/252	25.0	104	1	0.7	5.2	27.1	32.4	50
	H	208/230/60/3	197/252	14.0	83.1	1	0.7	5.2	19.9	23.4	35
060	G	208/230/60/1	197/252	28.9	152.9	1	0.7	6.9	34.7	41.5	60
	H	208/230/60/3	197/252	16.5	110	1	0.7	6.9	24.1	28.2	40

Wire length based on one way measurement with 2% voltage drop
 Wire size based on 60°C copper conductor
 All fuses Class RK-5

TZ Series Wiring Diagram Matrix

All current diagrams can be located online at climatemaster.com. Click 'Commercial Professional'.

1. Click 'Products' in the main navigation
2. Select 'Small Packaged Units'
3. Select the TZ product series
4. Click the Wire Diagrams tab in the middle of the page
5. Select your voltage and controls

Unit Controller	Hydronic Options	208/60/1	265/60/1	208/60/3	460/60/3
DXM2.5	None	96B0005N77		96B0232N21	96B0232N31
	Modulating Water Valve	96B0005N62		96B0243N40	96B0244N40
	Variable Speed Water Pump	96B0005N60		96B0243N45	96B0244N45
Auxiliary WD for MPC Controls		96B0147N18			

Tranquility® 22 (TZ) Series 60Hz Engineering Specifications – Page 1

General:

Furnish and install ClimateMaster Tranquility® (TZ) Water Source Heat Pumps, as indicated on the plans. Equipment shall be completely assembled, piped, and internally wired. Capacities and characteristics as listed in the schedule and the specifications that follow.

Units shall be supplied completely factory built capable of operating over an entering water temperature range from 20° to 120° F (-6.7° to 48.9° C) as standard. Equivalent units from other manufacturers may be proposed provided approval to bid is given 10 days prior to bid closing. All equipment listed in this section must be rated and certified in accordance with Air-Conditioning, Heating and Refrigeration Institute/International Standards Organization (AHRI/ISO 13256-1). All equipment must be tested, investigated, and determined to comply with the requirements of the standards for Heating and Cooling Equipment UL-1995 for the United States and CAN/CSA-C22.2 NO.236 for Canada, by Intertek Testing Laboratories (ETL). The units shall have AHRI/ISO and ETL-US-C labels.

All units shall pass a factory acceptance test. The quality control system shall automatically perform the factory acceptance test via computer. A detailed report card from the factory acceptance test shall ship with each unit. **(Note: If unit fails the factory acceptance test it shall not be allowed to ship. Unit serial number will be recorded by factory acceptance test and furnished on report card for ease of unit warranty status.)**

Basic Construction:

Horizontal units shall have one of the following air flow arrangements: Left Inlet/Straight (Right) Discharge; Right Inlet/Straight (Left) Discharge; Left Inlet/Back Discharge; or Right Inlet/Back Discharge as shown on the plans. Units must have the ability to be field convertible from straight to back or back to straight discharge with no additional parts or unit structure modification. Horizontal units will have factory installed hanger brackets with rubber isolation grommets packaged separately.

Vertical Units shall have one of the following air flow arrangements: Left Return/Top Discharge, Right Return/Top Discharge, as shown on the plans.

If units with these arrangements are not used, the contractor is responsible for any extra costs incurred by other trades. All units (horizontal and vertical) must have multiple access panels for serviceability of compressor compartment. **Units having only one access panel to compressor/heat exchangers/expansion device/refrigerant piping shall not be acceptable.**

Compressor section interior surfaces shall be lined with 1/2 inch (12.7mm) thick, 1-1/2 lb/ft³ (24 kg/m³) acoustic type glass fiber insulation. Air handling section interior surfaces shall be lined with 1/2 in (12.7mm) thick, 1-1/2 lb/ft³ (24 kg/m³) foil-faced fiber insulation for ease of cleaning. Insulation placement shall be designed in a manner that will eliminate any exposed edges to prevent the introduction of glass fibers into the air stream. **Units without foil-faced insulation in the air handling section will not be accepted.**

The heat pump cabinets shall be fabricated from heavy gauge galvanized steel.

Standard insulation must meet NFPA Fire Hazard Classification requirements 25/50 per ASTM E84, UL 723, CAN/ULC S102-M88 and NFPA 90A requirements; air erosion and mold growth limits of UL-181; stringent fungal resistance test per ASTM-C1071 and ASTM G21; and shall meet zero level bacteria growth per ASTM G22. **Unit insulation must meet these stringent requirements or unit(s) will not be accepted.**

All horizontal units to have factory installed 1 inch (25.4 mm) discharge air duct collars, 1 inch (25.4 mm) filter rails with 1 inch (25.4 mm) filters factory installed, and factory installed unit-mounting brackets. Vertical units to have field installed discharge air duct collar, shipped loose and 1 inch (25.4 mm) filter rails with 1 inch (25.4 mm) filters factory installed. **If units with these factory-installed provisions are not used, the contractor is responsible for any extra costs to field install these provisions, and/or the extra costs for his sub-contractor to install these provisions.**

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Tranquility® 22 (TZ) Series 60Hz Engineering Specifications – Page 2

All units must have an insulated panel separating the fan compartment from the compressor compartment. **Units with the compressor in the air stream are not acceptable.** Units shall have a factory installed 1 inch (25.4 mm) wide filter bracket for filter removal from either side. Units shall have a 1 inch (25.4 mm) thick throwaway type glass fiber filter. The contractor shall purchase one spare set of filters and replace factory shipped filters on completion of start-up. Filters shall be standard sizes. If units utilize non-standard filter sizes then the contractor shall provide 12 spare filters for each unit.

Cabinets shall have separate holes and knockouts for entrance of line voltage and low voltage control wiring. All factory-installed wiring passing through factory knockouts and openings shall be protected from sheet metal edges at openings by plastic ferrules. Supply and return water connections shall be copper FPT fittings, and shall be securely mounted flush to the cabinet corner post allowing for connection to a flexible hose without the use of a back-up wrench. **Water connections that protrude through the cabinet or require the use of a backup wrench shall not be allowed.** All water connections and electrical knockouts must be in the compressor compartment corner post as to not interfere with the serviceability of unit. Contractor shall be responsible for any extra costs involved in the installation of units that do not have this feature. Contractor must ensure that units can be easily removed for servicing and coordinate locations of electrical conduit and lights with the electrical contractor.

Option: The unit will be supplied with optional field or factory installed 2 inch air filter rails (typically used for free return installation) or 1 inch or 2 inch air filter frames with filter access door and return air duct flanges (typically used for ducted return installation). A corresponding 1 inch or 2 inch throwaway type glass fiber filter will ship with the factory installed filter rail or frame

Option: The contractor shall install 1 inch or 2 inch MERV rated pleated media disposable air filters on all units.

Option: UltraQuiet package shall consist of high technology sound attenuating material that is strategically applied to the compressor and air handling compartment casings and fan scroll in addition to the standard ClimaQuiet system design, to further dampen and attenuate sound transmissions.

Option: The unit will be supplied with internally factory mounted modulating water valve with delta T control. The factory built-in valve shall modulate water flow through unit based on a field adjustable water temperature difference between the entering and leaving water. For two-stage units, the modulating valve will automatically reduce the water flow through the unit during part load operation to maintain the configured temperature difference. The valve shall automatically adjust for operating mode, stage of capacity, source water temperature and variations in external head pressure. The valve will also act as a shut-off valve to prevent water flow through the unit when the unit is not activated and will have a minimum position capability. Externally mounted modulating water valves will not be accepted.

Option: The unit will be supplied with internally factory mounted variable speed water circulating pump with internal check valve. The variable speed pump shall modulate water flow through the unit based on a field adjustable temperature difference between the entering and leaving water. For two-stage units, the modulating valve will automatically reduce the water flow through the unit during part load operation to maintain the configured temperature difference. The variable speed pump shall automatically adjust for operating mode, stage of capacity, source water temperature, and variations in external head pressure. Externally mounted circulating pumps will not be accepted.

Tranquility® 22 (TZ) Series 60Hz Engineering Specifications – Page 3

Option: The unit will be supplied with internally mounted secondary pump for primary/secondary applications, including one-pipe systems. Externally mounted secondary pump will not be accepted.

Option: The unit shall be supplied with extended range insulation option, which adds closed cell insulation to internal water lines, and provides insulation on suction side refrigeration tubing including refrigerant to water heat exchanger.

Fan and Motor Assembly:

Blower shall have inlet rings to allow removal of wheel and motor from one side without removing housing. Units shall have a direct-drive centrifugal fan. The fan motor shall be an ECM variable speed ball bearing type motor. The ECM fan motor shall provide soft starting, maintain constant CFM over its static operating range and provide airflow adjustment in 25 CFM increments via its control board. The fan motor shall be isolated from the housing by rubber grommets. The motor shall be permanently lubricated and have thermal overload protection. A special dehumidification mode shall be provided to allow lower airflows in cooling for better dehumidification. The dehumidification mode may be constant or automatic (humidistat controlled). Airflow/Static pressure rating of the unit shall be based on a wet coil and a clean filter in place. **Ratings based on a dry coil, and/or no air filter, shall NOT be acceptable.**

Refrigerant Circuit:

All units shall contain an EarthPure®(HFC-410A) sealed refrigerant circuit including a high efficiency two-stage scroll compressor designed for heat pump operation, a thermostatic expansion valve for refrigerant metering, an enhanced corrugated aluminum lanced fin and rifled copper tube refrigerant to air heat exchanger, reversing valve, coaxial (tube in tube) refrigerant to water heat exchanger, and safety controls including a high pressure switch, low pressure switch (loss of charge), water coil low temperature sensor, and air coil low temperature sensor. Access fittings shall be factory installed on high and low pressure refrigerant lines to facilitate field service. Activation of any safety device shall prevent compressor operation via a microprocessor lockout circuit. The lockout circuit shall be reset at the thermostat or at the contractor supplied disconnect switch. **Units that cannot be reset at the thermostat shall not be acceptable.**

Hermetic compressors shall be internally sprung. The compressor shall have a dual level vibration isolation system. The compressor will be mounted on specially engineered sound-tested EPDM vibration isolation grommets to a large heavy gauge compressor mounting plate, which is then isolated from the cabinet base with rubber grommets for maximized vibration attenuation. All units shall include a discharge muffler to further enhance sound attenuation. Compressor shall have thermal overload protection. Compressor shall be located in an insulated compartment away from air stream to minimize sound transmission.

Refrigerant to air heat exchangers shall utilize enhanced corrugated lanced aluminum fins and rifled copper tube construction rated to withstand 625 PSIG (4309 kPa) refrigerant working pressure. Refrigerant to water heat exchangers shall be of copper inner water tube and steel refrigerant outer tube design, rated to withstand 625 PSIG (4309 kPa) working refrigerant pressure and 500 PSIG (3445 kPa) working water pressure. The refrigerant to water heat exchanger shall be "electro-coated" with a low cure cathodic epoxy material a minimum of 0.4 mils thick (0.4 – 1.5 mils range) on all surfaces. The black colored coating shall provide a minimum of 1,000 hours salt spray protection per ASTM B117-97 on all external steel and copper tubing. The material shall be formulated without the inclusion of any heavy metals and shall exhibit a pencil hardness of 2H (ASTM D3363-92A), crosshatch adhesion of 4B-5B (ASTM D3359-95), and impact resistance of 160 in-lbs (184 kg-cm) direct (ASTM D2794-93).

Refrigerant metering shall be accomplished by thermostatic expansion valve only. Expansion valves shall be dual port balanced types with external equalizer for optimum refrigerant metering. Units shall be designed and tested for operating ranges of entering water temperatures from 20° to 120° F (-6.7° to 48.9° C). Reversing valve shall be four-way solenoid activated refrigerant valve, which shall

Tranquility® 22 (TZ) Series 60Hz Engineering Specifications – Page 4

default to heating mode should the solenoid fail to function. If the reversing valve solenoid defaults to cooling mode, an additional low temperature thermostat must be provided to prevent over-cooling an already cold room.

Option: The unit will be supplied with a cupro-nickel coaxial water to refrigerant heat exchanger.

Option: The unit shall be supplied with a hot water generator (desuperheater).

Option: The refrigerant to air heat exchanger shall be tin-plated.

Drain Pan:

The drain pan shall be constructed of a polymer material that inhibits corrosion. Drain outlet shall be connected from pan using provided polymer coupling and clamps that meet UL 2043 as required for discrete products by the IMC and UMC when located in a plenum. If galvanized steel drain pan is used, it shall be fully insulated on all sides and must meet the stringent 1,000 hour salt spray test per ASTM B117. Drain outlet shall be located at pan as to allow unobstructed drainage of condensate. Drain outlet shall be connected from pan directly to a rubber coupling. **No hidden internal tubing extensions from pan outlet extending to unit casing (that can create drainage problems) will be accepted.** The unit as standard will be supplied with solid-state electronic condensate overflow protection. **Mechanical float switches will NOT be accepted.**

Option: The unit shall be supplied with stainless steel drain pan with 3/4" MPT plumbing connection. The stainless steel drain pan shall be fully insulated on all sides.

Electrical:

A control box shall be located within the unit compressor compartment and shall contain a 75 VA transformer, 24 volt activated, 2 or 3 pole compressor contactor, terminal block for thermostat wiring and solid-state controller for complete unit operation. Reversing valve and fan motor wiring shall be routed through this electronic controller. Units shall be name-plated for use with time delay fuses or HACR circuit breakers. Unit controls shall be 24 Volt and provide heating or cooling as required by the remote thermostat/sensor.

Option: Disconnect Switch, Non-Fused, classified as motor disconnect.

Enhanced Solid State Control System (DXM2.5)

This control system is a communicating controller with the following features.

- a. Anti-short cycle time delay on compressor operation.
- b. Random start on power up mode.
- c. Low voltage protection.
- d. High voltage protection.
- e. Unit shutdown on high or low refrigerant pressures.
- f. Unit shutdown on low water temperature.
- g. Condensate overflow electronic protection.
- h. Option to reset unit at thermostat or disconnect.
- i. Automatic intelligent reset. Unit shall automatically reset the unit 5 minutes after trip if the fault has cleared. If a fault occurs 3 times sequentially without thermostat meeting temperature, then lockout requiring manual reset will occur.
- j. Ability to defeat time delays for servicing.
- k. The low-pressure switch shall not be monitored for the first 120 seconds after a compressor start command to prevent nuisance safety trips.
- l. 24V output to cycle a motorized water valve or other device with compressor contactor.
- m. Unit Performance Sentinel (UPS). The UPS warns when the heat pump is running inefficiently.

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Tranquility® 22 (TZ) Series 60Hz Engineering Specifications – Page 5

- n. Water coil low temperature sensing (selectable for water or anti-freeze).
- o. Air coil low temperature sensing.
- p. Minimized reversing valve operation (Unit control logic shall only switch the reversing valve when cooling is demanded for the first time. The reversing valve shall be held in this position until the first call for heating, ensuring quiet operation and increased valve life).
- q. Emergency shutdown contacts.
- r. Entering and leaving water temperature sensing.
- s. Leaving air temperature sensing.
- t. Compressor discharge temperature sensing.
- u. Removable thermostat connector.
- v. Night setback control.
- w. Random start on return from night setback.
- x. Override temperature control with 2-hour timer for room occupant to override setback temperature at the thermostat.
- y. Dry contact night setback output for digital night setback thermostats.
- z. Ability to work with heat pump or heat/cool (Y, W) type thermostats.
- aa. Ability to work with heat pump thermostats using O or B reversing valve control.
- bb. Boilerless system heat control at low loop water temperature.
- cc. Ability to allow up to 3 units to be controlled by one thermostat.
- dd. Relay to operate an external damper.
- ee. Relay to start system pump.
- ff. 75 VA control transformer. Control transformer shall have load side short circuit and overload protection via a built-in circuit breaker.

NOTE: Units not providing the 8 safety protections of anti-short cycle, low voltage, high voltage, high refrigerant pressure, low pressure (loss of charge), air coil low temperature cut-out, water coil low temperature cut-out, and condensate overflow protection for both drain pans will not be accepted.

When DXM2.5 is connected to AWC99U01 communicating thermostat or handheld service tool, the installer/service technician can; check and set CFM and check DIP switch S1, S2, and S3 settings; run operation modes manually; check all physical inputs from thermostat and refrigerant pressure switches status, (Y1, Y2, W, O, G, H, ESD, NSB, OR, HP switch, and LOC switch); current or at time of fault the following temperatures - water coil (LT1), air coil (LT2), compressor discharge, leaving air, leaving water, entering water and control voltage; record last five faults, list possible reasons, and clear faults. When the AWC99U01 communicating thermostat is used this same functionality can be viewed and adjusted remotely with the only portal or mobile app. **Systems not providing remote access, diagnosis, and adjustment functionality will not be accepted.**

Digital Night Setback with Pump Restart (with either ATP32U03C, ATP32U04C, or iGate® 2 Communicating (AWC)Thermostat):

The unit will be provided with a Digital Night Setback feature using an accessory relay on the DXM2.5 controller and an external, field-provided time clock. The external time clock will initiate and terminate the night setback period. The thermostat will have a night setback override feature with a programmable override time period.

An additional accessory relay on the unit DXM2.5 controller will energize the building loop pump control for the duration of the override period. **(Note: This feature requires additional low voltage wiring. Consult Application Drawings for details.)**

Remote Service Sentinel:

Solid state control system shall communicate with thermostat to display (at the thermostat) the unit status, fault status, and specific fault condition, as well as retrieve previously stored fault that caused unit shutdown. The Remote Service Sentinel allows building

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Tranquility® 22 (TZ) Series 60Hz Engineering Specifications – Page 6

maintenance personnel or service personnel to diagnose unit from the wall thermostat. The control board shall provide a signal to the thermostat fault light, indicating a lockout. Upon cycling the G (fan) input 3 times within a 60 second time period, the fault light shall display the specific code as indicated by a sequence of flashes. A detailed flashing code shall be provided at the thermostat LED to display unit status and specific fault status such as over/under voltage fault, high pressure fault, low pressure fault, low water temperature fault, condensate overflow fault, etc. Units that do not provide this remote service sentinel shall not be acceptable.

Option: MPC (Multiple Protocol Control) Interface System

Units shall have all the features listed above and the control board will be supplied with a Multiple Protocol interface board. Available protocols are BACnet MS/TP, Modbus, or Johnson Controls N2. The choice of protocol shall be field selectable/changeable via the use of a simple selector switch. **Protocol selection shall not require any additional programming or special external hardware or software tools.** This will permit all units to be daisy chain connected by a 2-wire twisted pair shielded cable. The following points must be available at a central or remote computer location:

- a. space temperature
- b. leaving water temperature
- c. discharge air temperature
- d. command of space temperature setpoint
- e. cooling status
- f. heating status
- g. low temperature sensor alarm
- h. low pressure sensor alarm
- i. high pressure switch alarm
- j. condensate overflow alarm
- k. hi/low voltage alarm
- l. fan "ON/AUTO" position of space thermostat as specified above
- m. unoccupied/occupied command
- n. cooling command
- o. heating command
- p. fan "ON/AUTO" command
- q. fault reset command
- r. itemized fault code revealing reason for specific shutdown fault (any one of 7)

Warranty:

ClimateMaster shall warranty equipment for a period of 12 months from start up or 18 months from shipping (which ever occurs first).

Option: Extended 4-year compressor warranty covers compressor for a total of 5 years.

Option: Extended 4-year refrigeration circuit warranty covers coils, reversing valve, expansion valve and compressor for a total of 5 years.

Option: Extended 4-year control board warranty covers the DXM2.5 control board for a total of 5 years.

FIELD INSTALLED OPTIONS

Hose Kits:

All units shall be connected with hoses. The hoses shall be 2 feet (61 cm) long, braided stainless steel; fire rated hoses complete with adapters. Only fire rated hoses will be accepted.

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Tranquility® 22 (TZ) Series 60Hz Engineering Specifications – Page 7

Valves:

The following valves are available and will be shipped loose:

- a. Ball valve; bronze material, standard port full flow design, FPT connections.
- b. Ball valve with memory stop and PT port.
- c. “Y” strainer with blowdown valve; bronze material, FPT connections.
- d. Motorized water valve; slow acting, 24 V, FPT connections.

Hose Kit Assemblies:

The following assemblies ship with the valves already assembled to the hose described:

- a. Supply and return hoses having ball valve with PT port.
- b. Supply hose having ball valve with PT port; return hose having automatic flow regulator valve with PT ports, and ball valve.
- c. Supply hose having “Y” strainer with blowdown valve, and ball valve with PT port; return hose having automatic flow regulator with PT ports, and ball valve.
- d. Supply hose having “Y” strainer with blowdown valve, and ball valve with PT port; return hose having ball valve with PT port.

Thermostats:

The thermostat shall be a ClimateMaster mechanical or electronic type thermostat as selected below with the described features:

a. Thermostat (Communicating) iGate® 2 Communicating (AWC) Thermostat

An electronic communicating web-enabled touchscreen thermostat shall be provided. The thermostat shall offer three stages of heating and two stages of cooling with precise temperature control and have a four-wire connection to the unit. The thermostat shall be capable of manual or automatic change-over operation and shall operate in standard or programmable mode. An integrated humidity control feature shall be included to control a humidifier and/or a dehumidifier. The thermostat shall include a utility demand reduction feature to be initiated by an independent time program or an external input.

The thermostat shall provide access to via the web portal or mobile application to include temperature adjustment, schedule adjustment including occupied/unoccupied, entering water temperature, leaving water temperature, water coil temperature, air coil temperature, leaving air temperature, and compressor discharge temperature. A graphical system layout to be provided with real-time operating mode information of the temperature sensors for easy diagnostics.

The thermostat shall display system faults with probable cause and troubleshooting guidance. The system shall provide in clear language last five faults, time of faults, operating temps at time of fault, and possible reasons for the fault. The thermostat shall provide access for immediate manual control of all outputs via the web portal/mobile application for rapid troubleshooting.

b. CM500 – Color Touchscreen Display, Multi-stage, Automatic or Manual Changeover, 7-day Programmable with Wi-Fi and Humidity Control (AVB32V03C/R)

Thermostat shall have color resistive touchscreen display with space temperature, relative humidity, setpoints, mode, status indication and local weather (if connected to Wi-Fi). Residential version shall be 7 day programmable with up to 4 setpoints per day. Commercial version shall be 7 day programmable with 4 occupied/unoccupied periods per day with up to 4-hour override. Multi-stage (3H/2C), automatic or manual changeover with HEAT-OFF-COOL-AUTO-EM HEAT system settings and fan ON-AUTO settings, Wi-Fi, pre-occupancy purge fan option, customizable screen saver and background displays, indicator on display indicates a heating or cooling demand, set-point lock, title 24 compliant, openADR2.0b certified with Skyport web portal. Compatible with condensate overflow warning systems – lockout compressor with message on the display. Capable of being monitored by 3rd party software. Compatible with AST014 Wi-Fi remote sensor. Configurator mobile app or web portal for easy

Tranquility® 22 (TZ) Series 60Hz Engineering Specifications – Page 8

setup. Separate dehumidification and humidification setpoints shall be configurable for discreet outputs to a dehumidification option and/or an external humidifier. The temperature indication shall be selectable for °F or °C. Time display shall be selectable for 12- or 24-hour clock. The thermostat shall provide permanent memory of setpoints without batteries. Thermostat shall provide heating setpoint range limit, cooling setpoint range limit, temperature display offset, dead-band range setting, and inter-stage differential settings. Thermostat shall provide progressive recovery to anticipate time required to bring space temperature to the next programmed event. Thermostat shall provide access to a web portal and mobile app for installer setup for configuring options. Thermostat shall have menu-driven selections for ease of use and programming.

c. CM300 – Multi-stage, Automatic or Manual Changeover, 7-day Programmable with Wi-Fi and Humidity Control (AVB32V02C/R)

Residential version shall be 7 day programmable with up to 4 setpoints per day. Commercial version shall be 7 day programmable with 4 occupied/unoccupied periods per day with up to 4-hour override. Multi-stage (3H/2C), automatic or manual changeover with HEAT-OFF-COOL-AUTO-EM HEAT system settings and fan ON-AUTO settings, Wi-Fi, pre-occupancy purge fan option, night time control of display backlight, bi-color LED indicates a heating or cooling demand, keypad lock, title 24 compliant, openADR2.0b certified with Skyport web portal. Compatible with condensate overflow warning systems – lockout compressor with message on

d. CM100 - Multi-stage Automatic or Manual Changeover digital thermostat (ATA32V01)

Multi-stage (3H/2C), automatic or manual changeover with HEAT-OFF-COOL-AUTO-EM HEAT system settings and fan ON-AUTO settings. Thermostat shall have a green backlit LED display with temperature, setpoints, mode, and status indication via a green (cooling) or red(heating) LED. The temperature indication shall be selectable for °F or °C. Time display shall be selectable for 12 or 24 hour clock. The thermostat shall provide permanent memory of setpoints without batteries. Thermostat shall provide heating setpoint range limit, cooling setpoint range limit, temperature display offset, keypad lockout, dead-band range setting, and inter-stage differential settings. Thermostat shall provide progressive recovery to anticipate time required to bring space temperature to the next programmed event. Thermostat shall provide an installer setup for configuring. Thermostat navigation shall be accomplished via four buttons (Mode/fan/down/up) with menu-driven selections for ease of use and programming.

e. Multi-stage Digital Automatic Changeover (ATA22U01)

Thermostat shall be multi-stage (2H/2C), manual or automatic changeover with HEAT-OFF-COOL-AUTO-EM HEAT system settings and fan ON-AUTO settings. Thermostat shall have an LCD display with temperature, setpoint(s), mode, and status indication. The temperature indication shall be selectable for °F or °C. The thermostat shall provide permanent memory of setpoint(s) without batteries. A fault LED shall be provided to indicate specific fault condition(s). Thermostat shall provide temperature display offset for custom applications. Thermostat shall allow unit to provide better dehumidification by automatically using lower fan speed on stage 1 cooling (higher latent cooling) as main cooling mode, and automatically shifting to high speed fan on stage 2 cooling.

f. Multi-stage Automatic or Manual Changeover Programmable 7-Day (ATP32U03C)

Thermostat shall be 7-day programmable (with up to 4 setpoints per day), multi-stage (3H/2C), automatic or manual changeover with HEAT-OFF-COOL-AUTO-EM HEAT system settings and fan ON-AUTO settings. Thermostat shall have a blue backlit dot matrix LCD display with temperature, setpoints, mode, and status indication. The temperature indication shall be selectable for °F or °C. Time display shall be selectable for 12 or 24 hour clock. Fault identification shall be provided to simplify troubleshooting by providing specific unit fault at the thermostat with red backlit LCD during unit lockout. The thermostat shall provide permanent memory of setpoints without batteries. Thermostat shall provide heating setpoint range limit, cooling setpoint range limit, temperature display offset, keypad lockout, dead-band range setting, and inter-stage differential settings. Thermostat shall provide progressive recovery to anticipate time required to bring space temperature to the next programmed event. Thermostat shall provide an installer setup for configuring options and for setup of servicing contractor name and contact information. Thermostat shall allow the use of an accessory remote and/or outdoor temperature sensor (AST008). Thermostat navigation shall be accomplished via five buttons (up/down/right/left/select) with menu-driven selections for ease of use and programming.

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Tranquility® 22 (TZ) Series 60Hz Engineering Specifications – Page 9

g. Multi-stage Automatic or Manual Changeover Programmable 7-Day with Humidity Control (ATP32U04C)

Thermostat shall be 7-day programmable (with up to 4 setpoints per day), multi-stage (3H/2C), automatic or manual changeover with HEAT-OFF-COOL-AUTO-EM HEAT system settings and fan ON-AUTO settings. Separate dehumidification and humidification setpoints shall be configurable for discreet outputs to a dehumidification option and/or an external humidifier. Installer configuration mode shall allow thermostat to operate with ECM fan dehumidification mode via settings changes. Thermostat shall have a blue backlit dot matrix LCD display with temperature, relative humidity, setpoints, mode, and status indication. The temperature indication shall be selectable for °F or °C. Time display shall be selectable for 12 or 24 hour clock. Fault identification shall be provided to simplify troubleshooting by providing specific unit fault at the thermostat with red backlit LCD during unit lockout. The thermostat shall provide permanent memory of setpoints without batteries. Thermostat shall provide heating setpoint range limit, cooling setpoint range limit, temperature display offset, keypad lockout, dead-band range setting, and inter-stage differential settings. Thermostat shall provide progressive recovery to anticipate time required to bring space temperature to the next programmed event. Thermostat shall provide an installer setup for configuring options and for setup of servicing contractor name and contact information. Thermostat shall allow the use of an accessory remote and/or outdoor temperature sensor (AST008). Thermostat navigation shall be accomplished via five buttons (up/down/right/left/select) with menu-driven selections for ease of use and programming.

DDC Sensors:

ClimateMaster wall mounted DDC sensor to monitor room temperature and interfaces with optional interface system described above. Several types as described below:

- a. Sensor only with no display (MPC).
- b. Sensor with setpoint adjustment and override (MPC only).
- c. Sensor with setpoint adjustment and override, LCD display, status/fault indication (MPC).

NOTICE! This product specification document is furnished as a means to copy and paste ClimateMaster product information into project specification. It is not intended to be a complete list of product requirements. This document is an excerpt from the product submittal and must not be used without consulting the complete product submittal. For complete product installation and application requirements, please consult the complete product submittal. ClimateMaster is not responsible for misuse of this document or a failure to adequately review specific requirements in the product submittal.

Performance Sheet

SUBMITTAL DATA - S-I UNITS

Unit Designation: _____
Job Name: _____
Architect: _____
Engineer: _____
Contractor: _____

PERFORMANCE DATA

Cooling Capacity: _____ kW
EER: _____
Heating Capacity: _____ kW
COP: _____
Ambient Air Temp: _____ °C
Entering Water Temp (Clg): _____ °C
Entering Air Temp (Clg): _____ °C
Entering Water Temp (Htg): _____ °C
Entering Air Temp (Htg): _____ °C
Airflow: _____ l/s
Fan Speed or Motor/RPM/Turns: _____
Operating Weight: _____ (kg)

ELECTRICAL DATA

Power Supply: _____ Volts
_____ Phase _____ Hz
Minimum Circuit Ampacity: _____
Maximum Overcurrent Protection: _____

SUBMITTAL DATA - I-P UNITS

Unit Designation: _____
Job Name: _____
Architect: _____
Engineer: _____
Contractor: _____

PERFORMANCE DATA

Cooling Capacity: _____ Btuh
EER: _____
Heating Capacity: _____ Btuh
COP: _____
Ambient Air Temp: _____ °F
Entering Water Temp (Clg): _____ °F
Entering Air Temp (Clg): _____ °F
Entering Water Temp (Htg): _____ °F
Entering Air Temp (Htg): _____ °F
Airflow: _____ CFM
Fan Speed or Motor/RPM/Turns: _____
Operating Weight: _____ (lb)

ELECTRICAL DATA

Power Supply: _____ Volts
_____ Phase _____ Hz
Minimum Circuit Ampacity: _____
Maximum Overcurrent Protection: _____

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012

Revision History

Date:	Item:	Action:
01/24/23	All	Transitioned from DXM2 to DXM2.5 controls. Introduced new <u>AWW Wi-Fi cloud connected communicating thermostat</u>
09/22/21	All	Removed LON option, discontinued
08/25/21	Engineering Specs	Add drain pan insulation text
07/08/21	All	Introduced Polymer Drain Pans. Discontinued Painted Galvanized Pans.
02/20/20	Pages 47, 49-50	Updated Thermostat Info in Engineering Specs
	Pages 38-42	Updated Wiring Diagrams
	Pages 11-22	Changed HWG to HWC
02/18/20	All	Updated text
12/2/19	All	Updated for Rev. D, Pump Curves
01/19/19	Pages 25,36	High Head Variable Pump update
11/27/18	Electrical service disconnect	Added
11/7/18	Decoder	Updated water circuit options
11/1/16	Document Design Update	Updated
06/22/16	All	Updated Cabinet Photo and Description
03/15/16	Pages 44-46	Edit description of run test, vflow options and drain pan
07/31/15	Unit Features and Engineering Specifications	Edit Compressor Mount Text
06/09/15	Decoder - Page 10; Text - Page 36 & 37	Updated
05/12/15	Decoder - Page 10	Changed to Rev C
12/17/14	Table - Page 30	Updated
10/15/14	Performance Data Tables	Updated
09/30/14	Text Edit - Page 46	Updated
06/16/14	Page 45	Changed "rack" to "rails"
05/05/14	Page 12-23	Update table notes re. LWT
04/17/14	Page 44	Update text re. water pressure switch
11/27/13	TZ Corner Weights	Updated
11/07/13	ASHRAE/AHRI/ISO English Table	Updated
10/17/13	ASHRAE/AHRI/ISO English & Metric Tables	Updated
02/26/13	AHRI Table	Size 060 Updated
01/21/13	Modulating Valve Correction Tables	Update GPM, WPD size 060
09/27/12	Recommended Minimum Installation Clearances for Vertical Units *	Added
08/23/12	Unit Hanger Detail	Updated
08/21/12	Updated Performance Data - Sizes 024, 026	Miscellaneous Updates/ Additions
	Added Standard Head Pump Data	
	Updated ISO table size 060	
08/09/12	Unit Wiring Diagrams	Added/Updated
07/30/12	AHRI/ISO Tables	Updated
06/01/12	Created	



A NIBB GROUP MEMBER

7300 S.W. 44th Street
 Oklahoma City, OK 73179
 Phone: 405-745-6000
 climatemaster.com

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com. © ClimateMaster, Inc. All rights reserved 2012