



A **NIBE** GROUP MEMBER

CLIMATEMASTER® PACKAGE GAS ELECTRIC UNITS



RGEDZT Series 500

Nominal Sizes 7.5, 8.5, 10 & 12.5 Tons
Standard VFD and optional Hot Gas Reheat Technology
ASHRAE 90.1-2013 Compliant Models

RGEDZS Series 400

Nominal Sizes 7.5, 8.5, 10 & 12.5 Tons
Optional VFD and Hot Gas Reheat Technology
ASHRAE 90.1-2007 Compliant Models
ASHRAE 90.1-2013 Compliant Models

RGEDZR Series 300

Nominal Sizes 7.5, 8.5 & 10 Tons
ASHRAE 90.1-2007 Compliant Models

Manufactured for
ClimateMaster®
ClimateMaster.com



9001:2015



TABLE OF CONTENTS

Unit Features & Benefits	3-11
Model Number Identification	12
Options	13
Selection Procedure	14
General Data	
ZR Series	15
ZS Series	16
ZT Series	17
Heating Performance Data	19
Gross Systems Performance Data	
ZR Series	20-22
ZS Series	23-26
ZT Series	27-30
Reheat Gross Systems Performance Data	31-34
Airflow Performance Data	35-50
Electrical Data	
ZR Series	51-53
ZS Series	54-57
ZT Series	58-61
Dimensional Data	62-64
Field Installed Accessories	65-85
Guide Specifications	86-92
Limited Warranty	93



TIER COMPARISON

	Single-Stage Cooling	Two-Stage Cooling	2018 DOE Efficiency Standards Compliant	2023 DOE Efficiency Standards Compliant	VFD Technology	Reheat
RGEDZT		X	X	X	X	X (Optional)
RGEDZS		X	X		X (Optional)	X (Optional)
RGEDZR	X		X		Not Available	Not Available

RGED STANDARD FEATURES INCLUDE:

- Factory charged with R-410A HFC refrigerant
- Wired and run tested
- Scroll compressors with internal line break overload and high pressure protection
- Model RGEDZR has a single-stage compressor
- Models RGEDZS and RGEDZT have two-stage compressor
- Convertible airflow – vertical down flow or horizontal side flow
- Forkable base rails for easy handling and lifting
- Cooling operation up to 125°F ambient
- Two-stage gas heat input with direct spark ignition system, solid state furnace controls, and optimized induced draft combustion
- MicroChannel evaporator and condenser coil
- ServiceSmart package includes:
 - Quick-Change Flex-Fit Rack
 - Quick-Slide Blower Assembly
 - Quick-Clean Drain Pan
- Overflow condensate sensor
- Diagnostics with Dual 7-Segment LED Display to meet code compliance
- One-piece top cover and base pan with drawn supply and return opening
- Two-piece control door
- ¼ turn fasteners on filter access door
- Color-coded and labeled wiring
- External lockable gauge ports
- TXV refrigerant metering system
- Solid-core liquid line filter drier
- High pressure and low pressure/loss of charge protection with built-in Smart Logic
- Insulation encapsulated throughout entire unit
- High performance belt drive motor with variable pitch pulleys and quick adjust belt system
- Variable Frequency Drive (VFD) blower is standard on Model RGEDZT and optional on model RGEDZS
- New product footprint with matching connections
- Improved factory lead times
- For 7.5-10 ton units, MERV 8 (RXMF-M08A22020) & MERV 13 (RXMF-M13A22020) filters are available as an accessory
- For 12.5 ton units, MERV 8 (RXMF-M08A22520) & MERV 13 (RXMF-M13A22520) filters are available as an accessory

FACTORY INSTALLED OPTIONS:

- Louvered panels
- Hinged access doors
- Stainless steel heat exchanger (20 year warranty)
- Reheat Dehumidification System (RGEDZT and RGEDZS Series only)
- Low ambient/freeze stat
- Powered convenience outlet
- Non-powered convenience outlet
- Unfused disconnect


- Circuit breaker
- Economizer (Title 24 and ASHRAE 90.1 2013 compliant)
- Supply and return smoke detector
- Return smoke detector
- ElectroFin® E-Coat for Microchannel Condenser Coil Coating
- Direct Digital Control (DDC)
- Comfort Alert Phase-monitor Protection
- Vertical Economizer


FIELD INSTALLED ACCESSORIES:

Accessory	Model Number	Factory Installation Available?
Economizer w/Single Enthalpy (Downflow)	RXRD-01MDDAM3	Yes
Economizer w/Single Enthalpy (Horizontal)	RXRD-01MDHAM3	No
Economizer-w/Single Enthalpy (Downflow) DDC	RXRD-01MDDBM3	Yes
Economizer w/Single Enthalpy (Horizontal) DDC	RXRD-01MDHBM3	No
Dual Enthalpy Kit	RXXR-BV01	No
Dual Enthalpy Kit DDC	RXXR-BV02	No
Carbon Dioxide Sensor (Wall Mount)	RXXR-AR02	No
Power Exhaust	RXXR-CDF01C	No
Power Exhaust	RXXR-CDF01D	No
Manual Fresh Air Damper	RXXR-ADA1	No
Motorized Fresh Air Damper	RXXR-ADB1	No
Motorized Fresh Air Damper (DDC)	RXXR-ADC1	No
Roofcurb, 14"	RXKG-DDD14	No
Roofcurb, 24"	RXKG-DDD24	No
Roofcurb Adapter	RXXR-DDCAE	No
Roofcurb, 14" Welded	RXKG-SD14	No
Roofcurb, 24" Welded	RXKG-SD24	No
Concentric Diffuser 7.5/8.5 Ton Flush	RXRN-AEF2000	No
Concentric Diffuser 10.0 Ton Flush	RXRN-AEF3415	No
Concentric Diffuser 12.5 Ton Flush	RXRN-AEF3618	No
Concentric Diffuser 7.5/8.5 Ton Drop	RXRN-AED2000	No
Concentric Diffuser 10.0 Ton Drop	RXRN-AED3415	No
Concentric Diffuser 12.5 Ton Drop	RXRN-AED3618	No
Concentric Adapter 7.5/8.5 Ton Drop	RXMC-DD01	No
Concentric Adapter 10 Ton Drop	RXMC-DD02	No
Concentric Adapter 12.5 Ton Drop	RXMC-DD03	No
Outdoor Coil Louver Kit - GED-090/102/120	RXXR-ADD04A	Yes

Accessory	Model Number	Factory Installation Available?
Outdoor Coil Louver Kit - GED-150	RXXR-ADD04B	Yes
Unwired Convenience Outlet	RXXR-BN01	Yes
Unfused Service Disconnect	RXXR-BP01	Yes
Comfort Alert (1 Per Compressor)	RXXR-AZ02	Yes
BACnet Communication Card	RXXR-AY01	No
LonWorks Communication Card	RXXR-AY02	No
Room Humidity Sensor	RHC-ZNS4	No
Room Temperature and Relative Humidity Sensor	RHC-ZNS5	No
Low-Ambient Control Kit	RXRZ-A04	Yes
Freeze Stat Kit	RXXR-AM01	Yes
LP Conversion Kit	RXGJ-FP39	No
Flue Diverter	RXXR-DFG04	No
Variable Frequency Drive Kit* *See model number break down below	RXXR-AC02	No
	RXXR-AC03	No
	RXXR-AC05	No
	RXXR-AD02	No
	RXXR-AD03	No
	RXXR-AD05	No
	RXXR-CC02	No
	RXXR-CC03	No
	RXXR-CC05	No
	RXXR-CD02	No
	RXXR-CD03	No
	RXXR-CD05	No
MERV 8 Filter 7.5-10 Ton	RXMF-M08A22020	No
MERV 8 Filter 12.5 Ton	RXMF-M08A22520	No
MERV 13 Filter 7.5-10 Ton	RXMF-M13A22020	No
MERV 13 Filter 12.5 Ton	RXMF-M13A22520	No

*Compatible with 1st generation "B" series units

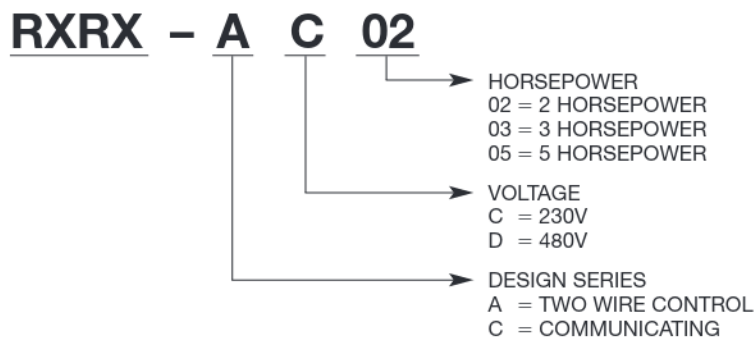

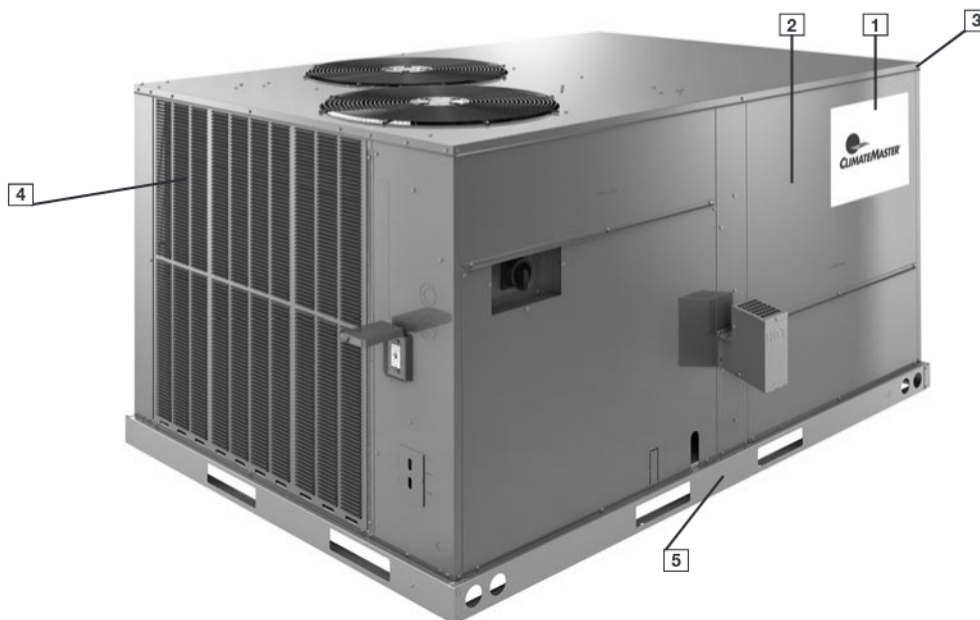

Cabinet and Foundation

Outwardly, the large ClimateMaster label (1) identifies the brand to the customer. The sheet-metal cabinet (2) uses 18-gauge material for structural components with an underlying coat of G90. To ensure the leak-proof integrity of these units, the design utilizes a one-piece top with a 1/8" drip lip (3) as well as gasket-protected panels and screws. The ClimateMaster hail guard (optional) (4) sets the standard for coil protection in the industry. Electro deposition, baked-on enamel that is tested to withstand a rigorous 1000-hour salt spray test, per ASTM B117.


Anything built to last must start with the right foundation. Following that model, the foundation is comprised of 14-gauge, commercial-grade, full perimeter base rails (5) that integrate fork slots and rigging holes to save set-up time on the job site.

Easy Installation

The line features a new footprint that simplifies the replacement process by eliminating the need for a new curb adapter and being able to match inlet, outlet and electrical connections of the most common/industry-standard configurations.


Base Pan

The base pan is stamped to form a 7/8" flange around the supply and return cover, which eliminates the worry of water entering the conditioned space (6). All insulation is secured with both adhesive and mechanical fasteners, and all edges are hidden.

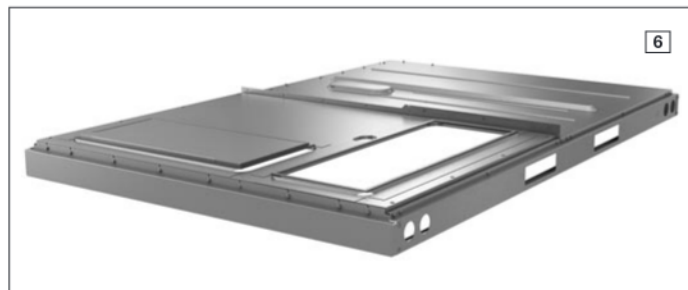

Drain Pan

The Quick-Clean Drain Pan (7) is made from a composite material that resists the growth of harmful bacteria. With both side and center drain options, the drain pan slides out completely for easy cleaning. It also features a standard overflow switch.

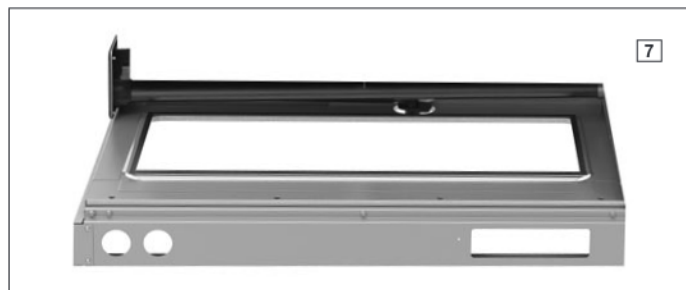

Test Standards


During development, each unit was tested to U.L. 1995, AHRI 340-360 as well as other ClimateMaster-required reliability tests. ClimateMaster adheres to stringent ISO 9002 quality procedures, and each unit bears the U.L. and AHRI certification labels located on the unit nameplate. Contractors can be assured that when a ClimateMaster package unit arrives at the job, it is ready to go with a factory charge and quality checks. Each unit also proudly displays the "Made in the USA" designation.

Easy Access

All major compartments are easily accessible from the front of the unit: the electrical compartment, blower compartment, heating section, and outdoor section. Each compartment has mechanical fasteners. Panels are permanently embossed with the compartment name (e.g. control/filter access, blower access, and electric heat access). The filter compartment is accessed through a large, mechanically fastened panel. Information is readily available on the outside of the panel, with a nameplate that contains the model and serial numbers, electrical data, and other important unit information. Hinged access is available as an option for the electrical, blower, and filter compartments.

Charging Charts, Wiring Diagrams, & Labels

The unit charging chart is located on the outside of the compressor access panel. Electrical wiring diagrams are found on the control box cover, which allows contractors to move them to more readable locations. The model and serial numbers are located on the right of the control box. Having this information on the inside means easier model identification for the life of the product. The production line quality test assurance label is also placed in this location ([8]).



Filter Rack


Located within the filter compartment, the Quick-Change Flex-Fit Rack ([9]) allows easy changeover between 2" and 4" standard size and readily available filters.



Blower Assembly


Removing three screws provides full access to the blower compartment. Inside, the Quick-Slide Blower Assembly ([10]) is incredibly easy to access and remove. This makes servicing internal components such as blower motor, TXV, and microchannel coil much easier. The entire assembly slides out by removing the 3/8" screws from the blower retention bracket. The adjustable motor pulley ([11]) can easily be adjusted by loosening the bolts on either side of the motor mount. Removing the bolts allows for easy removal of the blower pulley by pushing the blower assembly up to loosen the belt. Once the pulley is removed, the motor sheave can be adjusted to the desired number of turns, ranging from 0 to 6 turns open.

Where the demands for the job require high static, ClimateMaster offers drives that deliver nominal airflow up to 2" of static. By referring to the airflow performance tables listed in the installation instructions, proper static pressure and CFM requirements can be dialed in. The scroll housing ([12]) and blower scroll provide quiet and efficient airflow. The blower sheave is secured by an "H" bushing that firmly secures the pulley to the blower shaft, resulting in years of trouble-free operation. The "H" bushing allows for easy removal of the blower pulley from the shaft. This is an improvement from a set screw, which can score the shaft and create burrs that make blower-pulley removal difficult.

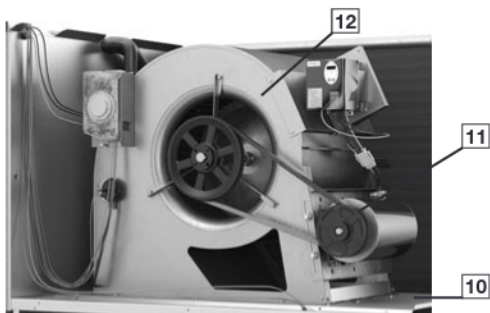


High and Low Pressure Switches & Freeze Stat

High pressure ([13]) and low pressure ([14]) switches are standard. They are located in the outdoor section along with the low-ambient control ([15]). The optional Freeze Stat ([16]) (standard on models with Direct Digital Control (DDC)), is clipped onto the suction line in the blower compartment. The low ambient control allows the compressor to operate down to 0 degrees ambient temperature by cycling the outdoor fans on high pressure. The high-pressure switch shuts off the compressors if pressures exceeding 610 PSIG are detected. The low-pressure switch shuts off the compressors if low pressure is detected due to loss of charge. Built-in Smart Logic reduces nuisance calls by only shutting off compressors after the third detection. The freeze stat protects the compressor if the evaporator coil gets too cold (below freezing) due to low airflow.

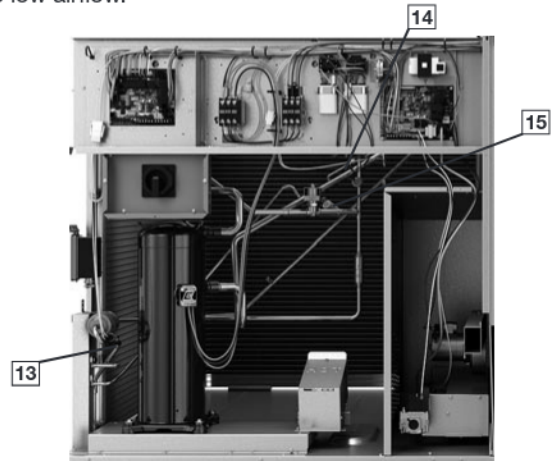


MicroChannel Evaporator & TXV

The Microchannel Evaporator ([17]) is accessible through the blower compartment, and through the filter rack, to simplify cleaning. The evaporator uses microchannel technology for maximum heat transfer, light weight, fewer manually brazed connections and reduced refrigerant charge. The TXV metering device maintains superheat over a wide range of varying temperatures optimizing unit performance for all conditions.

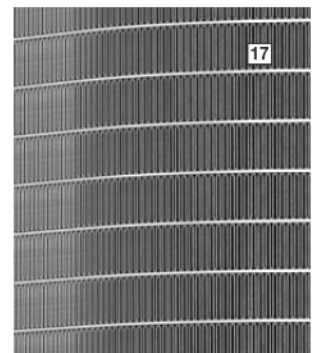


Control Box

Inside the control box (18), each electrical component is clearly labeled; that label matches the component to the wire diagram for ease of trouble shooting. All wiring is numbered on each end of the termination and is color-coded to match the wiring diagram. The integrated furnace control, incorporates the PlusOne Diagnostics: Dual 7-Segment LED Display (19) with easy-to-understand fault codes. The control transformer has a low voltage circuit breaker that trips if an electrical short occurs. There is a blower contactor and compressor contactor for each compressor.

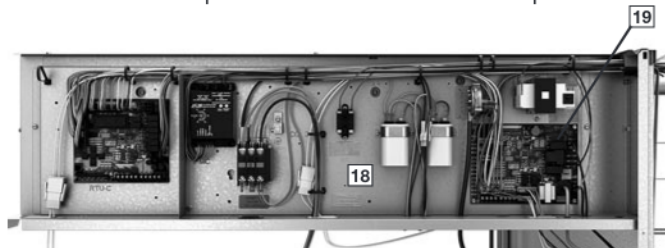

Direct Digital Control (DDC)

The optional Direct Digital Control (DDC) system consisting of a rooftop unit controller, temperature sensors, and pressure sensors, allows real-time monitoring and communication between rooftop units. The Rooftop Unit Controller (RTU-C) that is factory mounted and wired into the control panel. The RTU-C is a solid-state, microprocessor-based control board that provides flexible control and extensive diagnostics for all unit functions. The RTU-C, using proportional/integral control algorithms, performs specific unit functions that govern unit operation in response to zone conditions, system temperatures, system pressures, ambient conditions, and electrical inputs. The RTU-C features a 16 x 2 character LCD display and a five-button keypad for local configuration and direct diagnosis of the system (20). Features include a clogged filter switch (CFS), fan proving switch (FPS), return air temperature sensor (RAT), discharge air temperature sensor (DAT), and outdoor air temperature sensor (OAT). Freeze sensors (FS) are used in place of freeze stats to allow measurement of refrigerant suction line temperatures.

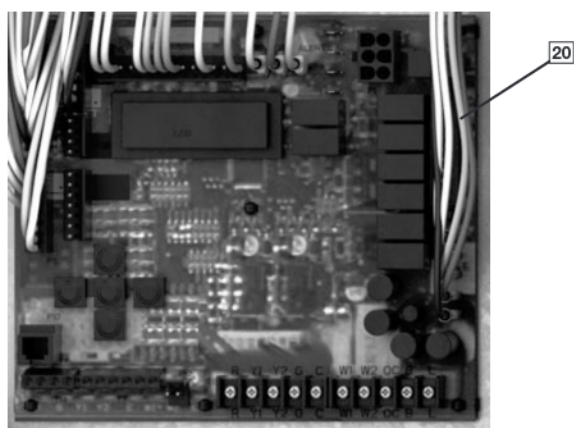


The RGED Gas Electric with the RTU-C is specifically designed to be applied in four distinct applications:

- 1. BACnet Communication** — The RGED is compatible with a third party building management system that supports the BACnet Application Specific Controller device profile, with the use of a field installed BACnet Communication Module. The BACnet Communication Module plugs onto the unit RTU-C controller and allows communication between the RTU-C and the BACnet MSTP network. A zone sensor, a BACnet network zone sensor, a BACnet thermostat, or DDC controller may be used to send the zone temperature or thermostat demands to the RTU-C. The BACnet Communication Module is compatible with MSTP EIA-485 daisy chain networks communicating at 38.4 bps. It is compatible with twisted pair, shielded cables.
- 2. LonWorks Communication** — The RGED is compatible with a third party building management system that supports the LonMark Space Comfort Controller (SCC) functional profile or LonMark Discharge Air Controller (DAC) functional profile. This is accomplished with a field installed LonMark communication module. The LonMark Communication Module plugs onto the RTU-C controller and allows communication between the RTU-C and a LonWorks network. A zone sensor, a LonTalk network zone sensor, or a LonTalk thermostat or DDC controller may be used to send the zone temperature or thermostat demands to the RTU-C. The LonMark Communication Module utilizes an FTT-10A free topology transceiver communicating at 78.8 kbps. It is compatible with Echelon qualified, twisted pair cable, Belden 8471, or NEMA Level 4 cables. The module can communicate up to 1640 feet with no repeater. The LonWorks limit of 64 nodes per segment applies to this device.
- 3. 24V Thermostat Compatibility** — The RGED is compatible with a programmable 24 volt thermostat. Connections are made via conventional thermostat screw terminals. Extensive unit status and diagnostics are displayed on the LCD screen of the RTU-C.
- 4. Zone Sensor Compatibility** — The RGED is compatible with a zone sensor and a mechanical or solid state time clock connected to the RTU-C. Extensive unit status and diagnostics are displayed on the LCD screen of the RTU-C.

ComfortAlert®

A factory or field installed Comfort Alert® (21) module is available for power phase-monitoring protection and additional compressor diagnostics. The alarms can be displayed on the RTU-C display, through the (BAS) network, or connected to the "L-Terminal" of a thermostat for notification.

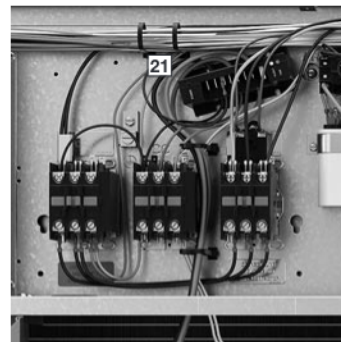

Variable Frequency Drive

The supply fan Variable Frequency Drive (VFD) (22) optimizes energy usage year round by providing a lower speed for first stage cooling operation, improving IEER's over the conventional constant fan system. Operating in the constant fan mode at the reduced speed can use as little as 1/5 of the energy of a conventional constant fan system. Also, by operating at a lower speed on first stage cooling, up to 126% more moisture is removed, improving comfort during low load operation. VFD comes standard in ZT models and is a factory or field installed option in ZS models. The VFD supply fan factory option meets California Title 24 and ASHRAE 90.1-2016 requirements for multi blower speed control. VFD also ramps up to the desired speed, reducing stress on the supply fan components and noise from a sudden inrush of air. Because the airflow is cut in half during first stage cooling and constant fan operation, noise is much less during these modes of operation.




Convenience Outlet, Disconnect, & Circuit Breaker

For added convenience in the field, factory-installed options of powered and non-powered convenience outlet (23), disconnect (24) and circuit breakers are available. Low and high voltage can enter from the side or through the base. Low-voltage connections are made through the low-voltage terminal strip. For ease of access, the U.L.-required low voltage barrier can be temporarily removed for low-voltage termination and then reinstalled. The high-voltage connection is terminated at the number 1 compressor contactor. The suggested mounting for the field-installed disconnect or circuit breaker is on the exterior side of the electrical control box.



External Lockable Gauge Ports


To the right left of the compressor compartment are the externally mounted lockable gauge ports. They are permanently identified by embossed lettering that identifies the compressor circuit, high pressure connection, (25) and low pressure connection (26). Because the gauge ports are mounted externally, an accurate diagnostic of system operation can be performed without removing access panels. Brass caps on the Schrader fitting ensure the gauge parts are leak proof.



Furnace & Gas Heat Exchanger

The furnace compartment contains the latest technology on the market. Each furnace is equipped with a two-stage gas valve (27) to provide two stages of gas heat input. The first stage operates at 70% of the second stage (full fire), 81% steady state efficiency is maintained. Stainless steel heat exchangers can be factory installed for those applications that have high fresh-air requirements or in applications with corrosive environments. The direct spark igniter (28) ensures reliable ignition in the most adverse conditions. This is coupled with remote flame sensor (29) so the flame is carried across the entire length of the burner assembly. Gas supply can be routed from the side or up through the base. Each furnace has the following safety devices to ensure consistent and reliable operation after ignition:

- Stainless steel heat exchanger warranty increases from 10 years to 20 years.
- Pressures switches to ensure adequate combustion airflow before ignition.
- Rollout switches to prevent obstruction or cracks in the heat exchanger.
- A limit device to protect the furnace from over-temperature problems.

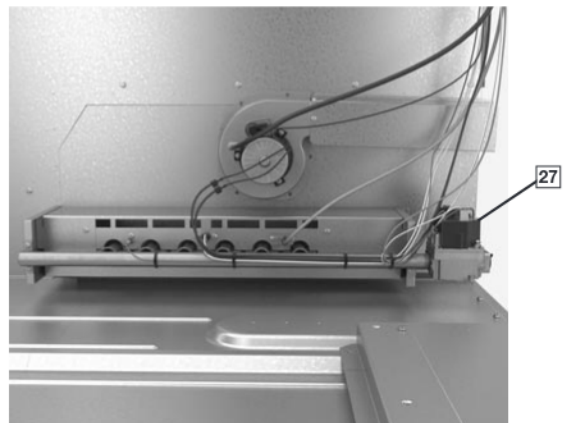

Compressor

The compressor compartment houses the heart-beat of the unit. The scroll compressor (30) is known for its long life and for reliable, quiet, and efficient operation. The suction and discharge lines are designed with shock loops (31) to absorb the strain and stress that the starting torque, steady state operation, and shut-down cycle impose on the refrigerant tubing. ZS and ZT units have two stages of efficient cooling operation in which the first stage is approximately 50% of second stage. Each unit comes standard with a filter dryer.




Condenser Fans

The condenser fan motors (32) can easily be accessed and maintained through the top of the unit. A down-mount fan provides corrosion protection and easy removal. The polarized plug connection allows the motor to be changed quickly and eliminates the need to snake wires through the unit.



MicroChannel Condenser Technology

The outdoor coil uses the latest microchannel technology (33) for the most effective method of heat transfer. The outdoor coil is protected by optional louvered panels, which allow unobstructed airflow while protecting the unit from both the environment and vandalism.

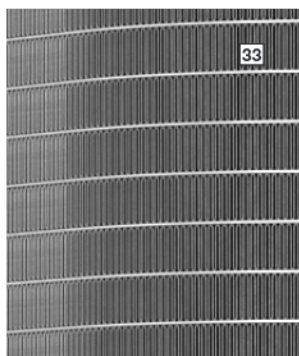


Coil Coating

Every unit offers the option of factory-applied ElectroFin® E-Coat condenser coating (34) that delivers superior corrosion resistance for outdoor coils to operate in the harshest of environments.



Economizer and Dampers

Each unit is designed for both down flow or horizontal applications (35) for job configuration flexibility. The return air compartment can also contain an economizer. Each unit is pre-wired for the economizer to allow quick, plug-in installation. Available as a factory-installed option, the economizer provides free cooling when outdoor conditions are suitable and also provides fresh air to meet local requirements. It comes standard with single enthalpy controls, which can be upgraded to dual enthalpy easily in the field. The direct drive actuator combined with gear drive dampers has eliminated the need for linkage adjustment in the field. The economizer control has a minimum position set point, an outdoor-air set point, a mixed-air set point, and a CO₂ set point. Barometric relief is standard on all economizers.

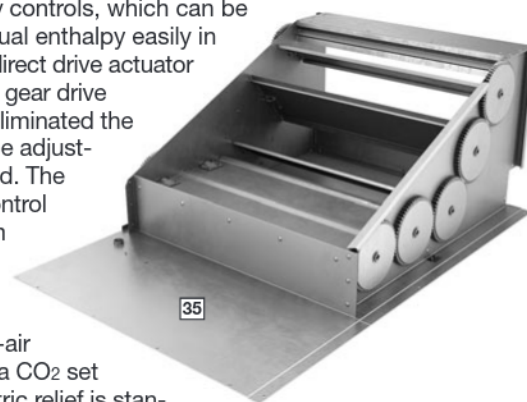

Power Exhaust is easily field-installed. The power exhaust is housed in the barometric relief opening and is easily slipped in with a plugin assembly. The wire harness to the economizer also has accommodations for a smoke detector.

The damper minimum position, actual damper position, power exhaust on/off set point, mixed air temperature limit set point, and Demand Controlled Ventilation (DCV) set point can be read and adjusted at the unit controller display or remotely through a network connection. The Space CO₂ level, mixed air temperature, and Economizer Status (free cooling available, single or dual enthalpy) can be read at the unit controller display or remotely through a network connection. Economizer faults will trigger a network alarm and can be read at the unit controller display or remotely through a network connection.

Roofcurb

The ClimateMaster roofcurb (36) is made for tool-less assembly at the jobsite by engaging tabs in slots of adjacent curb sides, which makes the assembly process quick and easy.



REHEAT SYSTEM FEATURES

Reheat is a ClimateMaster exclusive dehumidification package unit solution. It delivers maximum humidity control without compromising desired temperature set point for a high degree of comfort. Reheat maintains humidity levels at a desired set point when there's little or no demand for air conditioning. The Reheat rooftop unit is controlled by a thermostat and humidistat. The thermostat takes priority on single-stage system. When the thermostat is activated by temperatures that exceed it set point, Reheat operates like a standard rooftop unit. It can operate on first stage cooling when demand is low or at full capacity when air conditioning load is high. Unlike other rooftop or reheat units, Reheat is uniquely designed so the VFD will operate at a low speed, increasing moisture removal during first-stage cooling operation. This provides initial defense for controlling humidity. When temperature is desirable but humidity exceeds the humidistat set point, the Reheat rooftop unit initiates a dehumidification cycle using a combination of hot gas and sub-cooled liquid reheat and the VFD operates at low speed. During this cycle, the Reheat rooftop unit delivers dry, neutral air. On a two-stage system, it is possible for both a thermostat and humidistat to register readings above set point. Under this condition, the system runs in the high stage dehumidification cycle, and the VFD operates on high speed. This provides dry conditioned air.

Figure 1 shows the refrigerant path during the normal cooling mode. The liquid refrigerant leaves the TXV with the sudden pressure drop causing the liquid to expand to a vapor and absorbing the heat from the supply air going through the evaporator coil. The refrigerant vapor then travels to the compressor where it is elevated to a higher pressure and temperature. The superheated refrigerant vapor next carries the heat to the outside coil where the heat is then rejected and the refrigerant condenses into a subcooled liquid where the process repeats itself.

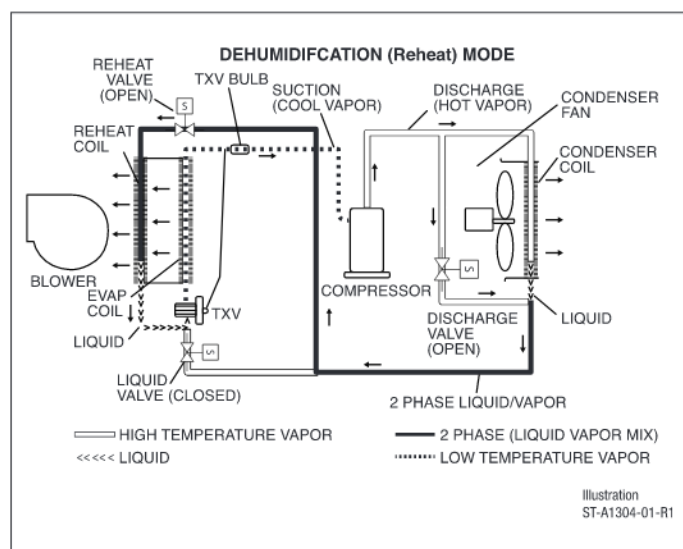
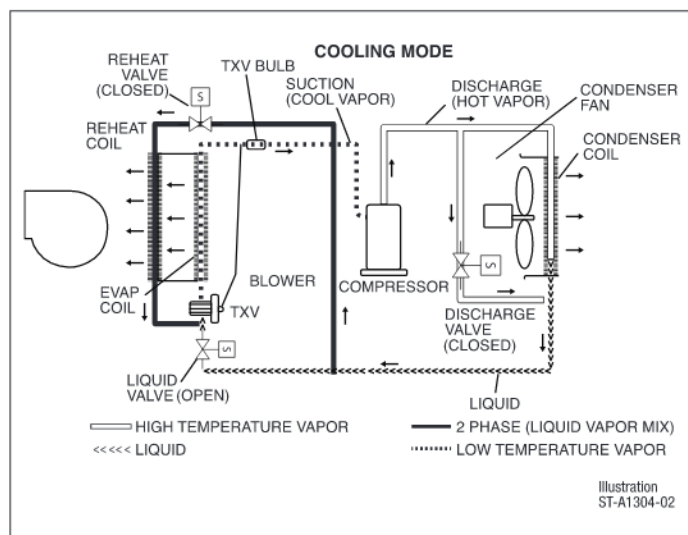


Figure 2 shows the refrigerant path during the reheat mode. When the reheat cycle is energized by the RTU-C, the reheat solenoid valve, upstream of the reheat coil opens. The liquid solenoid valve ahead of the TXV, closes. The discharge solenoid valve, in the compressor discharge line, opens. The liquid refrigerant leaves the TXV with the sudden pressure drop causing the liquid to expand to a vapor and absorbing the heat from the supply air going through the evaporator coil. The refrigerant vapor then travels to the compressor where it is elevated to a higher pressure and temperature. The refrigerant next carries the heat to a parallel path between the outside condenser coil and a bypass circuit. Some of the heat is rejected outdoors. The ratio of heat rejected outdoors versus indoors is controlled by an outdoor fan motor controller (OFMC) that monitors the two-phase temperature and varies the fan speed. This 2-phase refrigerant vapor is then sent to the reheat coil. As the refrigerant travels through the reheat coil it condenses into a subcooled liquid where the process repeats itself.

R	GE	D	ZT	090	A	C	A	15	2	A	A	***
1	23	4	56	789	10	11	12	13 14	15	16	17	18 19 20

1—Brand

R = ClimateMaster

2, 3—Unit Type

GE = Package Gas Electric

4—Cabinet Type

D = Medium Commercial

5, 6—Series

ZT¹ = Tier 1

ZS² = Tier 2

ZR³ = Tier 3

7, 8, 9—Capacity

090 = 7.5 ton

102 = 8.5 ton

120 = 10 ton

150 = 12.5 ton⁴

10—Major series

A

11—Voltage

C = 3 phase 208-230/60

D = 3 phase 460/60

Y = 3 phase 575/60

12—Drive

A = belt low static

B = belt med static

C = belt high static

F = belt VFD low static

G = belt VFD med static

H = belt VFD high static

13, 14—Heat Capacity

15 = 150k

20 = 205k⁵

22 = 225k⁶

15—Heat Configuration

2 = 2 stage

B = 2 stage Stainless

16—Control

A = Non communicating

B = Comfort Alert/Phase Monitor

C = Direct Digital Control (DDC)

D = Direct Digital Control (DDC)
& Comfort Alert

17—Minor series

A

18, 19, 20—Option Code

See next page

Notes:

1. ZT Series – can only select VFD drives (F, G, H) in character 12
2. ZS Series – can select any of the drive options in character 12
3. ZR Series – can only select standard drives (A, B, C) in character 12
4. ZR Series not available for 12.5 ton models
5. 205k heat capacity can only be selected for 7.5 ton models
6. 225k heat capacity can only be selected for 8.5 to 12.5 ton models

FACTORY INSTALLED OPTION CODES FOR RGED (7.5 TO 12.5 TON)

18					19					20				
LV = Louver protection					LF = Low Ambient / Freeze Stat					EC = Economizer				
RH = Reheat ¹										SS = Supply and Return Smoke Detector				
HA = Hinged Access					NP = Non-powered Convenience Outlet					RS = Return Smoke Detector				
CC ² = Coil Coating					DC = Disconnect Switch									
Option code character highlighted below					Option code character highlighted below					Option code character highlighted below				
A	None				A	None				0	None			
B	LV				B	LF				1	EC			
C	HA				C	NP				2	RS			
D	LV	HA			D	LF	NP			3	EC	RS		
E	LV	CC			E	DC				4	SS	RS		
F	LV	HA	CC		F	LF	DC			5	EC	SS	RS	
N	RH				G									
P	LV	RH			H	NP	DC							
Q	RH	HA			J									
R	LV	RH	CC		K	LF	NP	DC						
S	LV	RH	HA		L									
T	LV	RH	HA	CC	M									
					N									
					P									
					Q									
					R									

¹Reheat option only available on units with F, G or H drives (VFD) and "C" or "D" control. Low ambient freeze-stat included on all reheat models; low ambient option is not selectable for this unit.

²CC-requires LV (louver protection)

Instructions for Factory Installed Option(s) Selection

Note: Three characters following the model number will be utilized to designate a factory-installed option or combination of options. If no factory option(s) is required, "AAO" follows the model number.

- **Step 1:** In the table above, based on the desired features, choose option code character from highlighted options on the left side under the number 18. For example, the option code character "E" has Louver protection and Coil Coating.
- **Step 2:** In the table above, based on the desired features, choose option code character from highlighted options on the left side under the number 19. For example, the option code character "F" has Low Ambient / Freeze Stat and Disconnect switch.
- **Step 3:** In the table above, based on the desired features, choose option code character from highlighted options on the left side under the number 20. For example, the option code character "3" has Economizer and Return Smoke.
- The resulting option code from examples above is: "EF3"
- **Step 4:** Add your option code selection to the end of model number

◦ Example: RGEDZR090ACC152AA EF3 = RGEDZR090ACC152AAEF3

Base model Option code = Model number with option code

To select an RGEDZ Cooling and Heating unit to meet a job requirement, follow this procedure, with example, using data supplied in this specification sheet.

1. DETERMINE COOLING AND HEATING REQUIREMENTS AND SPECIFIC OPERATING CONDITIONS FROM PLANS AND SPECS.

Example:

Voltage—	208/240V – 3 Phase
Total cooling capacity—	105,000 BTUH [30.77 kW]
Sensible cooling capacity—	90,000 BTUH [26.38 kW]
Heating capacity—	159,000 BTUH [46.60 kW]
*Condenser Entering Air—	95°F [35°C] DB
*Evaporator Mixed Air Entering—	65°F [18°C] WB; 78°F [26°C] DB
*Indoor Air Flow (vertical)—	3750 CFM [1770 L/s]
*External Static Pressure—	.70 in. WG

2. SELECT UNIT TO MEET COOLING REQUIREMENTS.

Since total cooling is within the range of a nominal 10 ton [35.2 kW] unit, enter cooling performance table at 95°F [35°C] DB condenser inlet air. Interpolate between 63°F [2°C] and 67°F [19°C] to determine total and sensible capacity and power input for 65°F [18°C] WB evap inlet air at 3750 CFM [1770 L/s] indoor air flow (table basis):

Total Capacity = 120,060 BTUH [35.2 kW]
Sensible Capacity = 101,350 BTUH [29.7 kW]
Power Input (Compressor and Cond. Fans) = 8,950 watts

Use formula $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$ in note ① to determine sensible capacity at 80°F [26.7°C] DB evaporator entering air:

Sensible Capacity = 101,350 BTUH [29.7 kW]

3. CORRECT CAPACITIES OF STEP 2 FOR ACTUAL AIR FLOW.

Select factors from airflow correction table at 3700 & 3800 CFM, average data [1746.2 & 1793.4 L/s] and apply to data obtained in step 2 to obtain gross capacity:

Total Capacity, $120,060 \times .99 = 118,859$ BTUH [33.6 kW]
Sensible Capacity, $101,350 \times .95 = 96,283$ BTUH [28.2 kW]
Power Input $8,950 \times 1.0 = 8,950$ Watts

These are Gross Capacities, not corrected for blower motor heat or power.

4. DETERMINE BLOWER SPEED AND WATTS TO MEET SYSTEM DESIGN.

Enter Indoor Blower performance table at 3700 & 3800 CFM, average data [1746.2 & 1793.4 L/s]. Total ESP (external static pressure) per the spec of .70 in. includes the system duct and grilles. Add from the table “Component Air Resistance,” 0.08 for wet coil, for a total selection static pressure of .780 (.8) inches of water, and determine:

RPM = 835
WATTS = 1722
DRIVE = A (belt drive, low static)

5. CALCULATE INDOOR BLOWER BTUH HEAT EFFECT FROM MOTOR WATTS, STEP 4.

$$\text{BTUH} = 1,722 \times 3.412 = 5,875$$

6. CALCULATE NET COOLING CAPACITIES, EQUAL TO GROSS CAPACITY, STEP 3, MINUS INDOOR BLOWER MOTOR HEAT.

$$\text{Net Total Capacity} = 118,859 \text{ (step 3)} - 5,875 \text{ (step 5)} = 112,984 \text{ BTUH [33.1 kW]}$$

$$\text{Net Sensible Capacity} = 96,283 \text{ (step 3)} - 5,875 \text{ (step 5)} = 90,408 \text{ BTUH [26.5 kW]}$$

7. CALCULATE UNIT INPUT AND JOB EER.

$$\text{Total Power Input} = 8,950 \text{ (step 3)} + 5,875 \text{ (step 4)} = 10,672 \text{ Watts}$$

$$\text{EER} = \frac{\text{Net Total BTUH [kW] (step 6)}}{\text{Power Input, Watts (above)}} = \frac{112,984}{10,672} = 10.58$$

8. SELECT UNIT HEATING CAPACITY.

From Physical Data Table read that gas heating output (input rating x efficiency) is:

$$\text{Heating Capacity} = 159,000 \text{ BTUH [52.45 kW]}$$

Choose Model RGEDZS120ACA222AA

*NOTE: These operating conditions are typical of a commercial application in a 95°F/79°F [35°C/26°C] design area with indoor design of 76°F [24°C] DB and 50% RH and 10% ventilation air, with the unit roof mounted and centered on the zone it conditions by ducts.

[] Designates Metric Conversions

NOM. SIZES 7.5-12.5 TONS [26.4-44.0 kW] ASHRAE 90.1-2007 COMPLIANT MODELS

Model RGEDZR - Series	ZR090	ZR102	ZR120
Cooling Performance¹			
Gross Cooling Capacity Btu [kW]	88,000 [25.78]	99,000 [29.01]	118,000 [34.57]
EER/SEER ²	11/NA	11/NA	11/NA
Nominal CFM/AHRI Rated CFM [L/s]	3000/3175 [1416/1498]	3400/3200 [1604/1510]	4000/3480 [1888/1642]
AHRI Net Cooling Capacity Btu [kW]	85,000 [24.9]	96,000 [28.13]	114,000 [33.4]
Net Sensible Capacity Btu [kW]	62,700 [18.37]	68,300 [20.01]	80,600 [23.62]
Net Latent Capacity Btu [kW]	22,300 [6.53]	27,700 [8.12]	33,400 [9.79]
IEER ³	12.7	12.7	12.7
Net System Power kW	7.53	8.51	9.86
Compressor			
No./Type	1/Scroll	1/Scroll	1/Scroll
No. Stages	1	1	1
Outdoor Sound Rating (dB)⁴			
	88	88	88
Outdoor Coil - Fin Type			
Tube Type	Louvered	Louvered	Louvered
MicroChannel Depth in. [mm]	MicroChannel	MicroChannel	MicroChannel
Face Area sq. ft. [sq. m]	0.71 [18]	0.81 [20.6]	1 [25.4]
Rows / FPI [FPcm]	25.4 [2.36]	25.6 [2.38]	25.6 [2.38]
	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Indoor Coil - Fin Type			
Tube Type	Louvered	Louvered	Louvered
MicroChannel Depth in. [mm]	MicroChannel	MicroChannel	MicroChannel
Face Area sq. ft. [sq. m]	1 [25.4]	1.26 [32]	1.26 [32]
Rows / FPI [FPcm]	11 [1.02]	10.9 [1.01]	10.9 [1.01]
	1 / 20 [8]	1 / 20 [8]	1 / 20 [8]
Refrigerant Control	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	TX Valves	TX Valves	TX Valves
	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
Outdoor Fan - Type			
	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1
CFM [L/s]	8000 [3775]	8000 [3775]	8500 [4011]
No. Motors/HP	2 at 1/5 HP	2 at 1/5 HP	2 at 1/3 HP
Motor RPM	820	820	1075
Indoor Fan - Type			
	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Single	Single	Single
No. Motors	1	1	1
Motor RPM	1725	1725	1725
Motor Frame Size	56	56	56
Filter - Type			
	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(4)2x20x20 [51x508x508]	(4)2x20x20 [51x508x508]	(4)2x20x20 [51x508x508]
Refrigerant Charge Oz. [g]			
	100 [2835]	117 [3317]	136 [3856]
Weights			
Net Weight lbs. [kg]	839 [381]	868 [394]	896 [406]
Ship Weight lbs. [kg]	878 [398]	907 [411]	935 [424]

See Page 18 for Notes.

[] Designates Metric Conversions

NOM. SIZES 7.5-12.5 TONS [26.4-44.0 kW] ASHRAE 90.1-2007* COMPLIANT MODELS

Model RGEDZS - Series	ZS090	ZS102	ZS120A	ZS150
Cooling Performance¹				
Gross Cooling Capacity Btu [kW]	88,000 [25.78]	99,000 [29.01]	118,000 [34.57]	148,000 [43.36]
EER/SEER ²	11/NA	11/NA	11/NA	10.8/NA
Nominal CFM/AHRI Rated CFM [L/s]	3000/3175 [1416/1498]	3400/3225 [1604/1522]	4000/3480 [1888/1642]	5000/3750 [2360/1770]
AHRI Net Cooling Capacity Btu [kW]	85,000 [24.9]	96,000 [28.13]	114,000 [33.4]	142,000 [41.61]
Net Sensible Capacity Btu [kW]	62,700 [18.37]	68,300 [20.01]	79,600 [23.32]	98,600 [28.89]
Net Latent Capacity Btu [kW]	22,300 [6.53]	27,700 [8.12]	34,400 [10.08]	43,400 [12.72]
IEER ³	12.7	12.7	12.7	12.2
Net System Power kW	7.35	7.35	9.83	13.69
Compressor				
No./Type	1/Scroll	1/Scroll	1/Scroll	2/Tandem Scroll
No. Stages	2	2	2	2
Outdoor Sound Rating (dB)⁴				
	88	88	88	88
Outdoor Coil - Fin Type				
Tube Type	Louvered	Louvered	Louvered	Louvered
MicroChannel Depth in. [mm]	MicroChannel	MicroChannel	MicroChannel	MicroChannel
Face Area sq. ft. [sq. m]	0.71 [18]	0.81 [20.6]	1 [25.4]	1 [25.4]
Rows / FPI [FPcm]	25.4 [2.36]	25.6 [2.38]	25.6 [2.38]	31.5 [2.93]
	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Indoor Coil - Fin Type				
Tube Type	Louvered	Louvered	Louvered	Louvered
MicroChannel Depth in. [mm]	MicroChannel	MicroChannel	MicroChannel	MicroChannel
Face Area sq. ft. [sq. m]	1 [25.4]	1.26 [32]	1.26 [32]	1 [25.4]
Rows / FPI [FPcm]	11 [1.02]	10.9 [1.01]	10.9 [1.01]	13.8 [1.28]
	1 / 20 [8]	1 / 20 [8]	1 / 20 [8]	2 / 18 [7]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
Outdoor Fan - Type				
Propeller	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	8000 [3775]	8000 [3775]	8500 [4011]	9000 [4247]
No. Motors/HP	2 at 1/5 HP	2 at 1/5 HP	2 at 1/3 HP	2 at 3/4 HP
Motor RPM	820	820	1075	1100
Indoor Fan - Type				
FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Single	Single	Single	Single
No. Motors	1	1	1	1
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
Filter - Type				
Disposable	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(4)2x20x20 [51x508x508]	(4)2x20x20 [51x508x508]	(4)2x20x20 [51x508x508]	(4)2x20x25 [51x508x635]
Refrigerant Charge Oz. [g]				
	100 [2835]	117 [3317]	136 [3856]	186 [5273]
Weights				
Net Weight lbs. [kg]	839 [381]	868 [394]	896 [406]	1094 [496]
Ship Weight lbs. [kg]	878 [398]	907 [411]	935 [424]	1133 [514]

See Page 18 for Notes.
*2013 with optional VFD

[] Designates Metric Conversions

NOM. SIZES 7.5-12.5 TONS [26.4-44.0 kW] ASHRAE 90.1-2013 COMPLIANT MODELS

Model RGEDZT - Series	ZT090	ZT102	ZT120	ZT150
Cooling Performance¹				
Gross Cooling Capacity Btu [kW]	88,000 [25.78]	99,000 [29.01]	118,000 [34.57]	148,000 [43.36]
EER/SEER ²	11/NA	11/NA	11/NA	10.8/NA
Nominal CFM/AHRI Rated CFM [L/s]	3000/3175 [1416/1498]	3400/3225 [1604/1522]	4000/3480 [1888/1642]	5000/3750 [2360/1770]
AHRI Net Cooling Capacity Btu [kW]	85,000 [24.9]	96,000 [28.13]	114,000 [33.4]	142,000 [41.61]
Net Sensible Capacity Btu [kW]	62,700 [18.37]	68,300 [20.01]	79,600 [23.32]	98,600 [28.89]
Net Latent Capacity Btu [kW]	22,300 [6.53]	27,700 [8.12]	34,400 [10.08]	43,400 [12.72]
IEER ³	14.6	14.6	14.6	14
Net System Power kW	7.35	7.35	9.83	13.69
Compressor				
No./Type	1/Scroll	1/Scroll	1/Scroll	2/Tandem Scroll
No. Stages	2	2	2	2
Outdoor Sound Rating (dB)⁴				
	88	88	88	88
Outdoor Coil - Fin Type				
Tube Type	Louvered	Louvered	Louvered	Louvered
MicroChannel Depth in. [mm]	MicroChannel	MicroChannel	MicroChannel	MicroChannel
Face Area sq. ft. [sq. m]	0.71 [18]	0.81 [20.6]	1 [25.4]	1 [25.4]
Rows / FPI [FPcm]	25.4 [2.36]	25.6 [2.38]	25.6 [2.38]	31.5 [2.93]
	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Indoor Coil - Fin Type				
Tube Type	Louvered	Louvered	Louvered	Louvered
MicroChannel Depth in. [mm]	MicroChannel	MicroChannel	MicroChannel	MicroChannel
Face Area sq. ft. [sq. m]	1 [25.4]	1.26 [32]	1.26 [32]	1 [25.4]
Rows / FPI [FPcm]	11 [1.02]	10.9 [1.01]	10.9 [1.01]	13.8 [1.28]
	1 / 20 [8]	1 / 20 [8]	1 / 20 [8]	2 / 18 [7]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]	1/0.75 [19.05]
Outdoor Fan - Type				
Propeller	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	8000 [3775]	8000 [3775]	8500 [4011]	9000 [4247]
No. Motors/HP	2 at 1/5 HP	2 at 1/5 HP	2 at 1/3 HP	2 at 3/4 HP
Motor RPM	820	820	1075	1100
Indoor Fan - Type				
FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Single	Single	Single	Single
No. Motors	1	1	1	1
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	184
Filter - Type				
Disposable	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(4)2x20x20 [51x508x508]	(4)2x20x20 [51x508x508]	(4)2x20x20 [51x508x508]	(4)2x20x25 [51x508x635]
Refrigerant Charge Oz. [g]				
	117 [3317]	136 [3856]	186 [5273]	
Weights				
Net Weight lbs. [kg]	839 [381]	868 [394]	896 [406]	1094 [496]
Ship Weight lbs. [kg]	878 [398]	907 [411]	935 [424]	1133 [514]

See Page 18 for Notes.

[] Designates Metric Conversions

NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to $\pm 20\%$ of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 340/360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Integrated Energy Efficiency Ratio (IEER) is rated in accordance with AHRI Standard 340/360.
4. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

RGED** HEATING PERFORMANCE

Model RGED**	Heating Input BTU [kW] (1 st Stage / 2 nd Stage)	Heating Output BTU [kW] (1 st Stage / 2 nd Stage)	Temperature Rise Range °F [°C] (1 st Stage / 2 nd Stage)	Steady State Efficiency (%)	No. Burners	No. Stages	Gas Connection Pipe Size in. [mm]
090A**15**A	105,000/150,000 [30.76/43.95]	85,050/121,500 [24.92/35.6]	10-40 [5.6-22.2] / 25-55 [13.9-30.6]	81	6	2	0.75 [19]
090A**20**A	143,000/205,000 [42.06/60.06]	116,200/166,050 [34.07/48.66]	20-50 [11.1-27.8] / 35-65 [19.4-36.1]	81	9	2	0.75 [19]
102A**15**A	105,000/150,000 [30.76/43.95]	85,050/121,500 [24.92/35.6]	5-35 [2.8-19.4] / 15-45 [8.3-25]	81	6	2	0.75 [19]
102A**22**A	157,500/225,000 [46.16/65.92]	127,500/182,250 [37.39/53.4]	15-45 [8.3-25] / 35-65 [19.4-36.1]	81	9	2	0.75 [19]
120A**15**A	105,000/150,000 [30.76/43.95]	85,050/121,500 [24.92/35.6]	10-40 [5.6-22.2] / 20-50 [11.1-27.8]	81	6	2	0.75 [19]
120A**22**A	157,500/225,000 [46.16/65.92]	127,500/182,250 [37.39/53.4]	15-45 [8.3-25] / 35-65 [19.4-36.1]	81	9	2	0.75 [19]
150A**15**A	105,000/150,000 [30.76/43.95]	85,050/121,500 [24.92/35.6]	5-35 [2.8-19.4] / 15-45 [8.3-25]	81	6	2	0.75 [19]
150A**22**A	157,500/225,000 [46.16/65.92]	127,500/182,250 [37.39/53.4]	10-40 [5.6-22.2] / 25-55 [13.9-30.6]	81	9	2	0.75 [19]

Heating Performance limit settings and rating data were established and approved under laboratory test conditions using American National Standard Institute standards. Ratings shown are for elevations up to 2000 feet. For elevations above 2000 feet, ratings should be reduced at the rate of 4% for each 1000 feet above sea level.

COOLING PERFORMANCE DATA — RGEDZR102A

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①															
WBE		67°F [19.4°C]				63°F [17.2°C]				61°F [16.1°C]				59°F [15.0°C]	
CFM [L/s]		4100 [1935]		2700 [1274]		3200 [1510]		4100 [1935]		3200 [1510]		4100 [1935]		3200 [1510]	
DR ①		0.21		0.14		0.17		0.21		0.14		0.21		0.14	
75 [23.9]	Total BTUH [kW]	129.7 [38.0]		119.9 [35.1]		116.6 [34.2]		118.1 [34.6]		109.2 [32.0]		117.3 [34.4]		108.4 [31.8]	
	Sens BTUH [kW]	75.5 [22.1]		61.8 [18.1]		80.0 [23.4]		104.2 [30.5]		92.1 [27.0]		110.3 [32.3]		90.4 [26.5]	
	Power	6.2		5.9		6.0		6.0		5.9		6.0		5.8	
80 [26.7]	Total BTUH [kW]	125.5 [36.8]		119.4 [35.0]		112.5 [33.0]		113.9 [33.4]		108.3 [31.7]		113.1 [33.1]		107.6 [31.5]	
	Sens BTUH [kW]	73.3 [21.5]		64.8 [19.0]		78.2 [22.9]		102.1 [29.9]		90.3 [26.5]		108.2 [31.7]		95.6 [28.0]	
	Power	6.5		6.4		6.3		6.4		6.2		6.4		6.1	
85 [29.4]	Total BTUH [kW]	121.2 [35.5]		115.3 [33.8]		108.5 [31.8]		109.6 [32.1]		104.3 [30.6]		108.8 [31.9]		100.6 [29.5]	
	Sens BTUH [kW]	71.2 [20.9]		62.9 [18.4]		76.3 [22.3]		100.0 [29.3]		88.4 [25.9]		106.0 [31.1]		93.7 [27.5]	
	Power	6.9		6.7		6.7		6.8		6.6		6.7		6.5	
90 [32.2]	Total BTUH [kW]	117.0 [34.3]		111.3 [32.6]		104.4 [30.6]		105.4 [30.9]		100.2 [29.4]		104.6 [30.6]		96.7 [28.3]	
	Sens BTUH [kW]	69.0 [20.2]		61.0 [17.9]		74.3 [21.8]		97.8 [28.7]		86.5 [25.3]		103.9 [30.4]		91.8 [26.9]	
	Power	7.3		7.2		7.1		7.2		7.0		7.2		7.0	
95 [35]	Total BTUH [kW]	112.7 [33.0]		107.2 [31.4]		100.4 [29.4]		101.5 [29.7]		96.2 [28.2]		100.3 [29.4]		92.7 [27.2]	
	Sens BTUH [kW]	66.8 [19.6]		59.1 [17.3]		72.4 [21.2]		95.6 [28.0]		84.5 [24.8]		100.3 [29.4]		89.8 [26.3]	
	Power	7.8		7.6		7.5		7.6		7.5		7.6		7.4	
100 [37.8]	Total BTUH [kW]	108.4 [31.8]		103.1 [30.2]		96.3 [28.2]		93.6 [27.4]		92.1 [27.0]		96.0 [28.1]		88.8 [26.0]	
	Sens BTUH [kW]	64.6 [18.9]		57.1 [16.7]		70.4 [20.6]		93.3 [27.3]		82.5 [24.2]		96.0 [28.1]		87.9 [25.7]	
	Power	8.3		8.1		8.0		8.1		7.9		8.1		7.9	
105 [40.6]	Total BTUH [kW]	104.1 [30.5]		99.0 [29.0]		92.2 [27.0]		89.6 [26.2]		88.0 [25.8]		91.7 [26.9]		87.2 [25.6]	
	Sens BTUH [kW]	62.3 [18.2]		55.0 [16.1]		68.3 [20.0]		91.0 [26.7]		80.5 [23.6]		91.7 [26.9]		85.8 [25.1]	
	Power	8.8		8.6		8.5		8.6		8.4		8.6		8.4	
110 [43.3]	Total BTUH [kW]	99.8 [29.2]		94.9 [27.8]		88.1 [25.8]		85.6 [25.1]		83.9 [24.6]		87.4 [25.6]		80.8 [23.7]	
	Sens BTUH [kW]	59.9 [17.6]		53.0 [15.5]		66.3 [19.4]		88.2 [25.8]		78.4 [23.0]		87.4 [25.6]		83.1 [24.4]	
	Power	9.3		9.1		9.0		9.2		9.0		9.1		8.9	
115 [46.1]	Total BTUH [kW]	95.4 [28.0]		90.8 [26.6]		84.0 [24.6]		81.6 [23.9]		79.7 [23.4]		83.1 [24.3]		79.0 [23.2]	
	Sens BTUH [kW]	57.5 [16.9]		50.9 [14.9]		64.2 [18.8]		83.8 [24.6]		76.3 [22.4]		83.1 [24.3]		79.0 [23.2]	
	Power	9.9		9.6		9.5		9.8		9.5		9.7		9.5	
120 [48.9]	Total BTUH [kW]	91.1 [26.7]		86.7 [25.4]		79.8 [23.4]		77.6 [22.7]		75.6 [22.2]		78.7 [23.1]		74.9 [21.9]	
	Sens BTUH [kW]	55.1 [16.2]		48.7 [14.3]		62.1 [18.2]		79.5 [23.3]		74.2 [21.7]		78.7 [23.1]		74.9 [21.9]	
	Power	10.5		10.2		10.2		10.4		10.1		10.3		10.1	
125 [51.7]	Total BTUH [kW]	86.7 [25.4]		82.5 [24.2]		75.7 [22.2]		73.5 [21.5]		71.5 [20.9]		74.3 [21.8]		70.7 [20.7]	
	Sens BTUH [kW]	52.7 [15.4]		46.6 [13.6]		59.9 [17.5]		75.1 [22.0]		71.5 [20.9]		74.3 [21.8]		70.7 [20.7]	
	Power	11.1		10.9		10.8		11.0		10.7		11.0		10.7	

DR —Depression ratio
dbE —Entering air dry bulb
wbE —Entering air wet bulb

Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA — RGEDZR120A

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①																													
wB/E CFM [L/s]		71°F [21.7°C]					67°F [19.4°C]					63°F [17.2°C]					61°F [16.1°C]					59°F [15.0°C]							
		4800 [2265]	3750 [1770]	3200 [1510]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	3200 [1510]
75 [23.9]	Total BTUH [kW] Sens BTUH [kW] Power	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0
		155.3 [45.5]	147.8 [43.3]	143.8 [42.2]	143.8 [42.2]	147.8 [43.3]	140.7 [41.2]	136.9 [40.1]	132.2 [38.7]	142.8 [41.8]	135.8 [39.8]	132.2 [38.7]	131.1 [38.4]	141.5 [41.5]	134.7 [39.5]	131.1 [38.4]	131.1 [38.4]	141.4 [41.4]	134.5 [39.4]	131.1 [38.4]	131.1 [38.4]	141.4 [41.4]	134.5 [39.4]	131.1 [38.4]	131.1 [38.4]	141.4 [41.4]	134.5 [39.4]	131.1 [38.4]	131.1 [38.4]
		97.3 [28.5]	86.1 [25.2]	80.2 [23.5]	80.2 [23.5]	115.8 [33.9]	102.4 [30.0]	95.4 [28.0]	109.5 [32.1]	132.9 [38.9]	117.5 [34.4]	109.5 [32.1]	115.8 [33.9]	140.6 [41.2]	124.3 [36.4]	115.8 [33.9]	115.8 [33.9]	141.4 [41.4]	130.4 [38.2]	115.8 [33.9]	115.8 [33.9]	141.4 [41.4]	130.4 [38.2]	115.8 [33.9]	115.8 [33.9]	141.4 [41.4]	130.4 [38.2]	115.8 [33.9]	115.8 [33.9]
80 [26.7] <th rowspan="3">Total BTUH [kW] Sens BTUH [kW] Power</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th>	Total BTUH [kW] Sens BTUH [kW] Power	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0
		150.6 [44.1]	143.4 [42.0]	139.5 [40.9]	139.5 [40.9]	143.4 [42.0]	136.2 [39.9]	132.6 [38.9]	127.9 [37.5]	138.1 [40.5]	131.4 [38.5]	127.9 [37.5]	126.8 [37.1]	136.9 [40.1]	130.2 [38.2]	126.8 [37.1]	126.8 [37.1]	136.7 [40.1]	130.1 [38.1]	126.8 [37.1]	126.8 [37.1]	136.7 [40.1]	130.1 [38.1]	126.8 [37.1]	126.8 [37.1]	136.7 [40.1]	130.1 [38.1]	126.8 [37.1]	126.8 [37.1]
		94.9 [27.8]	84.0 [24.6]	78.2 [22.9]	78.2 [22.9]	113.5 [33.2]	100.3 [29.4]	93.5 [27.4]	107.5 [31.5]	130.5 [38.2]	115.4 [33.8]	107.5 [31.5]	113.5 [33.2]	136.9 [40.1]	122.2 [35.8]	113.8 [33.4]	113.8 [33.4]	136.7 [40.1]	128.3 [37.6]	113.5 [33.2]	113.5 [33.2]	136.7 [40.1]	128.3 [37.6]	113.5 [33.2]	113.5 [33.2]	136.7 [40.1]	128.3 [37.6]	113.5 [33.2]	113.5 [33.2]
85 [29.4] <th rowspan="3">Total BTUH [kW] Sens BTUH [kW] Power</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th>	Total BTUH [kW] Sens BTUH [kW] Power	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0
		146.0 [42.8]	138.9 [40.7]	135.2 [39.6]	135.2 [39.6]	138.9 [40.7]	131.8 [38.6]	128.3 [37.6]	123.6 [36.2]	133.5 [39.1]	127.0 [37.2]	123.6 [36.2]	122.5 [35.9]	132.2 [38.7]	125.8 [36.9]	122.5 [35.9]	122.5 [35.9]	132.1 [38.7]	125.7 [36.8]	122.5 [35.9]	122.5 [35.9]	132.1 [38.7]	125.7 [36.8]	122.5 [35.9]	122.5 [35.9]	132.1 [38.7]	125.7 [36.8]	122.5 [35.9]	122.5 [35.9]
		92.5 [27.1]	81.8 [24.0]	76.2 [22.3]	76.2 [22.3]	111.0 [32.5]	98.2 [28.8]	91.5 [26.8]	105.5 [30.9]	128.1 [37.5]	113.3 [33.2]	105.5 [30.9]	111.0 [32.5]	132.2 [38.7]	120.1 [35.2]	111.9 [32.8]	111.9 [32.8]	132.1 [38.7]	125.7 [36.8]	111.0 [32.5]	111.0 [32.5]	132.1 [38.7]	125.7 [36.8]	111.0 [32.5]	111.0 [32.5]	132.1 [38.7]	125.7 [36.8]	111.0 [32.5]	111.0 [32.5]
90 [32.2] <th rowspan="3">Total BTUH [kW] Sens BTUH [kW] Power</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th>	Total BTUH [kW] Sens BTUH [kW] Power	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0
		141.4 [41.4]	134.5 [39.4]	131.0 [38.4]	131.0 [38.4]	133.9 [39.2]	127.4 [37.3]	124.0 [36.3]	119.3 [35.0]	128.8 [37.8]	122.6 [35.9]	119.3 [35.0]	118.2 [34.6]	127.6 [37.4]	121.4 [35.6]	118.2 [34.6]	118.2 [34.6]	127.5 [37.4]	121.3 [35.5]	118.2 [34.6]	118.2 [34.6]	127.5 [37.4]	121.3 [35.5]	118.2 [34.6]	118.2 [34.6]	127.5 [37.4]	121.3 [35.5]	118.1 [34.6]	118.1 [34.6]
		90.1 [26.4]	79.7 [23.3]	74.2 [21.7]	74.2 [21.7]	108.6 [31.8]	96.0 [28.1]	89.5 [26.2]	103.5 [30.3]	125.6 [36.8]	111.1 [32.6]	103.5 [30.3]	111.1 [32.6]	127.6 [37.4]	117.9 [34.5]	109.8 [32.2]	109.8 [32.2]	127.5 [37.4]	121.3 [35.5]	109.8 [32.2]	109.8 [32.2]	127.5 [37.4]	121.3 [35.5]	109.8 [32.2]	109.8 [32.2]	127.5 [37.4]	121.3 [35.5]	115.5 [33.8]	115.5 [33.8]
95 [35] <th rowspan="3">Total BTUH [kW] Sens BTUH [kW] Power</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th>	Total BTUH [kW] Sens BTUH [kW] Power	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0
		136.8 [40.1]	130.2 [38.1]	126.7 [37.1]	126.7 [37.1]	129.3 [37.9]	123.0 [36.1]	119.7 [35.1]	115.1 [33.7]	124.2 [36.4]	118.2 [34.6]	115.1 [33.7]	113.8 [33.4]	123.0 [36.0]	117.0 [34.3]	113.9 [33.4]	113.9 [33.4]	122.9 [36.0]	116.9 [34.3]	113.9 [33.4]	113.9 [33.4]	122.9 [36.0]	116.9 [34.3]	113.9 [33.4]	113.9 [33.4]	122.9 [36.0]	116.9 [34.3]	113.8 [33.3]	113.8 [33.3]
		87.6 [25.7]	77.5 [22.7]	72.2 [21.1]	72.2 [21.1]	106.1 [31.1]	93.8 [27.5]	87.4 [25.6]	101.5 [29.7]	123.1 [36.1]	108.9 [31.9]	101.5 [29.7]	108.9 [31.9]	123.0 [36.0]	115.7 [33.9]	107.8 [31.6]	107.8 [31.6]	122.9 [36.0]	116.9 [34.3]	107.8 [31.6]	107.8 [31.6]	122.9 [36.0]	116.9 [34.3]	107.8 [31.6]	107.8 [31.6]	122.9 [36.0]	116.9 [34.3]	113.4 [33.2]	113.4 [33.2]
100 [37.8] <th rowspan="3">Total BTUH [kW] Sens BTUH [kW] Power</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th>	Total BTUH [kW] Sens BTUH [kW] Power	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0
		132.2 [38.7]	125.8 [36.9]	122.4 [35.9]	122.4 [35.9]	124.7 [36.5]	118.7 [34.8]	115.5 [33.8]	110.8 [32.5]	119.6 [35.1]	113.8 [33.4]	110.8 [32.5]	109.5 [32.1]	118.4 [34.7]	112.7 [33.0]	109.7 [32.1]	109.7 [32.1]	118.3 [34.7]	112.5 [33.0]	109.5 [32.1]	109.5 [32.1]	118.3 [34.7]	112.5 [33.0]	109.5 [32.1]	109.5 [32.1]	118.3 [34.7]	112.5 [33.0]	109.5 [32.1]	109.5 [32.1]
		85.1 [24.9]	75.2 [22.0]	70.1 [20.5]	70.1 [20.5]	103.6 [30.3]	91.6 [26.8]	85.3 [25.0]	99.4 [29.1]	119.6 [35.1]	106.7 [31.3]	99.4 [29.1]	106.7 [31.3]	123.0 [36.0]	115.7 [33.9]	107.8 [31.6]	107.8 [31.6]	122.9 [36.0]	116.9 [34.3]	107.8 [31.6]	107.8 [31.6]	122.9 [36.0]	116.9 [34.3]	107.8 [31.6]	107.8 [31.6]	122.9 [36.0]	116.9 [34.3]	113.4 [33.2]	113.4 [33.2]
105 [40.6] <th rowspan="3">Total BTUH [kW] Sens BTUH [kW] Power</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th>	Total BTUH [kW] Sens BTUH [kW] Power	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0
		127.6 [37.4]	121.4 [35.6]	118.2 [34.6]	118.2 [34.6]	120.1 [35.2]	114.3 [33.5]	111.2 [32.6]	106.6 [31.2]	115.1 [33.7]	109.5 [32.1]	106.6 [31.2]	105.4 [30.9]	113.8 [33.4]	108.3 [31.7]	105.4 [30.9]	105.4 [30.9]	113.7 [33.3]	108.2 [31.7]	105.4 [30.9]	105.4 [30.9]	113.7 [33.3]	108.2 [31.7]	105.4 [30.9]	105.4 [30.9]	113.7 [33.3]	108.2 [31.7]	105.3 [30.9]	105.3 [30.9]
		82.5 [24.2]	73.0 [21.4]	68.0 [19.9]	68.0 [19.9]	101.0 [29.6]	89.3 [26.2]	83.2 [24.4]	97.3 [28.5]	115.1 [33.7]	104.4 [30.6]	97.3 [28.5]	103.6 [30.4]	113.8 [33.4]	108.3 [31.7]	103.6 [30.4]	103.6 [30.4]	113.7 [33.3]	108.2 [31.7]	103.6 [30.4]	103.6 [30.4]	113.7 [33.3]	108.2 [31.7]	103.6 [30.4]	103.6 [30.4]	113.7 [33.3]	108.2 [31.7]	105.3 [30.9]	105.3 [30.9]
110 [43.3] <th rowspan="3">Total BTUH [kW] Sens BTUH [kW] Power</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th>	Total BTUH [kW] Sens BTUH [kW] Power	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0
		123 [36.1]	117.1 [34.3]	114.0 [33.4]	114.0 [33.4]	115.5 [33.9]	109.9 [32.2]	107.0 [31.4]	102.3 [30.0]	110.5 [32.4]	105.1 [30.8]	102.3 [30.0]	101.2 [29.7]	109.3 [32.0]	104.0 [30.5]	101.2 [29.7]	101.2 [29.7]	109.1 [32.0]	103.8 [30.4]	101.2 [29.7]	101.2 [29.7]	109.1 [32.0]	103.8 [30.4]	101.2 [29.7]	101.2 [29.7]	109.1 [32.0]	103.8 [30.4]	101.1 [29.6]	101.1 [29.6]
		79.9 [23.4]	70.6 [20.7]	65.8 [19.3]	65.8 [19.3]	98.4 [28.8]	87.0 [25.5]	81.1 [23.8]	95.1 [27.9]	110.5 [32.4]	102.1 [29.9]	95.1 [27.9]	101.2 [29.7]	109.3 [32.0]	104.0 [30.5]	101.2 [29.7]	101.2 [29.7]	109.1 [32.0]	103.8 [30.4]	101.2 [29.7]	101.2 [29.7]	109.1 [32.0]	103.8 [30.4]	101.2 [29.7]	101.2 [29.7]	109.1 [32.0]	103.8 [30.4]	101.1 [29.6]	101.1 [29.6]
115 [46.1] <th rowspan="3">Total BTUH [kW] Sens BTUH [kW] Power</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th>	Total BTUH [kW] Sens BTUH [kW] Power	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0
		118.5 [34.7]	112.7 [33.0]	109.7 [32.2]	109.7 [32.2]	111.0 [32.5]	105.6 [31.0]	102.8 [30.1]	98.1 [28.8]	105.9 [31.0]	100.8 [29.5]	98.1 [28.8]	96.9 [28.4]	104.7 [30.7]	99.6 [29.2]	97.0 [28.4]	97.0 [28.4]	104.6 [30.6]	99.5 [29.2]	97.0 [28.4]	97.0 [28.4]	104.6 [30.6]	99.5 [29.2]	97.0 [28.4]	97.0 [28.4]	104.6 [30.6]	99.5 [29.2]	96.8 [28.4]	96.8 [28.4]
		77.2 [22.6]	68.3 [20.0]	63.6 [18.6]	63.6 [18.6]	95.7 [28.1]	84.7 [24.8]	78.9 [23.1]	92.9 [27.2]	105.9 [31.0]	99.8 [29.2]	92.9 [27.2]	99.8 [29.2]	104.7 [30.7]	99.6 [29.2]	97.0 [28.4]	97.0 [28.4]	104.6 [30.6]	99.5 [29.2]	97.0 [28.4]	97.0 [28.4]	104.6 [30.6]	99.5 [29.2]	97.0 [28.4]	97.0 [28.4]	104.6 [30.6]	99.5 [29.2]	96.8 [28.4]	96.8 [28.4]
120 [48.9] <th rowspan="3">Total BTUH [kW] Sens BTUH [kW] Power</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th> <th>0.09</th> <th>0.03</th> <th>0</th> <th>0</th>	Total BTUH [kW] Sens BTUH [kW] Power	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0	0.09	0.03	0	0
		113.9 [33.4]	108.4 [31.8]	105.5 [30.9]	105.5 [30.9]	106.5 [31.2]	101.3 [29.7]	98.6 [28.9]	93.9 [27.5]	101.4 [29.7]	96.5 [28.3]	93.9 [27.5]	92.8 [27.2]	100.2 [29.4]	95.3 [27.9]	92.8 [27.2]	92.8 [27.2]	100.2 [29.4]	95.2 [27.9]	92.8 [27.2]	92.8 [27.2]	100.2 [29.4]	95.2 [27.9]	92.8 [27.2]	92.8 [27.2]	100.2 [29.4]	95.2 [27.9]	92.6 [27.1]	92.6 [27.1]
		74.5 [21.8]	65.9 [19.3]	61.4 [18.0]	61.4 [18.0]	93.0 [27.3]	82.3 [24.1]	76.7 [22.5]	90.7.																				

COOLING PERFORMANCE DATA — RGEDZS090A

WbE		ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①												61°F [16.1°C]				59°F [15.0°C]			
		3600 [1699]	2775 [1310]	2400 [1133]	2000 [900]	1600 [746]	1200 [593]	800 [479]	400 [319]	200 [159]	100 [79]	50 [39]	25 [19]	3600 [1699]	2775 [1310]	2400 [1133]	2000 [900]	1600 [746]	1200 [593]	800 [479]	400 [319]
CFM [L/s]		67°F [19.4°C]												63°F [17.2°C]				61°F [16.1°C]			
DR ①		0.17	0.13	0.11	0.09	0.07	0.05	0.03	0.02	0.01	0.01	0.01	0.01	0.17	0.13	0.11	0.09	0.17	0.13	0.11	0.09
75 [23.9]	Total BTUH [kW]	119.6 [35.0]	113.5 [33.2]	110.7 [32.4]	107.0 [31.3]	104.3 [30.6]	101.1 [29.6]	97.8 [28.7]	94.5 [27.7]	91.2 [26.7]	88.0 [25.8]	84.8 [24.9]	81.6 [24.0]	106.4 [31.2]	100.9 [29.6]	98.4 [28.8]	95.9 [28.1]	105.8 [31.0]	100.4 [29.4]	97.9 [28.7]	95.4 [28.0]
	Sens BTUH [kW]	70.3 [20.6]	61.8 [18.1]	57.9 [17.0]	54.3 [15.9]	50.8 [14.9]	47.3 [13.9]	43.8 [12.9]	40.3 [11.9]	36.8 [10.9]	33.3 [9.8]	29.8 [8.8]	26.3 [7.8]	83.3 [24.4]	77.8 [23.0]	75.3 [22.4]	72.8 [21.8]	105.8 [31.0]	99.4 [29.0]	96.9 [28.3]	94.4 [27.7]
Power		5.2	5.1	5.0	4.9	4.8	4.7	4.6	4.5	4.4	4.3	4.2	4.1	5.1	4.9	4.8	4.7	5.0	4.9	4.8	4.7
80 [26.7]	Total BTUH [kW]	116.1 [34.0]	110.1 [32.3]	107.4 [31.5]	103.6 [30.4]	100.4 [29.6]	97.1 [28.7]	93.8 [27.9]	90.5 [27.0]	87.2 [26.2]	83.9 [25.4]	80.6 [24.6]	77.3 [23.8]	102.9 [30.1]	97.4 [28.6]	94.9 [27.9]	92.4 [27.2]	102.3 [30.0]	96.8 [28.4]	94.3 [27.7]	91.8 [27.0]
	Sens BTUH [kW]	68.4 [20.1]	60.1 [17.6]	56.3 [16.5]	52.5 [15.4]	48.7 [14.4]	45.0 [13.3]	41.2 [12.2]	37.5 [11.2]	33.8 [10.2]	30.0 [9.1]	26.3 [8.1]	22.6 [7.1]	100.3 [29.4]	94.8 [27.9]	92.3 [27.2]	89.8 [26.5]	102.3 [30.0]	96.8 [28.4]	94.3 [27.7]	91.8 [27.0]
Power		5.6	5.4	5.4	5.2	5.0	4.8	4.6	4.4	4.2	4.0	3.8	3.6	5.4	5.2	5.1	5.0	5.4	5.3	5.2	5.1
85 [29.4]	Total BTUH [kW]	112.6 [33.0]	106.8 [31.3]	104.2 [30.5]	100.4 [29.6]	97.1 [28.7]	93.8 [27.9]	90.5 [27.0]	87.2 [26.2]	83.9 [25.4]	80.6 [24.6]	77.3 [23.8]	74.0 [23.0]	99.3 [29.1]	93.8 [27.6]	91.3 [26.9]	88.8 [26.2]	98.8 [28.9]	93.3 [27.4]	90.8 [26.7]	88.3 [26.0]
	Sens BTUH [kW]	66.6 [19.5]	58.5 [17.1]	54.8 [16.0]	51.0 [15.0]	47.3 [14.0]	43.6 [13.0]	39.9 [12.0]	36.2 [11.0]	32.5 [10.0]	28.8 [9.0]	25.1 [8.0]	21.4 [7.0]	98.4 [28.8]	92.9 [27.3]	90.4 [26.6]	87.9 [25.9]	98.8 [28.9]	93.3 [27.4]	90.8 [26.7]	88.3 [26.0]
Power		6.0	5.9	5.8	5.6	5.4	5.2	5.0	4.8	4.6	4.4	4.2	4.0	5.9	5.7	5.6	5.5	5.9	5.8	5.7	5.6
90 [32.2]	Total BTUH [kW]	109.0 [31.9]	103.4 [30.3]	100.9 [29.6]	97.1 [28.7]	93.8 [27.9]	90.5 [27.0]	87.2 [26.2]	83.9 [25.4]	80.6 [24.6]	77.3 [23.8]	74.0 [23.0]	70.7 [22.2]	95.8 [28.1]	90.3 [26.6]	87.8 [25.9]	85.3 [25.2]	95.2 [27.9]	90.3 [26.5]	87.8 [25.8]	85.3 [25.1]
	Sens BTUH [kW]	64.7 [19.0]	56.8 [16.7]	53.2 [15.6]	49.5 [14.6]	45.8 [13.5]	42.1 [12.5]	38.4 [11.5]	34.7 [10.5]	31.0 [9.5]	27.3 [8.5]	23.6 [7.5]	19.9 [7.0]	95.8 [28.1]	90.3 [26.6]	87.8 [25.9]	85.3 [25.2]	95.2 [27.9]	90.3 [26.5]	87.8 [25.8]	85.3 [25.1]
Power		6.6	6.4	6.3	6.1	5.9	5.7	5.5	5.3	5.1	4.9	4.7	4.5	6.4	6.2	6.1	6.0	6.4	6.3	6.2	6.1
95 [35]	Total BTUH [kW]	105.4 [30.9]	100.0 [29.3]	97.5 [28.6]	93.8 [27.9]	90.5 [27.0]	87.2 [26.2]	83.9 [25.4]	80.6 [24.6]	77.3 [23.8]	74.0 [23.0]	70.7 [22.2]	67.4 [21.4]	92.2 [27.0]	86.7 [25.5]	84.2 [24.8]	81.7 [24.1]	91.6 [26.8]	86.1 [25.3]	83.6 [24.6]	81.1 [23.9]
	Sens BTUH [kW]	62.9 [18.4]	55.2 [16.2]	51.7 [15.2]	48.0 [14.2]	44.3 [13.2]	40.6 [12.2]	36.9 [11.2]	33.2 [10.2]	29.5 [9.2]	25.8 [8.2]	22.1 [7.2]	18.4 [7.0]	92.2 [27.0]	86.7 [25.5]	84.2 [24.8]	81.7 [24.1]	91.6 [26.8]	86.1 [25.3]	83.6 [24.6]	81.1 [23.9]
Power		7.2	7.0	6.9	6.7	6.5	6.3	6.1	5.9	5.7	5.5	5.3	5.1	7.1	6.9	6.8	6.7	7.0	6.9	6.8	6.7
100 [37.8]	Total BTUH [kW]	101.7 [29.8]	96.5 [28.3]	94.2 [27.6]	90.5 [27.0]	87.2 [26.2]	83.9 [25.4]	80.6 [24.6]	77.3 [23.8]	74.0 [23.0]	70.7 [22.2]	67.4 [21.4]	64.1 [20.6]	88.5 [25.9]	83.0 [24.4]	80.5 [23.7]	78.0 [23.0]	88.0 [25.8]	82.5 [24.3]	80.0 [23.6]	77.5 [22.9]
	Sens BTUH [kW]	61.0 [17.9]	53.6 [15.7]	50.2 [14.7]	46.5 [13.7]	42.8 [12.7]	39.1 [11.7]	35.4 [10.7]	31.7 [9.7]	28.0 [9.0]	24.3 [8.0]	20.6 [7.6]	16.9 [7.0]	88.5 [25.9]	83.0 [24.4]	80.5 [23.7]	78.0 [23.0]	88.0 [25.8]	82.5 [24.3]	80.0 [23.6]	77.5 [22.9]
Power		7.9	7.7	7.6	7.4	7.2	7.0	6.8	6.6	6.4	6.2	6.0	5.8	7.8	7.6	7.5	7.4	7.7	7.5	7.4	7.3
105 [40.6]	Total BTUH [kW]	98.1 [28.7]	93.0 [27.3]	90.7 [26.6]	87.0 [25.9]	83.7 [25.2]	80.4 [24.5]	77.1 [23.8]	73.8 [23.1]	70.5 [22.4]	67.2 [21.7]	63.9 [21.0]	60.6 [20.3]	84.8 [24.9]	79.3 [23.4]	76.8 [22.7]	74.3 [22.0]	84.3 [24.7]	78.8 [23.2]	76.3 [22.5]	73.8 [21.8]
	Sens BTUH [kW]	59.3 [17.4]	52.0 [15.2]	48.8 [14.3]	45.1 [13.5]	41.4 [12.5]	37.7 [11.5]	34.0 [10.5]	30.3 [9.5]	26.6 [9.0]	22.9 [8.0]	19.2 [7.6]	15.5 [7.0]	84.8 [24.9]	79.3 [23.4]	76.8 [22.7]	74.3 [22.0]	84.3 [24.7]	78.8 [23.2]	76.3 [22.5]	73.8 [21.8]
Power		8.7	8.5	8.4	8.2	8.0	7.8	7.6	7.4	7.2	7.0	6.8	6.6	8.5	8.3	8.2	8.1	8.5	8.3	8.2	8.1
110 [43.3]	Total BTUH [kW]	94.3 [27.6]	89.5 [26.2]	87.3 [25.6]	83.6 [24.9]	80.3 [24.2]	77.0 [23.5]	73.7 [22.8]	70.4 [22.1]	67.1 [21.4]	63.8 [20.7]	60.5 [20.0]	57.2 [19.3]	81.1 [23.8]	75.6 [22.3]	73.1 [21.6]	70.6 [20.9]	80.5 [23.6]	75.0 [22.1]	72.5 [21.4]	70.0 [20.7]
	Sens BTUH [kW]	57.5 [16.8]	50.5 [14.8]	47.3 [13.9]	43.6 [13.0]	40.3 [12.3]	36.6 [11.6]	32.9 [10.9]	29.2 [10.2]	25.5 [9.5]	21.8 [9.0]	18.1 [8.4]	14.4 [7.8]	81.1 [23.8]	75.6 [22.3]	73.1 [21.6]	70.6 [20.9]	80.5 [23.6]	75.0 [22.1]	72.5 [21.4]	70.0 [20.7]
Power		9.5	9.3	9.2	9.0	8.8	8.6	8.4	8.2	8.0	7.8	7.6	7.4	9.4	9.2	9.1	9.0	9.4	9.2	9.1	9.0
115 [46.1]	Total BTUH [kW]	90.6 [26.5]	85.9 [25.2]	83.8 [24.6]	80.1 [23.9]	76.8 [23.2]	73.5 [22.5]	70.2 [21.8]	66.9 [21.1]	63.6 [20.4]	60.3 [19.7]	57.0 [19.0]	53.7 [18.3]	77.3 [22.7]	71.8 [21.2]	69.3 [20.5]	66.8 [19.8]	76.8 [22.5]	71.3 [21.0]	68.8 [20.3]	66.3 [19.6]
	Sens BTUH [kW]	55.7 [16.3]	48.9 [14.3]	45.8 [13.4]	42.1 [12.7]	38.4 [11.9]	34.7 [11.2]	31.0 [10.5]	27.3 [10.0]	23.6 [9.3]	19.9 [8.7]	16.2 [8.0]	12.5 [7.3]	77.3 [22.7]	71.8 [21.2]	69.3 [20.5]	66.8 [19.8]	76.8 [22.5]	71.3 [21.0]	68.8 [20.3]	66.3 [19.6]
Power		10.5	10.2	10.1	9.9	9.7	9.5	9.3	9.1	8.9	8.7	8.5	8.3	10.3	10.1	10.0	9.9	10.3	10.1	10.0	9.9
120 [48.9]	Total BTUH [kW]	86.8 [25.4]	82.3 [24.1]	80.3 [23.5]	76.6 [22.8]	73.3 [22.1]	70.0 [21.4]	66.7 [20.7]	63.4 [20.0]	60.1 [19.3]	56.8 [18.6]	53.5 [17.9]	50.2 [17.2]	73.5 [21.6]	68.0 [20.1]	65.5 [19.4]	63.0 [18.7]	73.0 [21.4]	67.5 [20.0]	65.0 [19.3]	62.5 [18.6]
	Sens BTUH [kW]	54.0 [15.8]	47.4 [13.9]	44.4 [13.0]	40.7 [12.3]	37.4 [11.6]	34.1 [10.9]	30.8 [10.2]	27.5 [9.5]	23.8 [9.0]	20.5 [8.3]	17.2 [7.6]	13.9 [7.0]	73.5 [21.6]	68.0 [20.1]	65.5 [19.4]	63.0 [18.7]	73.0 [21.4]	67.5 [20.0]	65.0 [19.3]	62.5 [18.6]
Power		11.5	11.2	11.1	10.9	10.7	10.5	10.3	10.1	9.9	9.7	9.5	9.3	11.3	11.1	11.0	10.9	11.3	11.1	11.0	10.9
125 [51.7]	Total BTUH [kW]	82.9 [24.3]	78.7 [23.1]	76.8 [22.5]	73.1 [21.8]	70.0 [21.2]	66.9 [20.5]	63.8 [19.8]	60.7 [19.1]	57.6 [18.4]	54.5 [17.7]	51.4 [17.0]	48.3 [16.3]	69.7 [20.4]	64.2 [18.9]	61.7 [18.2]	59.2 [17.5]	69.1 [20.3]	63.6 [18.8]	61.1 [18.1]	58.6 [17.4]
	Sens BTUH [kW]	52.3 [15.3]	45.9 [13.4]	43.0 [12.6]	39.3 [11.9]	36.4 [11.2]	32.7 [10.5]	29.0 [9.8]	25.3 [9.0]	21.6 [8.3]	17.9 [7.6]	14.2 [7.0]	10.5 [6.3]	69.7 [20.4]	64.2 [18.9]	61.7 [18.2]	59.2 [17.5]	69.1 [20.3]	63.6 [18.8]	61.1 [18.1]	58.6 [17.4]
Power		12.6	12.3	12.1	11.9	11.7	11.5	11.3	11.1	10.9	10.7	10.5	10.3	12.4	12.1	12.0	11.9	12.4	12.1	12.0	11.9

DR — Depression ratio
dbE — Entering air dry bulb
wbE — Entering air wet bulb

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding [1.10 x CFM x (1 – DR) x (dbE – 80)].

[] Designates Metric Conversions

COOLING PERFORMANCE DATA — RGEDZS102A

wB/E		ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①										61°F [16.1°C]										59°F [15.0°C]											
		67°F [19.4°C]					63°F [17.2°C]					61°F [16.1°C]					59°F [15.0°C]					57°F [13.9°C]											
CFM [L/s]		4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]
DR ①	75 [23.9]	0.11	0.05	0.01	0.01	0.11	0.05	0.01	0.01	0.11	0.05	0.01	0.01	0.11	0.05	0.01	0.01	0.11	0.05	0.01	0.01	0.11	0.05	0.01	0.01	0.11	0.05	0.01	0.01	0.11	0.05	0.01	0.01
		129.9 [38.1]	123.6 [36.2]	120.1 [35.2]	113.4 [33.2]	118.3 [34.7]	112.5 [33.0]	109.3 [32.0]	103.3 [30.4]	118.3 [34.7]	112.5 [33.0]	109.3 [32.0]	103.3 [30.4]	118.3 [34.7]	112.5 [33.0]	109.3 [32.0]	103.3 [30.4]	118.3 [34.7]	112.5 [33.0]	109.3 [32.0]	103.3 [30.4]	118.3 [34.7]	112.5 [33.0]	109.3 [32.0]	103.3 [30.4]	118.3 [34.7]	112.5 [33.0]	109.3 [32.0]	103.3 [30.4]	118.3 [34.7]	112.5 [33.0]	109.3 [32.0]	103.3 [30.4]
Power	80 [26.7]	81.3 [23.8]	71.9 [21.1]	66.6 [19.5]	61.0 [18.0]	96.4 [28.2]	85.2 [25.0]	79.0 [23.1]	73.7 [21.6]	96.4 [28.2]	85.2 [25.0]	79.0 [23.1]	73.7 [21.6]	96.4 [28.2]	85.2 [25.0]	79.0 [23.1]	73.7 [21.6]	96.4 [28.2]	85.2 [25.0]	79.0 [23.1]	73.7 [21.6]	96.4 [28.2]	85.2 [25.0]	79.0 [23.1]	73.7 [21.6]	96.4 [28.2]	85.2 [25.0]	79.0 [23.1]	73.7 [21.6]	96.4 [28.2]	85.2 [25.0]	79.0 [23.1]	73.7 [21.6]
		6.2	6.1	6.0	5.9	6.1	6.0	5.9	5.8	6.1	6.0	5.9	5.8	6.1	6.0	5.9	5.8	6.1	6.0	5.9	5.8	6.1	6.0	5.9	5.8	6.1	6.0	5.9	5.8	6.1	6.0	5.9	5.8
Power	85 [29.4]	125.7 [36.8]	119.5 [35.0]	116.1 [34.0]	109.5 [32.1]	118.5 [34.7]	112.7 [33.0]	109.5 [32.1]	105.4 [30.9]	118.5 [34.7]	112.7 [33.0]	109.5 [32.1]	105.4 [30.9]	118.5 [34.7]	112.7 [33.0]	109.5 [32.1]	105.4 [30.9]	118.5 [34.7]	112.7 [33.0]	109.5 [32.1]	105.4 [30.9]	118.5 [34.7]	112.7 [33.0]	109.5 [32.1]	105.4 [30.9]	118.5 [34.7]	112.7 [33.0]	109.5 [32.1]	105.4 [30.9]	118.5 [34.7]	112.7 [33.0]	109.5 [32.1]	105.4 [30.9]
		79.2 [23.2]	70.0 [20.5]	64.9 [19.0]	63.1 [18.5]	94.3 [27.6]	83.3 [24.4]	77.2 [22.6]	73.7 [21.6]	94.3 [27.6]	83.3 [24.4]	77.2 [22.6]	73.7 [21.6]	94.3 [27.6]	83.3 [24.4]	77.2 [22.6]	73.7 [21.6]	94.3 [27.6]	83.3 [24.4]	77.2 [22.6]	73.7 [21.6]	94.3 [27.6]	83.3 [24.4]	77.2 [22.6]	73.7 [21.6]	94.3 [27.6]	83.3 [24.4]	77.2 [22.6]	73.7 [21.6]	94.3 [27.6]	83.3 [24.4]	77.2 [22.6]	73.7 [21.6]
Power	90 [32.2]	121.4 [35.6]	115.5 [33.8]	112.2 [32.9]	108.7 [31.8]	114.2 [33.5]	108.7 [31.8]	105.6 [30.9]	101.6 [29.8]	114.2 [33.5]	108.7 [31.8]	105.6 [30.9]	101.6 [29.8]	114.2 [33.5]	108.7 [31.8]	105.6 [30.9]	101.6 [29.8]	114.2 [33.5]	108.7 [31.8]	105.6 [30.9]	101.6 [29.8]	114.2 [33.5]	108.7 [31.8]	105.6 [30.9]	101.6 [29.8]	114.2 [33.5]	108.7 [31.8]	105.6 [30.9]	101.6 [29.8]	114.2 [33.5]	108.7 [31.8]	105.6 [30.9]	101.6 [29.8]
		77.0 [22.6]	68.1 [20.0]	63.1 [18.5]	61.4 [18.0]	92.1 [27.0]	81.4 [23.9]	75.5 [22.1]	71.9 [21.1]	92.1 [27.0]	81.4 [23.9]	75.5 [22.1]	71.9 [21.1]	92.1 [27.0]	81.4 [23.9]	75.5 [22.1]	71.9 [21.1]	92.1 [27.0]	81.4 [23.9]	75.5 [22.1]	71.9 [21.1]	92.1 [27.0]	81.4 [23.9]	75.5 [22.1]	71.9 [21.1]	92.1 [27.0]	81.4 [23.9]	75.5 [22.1]	71.9 [21.1]	92.1 [27.0]	81.4 [23.9]	75.5 [22.1]	71.9 [21.1]
Power	95 [35]	117.1 [34.3]	111.4 [32.7]	108.3 [31.7]	101.6 [29.8]	110.0 [32.2]	104.6 [30.7]	101.6 [29.8]	97.5 [28.6]	110.0 [32.2]	104.6 [30.7]	101.6 [29.8]	97.5 [28.6]	110.0 [32.2]	104.6 [30.7]	101.6 [29.8]	97.5 [28.6]	110.0 [32.2]	104.6 [30.7]	101.6 [29.8]	97.5 [28.6]	110.0 [32.2]	104.6 [30.7]	101.6 [29.8]	97.5 [28.6]	110.0 [32.2]	104.6 [30.7]	101.6 [29.8]	97.5 [28.6]	110.0 [32.2]	104.6 [30.7]	101.6 [29.8]	97.5 [28.6]
		74.9 [21.9]	66.2 [19.4]	61.4 [18.0]	57.5 [16.8]	89.9 [26.4]	79.5 [23.3]	73.7 [21.6]	70.0 [20.5]	89.9 [26.4]	79.5 [23.3]	73.7 [21.6]	70.0 [20.5]	89.9 [26.4]	79.5 [23.3]	73.7 [21.6]	70.0 [20.5]	89.9 [26.4]	79.5 [23.3]	73.7 [21.6]	70.0 [20.5]	89.9 [26.4]	79.5 [23.3]	73.7 [21.6]	70.0 [20.5]	89.9 [26.4]	79.5 [23.3]	73.7 [21.6]	70.0 [20.5]	89.9 [26.4]	79.5 [23.3]	73.7 [21.6]	70.0 [20.5]
Power	100 [37.8]	112.9 [33.1]	107.4 [31.5]	104.3 [30.6]	97.7 [28.6]	105.7 [31.0]	100.5 [29.5]	97.7 [28.6]	93.6 [27.4]	105.7 [31.0]	100.5 [29.5]	97.7 [28.6]	93.6 [27.4]	105.7 [31.0]	100.5 [29.5]	97.7 [28.6]	93.6 [27.4]	105.7 [31.0]	100.5 [29.5]	97.7 [28.6]	93.6 [27.4]	105.7 [31.0]	100.5 [29.5]	97.7 [28.6]	93.6 [27.4]	105.7 [31.0]	100.5 [29.5]	97.7 [28.6]	93.6 [27.4]	105.7 [31.0]	100.5 [29.5]	97.7 [28.6]	93.6 [27.4]
		72.6 [21.3]	64.2 [18.8]	59.5 [17.4]	55.8 [16.4]	87.7 [25.7]	77.5 [22.7]	71.9 [21.1]	68.1 [20.0]	87.7 [25.7]	77.5 [22.7]	71.9 [21.1]	68.1 [20.0]	87.7 [25.7]	77.5 [22.7]	71.9 [21.1]	68.1 [20.0]	87.7 [25.7]	77.5 [22.7]	71.9 [21.1]	68.1 [20.0]	87.7 [25.7]	77.5 [22.7]	71.9 [21.1]	68.1 [20.0]	87.7 [25.7]	77.5 [22.7]	71.9 [21.1]	68.1 [20.0]	87.7 [25.7]	77.5 [22.7]	71.9 [21.1]	68.1 [20.0]
Power	105 [40.6]	108.6 [31.8]	103.3 [30.3]	100.4 [29.4]	93.7 [27.5]	101.4 [29.7]	96.5 [28.3]	93.7 [27.5]	89.7 [26.3]	101.4 [29.7]	96.5 [28.3]	93.7 [27.5]	89.7 [26.3]	101.4 [29.7]	96.5 [28.3]	93.7 [27.5]	89.7 [26.3]	101.4 [29.7]	96.5 [28.3]	93.7 [27.5]	89.7 [26.3]	101.4 [29.7]	96.5 [28.3]	93.7 [27.5]	89.7 [26.3]	101.4 [29.7]	96.5 [28.3]	93.7 [27.5]	89.7 [26.3]	101.4 [29.7]	96.5 [28.3]	93.7 [27.5]	89.7 [26.3]
		70.4 [20.6]	62.2 [18.2]	57.7 [16.9]	54.0 [15.8]	85.5 [25.0]	75.5 [22.1]	70.0 [20.5]	66.2 [19.4]	85.5 [25.0]	75.5 [22.1]	70.0 [20.5]	66.2 [19.4]	85.5 [25.0]	75.5 [22.1]	70.0 [20.5]	66.2 [19.4]	85.5 [25.0]	75.5 [22.1]	70.0 [20.5]	66.2 [19.4]	85.5 [25.0]	75.5 [22.1]	70.0 [20.5]	66.2 [19.4]	85.5 [25.0]	75.5 [22.1]	70.0 [20.5]	66.2 [19.4]	85.5 [25.0]	75.5 [22.1]	70.0 [20.5]	66.2 [19.4]
Power	110 [43.3]	104.3 [30.6]	99.2 [29.1]	96.4 [28.2]	90.4 [26.5]	97.1 [28.4]	92.4 [27.1]	89.7 [26.3]	85.7 [25.1]	97.1 [28.4]	92.4 [27.1]	89.7 [26.3]	85.7 [25.1]	97.1 [28.4]	92.4 [27.1]	89.7 [26.3]	85.7 [25.1]	97.1 [28.4]	92.4 [27.1]	89.7 [26.3]	85.7 [25.1]	97.1 [28.4]	92.4 [27.1]	89.7 [26.3]	85.7 [25.1]	97.1 [28.4]	92.4 [27.1]	89.7 [26.3]	85.7 [25.1]	97.1 [28.4]	92.4 [27.1]	89.7 [26.3]	85.7 [25.1]
		68.1 [20.0]	60.2 [17.6]	55.8 [16.4]	52.1 [15.3]	83.2 [24.4]	73.5 [21.5]	68.1 [20.0]	64.3 [18.8]	83.2 [24.4]	73.5 [21.5]	68.1 [20.0]	64.3 [18.8]	83.2 [24.4]	73.5 [21.5]	68.1 [20.0]	64.3 [18.8]	83.2 [24.4]	73.5 [21.5]	68.1 [20.0]	64.3 [18.8]	83.2 [24.4]	73.5 [21.5]	68.1 [20.0]	64.3 [18.8]	83.2 [24.4]	73.5 [21.5]	68.1 [20.0]	64.3 [18.8]	83.2 [24.4]	73.5 [21.5]	68.1 [20.0]	64.3 [18.8]
Power	115 [46.1]	99.9 [29.3]	95.1 [27.9]	92.4 [27.1]	85.7 [25.1]	92.8 [27.2]	88.2 [25.9]	85.7 [25.1]	81.7 [24.0]	92.8 [27.2]	88.2 [25.9]	85.7 [25.1]	81.7 [24.0]	92.8 [27.2]	88.2 [25.9]	85.7 [25.1]	81.7 [24.0]	92.8 [27.2]	88.2 [25.9]	85.7 [25.1]	81.7 [24.0]	92.8 [27.2]	88.2 [25.9]	85.7 [25.1]	81.7 [24.0]	92.8 [27.2]	88.2 [25.9]	85.7 [25.1]	81.7 [24.0]	92.8 [27.2]	88.2 [25.9]	85.7 [25.1]	81.7 [24.0]
		65.8 [19.3]	58.1 [17.0]	53.9 [15.8]	50.2 [14.8]	80.8 [23.7]	71.4 [20.9]	66.2 [19.4]	62.5 [18.3]	80.8 [23.7]	71.4 [20.9]	66.2 [19.4]	62.5 [18.3]	80.8 [23.7]	71.4 [20.9]	66.2 [19.4]	62.5 [18.3]	80.8 [23.7]	71.4 [20.9]	66.2 [19.4]	62.5 [18.3]	80.8 [23.7]	71.4 [20.9]	66.2 [19.4]	62.5 [18.3]	80.8 [23.7]	71.4 [20.9]	66.2 [19.4]	62.5 [18.3]	80.8 [23.7]	71.4 [20.9]	66.2 [19.4]	62.5 [18.3]
Power	120 [48.9]	95.6 [28.0]	91.0 [26.7]	88.4 [25.9]	81.7 [24.0]	88.4 [25.9]	84.1 [24.6]	81.7 [24.0]	77.7 [22.8]	88.4 [25.9]	84.1 [24.6]	81.7 [24.0]	77.7 [22.8]	88.4 [25.9]	84.1 [24.6]	81.7 [24.0]	77.7 [22.8]	88.4 [25.9]	84.1 [24.6]	81.7 [24.0]	77.7 [22.8]	88.4 [25.9]	84.1 [24.6]	81.7 [24.0]	77.7 [22.8]	88.4 [25.9]	84.1 [24.6]	81.7 [24.0]	77.7 [22.8]	88.4 [25.9]	84.1 [24.6]	81.7 [24.0]	77.7 [22.8]
		63.4 [18.6]	56.0 [16.4]	51.9 [15.2]	48.1 [14.2]	78.4 [23.0]	69.3 [20.3]	64.3 [18.8]	60.6 [17.8]	78.4 [23.0]	69.3 [20.3]	64.3 [18.8]	60.6 [17.8]	78.4 [23.0]	69.3 [20.3]	64.3 [18.8]	60.6 [17.8]	78.4 [23.0]	69.3 [20.3]	64.3 [18.8]	60.6 [17.8]	78.4 [23.0]	69.3 [20.3]	64.3 [18.8]	60.6 [17.8]	78.4 [23.0]	69.3 [20.3]	64.3 [18.8]	60.6 [17.8]	78.4 [23.0]	69.3 [20.3]	64.3 [18.8]	60.6 [17.8]
Power	125 [51.7]	91.3 [26.7]	86.8 [25.4]	84.4 [24.7]	77.7 [22.8]	84.4 [24.7]	80.0 [23.4]	77.7 [22.8]	73.7 [21.6]	84.4 [24.7]	80.0 [23.4]	77.7 [22.8]	73.7 [21.6]	84.4 [24.7]	80.0 [23.4]	77.7 [22.8]	73.7 [21.6]	84.4 [24.7]	80.0 [23.4]	77.7 [22.8]	73.7 [21.6]	84.4 [24.7]	80.0 [23.4]	77.7 [22.8]	73.7 [21.6]	84.4 [24.7]	80.0 [23.4]	77.7 [22.8]	73.7 [21.6]	84.4 [24.7]	80.0 [23.4]	77.7 [22.8]	73.7 [21.6]
		61.0 [17.9]	53.9 [15.8]	50.0 [14.6]	46.3 [13.7]	76.0 [22.3]	67.2 [19.7]	62.3 [18.3]	58.6 [17.3]	76.0 [22.3]	67.2 [19.7]	62.3 [18.3]	58.6 [17.3]	76.0 [22.3]	67.2 [19.7]	62.3 [18.3]	58.6 [17.3]	76.0 [22.3]	67.2 [19.7]	62.3 [18.3]	58.6 [17.3]	76.0 [22.3]	67.2 [19.7]	62.3 [18.3]	58.6 [17.3]	76.0 [22.3]	67.2 [19.7]	62.3 [18.3]	58.6 [17.3]	76.0 [22.3]	67.2 [19.7]	62.3 [18.3]	58.6 [17.3]
Power	125 [51.7]	86.9 [25.5]	82.7 [24.2]	80.3 [23.5]	73.7 [21.6]	80.3 [23.5]	75.8 [22.2]	73.7 [21.6]	69.7 [20.5]	80.3 [23.5]	75.8 [22.2]	73.7 [21.6]	69.7 [20.5]	80.3 [23.5]	75.8 [22.2]	73.7 [21.6]	69.7 [20.5]	80.3 [23.5]	75.8 [22.2]	73.7 [21.6]	69.7 [20.5]	80.3 [23.5]	75.8 [22.2]	73.7 [21.6]	69.7 [20.5]	80.3 [23.5]	75.8 [22.2]	73.7 [21.6]	69.7 [20.5]	80.3 [23.5]	75.8 [22.2]	73.7 [21.6]	69.7 [20.5]
		58.5 [17.1]	51.7 [15.2]	48.0 [14.1]	44.3 [13.2]	73.6 [21.6]	65.0 [19.1]	60.3 [17.7]	56.6 [16.6]	73.6 [21.6]	65.0 [19.1]	60.3 [17.7]	56.6 [16.6]	73.6 [21.6]	65.0 [19.1]	60.3 [17.7]	56.6 [16.6]	73.6 [21.6]	65.0 [19.1]	60.3 [17.7]	56.6 [16.6]	73.6 [21.6]	65.0 [19.1]	60.3 [17.7]	56.6 [16.6]	73.6 [21.6]	65.0 [19.1]	60.3 [17.7]	56.6 [16.6]	73.6 [21.6]	65.0 [19.1]	60.3 [17.7]	56.6 [16.6]
Power		11.2	10.9	10.7	10.7	11.1	10.8	10.7	10.7	11.1	10.8	10.7	10.7	11.1	10.8	10.7	10.7																

DR — Depression ratio
dbE — Entering air dry bulb
wB/E — Entering air wet bulb

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

[] Designates Metric Conversions

Total — Total capacity x 1000 BTUH
Sens — Sensible capacity x 1000 BTUH
Power — KW Input

COOLING PERFORMANCE DATA — RGEDZS120A

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①																
WDE		71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]			61°F [16.1°C]			59°F [15.0°C]		
CFM [L/s]		4800 [2265]	3750 [1770]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	4800 [2265]	3750 [1770]	
DR ①		0.09	0.03	0	0.09	0.03	0	0.09	0.03	0	0.09	0.03	0	0.09	0.03	
75 [23.9]	Total BTUH [kW]	155.3 [45.5]	147.8 [43.3]	143.8 [42.2]	147.8 [43.3]	140.7 [41.2]	136.9 [40.1]	142.8 [41.8]	135.8 [39.8]	132.2 [38.7]	141.5 [41.5]	134.7 [39.5]	131.1 [38.4]	141.4 [41.4]	130.9 [38.4]	
	Sens BTUH [kW]	97.3 [28.5]	86.1 [25.2]	80.2 [23.5]	115.8 [33.9]	102.4 [30.0]	95.4 [28.0]	132.9 [38.9]	117.5 [34.4]	109.5 [32.1]	140.6 [41.2]	124.3 [36.4]	115.8 [33.9]	141.4 [41.4]	121.4 [35.6]	
	Power	7.5	7.3	7.2	7.4	7.2	7.1	7.3	7.1	7.0	7.2	7.1	7	7.2	6.9	
80 [26.7]	Total BTUH [kW]	150.6 [44.1]	143.4 [42.0]	139.5 [40.9]	143.2 [42.0]	136.2 [39.9]	132.6 [38.9]	138.1 [40.5]	131.4 [38.5]	127.9 [37.5]	136.9 [40.1]	130.2 [38.2]	126.8 [37.1]	136.7 [40.1]	126.6 [37.1]	
	Sens BTUH [kW]	94.9 [27.8]	84.0 [24.6]	78.2 [22.9]	113.5 [33.2]	100.3 [29.4]	93.5 [27.4]	130.5 [38.2]	115.4 [33.8]	107.5 [31.5]	136.9 [40.1]	122.2 [35.8]	113.8 [33.4]	136.7 [40.1]	119.5 [35.0]	
	Power	7.9	7.7	7.6	7.8	7.6	7.5	7.7	7.5	7.4	7.7	7.5	7.4	7.6	7.3	
85 [29.4]	Total BTUH [kW]	146.0 [42.8]	138.9 [40.7]	135.2 [39.6]	138.5 [40.6]	131.8 [38.6]	128.3 [37.6]	133.5 [39.1]	127.0 [37.2]	123.6 [36.2]	132.2 [38.7]	125.8 [36.9]	122.5 [35.9]	132.1 [38.7]	122.3 [35.9]	
	Sens BTUH [kW]	92.5 [27.1]	81.8 [24.0]	76.2 [22.3]	111.0 [32.5]	98.2 [28.8]	91.5 [26.8]	128.1 [37.5]	113.3 [33.2]	105.5 [30.9]	132.2 [38.7]	120.1 [35.2]	111.9 [32.8]	132.1 [38.7]	117.5 [34.4]	
	Power	8.3	8.1	8.0	8.2	8.0	7.9	8.2	8.0	7.9	8.1	7.9	7.8	8.1	7.8	
90 [32.2]	Total BTUH [kW]	141.4 [41.4]	134.5 [39.4]	131.0 [38.4]	133.9 [39.2]	127.4 [37.3]	124.0 [36.3]	128.8 [37.8]	122.6 [35.9]	119.3 [35.0]	127.6 [37.4]	121.4 [35.6]	118.2 [34.6]	127.5 [37.4]	118.1 [34.6]	
	Sens BTUH [kW]	90.1 [26.4]	79.7 [23.3]	74.2 [21.7]	108.6 [31.8]	96.0 [28.1]	89.5 [26.2]	125.6 [36.8]	111.1 [32.6]	103.5 [30.3]	127.6 [37.4]	117.9 [34.5]	109.8 [32.2]	127.5 [37.4]	115.5 [33.8]	
	Power	8.8	8.6	8.5	8.7	8.5	8.4	8.6	8.4	8.3	8.6	8.4	8.3	8.5	8.2	
95 [35]	Total BTUH [kW]	136.8 [40.1]	130.2 [38.1]	126.7 [37.1]	129.3 [37.9]	123.0 [36.1]	119.7 [35.1]	124.2 [36.4]	118.2 [34.6]	115.1 [33.7]	123.0 [36.0]	117.0 [34.3]	113.9 [33.4]	122.9 [36.0]	113.8 [33.3]	
	Sens BTUH [kW]	87.6 [25.7]	77.5 [22.7]	72.2 [21.1]	106.1 [31.1]	93.8 [27.5]	87.4 [25.6]	123.1 [36.1]	108.9 [31.9]	101.5 [29.7]	123.0 [36.0]	115.7 [33.9]	107.8 [31.6]	122.9 [36.0]	116.9 [34.3]	
	Power	9.3	9.1	9.0	9.2	9.0	8.9	9.1	8.9	8.8	9.1	8.9	8.8	9.1	8.7	
100 [37.8]	Total BTUH [kW]	132.2 [38.7]	125.8 [36.9]	122.4 [35.9]	124.7 [36.5]	118.7 [34.8]	115.5 [33.8]	119.6 [35.1]	113.8 [33.4]	110.8 [32.5]	118.4 [34.7]	112.7 [33.0]	109.7 [32.1]	118.3 [34.7]	109.5 [32.1]	
	Sens BTUH [kW]	85.1 [24.9]	75.2 [22.0]	70.1 [20.5]	103.6 [30.3]	91.6 [26.8]	85.3 [25.0]	119.6 [35.1]	106.7 [31.3]	99.4 [29.1]	118.4 [34.7]	112.7 [33.0]	105.7 [31.0]	118.3 [34.7]	109.5 [32.1]	
	Power	9.9	9.6	9.5	9.8	9.5	9.4	9.7	9.5	9.3	9.6	9.4	9.3	9.6	9.2	
105 [40.6]	Total BTUH [kW]	127.6 [37.4]	121.4 [35.6]	118.2 [34.6]	120.1 [35.2]	114.3 [33.5]	111.2 [32.6]	115.1 [33.7]	109.5 [32.1]	106.6 [31.2]	113.8 [33.4]	108.3 [31.7]	105.4 [30.9]	113.7 [33.3]	105.3 [30.9]	
	Sens BTUH [kW]	82.5 [24.2]	73.0 [21.4]	68.0 [19.9]	101.0 [29.6]	89.3 [26.2]	83.2 [24.4]	115.1 [33.7]	104.4 [30.6]	97.3 [28.5]	113.8 [33.4]	108.3 [31.7]	103.6 [30.4]	113.7 [33.3]	105.3 [30.9]	
	Power	10.5	10.2	10.1	10.4	10.1	10.0	10.3	10.0	9.9	10.2	10.0	9.8	10.2	9.8	
110 [43.3]	Total BTUH [kW]	123.0 [36.1]	117.1 [34.3]	114.0 [33.4]	115.5 [33.9]	109.9 [32.2]	107.0 [31.4]	110.5 [32.4]	105.1 [30.8]	102.3 [30.0]	109.3 [32.0]	104.0 [30.5]	101.2 [29.7]	109.1 [32.0]	101.1 [29.6]	
	Sens BTUH [kW]	79.9 [23.4]	70.6 [20.7]	65.8 [19.3]	98.4 [28.8]	87.0 [25.5]	81.1 [23.8]	110.5 [32.4]	102.1 [29.9]	95.1 [27.9]	109.3 [32.0]	104.0 [30.5]	101.2 [29.7]	109.1 [32.0]	101.1 [29.6]	
	Power	11.1	10.8	10.7	11.0	10.7	10.6	10.9	10.6	10.5	10.8	10.6	10.4	10.8	10.4	
115 [46.1]	Total BTUH [kW]	118.5 [34.7]	112.7 [33.0]	109.7 [32.2]	111.0 [32.5]	105.6 [31.0]	102.8 [30.1]	105.9 [31.0]	100.8 [29.5]	98.1 [28.8]	104.7 [30.7]	99.6 [29.2]	97.0 [28.4]	104.6 [30.6]	96.8 [28.4]	
	Sens BTUH [kW]	77.2 [22.6]	68.3 [20.0]	63.6 [18.6]	95.7 [28.1]	84.7 [24.8]	78.9 [23.1]	105.9 [31.0]	99.8 [29.2]	92.9 [27.2]	104.7 [30.7]	99.6 [29.2]	97.0 [28.4]	104.6 [30.6]	96.8 [28.4]	
	Power	11.7	11.4	11.3	11.6	11.3	11.2	11.5	11.2	11.1	11.5	11.2	11.1	11.4	11.0	
120 [48.9]	Total BTUH [kW]	113.9 [33.4]	108.4 [31.8]	105.5 [30.9]	106.5 [31.2]	101.3 [29.7]	98.6 [28.9]	101.4 [29.7]	96.5 [28.3]	93.9 [27.5]	100.2 [29.4]	95.3 [27.9]	92.8 [27.2]	100.0 [29.3]	92.6 [27.1]	
	Sens BTUH [kW]	74.5 [21.8]	65.9 [19.3]	61.4 [18.0]	93.0 [27.3]	82.3 [24.1]	76.7 [22.5]	101.4 [29.7]	96.5 [28.3]	90.7 [26.6]	100.2 [29.4]	95.3 [27.9]	92.8 [27.2]	100.0 [29.3]	92.6 [27.1]	
	Power	12.4	12.1	11.9	12.3	12.0	11.8	12.2	11.9	11.7	12.1	11.9	11.7	12.1	11.7	
125 [51.7]	Total BTUH [kW]	109.4 [32.1]	104.1 [30.5]	101.3 [29.7]	101.9 [29.9]	97.0 [28.4]	94.4 [27.7]	96.9 [28.4]	92.2 [27.0]	89.7 [26.3]	95.6 [28.0]	91.0 [26.7]	88.6 [26.0]	95.5 [28.0]	88.5 [25.9]	
	Sens BTUH [kW]	71.8 [21.0]	63.5 [18.6]	59.2 [17.3]	90.3 [26.5]	79.9 [23.4]	74.4 [21.8]	96.9 [28.4]	92.2 [27.0]	88.5 [25.9]	95.6 [28.0]	91.0 [26.7]	88.6 [26.0]	95.5 [28.0]	88.5 [25.9]	
	Power	13.1	12.8	12.6	13.0	12.7	12.5	12.9	12.6	12.4	12.9	12.5	12.4	12.8	12.3	

DR —Depression ratio
dbE —Entering air dry bulb
wbE —Entering air wet bulb

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

[] Designates Metric Conversions

Total —Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power —KW input

COOLING PERFORMANCE DATA—RGEDZS150A

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			4500 [2124]	3750 [1770]	3000 [1416]	4500 [2124]	3750 [1770]	3000 [1416]	4500 [2124]	3750 [1770]	3000 [1416]
DR ①			0	0.01	0.09	0	0.01	0.09	0	0.01	0.09
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	179.6 [52.6]	173.3 [50.8]	167.0 [48.9]	172.2 [50.5]	166.2 [48.7]	160.2 [46.9]	167.3 [49.0]	161.4 [47.3]	155.5 [45.6]
		Sens BTUH [kW]	113.4 [33.2]	97.4 [28.5]	82.6 [24.2]	131.0 [38.4]	113.8 [33.3]	97.7 [28.6]	147.4 [43.2]	128.9 [37.8]	111.5 [32.7]
		Power	10.2	10.0	9.9	10.1	9.9	9.8	10.0	9.9	9.7
	80 [26.7]	Total BTUH [kW]	175.0 [51.3]	168.9 [49.5]	162.8 [47.7]	167.6 [49.1]	161.8 [47.4]	155.9 [45.7]	162.7 [47.7]	157.0 [46.0]	151.3 [44.3]
		Sens BTUH [kW]	110.9 [32.5]	95.3 [27.9]	80.9 [23.7]	128.5 [37.7]	111.7 [32.7]	95.9 [28.1]	144.9 [42.5]	126.8 [37.2]	109.8 [32.2]
		Power	10.6	10.4	10.3	10.5	10.4	10.2	10.4	10.3	10.1
	85 [29.4]	Total BTUH [kW]	170.5 [50.0]	164.5 [48.2]	158.5 [46.4]	163.1 [47.8]	157.4 [46.1]	151.6 [44.4]	158.1 [46.3]	152.5 [44.7]	147.0 [43.1]
		Sens BTUH [kW]	108.5 [31.8]	93.2 [27.3]	79.1 [23.2]	126.1 [36.9]	109.6 [32.1]	94.1 [27.6]	142.4 [41.7]	124.6 [36.5]	108.0 [31.6]
		Power	11.1	10.9	10.7	11.0	10.8	10.6	10.9	10.7	10.5
	90 [32.2]	Total BTUH [kW]	165.9 [48.6]	160.1 [46.9]	154.3 [45.2]	158.5 [46.4]	153.0 [44.8]	147.4 [43.2]	153.5 [45.0]	148.1 [43.4]	142.8 [41.8]
		Sens BTUH [kW]	105.8 [31.0]	91.0 [26.7]	77.2 [22.6]	123.4 [36.2]	107.4 [31.5]	92.3 [27.0]	139.7 [40.9]	122.4 [35.9]	106.2 [31.1]
		Power	11.6	11.4	11.2	11.5	11.3	11.1	11.4	11.2	11.0
95 [35]	Total BTUH [kW]	161.4 [47.3]	155.7 [45.6]	150.0 [43.9]	154.0 [45.1]	148.6 [43.5]	143.2 [42.0]	149.0 [43.7]	143.8 [42.1]	138.5 [40.6]	
	Sens BTUH [kW]	103.3 [30.3]	88.8 [26.0]	75.3 [22.1]	120.9 [35.4]	105.2 [30.8]	90.5 [26.5]	137.2 [40.2]	120.3 [35.2]	104.3 [30.6]	
	Power	12.1	11.9	11.6	12.0	11.8	11.6	11.9	11.7	11.5	
100 [37.8]	Total BTUH [kW]	156.8 [45.9]	151.3 [44.3]	145.8 [42.7]	149.4 [43.8]	144.2 [42.3]	139.0 [40.7]	144.5 [42.3]	139.4 [40.8]	134.3 [39.3]	
	Sens BTUH [kW]	100.6 [29.5]	86.5 [25.3]	73.4 [21.5]	118.2 [34.6]	102.9 [30.1]	88.6 [26.0]	134.6 [39.4]	118.0 [34.6]	102.4 [30.0]	
	Power	12.6	12.4	12.2	12.5	12.3	12.1	12.4	12.2	12.0	
105 [40.6]	Total BTUH [kW]	152.3 [44.6]	147.0 [43.1]	141.6 [41.5]	144.9 [42.5]	139.8 [41.0]	134.8 [39.5]	139.9 [41.0]	135.0 [39.6]	130.1 [38.1]	
	Sens BTUH [kW]	98.0 [28.7]	84.3 [24.7]	71.5 [20.9]	115.6 [33.9]	100.6 [29.5]	86.7 [25.4]	131.9 [38.6]	115.7 [33.9]	100.5 [29.4]	
	Power	13.2	13.0	12.7	13.1	12.9	12.6	13.0	12.8	12.5	
110 [43.3]	Total BTUH [kW]	147.8 [43.3]	142.6 [41.8]	137.4 [40.3]	140.4 [41.1]	135.5 [39.7]	130.6 [38.3]	135.4 [39.7]	130.7 [38.3]	125.9 [36.9]	
	Sens BTUH [kW]	95.3 [27.9]	82.0 [24.0]	69.6 [20.4]	112.9 [33.1]	98.4 [28.8]	84.8 [24.8]	129.2 [37.9]	113.5 [33.3]	98.6 [28.9]	
	Power	13.8	13.5	13.3	13.7	13.5	13.2	13.6	13.4	13.1	
115 [46.1]	Total BTUH [kW]	143.3 [42.0]	138.3 [40.5]	133.3 [39.1]	135.9 [39.8]	131.2 [38.4]	126.4 [37.0]	130.9 [38.4]	126.4 [37.0]	121.8 [35.7]	
	Sens BTUH [kW]	92.6 [27.1]	79.7 [23.4]	67.7 [19.8]	110.1 [32.3]	96.0 [28.1]	82.7 [24.2]	126.4 [37.0]	111.1 [32.6]	96.6 [28.3]	
	Power	14.4	14.2	13.9	14.3	14.1	13.8	14.2	14.0	13.7	

DR —Depression ratio
dbE —Entering air dry bulb
wbE —Entering air wet bulb

Total —Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA — RGEDZT090A

WBE		ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①												61°F [16.1°C]				59°F [15.0°C]			
		67°F [19.4°C]			63°F [17.2°C]			61°F [16.1°C]			59°F [15.0°C]										
CFM [L/s]		3600 [1699]	2775 [1310]	2400 [1133]	3600 [1699]	2775 [1310]	2400 [1133]	3600 [1699]	2775 [1310]	2400 [1133]	3600 [1699]	2775 [1310]	2400 [1133]	3600 [1699]	2775 [1310]	2400 [1133]	3600 [1699]	2775 [1310]	2400 [1133]		
75 [23.9]	Total BTUH [kW]	119.6 [35.0]	113.5 [33.2]	110.7 [32.4]	112.7 [33.0]	107.0 [31.3]	104.3 [30.6]	107.8 [31.6]	102.3 [30.0]	99.8 [29.2]	106.4 [31.2]	100.9 [29.6]	98.4 [28.8]	105.8 [31.0]	100.4 [29.4]	97.9 [28.7]	105.8 [31.0]	100.4 [29.4]	97.9 [28.7]		
	Sens BTUH [kW]	70.3 [20.6]	61.8 [18.1]	57.9 [17.0]	83.3 [24.4]	73.2 [21.4]	68.5 [20.1]	96.0 [28.1]	84.3 [24.7]	79.0 [23.2]	102.2 [29.9]	89.7 [26.3]	84.1 [24.6]	105.8 [31.0]	94.9 [27.8]	88.9 [26.1]	105.8 [31.0]	94.9 [27.8]	88.9 [26.1]		
	Power	5.2	5.1	5.0	5.1	5.0	4.9	5.1	4.9	4.9	5.0	4.9	4.9	4.9	5.0	4.9	4.8	5.0	4.9	4.8	
80 [26.7]	Total BTUH [kW]	116.1 [34.0]	110.1 [32.3]	107.4 [31.5]	109.2 [32.0]	103.6 [30.4]	101.1 [29.6]	104.3 [30.6]	99.0 [29.0]	96.5 [28.3]	102.9 [30.1]	97.6 [28.6]	95.2 [27.9]	102.3 [30.0]	97.1 [28.4]	94.7 [27.7]	102.3 [30.0]	97.1 [28.4]	94.7 [27.7]		
	Sens BTUH [kW]	68.4 [20.1]	60.1 [17.6]	56.3 [16.5]	81.4 [23.9]	71.5 [20.9]	67.0 [19.6]	94.1 [27.6]	82.7 [24.2]	77.4 [22.7]	100.3 [29.4]	88.1 [25.8]	82.5 [24.2]	102.3 [30.0]	93.2 [27.3]	87.4 [25.6]	102.3 [30.0]	93.2 [27.3]	87.4 [25.6]		
	Power	5.6	5.4	5.4	5.5	5.4	5.3	5.5	5.3	5.3	5.4	5.3	5.3	5.4	5.3	5.2	5.4	5.3	5.2		
85 [29.4]	Total BTUH [kW]	112.6 [33.0]	106.8 [31.3]	104.2 [30.5]	105.7 [31.0]	100.3 [29.4]	97.8 [28.7]	100.8 [29.5]	95.6 [28.0]	93.3 [27.3]	99.3 [29.1]	94.2 [27.6]	91.9 [26.9]	98.8 [28.9]	93.7 [27.5]	91.4 [26.8]	98.8 [28.9]	93.7 [27.5]	91.4 [26.8]		
	Sens BTUH [kW]	66.6 [19.5]	58.5 [17.1]	54.8 [16.0]	79.5 [23.3]	69.8 [20.5]	65.4 [19.2]	92.3 [27.0]	81.0 [23.7]	75.9 [22.2]	98.4 [28.8]	86.4 [25.3]	81.0 [23.7]	98.8 [28.9]	91.6 [26.8]	85.8 [25.1]	98.8 [28.9]	91.6 [26.8]	85.8 [25.1]		
	Power	6.0	5.9	5.8	6.0	5.8	5.8	5.9	5.8	5.7	5.9	5.7	5.7	5.9	5.7	5.6	5.9	5.7	5.6		
90 [32.2]	Total BTUH [kW]	109.0 [31.9]	103.4 [30.3]	100.9 [29.6]	102.1 [29.9]	96.9 [28.4]	94.5 [27.7]	97.2 [28.5]	92.2 [27.0]	90.0 [26.4]	95.8 [28.1]	90.9 [27.9]	88.6 [26.0]	95.2 [27.9]	90.3 [26.5]	88.1 [25.8]	95.2 [27.9]	90.3 [26.5]	88.1 [25.8]		
	Sens BTUH [kW]	64.7 [19.0]	56.8 [16.7]	53.2 [15.6]	77.7 [22.8]	68.2 [20.0]	63.9 [18.7]	90.4 [26.5]	79.4 [23.3]	74.4 [21.8]	95.8 [28.1]	84.8 [24.8]	79.4 [23.3]	95.2 [27.9]	90.0 [26.4]	84.3 [24.7]	95.2 [27.9]	90.0 [26.4]	84.3 [24.7]		
	Power	6.6	6.4	6.3	6.5	6.4	6.3	6.5	6.3	6.3	6.4	6.3	6.2	6.4	6.2	6.2	6.4	6.2	6.2		
95 [35]	Total BTUH [kW]	105.4 [30.9]	100.0 [29.3]	97.5 [28.6]	98.5 [28.9]	93.5 [27.4]	91.2 [26.7]	93.6 [27.4]	88.8 [26.0]	86.6 [25.4]	92.2 [27.0]	87.4 [25.6]	85.3 [25.0]	91.6 [26.8]	86.9 [25.5]	84.8 [24.8]	91.6 [26.8]	86.9 [25.5]	84.8 [24.8]		
	Sens BTUH [kW]	62.9 [18.4]	55.2 [16.2]	51.7 [15.2]	75.8 [22.2]	66.6 [19.5]	62.4 [18.3]	88.6 [26.0]	77.8 [22.8]	72.9 [21.4]	92.2 [27.0]	83.2 [24.4]	77.9 [22.8]	91.6 [26.8]	86.9 [25.5]	82.8 [24.3]	91.6 [26.8]	86.9 [25.5]	82.8 [24.3]		
	Power	7.2	7.0	6.9	7.2	7.0	6.9	7.1	6.9	6.9	7.1	6.9	6.9	6.8	7.0	6.9	7.0	6.9	6.8		
100 [37.8]	Total BTUH [kW]	101.7 [29.8]	96.5 [28.3]	94.2 [27.6]	94.9 [27.8]	90.0 [26.4]	87.8 [25.7]	90.0 [26.4]	85.4 [25.0]	83.3 [24.4]	88.5 [25.9]	84.0 [24.6]	81.9 [24.0]	88.0 [25.8]	83.4 [24.5]	81.4 [23.9]	88.0 [25.8]	83.4 [24.5]	81.3 [23.8]		
	Sens BTUH [kW]	61.0 [17.9]	53.6 [15.7]	50.2 [14.7]	74.0 [21.7]	65.0 [19.0]	60.9 [17.8]	86.7 [25.4]	76.2 [22.3]	71.4 [20.9]	88.5 [25.9]	81.6 [23.9]	76.4 [22.4]	88.0 [25.8]	83.4 [24.5]	81.3 [23.8]	88.0 [25.8]	83.4 [24.5]	81.3 [23.8]		
	Power	7.9	7.7	7.6	7.9	7.7	7.6	7.8	7.6	7.6	7.5	7.8	7.6	7.5	7.7	7.4	7.7	7.5	7.4		
105 [40.6]	Total BTUH [kW]	98.1 [28.7]	93.0 [27.3]	90.7 [26.6]	91.2 [26.7]	86.5 [25.4]	84.4 [24.7]	86.3 [25.3]	81.9 [24.0]	79.8 [23.4]	84.8 [24.9]	80.5 [23.6]	78.5 [23.0]	84.3 [24.7]	79.9 [23.4]	78.0 [22.9]	84.3 [24.7]	79.9 [23.4]	78.0 [22.9]		
	Sens BTUH [kW]	59.3 [17.4]	52.0 [15.2]	48.8 [14.3]	72.2 [21.2]	63.4 [18.6]	59.4 [17.4]	84.9 [24.9]	74.6 [21.9]	69.9 [20.5]	84.8 [24.9]	80.0 [23.4]	74.9 [22.0]	84.3 [24.7]	79.9 [23.4]	78.0 [22.9]	84.3 [24.7]	79.9 [23.4]	78.0 [22.9]		
	Power	8.7	8.5	8.4	8.6	8.4	8.3	8.6	8.4	8.4	8.3	8.5	8.3	8.2	8.5	8.2	8.5	8.3	8.2		
110 [43.3]	Total BTUH [kW]	94.3 [27.6]	89.5 [26.2]	87.3 [25.6]	87.5 [25.6]	83.0 [24.3]	81.0 [23.7]	82.6 [24.2]	78.3 [23.0]	76.4 [22.4]	81.1 [23.8]	76.9 [22.5]	75.1 [22.0]	80.5 [23.6]	76.4 [22.4]	74.5 [21.8]	80.5 [23.6]	76.4 [22.4]	74.5 [21.8]		
	Sens BTUH [kW]	57.5 [16.8]	50.5 [14.8]	47.3 [13.9]	70.4 [20.6]	61.9 [18.1]	57.9 [17.0]	82.6 [24.2]	73.0 [21.4]	68.4 [20.1]	81.1 [23.8]	76.9 [22.5]	73.5 [21.5]	80.5 [23.6]	76.4 [22.4]	74.5 [21.8]	80.5 [23.6]	76.4 [22.4]	74.5 [21.8]		
	Power	9.5	9.3	9.2	9.5	9.2	9.1	9.4	9.2	9.1	9.1	9.4	9.2	9.0	9.4	9.1	9.0	9.4	9.1		
115 [46.1]	Total BTUH [kW]	90.6 [26.5]	85.9 [25.2]	83.8 [24.6]	83.7 [24.5]	79.4 [23.3]	77.5 [22.7]	78.8 [23.1]	74.8 [21.9]	72.9 [21.4]	77.3 [22.7]	73.4 [21.5]	71.6 [21.0]	76.8 [22.5]	72.8 [21.3]	71.1 [20.8]	76.8 [22.5]	72.8 [21.3]	71.1 [20.8]		
	Sens BTUH [kW]	55.7 [16.3]	48.9 [14.3]	45.8 [13.4]	68.7 [20.1]	60.3 [17.7]	56.5 [16.6]	78.8 [23.1]	71.5 [20.9]	67.0 [19.6]	77.3 [22.7]	73.4 [21.5]	71.6 [21.0]	76.8 [22.5]	72.8 [21.3]	71.1 [20.8]	76.8 [22.5]	72.8 [21.3]	71.1 [20.8]		
	Power	10.5	10.2	10.1	10.4	10.2	10.0	10.4	10.1	10.1	10.0	10.3	10.1	9.9	10.3	10.0	9.9	10.3	10.0		
120 [48.9]	Total BTUH [kW]	86.8 [25.4]	82.3 [24.1]	80.3 [23.5]	79.9 [23.4]	75.8 [22.2]	74.0 [21.7]	75.0 [22.0]	71.1 [20.8]	69.4 [20.3]	73.5 [21.6]	69.8 [20.4]	68.1 [19.9]	73.0 [21.4]	69.2 [20.3]	67.5 [19.8]	73.0 [21.4]	69.2 [20.3]	67.5 [19.8]		
	Sens BTUH [kW]	54.0 [15.8]	47.4 [13.9]	44.4 [13.0]	66.9 [19.6]	58.8 [17.2]	55.1 [16.1]	75.0 [22.0]	70.0 [20.5]	65.5 [19.2]	73.5 [21.6]	69.8 [20.4]	68.1 [19.9]	73.0 [21.4]	69.2 [20.3]	67.5 [19.8]	73.0 [21.4]	69.2 [20.3]	67.5 [19.8]		
	Power	11.5	11.2	11.1	11.4	11.1	11.0	11.4	11.1	11.1	11.0	11.3	11.1	10.9	11.3	11.0	10.9	11.3	11.0		
125 [51.7]	Total BTUH [kW]	82.9 [24.3]	78.7 [23.1]	76.8 [22.5]	76.1 [22.3]	72.2 [21.2]	70.4 [20.6]	71.2 [20.9]	67.5 [19.8]	65.8 [19.3]	69.7 [20.4]	66.1 [19.4]	64.5 [18.9]	69.1 [20.3]	65.6 [19.2]	64.0 [18.8]	69.1 [20.3]	65.6 [19.2]	64.0 [18.8]		
	Sens BTUH [kW]	52.3 [15.3]	45.9 [13.4]	43.0 [12.6]	65.2 [19.1]	57.3 [16.8]	53.7 [15.7]	71.2 [20.9]	67.5 [19.8]	64.1 [18.8]	69.7 [20.4]	66.1 [19.4]	64.5 [18.9]	69.1 [20.3]	65.6 [19.2]	64.0 [18.8]	69.1 [20.3]	65.6 [19.2]	64.0 [18.8]		
	Power	12.6	12.3	12.1	12.5	12.2	12.1	12.5	12.1	12.1	12.0	12.4	12.1	12.0	12.4	12.1	11.9	12.4	12.1		

COOLING PERFORMANCE DATA — RGEDZT102A

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①																																	
wB/E CFM [L/s]		71°F [21.7°C]					67°F [19.4°C]					63°F [17.2°C]					61°F [16.1°C]					59°F [15.0°C]											
		4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]	4100 [1935]	3200 [1510]	2700 [1274]	2700 [1274]				
75 [23.9]	Total BTUH [kW]	129.9 [38.1]	123.6 [36.2]	120.1 [35.2]	113.4 [33.2]	118.3 [34.7]	112.5 [33.0]	109.3 [32.0]	103.9 [32.0]	117.5 [34.4]	111.8 [32.8]	108.6 [31.8]	103.6 [31.8]	118.0 [34.6]	112.2 [32.9]	109.3 [32.0]	103.6 [31.8]	118.0 [34.6]	112.2 [32.9]	109.3 [32.0]	103.6 [31.8]	118.0 [34.6]	112.2 [32.9]	109.3 [32.0]	103.6 [31.8]	118.0 [34.6]	112.2 [32.9]	109.3 [32.0]	103.6 [31.8]	118.0 [34.6]	112.2 [32.9]	109.3 [32.0]	
	Sens BTUH [kW]	81.3 [23.8]	71.9 [21.1]	66.6 [19.5]	61.0 [18.1]	96.4 [28.2]	85.2 [25.0]	79.0 [23.1]	73.7 [21.6]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]	110.1 [32.3]		
	Power	6.2	6.1	6.0	5.9	6.1	6.0	5.9	5.8	5.7	6.1	6.0	5.9	5.8	6.1	6.0	5.9	5.8	6.1	6.0	5.9	5.8	6.1	6.0	5.9	5.8	6.1	6.0	5.9	5.8	6.1	6.0	5.9
80 [26.7]	Total BTUH [kW]	125.7 [36.8]	119.5 [35.0]	116.1 [34.0]	109.5 [32.1]	118.5 [34.7]	112.7 [33.0]	109.5 [32.1]	105.4 [30.9]	114.0 [33.4]	108.5 [31.8]	105.4 [30.9]	101.5 [29.7]	113.3 [33.2]	107.8 [31.6]	104.7 [30.7]	101.5 [29.7]	113.3 [33.2]	107.8 [31.6]	104.7 [30.7]	101.5 [29.7]	113.3 [33.2]	107.8 [31.6]	104.7 [30.7]	101.5 [29.7]	113.3 [33.2]	107.8 [31.6]	104.7 [30.7]	101.5 [29.7]	113.3 [33.2]	107.8 [31.6]	104.7 [30.7]	101.5 [29.7]
	Sens BTUH [kW]	79.2 [23.2]	70.0 [20.5]	64.9 [19.0]	60.0 [17.5]	94.3 [27.6]	83.3 [24.4]	77.2 [22.6]	72.0 [21.1]	108.0 [31.6]	100.5 [29.0]	95.4 [28.0]	90.2 [26.4]	111.3 [33.2]	103.6 [31.8]	100.8 [29.5]	93.4 [27.4]	111.3 [33.2]	103.6 [31.8]	100.8 [29.5]	93.4 [27.4]	111.3 [33.2]	103.6 [31.8]	100.8 [29.5]	93.4 [27.4]	111.3 [33.2]	103.6 [31.8]	100.8 [29.5]	93.4 [27.4]	111.3 [33.2]	103.6 [31.8]	100.8 [29.5]	93.4 [27.4]
	Power	6.6	6.4	6.3	6.2	6.5	6.3	6.2	6.1	6.4	6.3	6.2	6.1	6.0	6.3	6.2	6.1	6.0	6.3	6.2	6.1	6.0	6.3	6.2	6.1	6.0	6.3	6.2	6.1	6.0	6.3	6.2	6.1
85 [29.4]	Total BTUH [kW]	121.4 [35.6]	115.5 [33.8]	112.2 [32.9]	105.6 [30.9]	114.2 [33.5]	108.7 [32.2]	104.4 [30.6]	101.5 [29.7]	109.8 [32.2]	105.8 [31.0]	102.6 [30.6]	99.3 [29.0]	109.0 [31.9]	103.7 [30.4]	100.8 [29.5]	97.7 [28.4]	109.0 [31.9]	103.7 [30.4]	100.8 [29.5]	97.7 [28.4]	109.0 [31.9]	103.7 [30.4]	100.8 [29.5]	97.7 [28.4]	109.0 [31.9]	103.7 [30.4]	100.8 [29.5]	97.7 [28.4]	109.0 [31.9]	103.7 [30.4]	100.8 [29.5]	97.7 [28.4]
	Sens BTUH [kW]	77.0 [22.6]	68.1 [20.0]	63.1 [18.5]	58.5 [17.1]	92.1 [27.0]	81.4 [23.9]	75.5 [22.1]	70.2 [20.6]	105.8 [31.0]	98.5 [29.0]	93.5 [27.4]	88.5 [25.9]	109.0 [31.9]	103.7 [30.4]	100.8 [29.5]	97.7 [28.4]	109.0 [31.9]	103.7 [30.4]	100.8 [29.5]	97.7 [28.4]	109.0 [31.9]	103.7 [30.4]	100.8 [29.5]	97.7 [28.4]	109.0 [31.9]	103.7 [30.4]	100.8 [29.5]	97.7 [28.4]	109.0 [31.9]	103.7 [30.4]	100.8 [29.5]	97.7 [28.4]
	Power	6.9	6.8	6.7	6.6	6.9	6.7	6.6	6.5	6.8	6.7	6.6	6.5	6.4	6.7	6.6	6.5	6.4	6.7	6.6	6.5	6.4	6.7	6.6	6.5	6.4	6.7	6.6	6.5	6.4	6.7	6.6	6.5
90 [32.2]	Total BTUH [kW]	117.1 [34.3]	111.4 [32.7]	108.3 [31.7]	101.6 [29.8]	110.0 [32.2]	104.6 [30.7]	101.6 [29.8]	97.5 [28.4]	105.5 [30.9]	100.4 [29.4]	97.5 [28.4]	94.4 [27.4]	104.8 [30.7]	99.7 [29.2]	96.8 [28.4]	93.7 [27.4]	104.8 [30.7]	99.7 [29.2]	96.8 [28.4]	93.7 [27.4]	104.8 [30.7]	99.7 [29.2]	96.8 [28.4]	93.7 [27.4]	104.8 [30.7]	99.7 [29.2]	96.8 [28.4]	93.7 [27.4]	104.8 [30.7]	99.7 [29.2]	96.8 [28.4]	93.7 [27.4]
	Sens BTUH [kW]	74.9 [21.9]	66.2 [19.4]	61.4 [18.0]	57.1 [16.7]	89.9 [26.4]	79.5 [23.3]	73.7 [21.6]	69.0 [20.3]	103.6 [30.4]	96.3 [28.4]	91.6 [26.8]	86.9 [25.4]	104.8 [30.7]	99.7 [29.2]	96.8 [28.4]	93.7 [27.4]	104.8 [30.7]	99.7 [29.2]	96.8 [28.4]	93.7 [27.4]	104.8 [30.7]	99.7 [29.2]	96.8 [28.4]	93.7 [27.4]	104.8 [30.7]	99.7 [29.2]	96.8 [28.4]	93.7 [27.4]	104.8 [30.7]	99.7 [29.2]	96.8 [28.4]	93.7 [27.4]
	Power	7.4	7.2	7.1	7.0	7.3	7.1	7.0	6.9	7.2	7.1	7.0	6.9	6.8	7.1	7.0	6.9	6.8	7.1	7.0	6.9	6.8	7.1	7.0	6.9	6.8	7.1	7.0	6.9	6.8	7.1	7.0	6.9
95 [35]	Total BTUH [kW]	112.9 [33.1]	107.4 [31.5]	104.3 [30.6]	97.7 [28.6]	105.7 [31.0]	100.5 [29.5]	97.7 [28.6]	94.4 [27.4]	101.2 [29.7]	96.3 [28.2]	93.6 [27.4]	90.5 [26.8]	100.5 [29.4]	95.6 [28.0]	92.9 [27.2]	89.9 [26.8]	100.5 [29.4]	95.6 [28.0]	92.9 [27.2]	89.9 [26.8]	100.5 [29.4]	95.6 [28.0]	92.9 [27.2]	89.9 [26.8]	100.5 [29.4]	95.6 [28.0]	92.9 [27.2]	89.9 [26.8]	100.5 [29.4]	95.6 [28.0]	92.9 [27.2]	89.9 [26.8]
	Sens BTUH [kW]	72.6 [21.3]	64.2 [18.8]	59.5 [17.4]	55.1 [16.1]	87.7 [25.7]	77.5 [22.7]	71.9 [21.1]	67.4 [20.1]	101.2 [29.7]	94.4 [27.4]	89.7 [26.3]	85.1 [25.1]	100.5 [29.4]	95.6 [28.0]	92.9 [27.2]	89.9 [26.8]	100.5 [29.4]	95.6 [28.0]	92.9 [27.2]	89.9 [26.8]	100.5 [29.4]	95.6 [28.0]	92.9 [27.2]	89.9 [26.8]	100.5 [29.4]	95.6 [28.0]	92.9 [27.2]	89.9 [26.8]	100.5 [29.4]	95.6 [28.0]	92.9 [27.2]	89.9 [26.8]
	Power	7.8	7.6	7.5	7.4	7.7	7.6	7.5	7.4	7.7	7.6	7.5	7.4	7.3	7.6	7.5	7.4	7.3	7.6	7.5	7.4	7.3	7.6	7.5	7.4	7.3	7.6	7.5	7.4	7.3	7.6	7.5	7.4
100 [37.8]	Total BTUH [kW]	108.6 [31.8]	103.3 [30.3]	100.4 [29.4]	93.7 [27.5]	101.4 [29.7]	96.5 [28.3]	93.7 [27.5]	90.5 [26.8]	97.0 [28.4]	92.2 [27.0]	89.6 [26.3]	86.5 [25.7]	96.2 [28.2]	91.5 [26.8]	88.9 [26.1]	85.8 [25.5]	96.2 [28.2]	91.5 [26.8]	88.9 [26.1]	85.8 [25.5]	96.2 [28.2]	91.5 [26.8]	88.9 [26.1]	85.8 [25.5]	96.2 [28.2]	91.5 [26.8]	88.9 [26.1]	85.8 [25.5]	96.2 [28.2]	91.5 [26.8]	88.9 [26.1]	85.8 [25.5]
	Sens BTUH [kW]	70.4 [20.6]	62.2 [18.2]	57.7 [16.9]	53.4 [15.7]	85.5 [25.0]	75.5 [22.1]	70.0 [20.5]	65.7 [19.4]	97.0 [28.4]	90.5 [26.8]	85.8 [25.5]	81.3 [23.8]	96.2 [28.2]	91.5 [26.8]	88.9 [26.1]	85.8 [25.5]	96.2 [28.2]	91.5 [26.8]	88.9 [26.1]	85.8 [25.5]	96.2 [28.2]	91.5 [26.8]	88.9 [26.1]	85.8 [25.5]	96.2 [28.2]	91.5 [26.8]	88.9 [26.1]	85.8 [25.5]	96.2 [28.2]	91.5 [26.8]	88.9 [26.1]	85.8 [25.5]
	Power	8.3	8.1	8.0	7.9	8.2	8.0	7.9	7.8	8.2	8.1	8.0	7.9	7.8	8.1	8.0	7.9	7.8	8.1	8.0	7.9	7.8	8.1	8.0	7.9	7.8	8.1	8.0	7.9	7.8	8.1	8.0	7.9
105 [40.6]	Total BTUH [kW]	104.3 [30.6]	99.2 [29.1]	96.4 [28.2]	90.5 [26.8]	97.1 [28.4]	92.4 [27.1]	89.7 [26.3]	86.5 [25.7]	92.7 [27.2]	88.1 [25.8]	85.6 [25.1]	82.5 [24.5]	91.9 [26.9]	87.4 [25.6]	84.9 [24.9]	81.8 [24.3]	91.9 [26.9]	87.4 [25.6]	84.9 [24.9]	81.8 [24.3]	91.9 [26.9]	87.4 [25.6]	84.9 [24.9]	81.8 [24.3]	91.9 [26.9]	87.4 [25.6]	84.9 [24.9]	81.8 [24.3]	91.9 [26.9]	87.4 [25.6]	84.9 [24.9]	81.8 [24.3]
	Sens BTUH [kW]	68.1 [20.0]	60.2 [17.6]	55.8 [16.4]	51.5 [15.1]	83.2 [24.4]	73.5 [21.5]	68.1 [20.0]	63.8 [18.8]	92.7 [27.2]	86.5 [25.7]	81.8 [24.3]	77.5 [22.7]	91.9 [26.9]	87.4 [25.6]	84.9 [24.9]	81.8 [24.3]	91.9 [26.9]	87.4 [25.6]	84.9 [24.9]	81.8 [24.3]	91.9 [26.9]	87.4 [25.6]	84.9 [24.9]	81.8 [24.3]	91.9 [26.9]	87.4 [25.6]	84.9 [24.9]	81.8 [24.3]	91.9 [26.9]	87.4 [25.6]	84.9 [24.9]	81.8 [24.3]
	Power	8.8	8.6	8.5	8.4	8.7	8.5	8.4	8.3	8.7	8.6	8.5	8.4	8.3	8.6	8.5	8.4	8.3	8.6	8.5	8.4	8.3	8.6	8.5	8.4	8.3	8.6	8.5	8.4	8.3	8.6	8.5	8.4
110 [43.3]	Total BTUH [kW]	99.9 [29.3]	95.1 [27.9]	92.4 [27.1]	85.7 [25.1]	92.8 [27.2]	88.2 [25.9]	85.7 [25.1]	82.5 [24.5]	88.3 [25.9]	84.0 [24.6]	81.6 [23.9]	78.5 [23.3]	87.6 [25.7]	83.3 [24.4]	80.9 [23.7]	77.8 [23.1]	87.6 [25.7]	83.3 [24.4]	80.9 [23.7]	77.8 [23.1]	87.6 [25.7]	83.3 [24.4]	80.9 [23.7]	77.8 [23.1]	87.6 [25.7]	83.3 [24.4]	80.9 [23.7]	77.8 [23.1]	87.6 [25.7]	83.3 [24.4]	80.9 [23.7]	77.8 [23.1]
	Sens BTUH [kW]	65.8 [19.3]	58.1 [17.0]	53.9 [15.8]	49.6 [14.6]	80.8 [23.7]	71.4 [20.9]	66.2 [19.4]	62.0 [18.1]	84.0 [24.6]	79.2 [23.2]	74.5 [22.5]	70.2 [20.6]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]
	Power	9.3	9.1	9.0	8.9	9.3	9.0	8.9	8.8	9.2	9.1	9.0	8.9	8.8	9.1	9.0	8.9	8.8	9.1	9.0	8.9	8.8	9.1	9.0	8.9	8.8	9.1	9.0	8.9	8.8	9.1	9.0	8.9
115 [46.1]	Total BTUH [kW]	95.6 [28.0]	91.0 [26.7]	88.4 [25.9]	81.8 [24.3]	88.4 [25.9]	84.1 [24.6]	81.7 [24.0]	78.5 [23.3]	84.0 [24.6]	80.0 [24.3]	77.6 [23.1]	74.5 [22.5]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]
	Sens BTUH [kW]	63.4 [18.6]	56.0 [16.4]	51.9 [15.2]	47.6 [14.1]	78.4 [23.0]	69.3 [20.3]	64.3 [18.8]	60.0 [17.5]	84.0 [24.6]	79.2 [23.2]	74.5 [22.5]	70.2 [20.6]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]	83.2 [24.4]	79.2 [23.2]	76.9 [22.5]	73.8 [22.9]
	Power	9.9	9.7	9.5	9.4	9.8	9.6	9.5	9.4	9.8	9.7	9.6	9.5	9.4	9.7	9.6	9.5	9.4	9.7	9.6	9.5	9.4	9.7	9.6	9.5	9.4	9.7	9.6	9.5	9.4	9.7		

DR — Depression ratio
dbE — Entering air dry bulb
wB/E — Entering air wet bulb

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

[] Designates Metric Conversions

Total — Total capacity x 1000 BTUH
Sens — Sensible capacity x 1000 BTUH
Power — kW Input

COOLING PERFORMANCE DATA — RGEDZT120A

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①																
WDE		71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]			61°F [16.1°C]			59°F [15.0°C]		
CFM [L/s]		4800 [2265]	3750 [1770]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	4800 [2265]	3750 [1770]	3200 [1510]	4800 [2265]	3750 [1770]	
DR ①		0.09	0.03	0	0.09	0.03	0	0.09	0.03	0	0.09	0.03	0	0.09	0.03	
75 [23.9]	Total BTUH [kW]	155.3 [45.5]	147.8 [43.3]	143.8 [42.2]	147.8 [43.3]	140.7 [41.2]	136.9 [40.1]	142.8 [41.8]	135.8 [39.8]	132.2 [38.7]	141.5 [41.5]	134.7 [39.5]	131.1 [38.4]	141.4 [41.4]	130.9 [38.4]	
	Sens BTUH [kW]	97.3 [28.5]	86.1 [25.2]	80.2 [23.5]	115.8 [33.9]	102.4 [30.0]	95.4 [28.0]	132.9 [38.9]	117.5 [34.4]	109.5 [32.1]	140.6 [41.2]	124.3 [36.4]	115.8 [33.9]	141.4 [41.4]	121.4 [35.6]	
	Power	7.5	7.3	7.2	7.4	7.2	7.1	7.3	7.1	7.0	7.2	7.1	7.0	7.2	6.9	
80 [26.7]	Total BTUH [kW]	150.6 [44.1]	143.4 [42.0]	139.5 [40.9]	143.2 [42.0]	136.2 [39.9]	132.6 [38.9]	138.1 [40.5]	131.4 [38.5]	127.9 [37.5]	136.9 [40.1]	130.2 [38.2]	126.8 [37.1]	136.7 [40.1]	126.6 [37.1]	
	Sens BTUH [kW]	94.9 [27.8]	84.0 [24.6]	78.2 [22.9]	113.5 [33.2]	100.3 [29.4]	93.5 [27.4]	130.5 [38.2]	115.4 [33.8]	107.5 [31.5]	136.9 [40.1]	122.2 [35.8]	113.8 [33.4]	136.7 [40.1]	119.5 [35.0]	
	Power	7.9	7.7	7.6	7.8	7.6	7.5	7.7	7.5	7.4	7.7	7.5	7.4	7.6	7.3	
85 [29.4]	Total BTUH [kW]	146.0 [42.8]	138.9 [40.7]	135.2 [39.6]	138.5 [40.6]	131.8 [38.6]	128.3 [37.6]	133.5 [39.1]	127.0 [37.2]	123.6 [36.2]	132.2 [38.7]	125.8 [36.9]	122.5 [35.9]	132.1 [38.7]	122.3 [35.9]	
	Sens BTUH [kW]	92.5 [27.1]	81.8 [24.0]	76.2 [22.3]	111.0 [32.5]	98.2 [28.8]	91.5 [26.8]	128.1 [37.5]	113.3 [33.2]	105.5 [30.9]	132.2 [38.7]	120.1 [35.2]	111.9 [32.8]	132.1 [38.7]	117.5 [34.4]	
	Power	8.3	8.1	8.0	8.2	8.0	7.9	8.2	8.0	7.9	8.1	7.9	7.8	8.1	7.8	
90 [32.2]	Total BTUH [kW]	141.4 [41.4]	134.5 [39.4]	131.0 [38.4]	133.9 [39.2]	127.4 [37.3]	124.0 [36.3]	128.8 [37.8]	122.6 [35.9]	119.3 [35.0]	127.6 [37.4]	121.4 [35.6]	118.2 [34.6]	127.5 [37.4]	118.1 [34.6]	
	Sens BTUH [kW]	90.1 [26.4]	79.7 [23.3]	74.2 [21.7]	108.6 [31.8]	96.0 [28.1]	89.5 [26.2]	125.6 [36.8]	111.1 [32.6]	103.5 [30.3]	127.6 [37.4]	117.9 [34.5]	109.8 [32.2]	127.5 [37.4]	115.5 [33.8]	
	Power	8.8	8.6	8.5	8.7	8.5	8.4	8.6	8.4	8.3	8.6	8.4	8.3	8.5	8.2	
95 [35]	Total BTUH [kW]	136.8 [40.1]	130.2 [38.1]	126.7 [37.1]	129.3 [37.9]	123.0 [36.1]	119.7 [35.1]	124.2 [36.4]	118.2 [34.6]	115.1 [33.7]	123.0 [36.0]	117.0 [34.3]	113.9 [33.4]	122.9 [36.0]	113.8 [33.3]	
	Sens BTUH [kW]	87.6 [25.7]	77.5 [22.7]	72.2 [21.1]	106.1 [31.1]	93.8 [27.5]	87.4 [25.6]	123.1 [36.1]	108.9 [31.9]	101.5 [29.7]	123.0 [36.0]	115.7 [33.9]	107.8 [31.6]	122.9 [36.0]	116.9 [34.3]	
	Power	9.3	9.1	9.0	9.2	9.0	8.9	9.1	8.9	8.8	9.1	8.9	8.8	9.1	8.7	
100 [37.8]	Total BTUH [kW]	132.2 [38.7]	125.8 [36.9]	122.4 [35.9]	124.7 [36.5]	118.7 [34.8]	115.5 [33.8]	119.6 [35.1]	113.8 [33.4]	110.8 [32.5]	118.4 [34.7]	112.7 [33.0]	109.7 [32.1]	118.3 [34.7]	109.5 [32.1]	
	Sens BTUH [kW]	85.1 [24.9]	75.2 [22.0]	70.1 [20.5]	103.6 [30.3]	91.6 [26.8]	85.3 [25.0]	119.6 [35.1]	106.7 [31.3]	99.4 [29.1]	118.4 [34.7]	112.7 [33.0]	105.7 [31.0]	118.3 [34.7]	109.5 [32.1]	
	Power	9.9	9.6	9.5	9.8	9.5	9.4	9.7	9.5	9.3	9.6	9.4	9.3	9.6	9.2	
105 [40.6]	Total BTUH [kW]	127.6 [37.4]	121.4 [35.6]	118.2 [34.6]	120.1 [35.2]	114.3 [33.5]	111.2 [32.6]	115.1 [33.7]	109.5 [32.1]	106.6 [31.2]	113.8 [33.4]	108.3 [31.7]	105.4 [30.9]	113.7 [33.3]	105.3 [30.9]	
	Sens BTUH [kW]	82.5 [24.2]	73.0 [21.4]	68.0 [19.9]	101.0 [29.6]	89.3 [26.2]	83.2 [24.4]	115.1 [33.7]	104.4 [30.6]	97.3 [28.5]	113.8 [33.4]	108.3 [31.7]	103.6 [30.4]	113.7 [33.3]	105.3 [30.9]	
	Power	10.5	10.2	10.1	10.4	10.1	10.0	10.3	10.0	9.9	10.2	10.0	9.8	10.2	9.8	
110 [43.3]	Total BTUH [kW]	123.0 [36.1]	117.1 [34.3]	114.0 [33.4]	115.5 [33.9]	109.9 [32.2]	107.0 [31.4]	110.5 [32.4]	105.1 [30.8]	102.3 [30.0]	109.3 [32.0]	104.0 [30.5]	101.2 [29.7]	109.1 [32.0]	101.1 [29.6]	
	Sens BTUH [kW]	79.9 [23.4]	70.6 [20.7]	65.8 [19.3]	98.4 [28.8]	87.0 [25.5]	81.1 [23.8]	110.5 [32.4]	102.1 [29.9]	95.1 [27.9]	109.3 [32.0]	104.0 [30.5]	101.2 [29.7]	109.1 [32.0]	101.1 [29.6]	
	Power	11.1	10.8	10.7	11.0	10.7	10.6	10.9	10.6	10.5	10.8	10.6	10.4	10.8	10.4	
115 [46.1]	Total BTUH [kW]	118.5 [34.7]	112.7 [33.0]	109.7 [32.2]	111.0 [32.5]	105.6 [31.0]	102.8 [30.1]	105.9 [31.0]	100.8 [29.5]	98.1 [28.8]	104.7 [30.7]	99.6 [29.2]	97.0 [28.4]	104.6 [30.6]	96.8 [28.4]	
	Sens BTUH [kW]	77.2 [22.6]	68.3 [20.0]	63.6 [18.6]	95.7 [28.1]	84.7 [24.8]	78.9 [23.1]	105.9 [31.0]	99.8 [29.2]	92.9 [27.2]	104.7 [30.7]	99.6 [29.2]	97.0 [28.4]	104.6 [30.6]	96.8 [28.4]	
	Power	11.7	11.4	11.3	11.6	11.3	11.2	11.5	11.2	11.1	11.5	11.2	11.1	11.4	11.0	
120 [48.9]	Total BTUH [kW]	113.9 [33.4]	108.4 [31.8]	105.5 [30.9]	106.5 [31.2]	101.3 [29.7]	98.6 [28.9]	101.4 [29.7]	96.5 [28.3]	93.9 [27.5]	100.2 [29.4]	95.3 [27.9]	92.8 [27.2]	100.0 [29.3]	92.6 [27.1]	
	Sens BTUH [kW]	74.5 [21.8]	65.9 [19.3]	61.4 [18.0]	93.0 [27.3]	82.3 [24.1]	76.7 [22.5]	101.4 [29.7]	96.5 [28.3]	90.7 [26.6]	100.2 [29.4]	95.3 [27.9]	92.8 [27.2]	100.0 [29.3]	92.6 [27.1]	
	Power	12.4	12.1	11.9	12.3	12.0	11.8	12.2	11.9	11.7	12.1	11.9	11.7	12.1	11.7	
125 [51.7]	Total BTUH [kW]	109.4 [32.1]	104.1 [30.5]	101.3 [29.7]	101.9 [29.9]	97.0 [28.4]	94.4 [27.7]	96.9 [28.4]	92.2 [27.0]	89.7 [26.3]	95.6 [28.0]	91.0 [26.7]	88.6 [26.0]	95.5 [28.0]	88.5 [25.9]	
	Sens BTUH [kW]	71.8 [21.0]	63.5 [18.6]	59.2 [17.3]	90.3 [26.5]	79.9 [23.4]	74.4 [21.8]	96.9 [28.4]	92.2 [27.0]	88.5 [25.9]	95.6 [28.0]	91.0 [26.7]	88.6 [26.0]	95.5 [28.0]	88.5 [25.9]	
	Power	13.1	12.8	12.6	13.0	12.7	12.5	12.9	12.6	12.4	12.9	12.5	12.4	12.8	12.3	

DR —Depression ratio
dbE —Entering air dry bulb
wbE —Entering air wet bulb

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

[] Designates Metric Conversions

Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power —KW input

COOLING PERFORMANCE DATA—RGEDZT150A

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			4500 [2124]	3750 [1770]	3000 [1416]	4500 [2124]	3750 [1770]	3000 [1416]	4500 [2124]	3750 [1770]	3000 [1416]
DR ①			0	0.01	0.09	0	0.01	0.09	0	0.01	0.09
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	179.6 [52.6]	173.3 [50.8]	167.0 [48.9]	172.2 [50.5]	166.2 [48.7]	160.2 [46.9]	167.3 [49.0]	161.4 [47.3]	155.5 [45.6]
		Sens BTUH [kW]	113.4 [33.2]	97.4 [28.5]	82.6 [24.2]	131.0 [38.4]	113.8 [33.3]	97.7 [28.6]	147.4 [43.2]	128.9 [37.8]	111.5 [32.7]
		Power	10.2	10.0	9.9	10.1	9.9	9.8	10.0	9.9	9.7
	80 [26.7]	Total BTUH [kW]	175.0 [51.3]	168.9 [49.5]	162.8 [47.7]	167.6 [49.1]	161.8 [47.4]	155.9 [45.7]	162.7 [47.7]	157.0 [46.0]	151.3 [44.3]
		Sens BTUH [kW]	110.9 [32.5]	95.3 [27.9]	80.9 [23.7]	128.5 [37.7]	111.7 [32.7]	95.9 [28.1]	144.9 [42.5]	126.8 [37.2]	109.8 [32.2]
		Power	10.6	10.4	10.3	10.5	10.4	10.2	10.4	10.3	10.1
	85 [29.4]	Total BTUH [kW]	170.5 [50.0]	164.5 [48.2]	158.5 [46.4]	163.1 [47.8]	157.4 [46.1]	151.6 [44.4]	158.1 [46.3]	152.5 [44.7]	147.0 [43.1]
		Sens BTUH [kW]	108.5 [31.8]	93.2 [27.3]	79.1 [23.2]	126.1 [36.9]	109.6 [32.1]	94.1 [27.6]	142.4 [41.7]	124.6 [36.5]	108.0 [31.6]
		Power	11.1	10.9	10.7	11.0	10.8	10.6	10.9	10.7	10.5
	90 [32.2]	Total BTUH [kW]	165.9 [48.6]	160.1 [46.9]	154.3 [45.2]	158.5 [46.4]	153.0 [44.8]	147.4 [43.2]	153.5 [45.0]	148.1 [43.4]	142.8 [41.8]
		Sens BTUH [kW]	105.8 [31.0]	91.0 [26.7]	77.2 [22.6]	123.4 [36.2]	107.4 [31.5]	92.3 [27.0]	139.7 [40.9]	122.4 [35.9]	106.2 [31.1]
		Power	11.6	11.4	11.2	11.5	11.3	11.1	11.4	11.2	11.0
	95 [35]	Total BTUH [kW]	161.4 [47.3]	155.7 [45.6]	150.0 [43.9]	154.0 [45.1]	148.6 [43.5]	143.2 [42.0]	149.0 [43.7]	143.8 [42.1]	138.5 [40.6]
		Sens BTUH [kW]	103.3 [30.3]	88.8 [26.0]	75.3 [22.1]	120.9 [35.4]	105.2 [30.8]	90.5 [26.5]	137.2 [40.2]	120.3 [35.2]	104.3 [30.6]
		Power	12.1	11.9	11.6	12.0	11.8	11.6	11.9	11.7	11.5
	100 [37.8]	Total BTUH [kW]	156.8 [45.9]	151.3 [44.3]	145.8 [42.7]	149.4 [43.8]	144.2 [42.3]	139.0 [40.7]	144.5 [42.3]	139.4 [40.8]	134.3 [39.3]
		Sens BTUH [kW]	100.6 [29.5]	86.5 [25.3]	73.4 [21.5]	118.2 [34.6]	102.9 [30.1]	88.6 [26.0]	134.6 [39.4]	118.0 [34.6]	102.4 [30.0]
		Power	12.6	12.4	12.2	12.5	12.3	12.1	12.4	12.2	12.0
	105 [40.6]	Total BTUH [kW]	152.3 [44.6]	147.0 [43.1]	141.6 [41.5]	144.9 [42.5]	139.8 [41.0]	134.8 [39.5]	139.9 [41.0]	135.0 [39.6]	130.1 [38.1]
		Sens BTUH [kW]	98.0 [28.7]	84.3 [24.7]	71.5 [20.9]	115.6 [33.9]	100.6 [29.5]	86.7 [25.4]	131.9 [38.6]	115.7 [33.9]	100.5 [29.4]
		Power	13.2	13.0	12.7	13.1	12.9	12.6	13.0	12.8	12.5
	110 [43.3]	Total BTUH [kW]	147.8 [43.3]	142.6 [41.8]	137.4 [40.3]	140.4 [41.1]	135.5 [39.7]	130.6 [38.3]	135.4 [39.7]	130.7 [38.3]	125.9 [36.9]
		Sens BTUH [kW]	95.3 [27.9]	82.0 [24.0]	69.6 [20.4]	112.9 [33.1]	98.4 [28.8]	84.8 [24.8]	129.2 [37.9]	113.5 [33.3]	98.6 [28.9]
		Power	13.8	13.5	13.3	13.7	13.5	13.2	13.6	13.4	13.1
	115 [46.1]	Total BTUH [kW]	143.3 [42.0]	138.3 [40.5]	133.3 [39.1]	135.9 [39.8]	131.2 [38.4]	126.4 [37.0]	130.9 [38.4]	126.4 [37.0]	121.8 [35.7]
		Sens BTUH [kW]	92.6 [27.1]	79.7 [23.4]	67.7 [19.8]	110.1 [32.3]	96.0 [28.1]	82.7 [24.2]	126.4 [37.0]	111.1 [32.6]	96.6 [28.3]
		Power	14.4	14.2	13.9	14.3	14.1	13.8	14.2	14.0	13.7

DR —Depression ratio
dbE —Entering air dry bulb
wbE —Entering air wet bulb

Total —Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

[] Designates Metric Conversions

GROSS SYSTEMS PERFORMANCE DATA (LOW REHEAT MODE) – RGEDZ(S,T)090

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			1800 [850]	1700 [802]	1200 [566]	1800 [850]	1700 [802]	1200 [566]	1800 [850]	1700 [802]	1200 [566]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	29.7 [8.7]	29.4 [8.6]	27.9 [8.2]	27.0 [7.9]	26.7 [7.8]	25.3 [7.4]	26.6 [7.8]	26.4 [7.7]	24.9 [7.3]
		Sens BTUH [kW]	6.5 [1.9]	6.3 [1.8]	5.4 [1.6]	9.0 [2.6]	8.7 [2.6]	7.5 [2.2]	11.4 [3.4]	11.1 [3.3]	9.6 [2.8]
		Power	3.2	3.1	3.1	3.2	3.2	3.1	3.2	3.2	3.1
	65 [18.3]	Total BTUH [kW]	29.5 [8.6]	29.2 [8.5]	27.6 [8.1]	26.7 [7.8]	26.4 [7.7]	25.0 [7.3]	26.4 [7.7]	26.1 [7.6]	24.7 [7.2]
		Sens BTUH [kW]	5.0 [1.5]	4.9 [1.4]	4.2 [1.2]	7.6 [2.2]	7.4 [2.2]	6.3 [1.9]	10.0 [2.9]	9.7 [2.9]	8.4 [2.5]
		Power	3.2	3.2	3.1	3.3	3.2	3.2	3.2	3.2	3.1
	70 [21.1]	Total BTUH [kW]	28.8 [8.4]	28.5 [8.4]	27.0 [7.9]	26.0 [7.6]	25.8 [7.6]	24.4 [7.1]	25.7 [7.5]	25.4 [7.5]	24.1 [7.1]
		Sens BTUH [kW]	3.7 [1.1]	3.6 [1.0]	3.1 [0.9]	6.2 [1.8]	6.0 [1.8]	5.2 [1.5]	8.6 [2.5]	8.4 [2.5]	7.2 [2.1]
		Power	3.2	3.2	3.1	3.3	3.3	3.2	3.3	3.3	3.2
	75 [23.9]	Total BTUH [kW]	27.8 [8.1]	27.5 [8.1]	26.0 [7.6]	25.0 [7.3]	24.7 [7.2]	23.4 [6.9]	24.7 [7.2]	24.4 [7.2]	23.1 [6.8]
		Sens BTUH [kW]	2.3 [0.7]	2.3 [0.7]	2.0 [0.6]	4.9 [1.4]	4.7 [1.4]	4.1 [1.2]	7.3 [2.1]	7.1 [2.1]	6.1 [1.8]
		Power	3.3	3.3	3.2	3.4	3.4	3.3	3.4	3.4	3.3
	80 [26.7]	Total BTUH [kW]	26.3 [7.7]	26.0 [7.6]	24.6 [7.2]	23.5 [6.9]	23.3 [6.8]	22.1 [6.5]	23.2 [6.8]	23.0 [6.7]	21.7 [6.4]
		Sens BTUH [kW]	1.1 [0.3]	1.0 [0.3]	0.9 [0.3]	3.6 [1.0]	3.5 [1.0]	3.0 [0.9]	6.0 [1.8]	5.9 [1.7]	5.1 [1.5]
		Power	3.4	3.4	3.3	3.5	3.5	3.4	3.5	3.5	3.4
	85 [29.4]	Total BTUH [kW]	24.5 [7.2]	24.2 [7.1]	22.9 [6.7]	21.7 [6.4]	21.5 [6.3]	20.3 [6.0]	21.4 [6.3]	21.1 [6.2]	20.0 [5.9]
		Sens BTUH [kW]	-0.2 [-0.1]	-0.2 [0.0]	-0.1 [0.0]	2.4 [0.7]	2.3 [0.7]	2.0 [0.6]	4.8 [1.4]	4.7 [1.4]	4.0 [1.2]
		Power	3.6	3.6	3.5	3.7	3.6	3.6	3.6	3.6	3.5
	90 [32.2]	Total BTUH [kW]	22.2 [6.5]	22.0 [6.4]	20.8 [6.1]	19.5 [5.7]	19.3 [5.6]	18.2 [5.3]	19.1 [5.6]	18.9 [5.5]	17.9 [5.3]
		Sens BTUH [kW]	-1.3 [-0.4]	-1.3 [-0.4]	-1.1 [-0.3]	1.2 [0.3]	1.1 [0.3]	1.0 [0.3]	3.6 [1.1]	3.5 [1.0]	3.0 [0.9]
		Power	3.8	3.7	3.6	3.8	3.8	3.7	3.8	3.8	3.7

GROSS SYSTEMS PERFORMANCE DATA (HIGH REHEAT MODE) – RGEDZ(S,T)090

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			3600 [1699]	2900 [1369]	2400 [1133]	3600 [1699]	2900 [1369]	2400 [1133]	3600 [1699]	2900 [1369]	2400 [1133]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	41.7 [12.2]	39.9 [11.7]	38.7 [11.3]	40.1 [11.8]	38.4 [11.3]	37.2 [10.9]	40.0 [11.7]	38.3 [11.2]	37.1 [10.9]
		Sens BTUH [kW]	8.9 [2.6]	8.0 [2.4]	7.4 [2.2]	12.8 [3.7]	11.5 [3.4]	10.5 [3.1]	18.5 [5.4]	16.7 [4.9]	15.3 [4.5]
		Power	5.0	4.9	4.8	4.9	4.8	4.8	4.9	4.8	4.8
	70 [21.1]	Total BTUH [kW]	39.8 [11.7]	38.1 [11.2]	36.9 [10.8]	38.3 [11.2]	36.7 [10.7]	35.5 [10.4]	38.1 [11.2]	36.5 [10.7]	35.4 [10.4]
		Sens BTUH [kW]	5.9 [1.7]	5.3 [1.6]	4.9 [1.4]	9.8 [2.9]	8.8 [2.6]	8.1 [2.4]	15.5 [4.6]	14.0 [4.1]	12.8 [3.8]
		Power	5.1	5.0	4.9	5.1	5.0	4.9	5.0	4.9	4.9
	80 [26.7]	Total BTUH [kW]	36.7 [10.7]	35.1 [10.3]	34.0 [10.0]	35.1 [10.3]	33.7 [9.9]	32.6 [9.6]	35.0 [10.3]	33.5 [9.8]	32.5 [9.5]
		Sens BTUH [kW]	2.1 [0.6]	1.9 [0.5]	1.7 [0.5]	5.9 [1.7]	5.3 [1.6]	4.9 [1.4]	11.7 [3.4]	10.5 [3.1]	9.6 [2.8]
		Power	5.4	5.3	5.2	5.3	5.2	5.1	5.3	5.2	5.1
	90 [32.2]	Total BTUH [kW]	32.3 [9.5]	30.9 [9.1]	30.0 [8.8]	30.8 [9.0]	29.5 [8.6]	28.5 [8.4]	30.6 [9.0]	29.3 [8.6]	28.4 [8.3]
		Sens BTUH [kW]	-2.7 [-0.8]	-2.4 [-0.7]	-2.2 [-0.6]	1.2 [0.3]	1.0 [0.3]	1.0 [0.3]	6.9 [2.0]	6.2 [1.8]	5.7 [1.7]
		Power	5.8	5.6	5.6	5.7	5.6	5.5	5.7	5.6	5.5
	100 [37.8]	Total BTUH [kW]	26.7 [7.8]	25.5 [7.5]	24.7 [7.3]	25.1 [7.4]	24.1 [7.1]	23.3 [6.8]	25.0 [7.3]	23.9 [7.0]	23.2 [6.8]
		Sens BTUH [kW]	-8.3 [-2.4]	-7.4 [-2.2]	-6.8 [-2.0]	-4.4 [-1.3]	-4.0 [-1.2]	-3.7 [-1.1]	1.3 [0.4]	1.2 [0.4]	1.1 [0.3]
		Power	6.3	6.2	6.1	6.2	6.1	6.0	6.2	6.1	6.0
	110 [43.3]	Total BTUH [kW]	19.8 [5.8]	19.0 [5.6]	18.4 [5.4]	18.3 [5.4]	17.5 [5.1]	17.0 [5.0]	18.1 [5.3]	17.4 [5.1]	16.8 [4.9]
		Sens BTUH [kW]	-14.7 [-4.3]	-13.2 [-3.9]	-12.2 [-3.6]	-10.9 [-3.2]	-9.8 [-2.9]	-9.0 [-2.6]	-5.1 [-1.5]	-4.6 [-1.4]	-4.2 [-1.2]
		Power	6.9	6.8	6.7	6.9	6.7	6.6	6.9	6.7	6.6
	120 [48.9]	Total BTUH [kW]	11.7 [3.4]	11.2 [3.3]	10.8 [3.2]	10.1 [3.0]	9.7 [2.8]	9.4 [2.8]	10.0 [2.9]	9.6 [2.8]	9.3 [2.7]
		Sens BTUH [kW]	-22.1 [-6.5]	-19.8 [-5.8]	-18.2 [-5.3]	-18.2 [-5.3]	-16.4 [-4.8]	-15.1 [-4.4]	-12.5 [-3.7]	-11.2 [-3.3]	-10.3 [-3.0]
		Power	7.8	7.6	7.5	7.7	7.5	7.4	7.7	7.5	7.4

GROSS SYSTEMS PERFORMANCE DATA (LOW REHEAT MODE)–RGEDZ(S,T)102

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			2100 [991]	1700 [802]	1400 [661]	2100 [991]	1700 [802]	1400 [661]	2100 [991]	1700 [802]	1400 [661]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	36.6 [10.7]	35.1 [10.3]	33.9 [9.9]	34.5 [10.1]	33.1 [9.7]	32.1 [9.4]	31.9 [9.3]	30.6 [9.0]	29.6 [8.7]
		Sens BTUH [kW]	7.1 [2.1]	6.4 [1.9]	5.9 [1.7]	9.0 [2.6]	8.1 [2.4]	7.4 [2.2]	10.7 [3.1]	9.7 [2.8]	8.9 [2.6]
		Power	3.9	3.8	3.7	3.8	3.8	3.7	3.8	3.8	3.7
	65 [18.3]	Total BTUH [kW]	35.5 [10.4]	34.0 [10.0]	32.9 [9.6]	33.4 [9.8]	32.1 [9.4]	31.0 [9.1]	30.8 [9.0]	29.5 [8.6]	28.6 [8.4]
		Sens BTUH [kW]	6.1 [1.8]	5.5 [1.6]	5.0 [1.5]	8.0 [2.3]	7.2 [2.1]	6.6 [1.9]	9.7 [2.8]	8.7 [2.6]	8.0 [2.4]
		Power	3.9	3.8	3.8	3.9	3.8	3.8	3.9	3.8	3.8
	70 [21.1]	Total BTUH [kW]	34.1 [10.0]	32.7 [9.6]	31.7 [9.3]	32.1 [9.4]	30.8 [9.0]	29.8 [8.7]	29.5 [8.6]	28.3 [8.3]	27.4 [8.0]
		Sens BTUH [kW]	4.8 [1.4]	4.3 [1.3]	4.0 [1.2]	6.7 [2.0]	6.0 [1.8]	5.5 [1.6]	8.5 [2.5]	7.6 [2.2]	7.0 [2.0]
		Power	4.0	3.9	3.9	4.0	3.9	3.9	4.0	3.9	3.9
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	32.7 [9.6]	31.3 [9.2]	30.3 [8.9]	30.6 [9.0]	29.4 [8.6]	28.4 [8.3]	28.0 [8.2]	26.8 [7.9]	26.0 [7.6]
		Sens BTUH [kW]	3.3 [1.0]	3.0 [0.9]	2.8 [0.8]	5.2 [1.5]	4.7 [1.4]	4.3 [1.3]	7.0 [2.0]	6.3 [1.8]	5.8 [1.7]
		Power	4.1	4.0	4.0	4.1	4.0	4.0	4.1	4.0	4.0
	80 [26.7]	Total BTUH [kW]	31.0 [9.1]	29.7 [8.7]	28.8 [8.4]	29.0 [8.5]	27.8 [8.1]	26.9 [7.9]	26.3 [7.7]	25.2 [7.4]	24.4 [7.2]
		Sens BTUH [kW]	1.7 [0.5]	1.5 [0.4]	1.4 [0.4]	3.6 [1.0]	3.2 [0.9]	2.9 [0.9]	5.3 [1.6]	4.8 [1.4]	4.4 [1.3]
		Power	4.3	4.2	4.1	4.3	4.2	4.1	4.3	4.2	4.1
	85 [29.4]	Total BTUH [kW]	29.1 [8.5]	27.9 [8.2]	27.0 [7.9]	27.1 [7.9]	26.0 [7.6]	25.1 [7.4]	24.4 [7.2]	23.4 [6.9]	22.7 [6.6]
		Sens BTUH [kW]	-0.2 [-0.1]	-0.2 [-0.1]	-0.2 [-0.1]	1.7 [0.5]	1.5 [0.4]	1.4 [0.4]	3.4 [1.0]	3.1 [0.9]	2.8 [0.8]
		Power	4.4	4.3	4.3	4.4	4.3	4.3	4.4	4.3	4.3
OUTDOOR DRY BULB TEMPERATURE °F [°C]	90 [32.2]	Total BTUH [kW]	27.1 [7.9]	26.0 [7.6]	25.1 [7.4]	25.0 [7.3]	24.0 [7.0]	23.2 [6.8]	22.4 [6.6]	21.5 [6.3]	20.8 [6.1]
		Sens BTUH [kW]	-2.3 [-0.7]	-2.1 [-0.6]	-1.9 [-0.6]	-0.4 [-0.1]	-0.4 [-0.1]	-0.4 [-0.1]	1.3 [0.4]	1.2 [0.3]	1.1 [0.3]
		Power	4.6	4.5	4.4	4.6	4.5	4.4	4.6	4.5	4.4

GROSS SYSTEMS PERFORMANCE DATA (HIGH REHEAT MODE)–RGEDZ(S,T)102

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			4100 [1935]	2900 [1369]	2700 [1274]	4100 [1935]	2900 [1369]	2700 [1274]	4100 [1935]	2900 [1369]	2700 [1274]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	57.6 [16.9]	53.6 [15.7]	52.9 [15.5]	45.7 [13.4]	42.5 [12.5]	42.0 [12.3]	51.3 [15.0]	47.7 [14.0]	47.1 [13.8]
		Sens BTUH [kW]	12.7 [3.7]	10.7 [3.1]	10.3 [3.0]	14.6 [4.3]	12.2 [3.6]	11.8 [3.5]	20.5 [6.0]	17.2 [5.0]	16.6 [4.9]
		Power	6.6	6.4	6.3	5.2	5.0	5.0	6.3	6.1	6.0
	70 [21.1]	Total BTUH [kW]	52.7 [15.5]	49.1 [14.4]	48.4 [14.2]	40.9 [12.0]	38.0 [11.1]	37.5 [11.0]	46.4 [13.6]	43.2 [12.7]	42.6 [12.5]
		Sens BTUH [kW]	10.1 [3.0]	8.5 [2.5]	8.2 [2.4]	11.9 [3.5]	10.0 [2.9]	9.7 [2.8]	17.9 [5.2]	15.0 [4.4]	14.5 [4.2]
		Power	6.4	6.1	6.1	5.0	4.8	4.8	6.0	5.8	5.8
	80 [26.7]	Total BTUH [kW]	46.3 [13.6]	43.1 [12.6]	42.6 [12.5]	34.5 [10.1]	32.1 [9.4]	31.6 [9.3]	40.0 [11.7]	37.2 [10.9]	36.7 [10.8]
		Sens BTUH [kW]	5.6 [1.6]	4.7 [1.4]	4.5 [1.3]	7.4 [2.2]	6.2 [1.8]	6.0 [1.8]	13.3 [3.9]	11.2 [3.3]	10.8 [3.2]
		Power	6.4	6.1	6.1	5.0	4.8	4.8	6.1	5.8	5.8
OUTDOOR DRY BULB TEMPERATURE °F [°C]	90 [32.2]	Total BTUH [kW]	38.4 [11.2]	35.7 [10.5]	35.2 [10.3]	26.5 [7.8]	24.7 [7.2]	24.3 [7.1]	32.1 [9.4]	29.8 [8.7]	29.4 [8.6]
		Sens BTUH [kW]	-0.9 [-0.3]	-0.7 [-0.2]	-0.7 [-0.2]	0.9 [0.3]	0.8 [0.2]	0.8 [0.2]	6.9 [2.0]	5.8 [1.7]	5.6 [1.6]
		Power	6.6	6.4	6.4	5.2	5.1	5.0	6.3	6.1	6.1
	100 [37.8]	Total BTUH [kW]	28.9 [8.5]	26.9 [7.9]	26.5 [7.8]	17.0 [5.0]	15.8 [4.6]	15.6 [4.6]	22.6 [6.6]	21.0 [6.1]	20.7 [6.1]
		Sens BTUH [kW]	-9.2 [-2.7]	-7.7 [-2.3]	-7.5 [-2.2]	-7.4 [-2.2]	-6.2 [-1.8]	-6.0 [-1.8]	-1.5 [-0.4]	-1.2 [-0.4]	-1.2 [-0.4]
		Power	7.2	6.9	6.9	5.8	5.6	5.5	6.8	6.6	6.6
	110 [43.3]	Total BTUH [kW]	17.9 [5.2]	16.6 [4.9]	16.4 [4.8]	6.0 [1.8]	5.6 [1.6]	5.5 [1.6]	11.5 [3.4]	10.7 [3.1]	10.6 [3.1]
		Sens BTUH [kW]	-19.5 [-5.7]	-16.3 [-4.8]	-15.8 [-4.6]	-17.7 [-5.2]	-14.8 [-4.3]	-14.3 [-4.2]	-11.7 [-3.4]	-9.8 [-2.9]	-9.5 [-2.8]
		Power	7.9	7.7	7.6	6.5	6.3	6.3	7.6	7.4	7.3
OUTDOOR DRY BULB TEMPERATURE °F [°C]	120 [48.9]	Total BTUH [kW]	5.3 [1.5]	4.9 [1.4]	4.9 [1.4]	-6.6 [-1.9]	-6.1 [-1.8]	-6.0 [-1.8]	-1.0 [-0.3]	-1.0 [-0.3]	-1.0 [-0.3]
		Sens BTUH [kW]	-31.6 [-9.3]	-26.5 [-7.8]	-25.7 [-7.5]	-29.8 [-8.7]	-25.0 [-7.3]	-24.2 [-7.1]	-23.9 [-7.0]	-20.0 [-5.9]	-19.4 [-5.7]
		Power	9.0	8.7	8.6	7.6	7.3	7.3	8.7	8.4	8.3

GROSS SYSTEMS PERFORMANCE DATA (LOW REHEAT MODE)—RGEDZ(S,T)120

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①										
wbE		65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]		3000 [1416]	2400 [1133]	2000 [944]	3000 [1416]	2400 [1133]	2000 [944]	3000 [1416]	2400 [1133]	2000 [944]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	46.5 [13.6]	44.4 [13.0]	43.1 [12.6]	43.1 [12.6]	41.2 [12.1]	40.0 [11.7]	40.3 [11.8]	38.6 [11.3]
		Sens BTUH [kW]	12.9 [3.8]	11.6 [3.4]	10.7 [3.1]	13.8 [4.0]	12.3 [3.6]	11.4 [3.3]	18.5 [5.4]	15.3 [4.5]
		Power	4.6	4.5	4.4	4.5	4.4	4.3	4.5	4.3
	65 [18.3]	Total BTUH [kW]	45.7 [13.4]	43.7 [12.8]	42.4 [12.4]	42.3 [12.4]	40.5 [11.9]	39.3 [11.5]	39.6 [11.6]	37.8 [11.1]
		Sens BTUH [kW]	10.5 [3.1]	9.4 [2.8]	8.7 [2.5]	11.4 [3.3]	10.2 [3.0]	9.4 [2.8]	16.1 [4.7]	13.3 [3.9]
		Power	4.6	4.5	4.5	4.6	4.5	4.4	4.5	4.4
	70 [21.1]	Total BTUH [kW]	44.7 [13.1]	42.7 [12.5]	41.4 [12.1]	41.3 [12.1]	39.5 [11.6]	38.3 [11.2]	38.5 [11.3]	36.9 [10.8]
		Sens BTUH [kW]	8.3 [2.4]	7.4 [2.2]	6.9 [2.0]	9.2 [2.7]	8.2 [2.4]	7.6 [2.2]	13.9 [4.1]	11.4 [3.4]
		Power	4.7	4.6	4.6	4.7	4.6	4.5	4.6	4.5
	75 [23.9]	Total BTUH [kW]	43.4 [12.7]	41.5 [12.2]	40.2 [11.8]	40.0 [11.7]	38.3 [11.2]	37.1 [10.9]	37.2 [10.9]	35.6 [10.4]
		Sens BTUH [kW]	6.3 [1.8]	5.6 [1.7]	5.2 [1.5]	7.2 [2.1]	6.4 [1.9]	5.9 [1.7]	11.9 [3.5]	9.8 [2.9]
		Power	4.9	4.8	4.7	4.8	4.7	4.7	4.8	4.6
	80 [26.7]	Total BTUH [kW]	41.8 [12.2]	40.0 [11.7]	38.8 [11.4]	38.4 [11.3]	36.8 [10.8]	35.6 [10.4]	35.7 [10.5]	34.1 [10.0]
		Sens BTUH [kW]	4.5 [1.3]	4.0 [1.2]	3.7 [1.1]	5.4 [1.6]	4.8 [1.4]	4.4 [1.3]	10.1 [2.9]	8.3 [2.4]
		Power	5.1	5.0	4.9	5.0	4.9	4.9	5.0	4.8
	85 [29.4]	Total BTUH [kW]	40.0 [11.7]	38.2 [11.2]	37.1 [10.9]	36.6 [10.7]	35.0 [10.3]	33.9 [9.9]	33.8 [9.9]	32.4 [9.5]
		Sens BTUH [kW]	2.9 [0.8]	2.6 [0.8]	2.4 [0.7]	3.8 [1.1]	3.4 [1.0]	3.1 [0.9]	8.5 [2.5]	7.0 [2.0]
		Power	5.4	5.3	5.2	5.3	5.2	5.1	5.3	5.1
	90 [32.2]	Total BTUH [kW]	37.9 [11.1]	36.2 [10.6]	35.1 [10.3]	34.5 [10.1]	33.0 [9.7]	32.0 [9.4]	31.7 [9.3]	30.4 [8.9]
		Sens BTUH [kW]	1.5 [0.4]	1.3 [0.4]	1.2 [0.4]	2.4 [0.7]	2.1 [0.6]	2.0 [0.6]	7.1 [2.1]	5.8 [1.7]
		Power	5.7	5.6	5.5	5.6	5.5	5.4	5.6	5.4

GROSS SYSTEMS PERFORMANCE DATA (HIGH REHEAT MODE)—RGEDZ(S,T)120

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①										
wbE		65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]		4800 [2265]	3800 [1793]	3200 [1510]	4800 [2265]	3800 [1793]	3200 [1510]	4800 [2265]	3800 [1793]	3200 [1510]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	58.1 [17.0]	55.4 [16.2]	53.9 [15.8]	55.5 [16.3]	53.0 [15.5]	51.4 [15.1]	53.1 [15.6]	49.2 [14.4]
		Sens BTUH [kW]	10.5 [3.1]	9.3 [2.7]	8.6 [2.5]	15.6 [4.6]	13.9 [4.1]	12.9 [3.8]	19.9 [5.8]	16.4 [4.8]
		Power	7.0	6.9	6.8	6.9	6.8	6.7	6.9	6.7
	70 [21.1]	Total BTUH [kW]	53.4 [15.7]	51.0 [14.9]	49.5 [14.5]	50.8 [14.9]	48.5 [14.2]	47.1 [13.8]	48.4 [14.2]	44.9 [13.2]
		Sens BTUH [kW]	8.3 [2.4]	7.4 [2.2]	6.8 [2.0]	13.4 [3.9]	12.0 [3.5]	11.1 [3.2]	17.7 [5.2]	14.6 [4.3]
		Power	7.1	7.0	6.9	7.0	6.9	6.8	7.0	6.8
	80 [26.7]	Total BTUH [kW]	48.4 [14.2]	46.2 [13.5]	44.9 [13.2]	45.8 [13.4]	43.7 [12.8]	42.5 [12.4]	43.4 [12.7]	40.3 [11.8]
		Sens BTUH [kW]	4.5 [1.3]	4.0 [1.2]	3.7 [1.1]	9.7 [2.8]	8.6 [2.5]	8.0 [2.3]	14.0 [4.1]	11.5 [3.4]
		Power	7.4	7.3	7.2	7.3	7.2	7.1	7.3	7.1
	90 [32.2]	Total BTUH [kW]	43.1 [12.6]	41.1 [12.0]	39.9 [11.7]	40.5 [11.9]	38.6 [11.3]	37.5 [11.0]	38.1 [11.2]	35.3 [10.3]
		Sens BTUH [kW]	-0.8 [-0.2]	-0.7 [-0.2]	-0.6 [-0.2]	4.4 [1.3]	3.9 [1.1]	3.6 [1.1]	8.7 [2.5]	7.2 [2.1]
		Power	7.9	7.7	7.6	7.8	7.7	7.5	7.8	7.5
	100 [37.8]	Total BTUH [kW]	37.4 [11.0]	35.7 [10.5]	34.6 [10.2]	34.8 [10.2]	33.2 [9.7]	32.2 [9.4]	32.4 [9.5]	30.9 [9.1]
		Sens BTUH [kW]	-7.6 [-2.2]	-6.8 [-2.0]	-6.3 [-1.8]	-2.5 [-0.7]	-2.2 [-0.6]	-2.0 [-0.6]	1.8 [0.5]	1.5 [0.4]
		Power	8.6	8.4	8.3	8.5	8.3	8.2	8.5	8.2
	110 [43.3]	Total BTUH [kW]	31.3 [9.2]	29.9 [8.8]	29.0 [8.5]	28.7 [8.4]	27.4 [8.0]	26.6 [7.8]	26.3 [7.7]	25.1 [7.4]
		Sens BTUH [kW]	-16.0 [-4.7]	-14.3 [-4.2]	-13.2 [-3.9]	-10.9 [-3.2]	-9.7 [-2.8]	-9.0 [-2.6]	-6.6 [-1.9]	-5.9 [-1.7]
		Power	9.5	9.3	9.2	9.4	9.2	9.1	9.4	9.0
	120 [48.9]	Total BTUH [kW]	24.9 [7.3]	23.8 [7.0]	23.1 [6.8]	22.3 [6.5]	21.3 [6.2]	20.7 [6.1]	19.9 [5.8]	19.0 [5.6]
		Sens BTUH [kW]	-26.0 [-7.6]	-23.2 [-6.8]	-21.5 [-6.3]	-20.9 [-6.1]	-18.6 [-5.5]	-17.2 [-5.0]	-16.6 [-4.9]	-14.8 [-4.3]
		Power	10.6	10.3	10.2	10.5	10.2	10.1	10.5	10.1

GROSS SYSTEMS PERFORMANCE DATA (LOW REHEAT MODE)—RGEDZ(S,T)150

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			3000 [1416]	2400 [1133]	2000 [944]	3000 [1416]	2400 [1133]	2000 [944]	3000 [1416]	2400 [1133]	2000 [944]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	46.5 [13.6]	44.4 [13.0]	43.1 [12.6]	43.1 [12.6]	41.2 [12.1]	40.0 [11.7]	40.3 [11.8]	38.6 [11.3]	37.4 [11.0]
		Sens BTUH [kW]	12.9 [3.8]	11.6 [3.4]	10.7 [3.1]	13.8 [4.0]	12.3 [3.6]	11.4 [3.3]	18.5 [5.4]	16.5 [4.8]	15.3 [4.5]
		Power	4.6	4.5	4.4	4.5	4.4	4.3	4.5	4.4	4.3
	65 [18.3]	Total BTUH [kW]	45.7 [13.4]	43.7 [12.8]	42.4 [12.4]	42.3 [12.4]	40.5 [11.9]	39.3 [11.5]	39.6 [11.6]	37.8 [11.1]	36.7 [10.8]
		Sens BTUH [kW]	10.5 [3.1]	9.4 [2.8]	8.7 [2.5]	11.4 [3.3]	10.2 [3.0]	9.4 [2.8]	16.1 [4.7]	14.4 [4.2]	13.3 [3.9]
		Power	4.6	4.5	4.5	4.6	4.5	4.4	4.5	4.4	4.4
	70 [21.1]	Total BTUH [kW]	44.7 [13.1]	42.7 [12.5]	41.4 [12.1]	41.3 [12.1]	39.5 [11.6]	38.3 [11.2]	38.5 [11.3]	36.9 [10.8]	35.7 [10.5]
		Sens BTUH [kW]	8.3 [2.4]	7.4 [2.2]	6.9 [2.0]	9.2 [2.7]	8.2 [2.4]	7.6 [2.2]	13.9 [4.1]	12.4 [3.6]	11.4 [3.4]
		Power	4.7	4.6	4.6	4.7	4.6	4.5	4.6	4.5	4.5
	75 [23.9]	Total BTUH [kW]	43.4 [12.7]	41.5 [12.2]	40.2 [11.8]	40.0 [11.7]	38.3 [11.2]	37.1 [10.9]	37.2 [10.9]	35.6 [10.4]	34.5 [10.1]
		Sens BTUH [kW]	6.3 [1.8]	5.6 [1.7]	5.2 [1.5]	7.2 [2.1]	6.4 [1.9]	5.9 [1.7]	11.9 [3.5]	10.6 [3.1]	9.8 [2.9]
		Power	4.9	4.8	4.7	4.8	4.7	4.7	4.8	4.7	4.6
	80 [26.7]	Total BTUH [kW]	41.8 [12.2]	40.0 [11.7]	38.8 [11.4]	38.4 [11.3]	36.8 [10.8]	35.6 [10.4]	35.7 [10.5]	34.1 [10.0]	33.1 [9.7]
		Sens BTUH [kW]	4.5 [1.3]	4.0 [1.2]	3.7 [1.1]	5.4 [1.6]	4.8 [1.4]	4.4 [1.3]	10.1 [2.9]	9.0 [2.6]	8.3 [2.4]
		Power	5.1	5.0	4.9	5.0	4.9	4.9	5.0	4.9	4.8
	85 [29.4]	Total BTUH [kW]	40.0 [11.7]	38.2 [11.2]	37.1 [10.9]	36.6 [10.7]	35.0 [10.3]	33.9 [9.9]	33.8 [9.9]	32.4 [9.5]	31.4 [9.2]
		Sens BTUH [kW]	2.9 [0.8]	2.6 [0.8]	2.4 [0.7]	3.8 [1.1]	3.4 [1.0]	3.1 [0.9]	8.5 [2.5]	7.6 [2.2]	7.0 [2.0]
		Power	5.4	5.3	5.2	5.3	5.2	5.1	5.3	5.2	5.1
	90 [32.2]	Total BTUH [kW]	37.9 [11.1]	36.2 [10.6]	35.1 [10.3]	34.5 [10.1]	33.0 [9.7]	32.0 [9.4]	31.7 [9.3]	30.4 [8.9]	29.4 [8.6]
		Sens BTUH [kW]	1.5 [0.4]	1.3 [0.4]	1.2 [0.4]	2.4 [0.7]	2.1 [0.6]	2.0 [0.6]	7.1 [2.1]	6.3 [1.9]	5.8 [1.7]
		Power	5.7	5.6	5.5	5.6	5.5	5.4	5.6	5.5	5.4

GROSS SYSTEMS PERFORMANCE DATA (HIGH REHEAT MODE)—RGEDZ(S,T)150

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			6000 [2832]	4100 [1935]	4000 [1888]	6000 [2832]	4100 [1935]	4000 [1888]	6000 [2832]	4100 [1935]	4000 [1888]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60°F [15.6]	Total BTUH [kW]	99.3 [29.1]	91.5 [26.8]	91.1 [26.7]	101.6 [29.8]	93.7 [27.4]	93.2 [27.3]	92.7 [27.2]	85.5 [25.1]	85.2 [25.0]
		Sens BTUH [kW]	33.3 [9.7]	27.4 [8.0]	27.0 [7.9]	40.1 [11.8]	33.0 [9.7]	32.6 [9.6]	46.4 [13.6]	38.1 [11.2]	37.7 [11.0]
		Power	9.5	9.1	9.1	9.3	8.9	8.9	9.3	8.9	8.9
	70°F [21.1]	Total BTUH [kW]	94.4 [27.7]	87.1 [25.5]	86.7 [25.4]	96.7 [28.3]	89.2 [26.1]	88.8 [26.0]	87.9 [25.8]	81.1 [23.8]	80.7 [23.7]
		Sens BTUH [kW]	27.0 [7.9]	22.2 [6.5]	21.9 [6.4]	33.9 [9.9]	27.9 [8.2]	27.5 [8.1]	40.1 [11.7]	33.0 [9.7]	32.6 [9.5]
		Power	9.7	9.3	9.3	9.5	9.2	9.2	9.5	9.2	9.1
	80°F [26.7]	Total BTUH [kW]	87.6 [25.7]	80.8 [23.7]	80.4 [23.6]	89.9 [26.3]	82.9 [24.3]	82.5 [24.2]	81.1 [23.8]	74.8 [21.9]	74.4 [21.8]
		Sens BTUH [kW]	20.1 [5.9]	16.5 [4.8]	16.3 [4.8]	27.0 [7.9]	22.2 [6.5]	21.9 [6.4]	33.2 [9.7]	27.3 [8.0]	27.0 [7.9]
		Power	10.2	9.8	9.8	10.0	9.6	9.6	10.0	9.6	9.6
	90°F [32.2]	Total BTUH [kW]	78.7 [23.1]	72.6 [21.3]	72.3 [21.2]	81.0 [23.7]	74.7 [21.9]	74.4 [21.8]	72.2 [21.2]	66.6 [19.5]	66.3 [19.4]
		Sens BTUH [kW]	12.5 [3.7]	10.3 [3.0]	10.2 [3.0]	19.4 [5.7]	15.9 [4.7]	15.8 [4.6]	25.6 [7.5]	21.0 [6.2]	20.8 [6.1]
		Power	11.0	10.5	10.5	10.8	10.4	10.3	10.8	10.3	10.3
	100°F [37.8]	Total BTUH [kW]	67.8 [19.9]	62.5 [18.3]	62.3 [18.2]	70.1 [20.5]	64.7 [18.9]	64.4 [18.9]	61.3 [18.0]	56.5 [16.6]	56.3 [16.5]
		Sens BTUH [kW]	4.3 [1.3]	3.5 [1.0]	3.5 [1.0]	11.2 [3.3]	9.2 [2.7]	9.1 [2.7]	17.4 [5.1]	14.3 [4.2]	14.1 [4.1]
		Power	11.9	11.5	11.4	11.8	11.3	11.3	11.8	11.3	11.3
	110 [43.3]	Total BTUH [kW]	54.9 [16.1]	50.6 [14.8]	50.4 [14.8]	57.2 [16.8]	52.7 [15.5]	52.5 [15.4]	48.4 [14.2]	44.6 [13.1]	44.4 [13.0]
		Sens BTUH [kW]	-4.6 [-1.3]	-3.8 [-1.1]	-3.7 [-1.1]	2.3 [0.7]	1.9 [0.5]	1.9 [0.5]	8.5 [2.5]	7.0 [2.0]	6.9 [2.0]
		Power	13.2	12.6	12.6	13.0	12.5	12.4	13.0	12.5	12.4
	120 [48.9]	Total BTUH [kW]	40.0 [11.7]	36.8 [10.8]	36.7 [10.8]	42.3 [12.4]	39.0 [11.4]	38.8 [11.4]	33.4 [9.8]	30.8 [9.0]	30.7 [9.0]
		Sens BTUH [kW]	-14.1 [-4.1]	-11.6 [-3.4]	-11.5 [-3.4]	-7.2 [-2.1]	-6.0 [-1.7]	-5.9 [-1.7]	-1.0 [-0.3]	-0.9 [-0.2]	-0.8 [-0.2]
		Power	14.6	14.1	14.0	14.5	13.9	13.9	14.4	13.9	13.8

AIRFLOW PERFORMANCE — 7.5 TON [26.4 kW] — 60 Hz — DOWNFLOW

Air Flow CFM [L/s]	Model RGEDZ*090* Voltage 208/230, 460, 575 — 3 phase 60 Hz																							
	External Static Pressure—Inches of Water [kPa]																							
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]				
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W			
2400 [1133]	—	551 782 585 814	619 848 652 885	684 926 717 969	748 1016 780 1065	810 1118 841 1174	870 1233 900 1294	929 1359 957 1427	985 1498 1012 1572	1039 1649 1065 1729	1091 1813 1118 1870	1143 1200 1162 1279	1219 1279 1162 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194
2500 [1180]	—	562 816 596 848	629 884 661 923	693 964 725 1009	756 1057 787 1108	817 1162 846 1219	876 1279 904 1343	933 1409 960 1478	987 1550 1014 1626	1040 1704 1066 1786	1092 1870 1118 1180	1143 1200 1162 1279	1219 1279 1162 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194
2600 [1227]	—	574 851 607 885	639 922 671 962	702 1006 733 1052	764 1101 794 1153	823 1209 852 1267	881 1329 909 1393	937 1461 964 1531	990 1605 1016 1682	1042 1762 1067 1844	1092 1930 1118 1180	1143 1200 1162 1279	1219 1279 1162 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194
2700 [1274]	553 857 889 618	925 963 681 1004	712 1049 742 1096	772 1147 801 1201	830 1258 858 1317	886 1380 914 1446	941 1515 967 1587	993 1662 1019 1740	1044 1821 1068 1905	1092 1993 1118 1180	1143 1200 1162 1279	1219 1279 1162 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194	
2800 [1321]	565 896 597 930	629 966 660 1006	691 1049 721 1095	751 1144 780 1196	808 1251 837 1309	864 1370 892 1434	919 1501 945 1572	971 1645 996 1721	1021 1801 1045 1883	1069 1969 1093 2057	1118 1180 1143 1200	1162 1279 1219 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194	
2900 [1368]	577 937 609 972	640 1010 670 1051	701 1096 730 1143	759 1193 788 1246	816 1303 843 1362	871 1425 897 1490	923 1559 949 1630	974 1705 999 1783	1023 1864 1047 1948	1070 2035 1093 2124	1118 1180 1143 1200	1162 1279 1219 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194	
3000 [1416]	590 981 621 1017	651 1057 681 1099	710 1145 739 1193	768 1245 796 1300	823 1357 850 1418	877 1476 883 1541	908 1610 933 1681	958 1755 982 1833	1005 1913 1028 1997	1051 2083 1073 2173	1094 2194 1118 1180	1143 1200 1162 1279	1219 1279 1162 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194
3100 [1463]	602 1027 633 1065	662 1105 692 1149	720 1196 749 1246	777 1299 804 1355	831 1414 857 1476	883 1541 908 1610	933 1681 958 1755	982 1833 1005 1913	1028 1997 1051 2083	1073 2173 1094 2194	1118 1180 1143 1200	1162 1279 1219 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194	
3200 [1510]	615 1075 645 1114	674 1157 702 1202	731 1250 758 1301	785 1356 812 1413	838 1473 864 1537	889 1603 914 1673	938 1746 962 1821	986 1900 1008 1982	1031 2067 1053 2155	1074 2246 1095 2340	1118 1180 1143 1200	1162 1279 1219 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194	
3300 [1557]	628 1126 657 1166	685 1210 713 1256	741 1306 768 1359	794 1414 820 1473	846 1535 871 1600	896 1668 920 1739	944 1813 967 1890	989 1970 1012 2053	1033 2139 1055 2229	1075 2321 1096 2416	1118 1180 1143 1200	1162 1279 1219 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194	
3400 [1604]	640 1179 669 1221	697 1266 724 1314	751 1365 777 1419	803 1476 829 1536	854 1599 878 1665	902 1734 926 1807	949 1882 971 1960	993 2042 1015 2126	1036 2214 1057 2305	1077 2398 1097 2495	1118 1180 1143 1200	1162 1279 1219 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194	
3500 [1652]	653 1235 681 1278	708 1324 735 1373	761 1425 787 1481	812 1539 837 1601	861 1665 885 1733	909 1803 932 1877	954 1954 976 2034	997 2116 1018 2202	1039 2291 1059 2383	1078 2478 1097 2576	1118 1180 1143 1200	1162 1279 1219 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194	
3600 [1699]	666 1292 693 1337	720 1384 746 1435	771 1489 797 1545	821 1605 845 1668	869 1734 892 1803	915 1875 938 1950	959 2028 981 2109	1001 2193 1022 2280	1042 2371 1061 2464	1080 2560 1098 2660	1118 1180 1143 1200	1162 1279 1219 1279	1279 1333 1209 1393	1337 1461 1351 1461	1434 1501 1446 1501	1501 1572 1587 1645	1645 1721 1662 1721	1721 1801 1801 1801	1801 1883 1883 1883	1883 1969 1969 1969	1969 2057 2057 2057	2057 2124 2124 2124	2124 2194 2194 2194	

NOTE: A/F- Drive left of the bold line, B/G-Drive right of bold line.

Drive Package	A/F				B/G				C/H				
Motor H.P. [W]	2 [1491.4]				3 [2237.1]				3 [2237.1]				
Blower Sheave	AK84H				AK84H				AK84H				
Motor Sheave	1VL40*7/8				1VP50*7/8				1VP56*7/8				
Belt	A49				A50				A51				
Turns Open	0	1	2	3	4	5	0	1	2	3	4	5	
RPM	767	721	678	635	590	548	992	949	908	866	823	782	740

NOTES: 1. Factory sheave settings are shown in bold type.

2. Do not set motor sheave below minimum or maximum turns open shown.

3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure

4. Drive data shown is for vertical airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE—7.5 TON [26.4 kW] — 60 Hz — DOWNFLOW (con't.)

Airflow		AIRFLOW CORRECTION FACTORS *			COMPONENT AIRFLOW RESISTANCE				
CFM [L/s]	Total MBH	Sensible MBH	Power kW	Wet Coil	Vertical Economizer RA Damper Open	Concentric Diffuser RXRN-AEF2000 & Concentric Adapter RXMC-DD01 (Flush)	Concentric Diffuser RXRN-AED2000 & Concentric Adapter RXMC-DD01 (Drop)	Pressure Drop MERV 8	Pressure Drop MERV 13
Resistance — Inches of Water [kPa]									
2400 [1133]	0.96	0.89	0.98	0.04 [.01]	0.01 [.00]	0.66 [.16]	0.53 [.13]	0.093 [.02]	0.047 [.01]
2500 [1180]	0.96	0.90	0.99	0.05 [.01]	0.02 [.00]	0.71 [.18]	0.57 [.14]	0.098 [.02]	0.055 [.01]
2600 [1227]	0.97	0.92	0.99	0.05 [.01]	0.02 [.01]	0.75 [.19]	0.60 [.15]	0.103 [.02]	0.062 [.01]
2700 [1274]	0.97	0.93	0.99	0.05 [.01]	0.03 [.01]	0.80 [.20]	0.65 [.16]	0.108 [.03]	0.070 [.02]
2800 [1321]	0.98	0.95	0.99	0.06 [.01]	0.04 [.01]	0.85 [.21]	0.69 [.17]	0.113 [.03]	0.078 [.02]
2900 [1368]	0.98	0.96	1.00	0.06 [.02]	0.04 [.01]	0.91 [.23]	0.74 [.18]	0.117 [.03]	0.085 [.02]
3000 [1416]	0.99	0.97	1.00	0.07 [.02]	0.05 [.01]	0.96 [.24]	0.79 [.20]	0.122 [.03]	0.093 [.02]
3100 [1463]	1.00	0.99	1.00	0.07 [.02]	0.06 [.02]	1.02 [.25]	0.86 [.21]	0.127 [.03]	0.100 [.02]
3200 [1510]	1.00	1.00	1.01	0.07 [.02]	0.07 [.02]	1.08 [.27]	0.92 [.23]	0.132 [.03]	0.108 [.03]
3300 [1557]	1.01	1.02	1.01	0.08 [.02]	0.08 [.02]	1.15 [.29]	0.99 [.25]	0.137 [.03]	0.115 [.03]
3400 [1604]	1.01	1.03	1.01	0.08 [.02]	0.09 [.02]	1.21 [.30]	1.05 [.26]	0.142 [.03]	0.123 [.03]
3500 [1652]	1.02	1.05	1.01	0.09 [.02]	0.10 [.02]	1.29 [.32]	1.09 [.27]	0.147 [.04]	0.131 [.03]
3600 [1699]	1.02	1.06	1.02	0.09 [.02]	0.11 [.03]	1.36 [.34]	1.13 [.28]	0.152 [.04]	0.138 [.03]

*Multiply correction factor times gross performance data resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE — 7.5 TON [26.4 kW] — 60 Hz — SIDEFLOW

Air Flow CFM [L/s]	Model RGEDZ*090* Voltage 208/230, 460, 575 — 3 phase 60 Hz																																						
	External Static Pressure—Inches of Water [kPa]																																						
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]																			
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W																		
—	—	—	558	822	594	853	629	887	663	925	697	965	730	1009	763	1056	794	1106	826	1159	856	1216	886	1275	915	1338	943	1404	971	1474	998	1546	1025	1622	1051	1700	1076	1782	
—	—	—	568	848	604	881	638	917	672	956	705	998	738	1044	769	1092	801	1144	831	1199	861	1258	890	1319	919	1384	947	1452	974	1523	1001	1597	1027	1674	1052	1755	1077	1838	
—	—	543	846	579	877	613	912	647	950	681	991	713	1035	745	1082	777	1132	807	1186	837	1243	867	1303	895	1366	923	1433	951	1502	978	1575	1004	1651	1029	1730	1054	1812	1078	1898
—	—	554	877	589	910	623	946	657	986	689	1029	722	1074	753	1124	784	1176	814	1231	844	1290	872	1352	901	1417	928	1485	955	1556	981	1631	1007	1708	1032	1789	1056	1873	1079	1961
—	—	566	911	600	946	634	984	666	1026	699	1070	730	1118	761	1169	792	1223	821	1280	850	1340	878	1404	906	1470	933	1540	959	1613	985	1690	1010	1769	1034	1852	1058	1938	1081	2027
543	916	577	949	611	986	644	1026	676	1069	708	1115	739	1164	770	1217	799	1273	828	1332	857	1394	885	1459	912	1528	938	1599	964	1674	989	1752	1014	1833	1037	1918	1061	2005	1083	2096
555	955	589	990	622	1029	655	1070	687	1115	718	1163	748	1214	778	1269	807	1326	836	1387	864	1451	891	1518	918	1588	944	1662	969	1738	994	1818	1017	1901	1041	1987	1063	2077	1085	2169
568	998	601	1035	634	1075	666	1118	697	1165	728	1215	758	1268	787	1324	816	1383	844	1445	871	1511	898	1580	924	1652	949	1727	974	1806	998	1887	1022	1972	1044	2060	1066	2151	1088	2245
581	1044	614	1083	646	1125	677	1170	708	1218	738	1270	768	1324	796	1382	824	1443	852	1507	879	1575	905	1646	931	1719	955	1796	980	1876	1003	1960	1026	2046	1048	2136	1070	2229	1091	2325
594	1093	626	1134	658	1178	689	1225	719	1275	749	1328	778	1384	806	1444	833	1507	860	1573	887	1642	912	1714	937	1790	962	1869	985	1951	1008	2036	1031	2124	1052	2216	1073	2310	1094	2408
607	1146	639	1189	670	1234	701	1283	730	1335	759	1390	788	1448	815	1509	843	1574	869	1642	895	1713	920	1787	944	1864	968	1945	991	2028	1014	2115	1036	2205	1057	2298	1077	2395	1097	2494
621	1203	652	1247	683	1294	713	1344	742	1398	770	1455	798	1515	825	1578	852	1644	878	1714	903	1786	928	1862	952	1941	975	2024	997	2109	1019	2198	1041	2290	1061	2385	1081	2483	1101	2584
635	1262	666	1308	696	1357	725	1409	754	1465	782	1523	809	1585	836	1650	862	1718	887	1789	912	1864	936	1941	959	2022	982	2106	1004	2194	1025	2284	1046	2378	1066	2474	1086	2574	1104	2677

NOTE: A/F—Drive left of the bold line, B/G—Drive right of bold lines.

Drive Package	A/F										B/G										C/H									
Motor H.P. [W]	2 [1491.4]										3 [2237.1]										3 [2237.1]									
Blower Sheave	AK84H										AK84H										AK84H									
Motor Sheave	1VL40*7/8										1VP50*7/8										1VP56*7/8									
Belt	A49										A50										A51									
Turns Open	0	1	2	3	4	5	0	1	2	3	4	5	0	1	2	3	4	5												
RPM	765	720	676	633	589	544	989	949	908	865	823	780	1108	1067	1029	987	946	905												

- NOTES: 1. Factory sheave settings are shown in bold type.
2. Do not set motor sheave below minimum or maximum turns open shown.
3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure
4. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE — 7.5 TON [26.4 kW] — 60 Hz — SIDEFLOW (con't.)

Airflow	AIRFLOW CORRECTION FACTORS *				COMPONENT AIRFLOW RESISTANCE						
	CFM [L/s]	Total MBH	Sensible MBH	Power kW	Wet Coil	Horizontal Economizer RA Damper Open	Resistance — Inches of Water [kPa]		Concentric Diffuser RXRN-AED2000 & Concentric Adapter RXMC-DD01 (Drop)	Pressure Drop MERV 8	Pressure Drop MERV 13
							Concentric Diffuser RXRN-AEF2000 & Concentric Adapter RXMC-DD01 (Flush)				
2400 [1133]	0.96	0.89	0.98	0.98	0.04 [.01]	0.21 [0.05]	0.66 [.16]	0.53 [.13]	0.093 [.02]	0.047 [.01]	
2500 [1180]	0.96	0.90	0.99	0.99	0.05 [.01]	0.25 [0.06]	0.71 [.18]	0.57 [.14]	0.098 [.02]	0.055 [.01]	
2600 [1227]	0.97	0.92	0.99	0.99	0.05 [.01]	0.28 [0.07]	0.75 [.19]	0.60 [.15]	0.103 [.02]	0.062 [.01]	
2700 [1274]	0.97	0.93	0.99	0.99	0.05 [.01]	0.32 [0.08]	0.80 [.20]	0.65 [.16]	0.108 [.03]	0.070 [.02]	
2800 [1321]	0.98	0.95	0.99	0.99	0.06 [.01]	0.36 [0.09]	0.85 [.21]	0.69 [.17]	0.113 [.03]	0.078 [.02]	
2900 [1368]	0.98	0.96	1.00	1.00	0.06 [.02]	0.39 [0.10]	0.91 [.23]	0.74 [.18]	0.117 [.03]	0.085 [.02]	
3000 [1416]	0.99	0.97	1.00	1.00	0.07 [.02]	0.43 [0.11]	0.96 [.24]	0.79 [.20]	0.122 [.03]	0.093 [.02]	
3100 [1463]	1.00	0.99	1.00	1.00	0.07 [.02]	0.47 [0.12]	1.02 [.25]	0.86 [.21]	0.127 [.03]	0.100 [.02]	
3200 [1510]	1.00	1.00	1.01	1.01	0.07 [.02]	0.51 [0.13]	1.08 [.27]	0.92 [.23]	0.132 [.03]	0.108 [.03]	
3300 [1557]	1.01	1.02	1.01	1.01	0.08 [.02]	0.54 [0.14]	1.15 [.29]	0.99 [.25]	0.137 [.03]	0.115 [.03]	
3400 [1604]	1.01	1.03	1.01	1.01	0.08 [.02]	0.58 [0.14]	1.21 [.30]	1.05 [.26]	0.142 [.03]	0.123 [.03]	
3500 [1652]	1.02	1.05	1.01	1.01	0.09 [.02]	0.62 [0.15]	1.29 [.32]	1.09 [.27]	0.147 [.04]	0.131 [.03]	
3600 [1699]	1.02	1.06	1.02	1.02	0.09 [.02]	0.66 [0.16]	1.36 [.34]	1.13 [.28]	0.152 [.04]	0.138 [.03]	

*Multiply correction factor times gross performance data resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE

Air Flow CFM (L/s)	Model RGEDZ*102*										Voltage 208/230, 460, 575 — 3 phase 60 Hz										External Static Pressure—Inches of Water [kPa]																		
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]																			
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W																		
—	—	561	894	596	934	631	975	665	1018	698	1062	730	1108	762	1155	793	1203	823	1253	853	1304	882	1357	910	1411	937	1467	964	1524	990	1583	1015	1643	1039	1704	1063	1767	1086	1832
—	—	573	927	608	969	642	1013	676	1058	708	1104	740	1152	771	1201	802	1252	832	1304	861	1358	889	1413	917	1470	943	1528	970	1587	995	1648	1020	1711	1044	1775	1067	1840	1090	1907
—	—	586	964	620	1008	654	1064	687	1101	719	1150	750	1200	781	1252	811	1305	840	1360	869	1416	897	1473	924	1532	950	1593	976	1654	1001	1718	1025	1782	1048	1848	1071	1916	1093	1985
564	959	599	1004	633	1051	666	1099	698	1149	730	1200	761	1253	791	1307	820	1362	849	1419	877	1477	904	1537	931	1598	957	1661	982	1725	1006	1791	1030	1858	1053	1926	1075	1996	1097	2067
578	1001	612	1048	645	1098	678	1148	710	1200	741	1254	771	1308	801	1365	830	1423	858	1482	886	1542	912	1605	939	1668	964	1733	989	1800	1012	1868	1036	1937	1058	2008	1080	2080	1101	2154
592	1046	625	1096	658	1148	690	1201	721	1255	752	1311	782	1368	811	1427	840	1487	867	1548	894	1611	921	1676	946	1742	971	1809	995	1878	1019	1948	1041	2020	1063	2093	1085	2168	1105	2244
605	1096	638	1148	671	1202	702	1257	733	1314	763	1372	793	1432	821	1493	849	1555	877	1619	903	1684	929	1751	954	1819	979	1889	1002	1960	1025	2033	1047	2107	1069	2182	1090	2259	1110	2337
619	1149	652	1204	684	1260	715	1317	745	1376	775	1437	804	1499	832	1562	860	1627	886	1693	912	1761	938	1830	962	1900	986	1972	1009	2046	1032	2121	1053	2197	1074	2275	1095	2354	1114	2435
634	1206	666	1263	697	1322	728	1382	758	1443	787	1506	815	1570	843	1635	870	1702	896	1771	922	1841	948	1912	970	1985	994	2060	1017	2135	1038	2213	1060	2291	1080	2371	1100	2453	1119	2536
648	1267	680	1326	711	1387	741	1449	770	1513	799	1578	827	1645	854	1713	880	1782	906	1853	931	1925	955	1999	979	2074	1002	2151	1024	2229	1045	2308	1066	2389	1086	2472	1100	2556	1124	2641
663	1332	694	1393	724	1456	754	1521	783	1587	811	1654	838	1723	865	1793	891	1865	916	1938	941	2013	965	2099	988	2167	1010	2246	1032	2326	1053	2408	1073	2491	1092	2576	1111	2662	1129	2750
678	1400	708	1464	738	1529	767	1596	795	1665	823	1734	850	1805	876	1878	902	1952	926	2028	951	2105	974	2183	996	2263	1018	2344	1039	2427	1060	2511	1080	2597	1099	2684	1117	2772	1134	2862
693	1472	723	1538	752	1606	781	1675	808	1746	836	1818	862	1892	888	1966	913	2037	937	2121	961	2200	983	2281	1005	2363	1027	2447	1048	2532	1067	2618	1087	2705	1105	2796	1123	2886	1140	2979
708	1540	737	1617	766	1687	794	1758	822	1831	848	1906	874	1981	900	2059	924	2143	947	2218	971	2299	993	2382	1015	2467	1036	2553	1056	2640	1075	2729	1094	2816	1110	2911	1129	3004	1146	3099
718	1572	742	1659	781	1771	808	1845	835	1920	861	1997	887	2075	911	2155	935	2236	959	2318	981	2402	1003	2488	1024	2574	1045	2663	1064	2752	1083	2844	1102	2936	1119	3030	1136	3126	1152	3223

NOTE: A/F-Drive left of the bold line, B/G-Drive right of bold lines.

Drive Package	A/F			B/G			C/H							
Motor H.P. [W]	2 [1491.4]			3 [2237.1]			3 [2237.1]							
Blower Sheave	AK79H			AK79H			AK79H							
Motor Sheave	1VL40*7/8			1VP50*7/8			1VP56*7/8							
Belt	A49			A50			A51							
Turns Open	0	1	2	3	4	5	0	1	2	3	4	5		
RPM	804	758	710	661	616	559	1048	1003	959	914	872	826	1002	957

NOTES: 1. Factory sheave settings are shown in bold type.

2. Do not set motor sheave below minimum or maximum turns open shown.
3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure
4. Drive data shown is for vertical airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE—8.5 TON [29.9 kW] — 60 Hz — DOWNFLOW (con't.)

Airflow	AIRFLOW CORRECTION FACTORS *				COMPONENT AIRFLOW RESISTANCE						
	CFM [L/s]	Total MBH	Sensible MBH	Power KW	Wet Coil	Vertical Economizer RA Damper Open	Concentric Diffuser RXRN-AEF2000 & Concentric Adapter RXMC-DD01 (Flush)	Concentric Diffuser RXRN-AED2000 & Concentric Adapter RXMC-DD01 (Drop)	Pressure Drop MERV 8	Pressure Drop MERV 13	
							Resistance — Inches of Water [kPa]				
2700 [1274]	0.97	0.93	0.99	0.99	0.07 [.02]	0.03 [.01]	0.80 [.20]	0.65 [.16]	0.108 [.03]	0.070 [.02]	
2800 [1321]	0.98	0.94	0.99	0.99	0.07 [.02]	0.03 [.01]	0.85 [.21]	0.69 [.17]	0.113 [.03]	0.078 [.02]	
2900 [1368]	0.98	0.96	0.99	0.99	0.08 [.02]	0.04 [.01]	0.91 [.23]	0.74 [.18]	0.117 [.03]	0.085 [.02]	
3000 [1416]	0.99	0.97	1.00	1.00	0.08 [.02]	0.05 [.01]	0.96 [.24]	0.79 [.20]	0.122 [.03]	0.093 [.02]	
3100 [1463]	0.99	0.99	1.00	1.00	0.09 [.02]	0.06 [.01]	1.02 [.25]	0.86 [.21]	0.127 [.03]	0.100 [.02]	
3200 [1510]	1.00	1.00	1.00	1.00	0.10 [.02]	0.07 [.02]	1.08 [.27]	0.92 [.23]	0.132 [.03]	0.108 [.03]	
3300 [1557]	1.01	1.01	1.00	1.00	0.10 [.03]	0.08 [.02]	1.15 [.29]	0.99 [.25]	0.137 [.03]	0.115 [.03]	
3400 [1604]	1.01	1.03	1.01	1.01	0.11 [.03]	0.09 [.02]	1.21 [.30]	1.05 [.26]	0.142 [.03]	0.123 [.03]	
3500 [1652]	1.02	1.04	1.01	1.01	0.11 [.03]	0.10 [.02]	1.29 [.32]	1.09 [.27]	0.147 [.04]	0.131 [.03]	
3600 [1699]	1.02	1.06	1.01	1.01	0.12 [.03]	0.11 [.03]	1.36 [.34]	1.13 [.28]	0.152 [.04]	0.138 [.03]	
3700 [1746]	1.03	1.07	1.02	1.02	0.13 [.03]	0.12 [.03]	1.43 [.36]	1.18 [.29]	0.157 [.04]	0.146 [.04]	
3800 [1793]	1.03	1.09	1.02	1.02	0.13 [.03]	0.13 [.03]	1.50 [.37]	1.23 [.31]	0.162 [.04]	0.153 [.04]	
3900 [1840]	1.04	1.10	1.02	1.02	0.14 [.04]	0.15 [.04]	1.59 [.40]	1.31 [.33]	0.167 [.04]	0.161 [.04]	
4000 [1888]	1.05	1.12	1.02	1.02	0.14 [.04]	0.16 [.04]	1.68 [.42]	1.38 [.34]	0.171 [.04]	0.169 [.04]	
4100 [1935]	1.05	1.13	1.03	1.03	0.15 [.04]	0.17 [.04]	1.74 [.43]	1.44 [.36]	0.176 [.04]	0.176 [.04]	

*Multiply correction factor times gross performance data resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE — 8.5 TON [29.9 kW] — 60 Hz — SIDEFLOW

Air Flow CFM [L/s]	Voltage 208/230, 460, 575 — 3 phase 60 Hz												External Static Pressure—Inches of Water [kPa]																											
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]																				
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W																			
2700 [1274]	—	—	—	577	932	611	969	644	1009	677	1052	710	1098	742	1147	774	1199	806	1254	837	1312	868	1373	898	1437	929	1505	959	1575	988	1648	1017	1725	1046	1804	1074	1886	1102	1972	
2800 [1321]	—	—	556	926	589	962	622	1000	655	1042	687	1087	719	1134	751	1185	783	1239	814	1295	844	1355	875	1418	905	1484	934	1553	963	1624	992	1699	1021	1777	1049	1858	1077	1942	1105	2029
2900 [1368]	—	—	568	958	601	995	633	1036	666	1079	697	1125	729	1174	760	1227	791	1282	821	1340	851	1402	881	1466	911	1533	940	1604	968	1677	997	1754	1025	1834	1052	1916	1080	2002	1107	2090
3000 [1416]	—	—	580	994	613	1033	645	1074	676	1119	708	1167	738	1218	769	1272	799	1329	829	1389	859	1452	888	1518	917	1587	945	1659	973	1734	1001	1812	1029	1894	1056	1978	1082	2065	1109	2155
3100 [1463]	561	996	593	1033	624	1073	656	1117	687	1163	718	1213	748	1265	778	1321	808	1379	837	1441	866	1506	895	1573	923	1644	951	1718	978	1794	1006	1874	1033	1957	1059	2043	1085	2132	1111	2224
3200 [1510]	574	1037	605	1076	636	1118	667	1163	698	1211	728	1262	758	1316	787	1373	816	1434	845	1497	873	1563	902	1632	929	1705	957	1780	984	1858	1010	1940	1037	2024	1063	2112	1088	2202	1113	2296
3300 [1557]	587	1082	618	1122	648	1166	679	1212	709	1262	738	1315	767	1371	796	1430	825	1491	853	1556	881	1624	908	1695	936	1769	962	1846	989	1926	1015	2009	1041	2095	1066	2184	1091	2276	1116	2372
3400 [1604]	600	1130	630	1172	660	1217	690	1266	720	1317	749	1371	777	1429	806	1489	834	1553	861	1619	888	1689	915	1761	942	1837	968	1916	994	1997	1020	2082	1045	2170	1070	2260	1094	2354	1118	2451
3500 [1652]	613	1182	643	1226	672	1273	702	1323	730	1376	759	1432	787	1491	815	1553	842	1618	869	1686	896	1757	922	1831	948	1909	974	1989	999	2072	1024	2158	1049	2248	1073	2340	1097	2436	1121	2534
3600 [1699]	626	1238	656	1283	685	1332	713	1383	741	1438	769	1495	797	1556	824	1620	851	1687	877	1756	904	1829	929	1905	955	1984	980	2066	1005	2151	1029	2238	1053	2329	1077	2423	1100	2520	1123	2621
3700 [1746]	640	1297	668	1344	697	1394	725	1447	753	1504	780	1563	807	1625	833	1690	860	1759	886	1830	911	1905	937	1982	961	2063	986	2146	1010	2233	1034	2322	1057	2415	1081	2510	1103	2609	1128	2711
3800 [1793]	653	1360	681	1409	709	1460	737	1515	764	1573	790	1634	817	1698	843	1765	869	1835	894	1908	919	1984	944	2063	968	2145	992	2230	1016	2318	1039	2410	1062	2504	1084	2601	1107	2701	1128	2805
3900 [1840]	667	1426	694	1477	721	1530	748	1587	775	1646	801	1709	827	1774	852	1843	878	1914	902	1989	927	2067	951	2147	975	2231	998	2318	1021	2408	1044	2500	1066	2596	1088	2695	1110	2797	1131	2902
4000 [1888]	680	1496	707	1548	734	1604	760	1662	786	1723	812	1787	837	1854	862	1924	887	1998	911	2074	935	2153	958	2235	981	2321	1004	2409	1027	2501	1049	2595	1071	2693	1092	2793	1113	2897	1134	3003
4100 [1935]	694	1570	720	1624	746	1681	772	1740	797	1803	822	1869	847	1938	872	2009	896	2084	919	2162	943	2243	965	2327	988	2414	1010	2504	1032	2597	1054	2693	1075	2792	1096	2895	1116	3000	1137	3108

NOTE: A/F—Drive left of the bold line, B/G—Drive right of bold lines.

Drive Package	A/F						B/G						C/H					
Motor H.P. [W]	2 [1491.4]						3 [2237.1]						3 [2237.1]					
Blower Sheave	AK79H						AK79H						AK79H					
Motor Sheave	1VL40*7/8						1VP50*7/8						1VP56*7/8					
Belt	A49						A50						A51					
Turns Open	0	1	2	3	4	5	0	1	2	3	4	5	0	1	2	3	4	5
RPM	802	754	707	662	616	555	1048	1005	960	916	870	827	1170	1126	1085	1044	1000	956

- NOTES: 1. Factory sheave settings are shown in bold type.
2. Do not set motor sheave below minimum or maximum turns open shown.
3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure
4. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE—8.5 TON [29.9 kW] — 60 Hz — SIDEFLOW (con't.)

AIRFLOW CORRECTION FACTORS *				COMPONENT AIRFLOW RESISTANCE					
Airflow				Wet Coil	Horizontal Economizer RA Damper Open	Concentric Diffuser RXRN-AEF2000 & Concentric Adapter RXMC-DD01 (Flush)	Concentric Diffuser RXRN-AED2000 & Concentric Adapter RXMC-DD01 (Drop)	Pressure Drop MERV 8	Pressure Drop MERV 13
CFM [L/s]	Total MBH	Sensible MBH	Power kW	Resistance — Inches of Water [kPa]					
2700 [1274]	0.97	0.93	0.99	0.07 [.02]	0.32 [0.08]	0.80 [.20]	0.65 [.16]	0.108 [.03]	0.070 [.02]
2800 [1321]	0.98	0.94	0.99	0.07 [.02]	0.36 [0.09]	0.85 [.21]	0.69 [.17]	0.113 [.03]	0.078 [.02]
2900 [1368]	0.98	0.96	0.99	0.08 [.02]	0.39 [0.10]	0.91 [.23]	0.74 [.18]	0.117 [.03]	0.085 [.02]
3000 [1416]	0.99	0.97	1.00	0.08 [.02]	0.43 [0.11]	0.96 [.24]	0.79 [.20]	0.122 [.03]	0.093 [.02]
3100 [1463]	0.99	0.99	1.00	0.09 [.02]	0.47 [0.12]	1.02 [.25]	0.86 [.21]	0.127 [.03]	0.100 [.02]
3200 [1510]	1.00	1.00	1.00	0.10 [.02]	0.51 [0.13]	1.08 [.27]	0.92 [.23]	0.132 [.03]	0.108 [.03]
3300 [1557]	1.01	1.01	1.00	0.10 [.03]	0.54 [0.14]	1.15 [.29]	0.99 [.25]	0.137 [.03]	0.115 [.03]
3400 [1604]	1.01	1.03	1.01	0.11 [.03]	0.58 [0.14]	1.21 [.30]	1.05 [.26]	0.142 [.03]	0.123 [.03]
3500 [1652]	1.02	1.04	1.01	0.11 [.03]	0.62 [0.15]	1.29 [.32]	1.09 [.27]	0.147 [.04]	0.131 [.03]
3600 [1699]	1.02	1.06	1.01	0.12 [.03]	0.66 [0.16]	1.36 [.34]	1.13 [.28]	0.152 [.04]	0.138 [.03]
3700 [1746]	1.03	1.07	1.02	0.13 [.03]	0.70 [0.17]	1.43 [.36]	1.18 [.29]	0.157 [.04]	0.146 [.04]
3800 [1793]	1.03	1.09	1.02	0.13 [.03]	0.74 [0.18]	1.50 [.37]	1.23 [.31]	0.162 [.04]	0.153 [.04]
3900 [1840]	1.04	1.10	1.02	0.14 [.04]	0.77 [0.19]	1.59 [.40]	1.31 [.33]	0.167 [.04]	0.161 [.04]
4000 [1888]	1.05	1.12	1.02	0.15 [.04]	0.81 [0.20]	1.68 [.42]	1.38 [.34]	0.171 [.04]	0.169 [.04]
4100 [1935]	1.05	1.13	1.03	0.15 [.04]	0.85 [0.21]	1.74 [.43]	1.44 [.36]	0.176 [.04]	0.176 [.04]

*Multiply correction factor times gross performance data resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE—10 TON [35.1 kW] — 60 Hz — DOWNFLOW

Air Flow CFM (L/s)	Voltage 208/230, 460, 575 — 3 phase 60 Hz										External Static Pressure—Inches of Water [kPa]																												
	Model RGEDZ*120*																																						
	0.1 [0.2]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]																			
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W																		
597	1046	629	1092	661	1141	692	1191	723	1242	753	1296	782	1351	811	1409	839	1468	867	1528	893	1591	920	1655	945	1722	970	1790	994	1859	1018	1931	1041	2004	1064	2080	1085	2157	1107	2236
610	1092	642	1141	674	1192	705	1244	735	1299	764	1355	793	1413	822	1473	849	1535	876	1599	903	1664	928	1731	954	1800	978	1871	1002	1943	1025	2018	1048	2094	1070	2172	1091	2251	1112	2333
624	1142	655	1194	686	1247	717	1303	747	1360	776	1414	804	1480	832	1542	859	1607	886	1673	912	1741	937	1811	962	1883	986	1956	1010	2031	1032	2108	1055	2187	1076	2268	1097	2350	1117	2435
638	1196	689	1251	699	1307	729	1365	759	1425	787	1487	815	1550	843	1616	870	1683	896	1752	921	1823	946	1895	974	1969	994	2046	1017	2124	1040	2203	1061	2285	1088	2368	1103	2454	1123	2545
651	1255	682	1312	712	1371	742	1432	771	1494	799	1559	827	1625	854	1693	880	1763	906	1835	931	1908	955	1984	979	2061	1003	2124	1025	2220	1047	2303	1068	2387	1089	2473	1109	2561	1129	2651
665	1317	696	1377	725	1439	755	1503	783	1568	811	1635	838	1704	865	1775	891	1848	916	1922	941	1998	965	2076	988	2156	1011	2238	1033	2321	1055	2406	1075	2493	1096	2582	1115	2673	1134	2765
679	1385	709	1447	739	1512	767	1578	795	1646	823	1716	850	1788	876	1861	901	1937	926	2014	950	2093	974	2173	997	2256	1019	2340	1041	2426	1062	2514	1083	2604	1102	2696	1122	2789	1140	2884
693	1456	723	1521	752	1589	780	1668	808	1728	835	1801	861	1875	887	1952	912	2030	936	2110	960	2191	983	2275	1006	2360	1028	2447	1049	2536	1070	2627	1090	2719	1109	2813	1128	2909	1146	3007
708	1532	737	1600	765	1670	793	1741	820	1815	847	1890	873	1967	898	2046	923	2121	947	2210	970	2294	993	2380	1015	2468	1036	2558	1057	2650	1077	2743	1097	2838	1116	2935	1134	3034	1152	3135
722	1612	751	1682	779	1755	806	1830	833	1906	859	1984	884	2064	909	2145	933	2229	957	2314	980	2401	1002	2490	1024	2581	1045	2673	1065	2768	1085	2864	1104	2962	1123	3061	1141	3163	1158	3266
736	1696	765	1769	792	1845	819	1922	845	2001	871	2082	896	2164	921	2249	944	2335	968	2423	990	2513	1012	2604	1033	2698	1054	2793	1074	2890	1093	2989	1112	3090	1130	3192	1147	3296	1164	3402
751	1784	779	1861	806	1939	832	2019	858	2100	883	2184	908	2269	932	2356	955	2445	978	2536	1000	2629	1022	2723	1043	2819	1063	2917	1082	3017	1101	3118	1119	3222	1137	3327	1154	3434	—	—
765	1877	793	1956	820	2037	846	2120	871	2204	896	2290	920	2378	944	2468	967	2560	989	2653	1010	2749	1032	2846	1052	2945	1072	3045	1091	3148	1109	3252	1127	3358	1144	3466	1161	3576	—	—
780	1974	807	2056	833	2140	859	2225	884	2312	908	2401	932	2492	955	2584	978	2679	1000	2775	1021	2873	1041	2973	1061	3074	1081	3178	1099	3283	1117	3390	1135	3499	1152	3609	1168	3722	—	—
795	2076	821	2160	847	2246	872	2335	898	2421	921	2516	944	2610	967	2705	989	2802	1010	3001	1031	3002	1051	3104	1071	3208	1090	3314	1108	3422	1126	3532	1143	3644	1159	3757	—	—		
810	2181	836	2269	861	2358	886	2448	910	2541	934	2635	957	2732	979	2830	1000	2929	1021	3031	1042	3134	1062	3240	1081	3347	1099	3455	1117	3566	1134	3679	1151	3793	1167	3909	—	—		
825	2291	850	2381	875	2473	900	2567	923	2662	946	2759	969	2858	991	2959	1012	3061	1033	3165	1052	3272	1072	3380	1090	3489	1108	3601	1126	3714	1143	3829	1159	3946	—	—	—	—		

NOTE: A/F-Drive left of the bold line, B/G-Drive right of bold lines.

Drive Package	A/F			B/G			C/H							
Motor H.P. [W]	2 [1491.4]			3 [2237.1]			3 [2237.1]							
Blower Sheave	AK79H			AK79H			AK79H							
Motor Sheave	1VL40*7/8			1VP50*7/8			1VP56*7/8							
Belt	A49			A50			A51							
Turns Open	0	1	2	3	4	5	0	1	2	3	4	5		
RPM	802	758	710	661	616	559	1040	999	955	911	868	824	996	933

NOTES: 1. Factory sheave settings are shown in bold type.

2. Do not set motor sheave below minimum or maximum turns open shown.
3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure
4. Drive data shown is for vertical airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE—10 TON [35.1 kW] — 60 Hz — DOWNFLOW (con't.)

Airflow	AIRFLOW CORRECTION FACTORS *				COMPONENT AIRFLOW RESISTANCE					
	CFM [L/s]	Total MBH	Sensible MBH	Power kW	Wet Coil	Vertical Economizer RA Damper Open	Concentric Diffuser RXRN-AEF3415 & Diffuser RXMC-DD02 (Flush)	Concentric Diffuser RXRN-AED3415 & Diffuser RXMC-DD02 (Drop)	Pressure Drop MERV 8	Pressure Drop MERV 13
							Resistance — Inches of Water [kPa]			
3200 [1510]	0.97	0.93	0.99	0.99	0.10 [.02]	0.07 [.02]	0.74 [.18]	0.56 [.14]	0.132 [.03]	0.108 [.03]
3300 [1557]	0.98	0.94	0.99	0.99	0.10 [.03]	0.08 [.02]	0.79 [.20]	0.59 [.15]	0.137 [.03]	0.115 [.03]
3400 [1604]	0.98	0.96	0.99	0.99	0.11 [.03]	0.09 [.02]	0.84 [.21]	0.62 [.15]	0.142 [.03]	0.123 [.03]
3500 [1652]	0.99	0.97	1.00	1.00	0.11 [.03]	0.10 [.02]	0.90 [.22]	0.66 [.16]	0.147 [.04]	0.131 [.03]
3600 [1699]	0.99	0.98	1.00	1.00	0.12 [.03]	0.11 [.03]	0.95 [.24]	0.69 [.17]	0.152 [.04]	0.138 [.03]
3700 [1746]	1.00	0.99	1.00	1.00	0.13 [.03]	0.12 [.03]	1.00 [.25]	0.73 [.18]	0.157 [.04]	0.146 [.04]
3800 [1793]	1.00	1.01	1.00	1.00	0.13 [.03]	0.13 [.03]	1.04 [.26]	0.76 [.19]	0.162 [.04]	0.153 [.04]
3900 [1840]	1.01	1.02	1.00	1.00	0.14 [.04]	0.15 [.04]	1.09 [.27]	0.80 [.20]	0.167 [.04]	0.161 [.04]
4000 [1888]	1.01	1.03	1.01	1.01	0.15 [.04]	0.16 [.04]	1.13 [.28]	0.84 [.21]	0.171 [.04]	0.169 [.04]
4100 [1935]	1.02	1.04	1.01	1.01	0.15 [.04]	0.17 [.04]	1.19 [.30]	0.88 [.22]	0.176 [.04]	0.176 [.04]
4200 [1982]	1.02	1.06	1.01	1.01	0.16 [.04]	0.19 [.05]	1.24 [.31]	0.92 [.23]	0.181 [.04]	0.184 [.05]
4300 [2029]	1.03	1.07	1.01	1.01	0.17 [.04]	0.20 [.05]	1.31 [.33]	0.97 [.24]	0.186 [.05]	0.191 [.05]
4400 [2076]	1.03	1.08	1.01	1.01	0.18 [.04]	0.21 [.05]	1.37 [.34]	1.02 [.25]	0.191 [.05]	0.199 [.05]
4500 [2123]	1.04	1.09	1.02	1.02	0.19 [.05]	0.23 [.06]	1.43 [.35]	1.07 [.27]	0.196 [.05]	0.207 [.05]
4600 [2171]	1.04	1.11	1.02	1.02	0.19 [.05]	0.24 [.06]	1.48 [.37]	1.11 [.28]	0.201 [.05]	0.214 [.05]
4700 [2218]	1.05	1.12	1.02	1.02	0.20 [.05]	0.26 [.06]	1.54 [.38]	1.15 [.29]	0.206 [.05]	0.222 [.05]
4800 [2265]	1.05	1.13	1.02	1.02	0.21 [.05]	0.28 [.07]	1.59 [.40]	1.19 [.30]	0.211 [.05]	0.229 [.06]

*Multiply correction factor times gross performance data resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE — 10 TON [35.1 kW] — 60 Hz — SIDEFLOW

Air Flow CFM [L/s]	Model RGEDZ*120* Voltage 208/230, 460, 575 — 3 phase 60 Hz																																							
	External Static Pressure—Inches of Water [kPa]																																							
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]																				
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W																			
3200 [151.0]	575	1018	607	1057	637	1099	667	1143	697	1191	727	1240	756	1293	785	1348	814	1406	842	1466	870	1529	897	1595	924	1664	951	1735	978	1809	1004	1885	1030	1965	1055	2047	1080	2131	1105	2219
3300 [155.7]	588	1060	618	1101	649	1146	679	1192	708	1242	737	1294	766	1349	795	1406	823	1466	850	1529	878	1595	905	1663	932	1734	958	1808	984	1884	1010	1963	1035	2045	1060	2129	1085	2216	1109	2306
3400 [160.4]	600	1106	630	1150	660	1196	690	1245	719	1297	748	1352	776	1409	804	1469	832	1531	859	1597	886	1664	913	1735	939	1808	965	1884	990	1963	1016	2044	1040	2128	1065	2215	1089	2305	1113	2397
3500 [165.2]	613	1156	643	1202	672	1251	701	1302	730	1357	758	1413	786	1473	814	1535	841	1600	868	1668	894	1738	920	1811	946	1887	972	1965	997	2046	1022	2130	1046	2217	1070	2306	1094	2397	1117	2492
3600 [169.9]	626	1210	655	1258	684	1310	713	1364	741	1420	769	1479	796	1541	823	1606	850	1673	877	1743	903	1816	929	1892	954	1970	979	2050	1004	2134	1028	2220	1052	2309	1076	2400	1099	2494	1122	2591
3700 [174.6]	639	1268	668	1319	696	1373	724	1429	752	1488	779	1550	806	1614	833	1681	860	1751	886	1823	911	1898	937	1976	962	2056	986	2140	1011	2225	1035	2314	1058	2405	1081	2499	1104	2596	1127	2695
3800 [179.3]	652	1330	680	1384	708	1440	736	1498	763	1560	790	1624	817	1690	843	1760	869	1832	895	1907	920	1984	945	2064	970	2147	994	2233	1018	2321	1041	2412	1064	2505	1087	2602	1110	2701	1132	2802
3900 [184.0]	665	1397	693	1452	721	1511	748	1572	775	1636	801	1702	828	1771	854	1843	879	1917	904	1995	929	2075	954	2157	978	2242	1001	2330	1025	2421	1048	2514	1071	2610	1093	2709	1115	2810	1137	2914
4000 [188.8]	678	1467	706	1525	733	1586	760	1650	787	1716	813	1785	839	1856	864	1930	889	2007	914	2087	938	2169	962	2254	986	2341	1009	2432	1032	2525	1055	2620	1077	2719	1099	2820	1121	2923	1142	3030
4100 [193.5]	692	1542	719	1602	746	1666	772	1731	798	1800	824	1871	850	1945	875	2022	899	2101	923	2183	947	2267	971	2355	994	2445	1017	2537	1040	2633	1062	2731	1084	2831	1105	2935	1126	3041	1147	3150
4200 [198.2]	706	1621	732	1684	759	1749	785	1817	810	1888	836	1962	861	2038	885	2117	909	2199	933	2283	957	2370	980	2460	1003	2552	1025	2647	1047	2745	1069	2845	1091	2948	1112	3054	1132	3163	1153	3274
4300 [202.9]	720	1704	746	1769	772	1837	797	1907	823	1981	847	2057	872	2135	896	2217	920	2301	943	2387	966	2477	989	2569	1012	2664	1034	2761	1055	2861	1077	2964	1098	3069	1118	3178	1139	3288	1158	3402
4400 [207.6]	734	1791	760	1858	785	1928	810	2001	835	2077	859	2155	883	2237	907	2320	931	2407	954	2496	976	2587	999	2682	1020	2779	1042	2879	1063	2981	1084	3087	1105	3195	1125	3305	1145	3418	—	—
4500 [212.3]	748	1882	773	1952	798	2024	823	2100	847	2178	871	2259	895	2342	918	2428	941	2517	964	2608	986	2702	1008	2799	1030	2899	1051	3001	1071	3106	1092	3214	1112	3324	1132	3437	1151	3552	—	—
4600 [217.1]	762	1977	787	2049	812	2124	836	2202	860	2283	884	2366	907	2451	930	2540	952	2631	974	2725	996	2822	1018	2921	1039	3023	1059	3127	1080	3235	1100	3345	1120	3457	1139	3573	1158	3691	—	—
4700 [221.8]	777	2076	801	2151	826	2228	849	2309	873	2391	896	2477	919	2565	941	2656	963	2750	985	2846	1006	2945	1027	3046	1048	3151	1068	3258	1088	3367	1108	3480	1127	3595	1146	3712	—	—	—	—
4800 [226.5]	792	2180	816	2257	840	2337	863	2419	886	2504	909	2592	931	2683	953	2776	975	2872	996	2971	1017	3072	1037	3176	1058	3283	1077	3392	1097	3504	1116	3619	1135	3736	1153	3856	—	—	—	—

NOTE: A/F- Drive left of the bold line, B/G- Drive right of bold lines.

Drive Package	A/F				B/G				C/H									
Motor H.P. [W]	2 [1491.4]				3 [2237.1]				3 [2237.1]									
Blower Sheave	AK79H				AK79H				AK79H									
Motor Sheave	1VL40*7/8				1VP50*7/8				1VP56*7/8									
Belt	A49				A50				A51									
Turns Open	0	1	2	3	4	5	0	1	2	3	4	5						
RPM	798	753	707	663	616	556	1041	998	955	912	867	824	1155	1119	1078	1037	994	951

- NOTES: 1. Factory sheave settings are shown in bold type.
2. Do not set motor sheave below minimum or maximum turns open shown.
3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure
4. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE—10 TON [35.1 kW] — 60 Hz — SIDEFLOW (con't.)

Airflow	AIRFLOW CORRECTION FACTORS *				COMPONENT AIRFLOW RESISTANCE						
	CFM [L/s]	Total MBH	Sensible MBH	Power kW	Wet Coil	Horizontal Economizer RA Damper Open	Concentric Diffuser RXRN-AEF3415 & Diffuser RXMC-DD02 (Flush)	Concentric Diffuser RXRN-AED3415 & Diffuser RXMC-DD02 (Drop)	Pressure Drop MERV 8	Pressure Drop MERV 13	
							Resistance — Inches of Water [kPa]				
3200 [1510]	0.97	0.93	0.99	0.99	0.10 [.02]	0.51 [.013]	0.74 [.18]	0.56 [.14]	0.132 [.03]	0.108 [.03]	
3300 [1557]	0.98	0.94	0.99	0.99	0.10 [.03]	0.54 [.014]	0.79 [.20]	0.59 [.15]	0.137 [.03]	0.115 [.03]	
3400 [1604]	0.98	0.96	0.99	0.99	0.11 [.03]	0.58 [.014]	0.84 [.21]	0.62 [.15]	0.142 [.03]	0.123 [.03]	
3500 [1652]	0.99	0.97	1.00	1.00	0.11 [.03]	0.62 [.015]	0.90 [.22]	0.66 [.16]	0.147 [.04]	0.131 [.03]	
3600 [1699]	0.99	0.98	1.00	1.00	0.12 [.03]	0.66 [.016]	0.95 [.24]	0.69 [.17]	0.152 [.04]	0.138 [.03]	
3700 [1746]	1.00	0.99	1.00	1.00	0.13 [.03]	0.70 [.017]	1.00 [.25]	0.73 [.18]	0.157 [.04]	0.146 [.04]	
3800 [1793]	1.00	1.01	1.00	1.00	0.13 [.03]	0.74 [.018]	1.04 [.26]	0.76 [.19]	0.162 [.04]	0.153 [.04]	
3900 [1840]	1.01	1.02	1.00	1.00	0.14 [.04]	0.77 [.019]	1.09 [.27]	0.80 [.20]	0.167 [.04]	0.161 [.04]	
4000 [1888]	1.01	1.03	1.01	1.01	0.15 [.04]	0.81 [.020]	1.13 [.28]	0.84 [.21]	0.171 [.04]	0.169 [.04]	
4100 [1935]	1.02	1.04	1.01	1.01	0.15 [.04]	0.85 [.021]	1.19 [.30]	0.88 [.22]	0.176 [.04]	0.176 [.04]	
4200 [1982]	1.02	1.06	1.01	1.01	0.16 [.04]	0.89 [.022]	1.24 [.31]	0.92 [.23]	0.181 [.04]	0.184 [.05]	
4300 [2029]	1.03	1.07	1.01	1.01	0.17 [.04]	0.93 [.023]	1.31 [.33]	0.97 [.24]	0.186 [.05]	0.191 [.05]	
4400 [2076]	1.03	1.08	1.01	1.01	0.18 [.04]	0.97 [.024]	1.37 [.34]	1.02 [.25]	0.191 [.05]	0.199 [.05]	
4500 [2123]	1.04	1.09	1.02	1.02	0.19 [.05]	1.01 [.025]	1.43 [.35]	1.07 [.27]	0.196 [.05]	0.207 [.05]	
4600 [2171]	1.04	1.11	1.02	1.02	0.19 [.05]	1.06 [.026]	1.48 [.37]	1.11 [.28]	0.201 [.05]	0.214 [.05]	
4700 [2218]	1.05	1.12	1.02	1.02	0.20 [.05]	1.10 [.027]	1.54 [.38]	1.15 [.29]	0.206 [.05]	0.222 [.05]	
4800 [2265]	1.05	1.13	1.02	1.02	0.21 [.05]	1.14 [.028]	1.59 [.40]	1.19 [.30]	0.211 [.05]	0.229 [.06]	

*Multiply correction factor times gross performance data resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE — 12.5 TON [43.9 kW] — 60 Hz — DOWNFLOW

Air Flow CFM [L/s]	Model RGEDZ*150* Voltage 208/230, 460, 575 — 3 phase 60 Hz																																							
	External Static Pressure—Inches of Water [kPa]																																							
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]																				
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W																			
4000 [1888]	766	1776	795	1806	824	1842	851	1883	878	1931	904	1985	929	2044	953	2110	976	2181	998	2259	1019	2342	1040	2431	1059	2526	1078	2627	1096	2734	1113	2847	1129	2966	1144	3091	1158	3221	1171	3358
4100 [1935]	778	1820	807	1856	835	1897	862	1944	888	1997	913	2056	937	2120	961	2191	983	2268	1005	2350	1026	2439	1045	2533	1064	2634	1082	2780	1109	2970	1119	3102	1131	3094	1145	3224	1159	3360	1171	3502
4200 [1982]	792	1875	820	1915	847	1961	873	2014	899	2072	923	2126	947	2206	969	2282	991	2364	1012	2451	1032	2545	1051	2645	1070	2750	1087	2882	1108	3079	1119	3102	1134	3232	1147	3367	1160	3508	1172	3655
4300 [2029]	806	1938	833	1984	859	2036	885	2093	910	2156	934	2226	957	2301	979	2382	1000	2469	1020	2562	1040	2661	1058	2766	1076	2877	1092	2993	1108	3116	1123	3244	1137	3379	1150	3519	1162	3665	1174	3818
4400 [2076]	820	2012	847	2063	873	2119	898	2182	922	2251	945	2325	967	2406	989	2492	1009	2584	1029	2682	1048	2787	1065	2897	1082	3013	1098	3134	1113	3262	1128	3396	1141	3536	1154	3681	1165	3833	1176	3990
4500 [2123]	835	2095	861	2151	886	2213	911	2281	934	2355	957	2434	978	2520	999	2611	1019	2709	1038	2812	1056	2922	1073	3037	1090	3158	1105	3285	1119	3418	1133	3557	1146	3702	1158	3853	1168	4009	1178	4172
4600 [2171]	851	2187	876	2249	901	2316	925	2389	947	2468	969	2553	990	2644	1010	2740	1030	2843	1048	2952	1065	3066	1082	3187	1097	3313	1112	3445	1126	3584	1139	3728	1151	3878	1162	4034	1172	4196	1182	4363
4700 [2218]	867	2290	892	2356	916	2428	939	2507	961	2591	982	2681	1003	2777	1022	2879	1041	2987	1058	3101	1075	3220	1091	3346	1106	3478	1120	3615	1133	3759	1145	3908	1157	4063	1167	4224	1177	4391	1186	4564
4800 [2265]	884	2401	908	2473	932	2551	954	2634	975	2723	996	2819	1016	2920	1034	3027	1052	3140	1069	3259	1085	3384	1101	3515	1115	3652	1128	3795	1141	3943	1153	4098	1163	4258	1173	4425	1182	4597	1190	4775
4900 [2312]	902	2523	925	2599	948	2682	969	2771	990	2866	1010	2966	1029	3073	1047	3185	1065	3303	1081	3427	1097	3558	1111	3694	1125	3836	1138	3984	1149	4137	1160	4297	1170	4463	1180	4634	1188	4812	1196	4995
5000 [2359]	920	2653	943	2736	965	2824	986	2917	1006	3017	1025	3123	1044	3235	1061	3352	1078	3476	1093	3605	1108	3741	1122	3882	1135	4029	1147	4182	1158	4341	1169	4506	1178	4677	1187	4854	1194	5036	1201	5225
5100 [2407]	939	2794	961	2881	982	2974	1003	3073	1022	3179	1041	3289	1058	3406	1075	3529	1091	3658	1106	3792	1120	3933	1134	4079	1146	4232	1158	4390	1168	4554	1178	4725	1187	4901	1194	5083	1201	5270	1208	5464
5200 [2454]	958	2944	980	3036	1000	3135	1020	3239	1039	3349	1057	3465	1074	3588	1090	3716	1105	3849	1120	3989	1133	4135	1146	4287	1158	4444	1168	4608	1178	4777	1187	4953	1196	5134	1203	5321	1209	5514	1215	5713
5300 [2501]	978	3103	999	3201	1019	3305	1038	3414	1056	3530	1074	3651	1090	3778	1106	3912	1120	4051	1134	4196	1147	4347	1159	4504	1170	4666	1180	4835	1189	5001	1198	5190	1205	5377	1212	5569	1217	5767	1222	5972
5400 [2548]	999	3273	1019	3376	1038	3484	1057	3599	1074	3720	1091	3846	1107	3979	1122	4117	1136	4261	1149	4412	1161	4568	1172	4730	1183	4898	1192	5072	1201	5252	1209	5438	1215	5629	1221	5827	1226	6030	—	—
5500 [2595]	1020	3451	1040	3559	1058	3673	1076	3793	1093	3919	1109	4051	1124	4189	1138	4332	1152	4482	1164	4637	1176	4799	1186	4966	1196	5139	1205	5318	1213	5503	1220	5694	1226	5891	—	—	—	—	—	
5600 [2643]	1042	3640	1061	3753	1079	3872	1096	3997	1112	4128	1128	4265	1142	4408	1156	4557	1168	4712	1180	4872	1191	5039	1201	5212	1210	5390	1218	5574	1226	5765	—	—	—	—	—	—	—	—		
5700 [2690]	1064	3838	1083	3956	1100	4080	1117	4211	1132	4347	1147	4489	1161	4637	1174	4791	1186	4951	1197	5117	1207	5289	1216	5467	1225	5650	—	—	—	—	—	—	—	—	—	—	—	—		
5800 [2737]	1088	4045	1105	4169	1122	4298	1138	4434	1153	4575	1167	4723	1180	4876	1192	5035	1204	5200	1214	5371	1224	5548	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	
5900 [2784]	1111	4262	1128	4391	1144	4526	1160	4666	1174	4813	1187	4966	1200	5124	1211	5289	1222	5459	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—		
6000 [2831]	1136	4489	1152	4623	1167	4763	1182	4909	1196	5061	1208	5218	1220	5382	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—		

NOTE: AF- Drive left of the bold line, B/G-Drive right of bold lines.

Drive Package	A												B											
Motor H.P. [W]	3 [1118.5]												5 [2237.1]											
Blower Sheave	AK71H												AK79H											
Motor Sheave	1VL44*7/8												1VP60*1x1/8											
Belt	A48												A52											
Turns Open	0	1	2	3	4	5	0	1	2	3	4	5	0	1	2	3	4	5	0	1	2	3	4	5
RPM	1003	958	912	863	814	764	1220	1171	1127	1085	1039	994	1220	1171	1127	1085	1039	994	1220	1171	1127	1085	1039	994

NOTES: 1. Factory sheave settings are shown in bold type.

2. Do not set motor sheave below minimum or maximum turns open shown.

3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure

4. Drive data shown is for vertical airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE — 12.5 TON [43.9 kW] — 60 Hz — DOWNFLOW (con't.)

Airflow		AIRFLOW CORRECTION FACTORS *				COMPONENT AIRFLOW RESISTANCE				
CFM [L/s]	Total MBH	Sensible MBH	Power kW	Wet Coil	Vertical Economizer RA Damper Open	Concentric Diffuser RXRN-AEF3618 & Concentric Adapter RXMC-DD03 (Flush)	Concentric Diffuser RXRN-AED3618 & Concentric Adapter RXMC-DD03 (Drop)	Pressure Drop MERV 8	Pressure Drop MERV 13	
Resistance — Inches of Water [kPa]										
4000 [1888]	1.01	1.03	1.01	0.15 [0.04]	0.16 [0.04]	0.76 [0.19]	0.68 [0.17]	0.132 [0.03]	0.108 [0.03]	
4100 [1935]	1.02	1.04	1.01	0.16 [0.04]	0.17 [0.04]	0.79 [0.20]	0.72 [0.18]	0.136 [0.03]	0.114 [0.03]	
4200 [1982]	1.02	1.06	1.01	0.17 [0.04]	0.19 [0.05]	0.82 [0.20]	0.75 [0.19]	0.140 [0.03]	0.120 [0.03]	
4300 [2029]	1.03	1.07	1.01	0.17 [0.04]	0.20 [0.05]	0.86 [0.21]	0.79 [0.20]	0.144 [0.03]	0.126 [0.03]	
4400 [2076]	1.03	1.08	1.01	0.18 [0.05]	0.21 [0.05]	0.90 [0.22]	0.83 [0.21]	0.148 [0.04]	0.132 [0.03]	
4500 [2123]	1.04	1.09	1.02	0.19 [0.05]	0.23 [0.06]	0.94 [0.23]	0.86 [0.21]	0.152 [0.04]	0.138 [0.03]	
4600 [2171]	1.04	1.11	1.02	0.20 [0.05]	0.24 [0.06]	0.98 [0.24]	0.89 [0.22]	0.156 [0.04]	0.145 [0.04]	
4700 [2218]	1.05	1.12	1.02	0.21 [0.05]	0.26 [0.06]	1.02 [0.25]	0.94 [0.23]	0.160 [0.04]	0.151 [0.04]	
4800 [2265]	1.05	1.13	1.02	0.21 [0.05]	0.28 [0.07]	1.06 [0.26]	0.98 [0.24]	0.164 [0.04]	0.157 [0.04]	
4900 [2312]	1.06	1.14	1.02	0.22 [0.06]	0.29 [0.07]	1.10 [0.27]	1.01 [0.25]	0.168 [0.04]	0.163 [0.04]	
5000 [2359]	1.06	1.16	1.03	0.23 [0.06]	0.31 [0.08]	1.14 [0.28]	1.04 [0.26]	0.172 [0.04]	0.169 [0.04]	
5100 [2407]	1.07	1.17	1.03	0.24 [0.06]	0.33 [0.08]	1.18 [0.29]	1.07 [0.27]	0.176 [0.04]	0.175 [0.04]	
5200 [2454]	1.07	1.18	1.03	0.25 [0.06]	0.35 [0.09]	1.22 [0.30]	1.10 [0.27]	0.180 [0.04]	0.182 [0.04]	
5300 [2501]	1.08	1.19	1.03	0.26 [0.06]	0.36 [0.09]	1.27 [0.32]	1.15 [0.29]	0.184 [0.05]	0.188 [0.05]	
5400 [2548]	1.08	1.21	1.03	0.27 [0.07]	0.38 [0.09]	1.33 [0.33]	1.20 [0.30]	0.188 [0.05]	0.194 [0.05]	
5500 [2595]	1.09	1.22	1.04	0.28 [0.07]	0.40 [0.10]	1.37 [0.34]	1.25 [0.31]	0.192 [0.05]	0.200 [0.05]	
5600 [2643]	1.09	1.23	1.04	0.29 [0.07]	0.42 [0.10]	1.42 [0.35]	1.30 [0.32]	0.196 [0.05]	0.206 [0.05]	
5700 [2690]	1.10	1.24	1.04	0.30 [0.07]	0.44 [0.11]	1.47 [0.37]	1.34 [0.33]	0.200 [0.05]	0.212 [0.05]	
5800 [2737]	1.10	1.26	1.04	0.31 [0.08]	0.46 [0.11]	1.52 [0.38]	1.38 [0.34]	0.204 [0.05]	0.219 [0.05]	
5900 [2784]	1.10	1.27	1.05	0.32 [0.08]	0.48 [0.12]	1.56 [0.39]	1.42 [0.35]	0.208 [0.05]	0.225 [0.05]	
6000 [2831]	1.11	1.28	1.05	0.33 [0.08]	0.51 [0.13]	1.60 [0.40]	1.45 [0.36]	0.212 [0.05]	0.231 [0.06]	

*Multiply correction factor times gross performance data resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE — 12.5 TON [43.9 kW] — 60 Hz — SIDEFLOW

Air Flow CFM [L/s]	Model RGEDZ*150*		Voltage 208/230, 460, 575 — 3 phase 60 Hz		External Static Pressure—Inches of Water [kPa]																																						
	0.1 [0.02] RPM	W	0.2 [0.05] RPM	W	0.3 [0.07] RPM	W	0.4 [0.10] RPM	W	0.5 [0.12] RPM	W	0.6 [0.15] RPM	W	0.7 [0.17] RPM	W	0.8 [0.20] RPM	W	0.9 [0.22] RPM	W	1.0 [0.25] RPM	W	1.1 [0.27] RPM	W	1.2 [0.30] RPM	W	1.3 [0.32] RPM	W	1.4 [0.35] RPM	W	1.5 [0.37] RPM	W	1.6 [0.40] RPM	W	1.7 [0.42] RPM	W	1.8 [0.45] RPM	W	1.9 [0.47] RPM	W	2.0 [0.50] RPM	W			
4000 [1888]	—	—	791	1757	819	1824	846	1892	872	1961	897	2031	922	2101	946	2173	970	2245	993	2318	1015	2392	1036	2467	1057	2542	1077	2619	1096	2696	1115	2774	1133	2853	1150	2933	1167	3014	1183	3095			
4100 [1935]	782	1773	809	1841	836	1911	863	1982	888	2053	913	2125	937	2198	961	2272	984	2346	1006	2422	1027	2498	1048	2576	1068	2654	1088	2733	1106	2812	1124	2893	1142	2975	1158	3057	1174	3140	1189	3224			
4200 [1982]	801	1860	828	1932	854	2004	880	2077	905	2150	929	2225	952	2300	975	2377	997	2454	1019	2532	1040	2611	1060	2691	1079	2771	1098	2853	1116	2935	1133	3018	1150	3102	1166	3187	1181	3272	1196	3359			
4300 [2029]	819	1954	845	2028	871	2102	896	2177	920	2254	944	2331	967	2409	989	2488	1011	2567	1032	2648	1052	2729	1071	2811	1090	2894	1114	2978	1125	3063	1142	3149	1158	3235	1174	3323	1188	3411	1202	3500			
4400 [2076]	837	2053	863	2129	888	2207	912	2284	936	2363	959	2443	981	2523	1003	2605	1024	2687	1044	2770	1064	2854	1082	2938	1101	3024	1118	3110	1135	3197	1151	3286	1166	3375	1181	3464	1195	3558	1208	3646			
4500 [2123]	855	2159	880	2237	905	2317	929	2397	952	2479	974	2561	996	2644	1016	2727	1037	2812	1056	2897	1075	2984	1093	3071	1111	3159	1128	3248	1144	3338	1159	3428	1174	3520	1188	3612	1201	3705	1214	3799			
4600 [2171]	873	2270	898	2351	921	2433	944	2516	967	2600	988	2684	1009	2770	1030	2856	1049	2943	1068	3031	1086	3120	1104	3210	1121	3300	1137	3392	1152	3484	1167	3577	1181	3671	1195	3766	1207	3861	1219	3958			
4700 [2218]	891	2387	914	2471	938	2556	960	2641	982	2727	1003	2814	1023	2902	1043	2991	1062	3080	1080	3171	1097	3262	1114	3354	1130	3447	1146	3541	1161	3636	1175	3732	1188	3828	1201	3925	1213	4023	—	—			
4800 [2265]	908	2511	931	2597	954	2684	975	2772	996	2860	1017	2950	1036	3040	1055	3132	1074	3224	1091	3317	1108	3410	1124	3505	1140	3601	1155	3697	1169	3794	1182	3892	1195	3991	1207	4091	1219	4191	—	—			
4900 [2312]	925	2640	947	2729	969	2818	990	2908	1011	3000	1031	3092	1050	3184	1068	3278	1086	3373	1102	3468	1119	3565	1134	3662	1149	3760	1163	3859	1177	3958	1190	4059	1202	4160	1213	4262	—	—	—	—			
5000 [2359]	942	2775	964	2866	985	2958	1005	3051	1025	3145	1044	3239	1062	3335	1080	3431	1097	3528	1113	3626	1129	3725	1144	3824	1158	3925	1172	4026	1185	4128	1197	4231	1208	4335	1219	4440	—	—	—	—			
5100 [2407]	958	2916	979	3010	1000	3104	1020	3200	1039	3296	1057	3393	1075	3491	1092	3589	1124	3789	1139	3891	1153	3993	1167	4096	1180	4200	1192	4304	1204	4410	1214	4503	1220	4703	—	—	—	—	—				
5200 [2454]	975	3063	995	3160	1015	3256	1034	3354	1053	3453	1070	3552	1087	3653	1104	3754	1120	3856	1135	3959	1149	4063	1162	4167	1175	4273	1188	4379	1199	4486	1210	4594	1220	4703	—	—	—	—	—	—			
5300 [2501]	991	3217	1010	3315	1030	3415	1048	3515	1066	3616	1083	3718	1100	3821	1115	3924	1130	4029	1145	4134	1158	4241	1171	4348	1184	4456	1195	4564	1206	4674	1216	4785	—	—	—	—	—	—	—	—			
5400 [2548]	1006	3376	1026	3477	1044	3579	1062	3681	1079	3785	1096	3889	1111	3995	1126	4101	1141	4208	1155	4316	1168	4425	1180	4534	1192	4645	1203	4756	1213	4868	—	—	—	—	—	—	—	—	—	—			
5500 [2595]	1022	3541	1040	3644	1058	3749	1075	3854	1092	3960	1108	4067	1123	4175	1137	4283	1151	4393	1164	4503	1177	4614	1188	4726	1199	4839	1201	4953	1219	5068	—	—	—	—	—	—	—	—	—	—			
5600 [2643]	1037	3712	1055	3818	1072	3924	1089	4032	1105	4141	1120	4250	1134	4361	1148	4472	1161	4584	1174	4697	1185	4810	1196	4925	1207	5040	1216	5156	—	—	—	—	—	—	—	—	—	—	—	—			
5700 [2690]	1052	3888	1069	3997	1086	4106	1102	4217	1117	4328	1132	4440	1145	4552	1159	4666	1171	4780	1183	4896	1194	5012	1204	5129	1214	5247	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	
5800 [2737]	1067	4071	1083	4182	1099	4294	1115	4407	1129	4520	1143	4635	1156	4750	1169	4866	1181	4983	1192	5101	1202	5220	1212	5339	1221	5460	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	
5900 [2784]	1081	4260	1097	4374	1113	4488	1127	4603	1141	4719	1154	4836	1167	4954	1179	5073	1190	5192	1200	5312	1210	5433	1219	5555	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6000 [2831]	1095	4455	1111	4571	1126	4688	1139	4805	1153	4924	1165	5043	1177	5164	1188	5285	1199	5407	1209	5529	1218	5653	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

NOTE: AF- Drive left of the bold line, B/G-Drive right of bold lines.

Drive Package	A												B											
Motor H.P. [W]	3 [2237.1]												5 [3728.5]											
Blower Sheave	AK71H												AK79H											
Motor Sheave	1VL44*7/8												1VP60*1x1/8											
Belt	A48												A52											
Turns Open	0	1	2	3	4	5	0	1	2	3	4	5	0	1	2	3	4	5	0	1	2	3	4	5
RPM	1002	955	909	862	813	765	1208	1171	1127	1084	1038	995	1208	1171	1127	1084	1038	995	1208	1171	1127	1084	1038	995

NOTES: 1. Factory sheave settings are shown in bold type.

2. Do not set motor sheave below minimum or maximum turns open shown.

3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure

4. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE — 12.5 TON [43.9 kW] — 60 Hz — SIDEFLOW (con't.)

Airflow		AIRFLOW CORRECTION FACTORS *			COMPONENT AIRFLOW RESISTANCE				
CFM [L/s]	Total MBH	Sensible MBH	Power kW	Wet Coil	Vertical Economizer RA Damper Open	Concentric Diffuser RXRN-AEF3618 & Concentric Adapter RXMC-DD03 (Flush)	Concentric Diffuser RXRN-AED3618 & Concentric Adapter RXMC-DD03 (Drop)	Pressure Drop MERV 8	Pressure Drop MERV 13
Resistance — Inches of Water [kPa]									
4000 [1888]	1.01	1.03	1.01	0.15 [0.04]	0.73 [0.18]	0.76 [0.19]	0.68 [0.17]	0.132 [0.03]	0.108 [0.03]
4100 [1935]	1.02	1.04	1.01	0.16 [0.04]	0.78 [0.19]	0.79 [0.20]	0.72 [0.18]	0.136 [0.03]	0.114 [0.03]
4200 [1982]	1.02	1.06	1.01	0.17 [0.04]	0.83 [0.21]	0.82 [0.20]	0.75 [0.19]	0.140 [0.03]	0.120 [0.03]
4300 [2029]	1.03	1.07	1.01	0.17 [0.04]	0.88 [0.22]	0.86 [0.21]	0.79 [0.20]	0.144 [0.03]	0.126 [0.03]
4400 [2076]	1.03	1.08	1.01	0.18 [0.05]	0.93 [0.23]	0.90 [0.22]	0.83 [0.21]	0.148 [0.04]	0.132 [0.03]
4500 [2123]	1.04	1.09	1.02	0.19 [0.05]	0.98 [0.24]	0.94 [0.23]	0.86 [0.21]	0.152 [0.04]	0.138 [0.03]
4600 [2171]	1.04	1.11	1.02	0.20 [0.05]	1.03 [0.26]	0.98 [0.24]	0.89 [0.22]	0.156 [0.04]	0.145 [0.04]
4700 [2218]	1.05	1.12	1.02	0.21 [0.05]	1.07 [0.27]	1.02 [0.25]	0.94 [0.23]	0.160 [0.04]	0.151 [0.04]
4800 [2265]	1.05	1.13	1.02	0.21 [0.05]	1.12 [0.28]	1.06 [0.26]	0.98 [0.24]	0.164 [0.04]	0.157 [0.04]
4900 [2312]	1.06	1.14	1.02	0.22 [0.06]	1.17 [0.29]	1.10 [0.27]	1.01 [0.25]	0.168 [0.04]	0.163 [0.04]
5000 [2359]	1.06	1.16	1.03	0.23 [0.06]	1.21 [0.30]	1.14 [0.28]	1.04 [0.26]	0.172 [0.04]	0.169 [0.04]
5100 [2407]	1.07	1.17	1.03	0.24 [0.06]	1.26 [0.31]	1.18 [0.29]	1.07 [0.27]	0.176 [0.04]	0.175 [0.04]
5200 [2454]	1.07	1.18	1.03	0.25 [0.06]	1.30 [0.32]	1.22 [0.30]	1.10 [0.27]	0.180 [0.04]	0.182 [0.04]
5300 [2501]	1.08	1.19	1.03	0.26 [0.06]	1.35 [0.34]	1.27 [0.32]	1.15 [0.29]	0.184 [0.05]	0.188 [0.05]
5400 [2548]	1.08	1.21	1.03	0.27 [0.07]	1.39 [0.35]	1.33 [0.33]	1.20 [0.30]	0.188 [0.05]	0.194 [0.05]
5500 [2595]	1.09	1.22	1.04	0.28 [0.07]	1.44 [0.36]	1.37 [0.34]	1.25 [0.31]	0.192 [0.05]	0.200 [0.05]
5600 [2643]	1.09	1.23	1.04	0.29 [0.07]	1.48 [0.37]	1.42 [0.35]	1.30 [0.32]	0.196 [0.05]	0.206 [0.05]
5700 [2690]	1.10	1.24	1.04	0.30 [0.07]	1.52 [0.38]	1.47 [0.37]	1.34 [0.33]	0.200 [0.05]	0.212 [0.05]
5800 [2737]	1.10	1.26	1.04	0.31 [0.08]	1.57 [0.39]	1.52 [0.38]	1.38 [0.34]	0.204 [0.05]	0.219 [0.05]
5900 [2784]	1.10	1.27	1.05	0.32 [0.08]	1.61 [0.40]	1.56 [0.39]	1.42 [0.35]	0.208 [0.05]	0.225 [0.05]
6000 [2831]	1.11	1.28	1.05	0.33 [0.08]	1.65 [0.41]	1.60 [0.40]	1.45 [0.36]	0.212 [0.05]	0.231 [0.06]

*Multiply correction factor times gross performance data resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

ELECTRICAL DATA – RGEDZR SERIES

	090ACA15 090ACA20	090ACB15 090ACC15 090ACC20 090ACB20	090ADA15 090ADA20	090ADB15 090ADB20 090ADC15 090ADC20	090AYA15	090AYA20	090AYB15	090AYB20	090AYC15	090AYC20
Unit Information	Unit Operating Voltage Range	187-253			414-506	517-633	517-633	517-633	517-633	517-633
	Volts	208/230			460	575	575	575	575	575
	Phase	3			3	3	3	3	3	3
	Hz	60			60	60	60	60	60	60
	Minimum Circuit Ampacity	41			21	16	17	17	17	17
Unit Information	Minimum Overcurrent Protection Device Size	50			25	20	20	20	20	20
	Maximum Overcurrent Protection Device Size	60			30	25	25	25	25	25
	No.	1			1	1	1	1	1	1
Compressor Motor	Volts	208/230			460	575	575	575	575	575
	Phase	3			3	3	3	3	3	3
	RPM	3450			3450	3450	3450	3450	3450	3450
	HP, Compressor 1	7			7	7	7	7	7	7
	Amps (RLA), Comp. 1	25			12.8	9.6	9.6	9.6	9.6	9.6
Condenser Motor	Amps (LRA), Comp. 1	164			100	78	78	78	78	78
	No.	2			2	2	2	2	2	2
	Volts	208/230			460	575	575	575	575	575
	Phase	1			1	1	1	1	1	1
	HP	1/5			1/5	1/5	1/5	1/5	1/5	1/5
Evaporator Fan	Amps (FLA, each)	1.2			0.8	0.6	0.6	0.6	0.6	0.6
	Amps (LRA, each)	2.3			1.4	1.1	1.1	1.1	1.1	1.1
	No.	1			1	1	1	1	1	1
	Volts	208/230			460	575	575	575	575	575
	Phase	3			3	3	3	3	3	3
Evaporator Fan	HP	2			2	2	2	2	2	2
	Amps (FLA, each)	6.6			3.3	2.5	3.5	3.5	3.5	3.5
	Amps (LRA, each)	47			22.5	19	20	20	20	20

ELECTRICAL DATA – RGEDZR SERIES

	102ACA15 102ACA22	102ACB15 102ACB22	102ACC15 102ACC22	102ADA15 102ADA22	102ADB15 102ADB22	102ADC15 102ADC22	102AYA15	102AYA22	102AYB15	102AYB22	102AYC15	102AYC22
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	517-633	517-633	517-633	517-633	517-633	517-633
	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3	3
	Hz	60	60	60	60	60	60	60	60	60	60	60
	Minimum Circuit Ampacity	44	46	49	22	23	16	16	17	17	17	17
Unit Information	Minimum Overcurrent Protection Device Size	60	60	60	25	30	20	20	20	20	20	20
	Maximum Overcurrent Protection Device Size	70	70	70	30	35	25	25	25	25	25	25
	No.	1	1	1	1	1	1	1	1	1	1	1
Compressor Motor	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2
	Amps (RLA), Comp. 1	27.6	27.6	27.6	12.8	12.8	9.6	9.6	9.6	9.6	9.6	9.6
Compressor Motor	Amps (LRA), Comp. 1	191	191	191	100	100	78	78	78	78	78	78
	No.	2	2	2	2	2	2	2	2	2	2	2
	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575	575
	Phase	1	1	1	1	1	1	1	1	1	1	1
	HP	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5
Condenser Motor	Amps (FLA, each)	1.2	1.2	1.2	0.8	0.8	0.6	0.6	0.6	0.6	0.6	0.6
	Amps (LRA, each)	2.3	2.3	203	1.4	1.4	1.1	1.1	1.1	1.1	1.1	1.1
	No.	1	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3	3
Evaporator Fan	HP	2	3	3	2	3	2	2	3	3	3	3
	Amps (FLA, each)	7.1	9.1	12.0	3.5	4.6	2.5	2.5	3.5	3.5	3.5	3.5
	Amps (LRA, each)	45	74.5	74.5	22.5	38.1	19	19	20	20	20	20

ELECTRICAL DATA – RGEDZR SERIES

	120ACA15 120ACA22	120ACB15 120ACB22	120ACC15 120ACC22	120ADA15 120ADA22	120ADB15 120ADB22	120ADC15 120ADC22	120AYA15	120AYB15	120AYB22	120AYC15	120AYC22
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	517-633	517-633	517-633	517-633	517-633
	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3
	Hz	60	60	60	60	60	60	60	60	60	60
	Minimum Circuit Ampacity	48	51	53	26	27	19	20	20	20	20
	Minimum Overcurrent Protection Device Size	60	60	60	30	30	25	25	25	25	25
Compressor Motor	Maximum Overcurrent Protection Device Size	70	70	80	35	40	25	30	30	30	30
	No.	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	10	10	10	10	10	10	10	10	10	10
Condenser Motor	Amps (RLA), Comp. 1	28.2	28.2	28.2	14.7	14.7	11.3	11.3	11.3	11.3	11.3
	Amps (LRA), Comp. 1	239	239	239	130	130	93.7	93.7	93.7	93.7	93.7
	No.	2	2	2	2	2	2	2	2	2	2
	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575
	Phase	1	1	1	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
Evaporator Fan	Amps (FLA, each)	2.4	2.4	2.4	1.4	1.4	1	1	1	1	1
	Amps (LRA, each)	4.7	4.7	4.7	2.4	2.4	1.6	1.6	1.6	1.6	1.6
	No.	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3
	HP	2	2	2	2	3	2	3	3	3	3
	Amps (FLA, each)	7.9	10.1	12	3.9	5	2.5	3.5	3.5	3.5	3.5
	Amps (LRA, each)	45	74.5	74.5	22.5	38.1	19	20	20	20	20

ELECTRICAL DATA – RGEDZS SERIES

	090ACA15 090ACA20	090ACB15 090ACB20 090ACC15 090ACC20	090ACF15 090ACF20	090ACG15 090ACG20 090ACH15 090ACH20	090ADA15 090ADF15 090ADF20 090ADA20	090ADB15 090ADB20 090ADC15 090ADC20 090ADG15 090ADG20 090ADH15 090ADH20	090AYA15	090AYB15	090AYB20	090AYC15	090AYC20
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	517-633	517-633	517-633	517-633	517-633
	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3
	Hz	60	60	60	60	60	60	60	60	60	60
	Minimum Circuit Ampacity	41	44	41	44	19	13	14	14	14	14
Compressor Motor	Minimum Overcurrent Protection Device Size	50	50	50	20	25	15	20	20	20	20
	Maximum Overcurrent Protection Device Size	60	60	60	25	25	15	20	20	20	20
	No.	1	1	1	1	1	1	1	1	1	1
Condenser Motor	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	7	7	7	7	7	7	7	7	7	7
	Amps (RLA), Comp. 1	25.3	25.3	25.3	9.6	9.6	7.1	7.1	7.1	7.1	7.1
Evaporator Fan	Amps (LRA), Comp. 1	184	184	184	84	84	60	60	60	60	60
	No.	2	2	2	2	2	2	2	2	2	2
	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575
	Phase	1	1	1	1	1	1	1	1	1	1
	HP	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5
Evaporator Fan	Amps (FLA, each)	1.2	1.2	1.2	0.8	0.8	0.6	0.6	0.6	0.6	0.6
	Amps (LRA, each)	2.3	2.3	2.3	1.4	1.4	1.1	1.1	1.1	1.1	1.1
	No.	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3
Evaporator Fan	HP	2	3	2	2	3	2	3	3	3	3
	Amps (FLA, each)	6.6	9.1	6.6	3.2	4.6	2.5	3.5	3.5	3.5	3.5
	Amps (LRA, each)	47	74.5	22.5	22.5	38.1	19	20	20	20	20

ELECTRICAL DATA – RGEDZS SERIES

	102ACA15 102ACF15 102ACF22 102ACA22	102ACB15 102ACB22 102ACG15 102ACG22	102ACC15 102ACC22 102ACH15 102ACH22	102ADA15 102ADA22 102ADF15 102ADF22	102ADB15 102ADB22 102ADG15 102ADG22	102ADC15 102ADC22 102ADH15 102ADH22	102AVA15	102AVA22	102AVB15	102AVB22	102AVC15	102AVC22
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506	517-633	517-633	517-633	517-633	517-633
	Volts	208/230	208/230	208/230	460	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3	3
	Hz	60	60	60	60	60	60	60	60	60	60	60
	Minimum Circuit Ampacity	46	48	51	21	22	24	16	17	17	17	17
Compressor Motor	Minimum Overcurrent Protection Device Size	60	60	60	25	25	30	20	20	20	20	20
	Maximum Overcurrent Protection Device Size	70	70	70	30	30	35	25	25	25	25	25
	No.	1	1	1	1	1	1	1	1	1	1	1
Condenser Motor	Volts	208/230	208/230	208/230	460	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2
	Amps (RLA), Comp. 1	28.8	28.8	28.8	12.5	12.5	12.5	9.7	9.7	9.7	9.7	9.7
Evaporator Fan	Amps (LRA), Comp. 1	191	191	191	100	100	100	70	70	70	70	70
	No.	2	2	2	2	2	2	2	2	2	2	2
	Volts	208/230	208/230	208/230	460	460	460	575	575	575	575	575
	Phase	1	1	1	1	1	1	1	1	1	1	1
	HP	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5	1/5
Evaporator Fan	Amps (FLA, each)	1.2	1.2	1.2	0.8	0.8	0.8	0.6	0.6	0.6	0.6	0.6
	Amps (LRA, each)	2.3	2.3	2.3	1.4	1.4	1.4	1.1	1.1	1.1	1.1	1.1
	No.	1	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3	3
Evaporator Fan	HP	2	3	3	2	3	3	2	3	3	3	3
	Amps (FLA, each)	7	9.1	12	3.5	4.6	6	2.5	3.5	3.5	3.5	3.5
	Amps (LRA, each)	45	74.5	74.5	22.5	38.1	38.1	19	20	20	20	20

ELECTRICAL DATA – RGEDZS SERIES

	120ACA15 120ACA22 120ACF15 120ACF22	120ACB15 120ACB22 120ACG15 120ACG22	120ACC15 120ACC22 120ACH15 120ACH22	120ADA15 120ADA22 120ADF15 120ADF22	120ADB15 120ADB22 120ADG15 120ADG22	120ADC15 120ADC22 120ADH15 120ADH22	120AYA15	120AYA22	120AYB15	120AYB22	120AYC15	120AYC22
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506	517-633	517-633	517-633	517-633	517-633
	Volts	208/230	208/230	208/230	460	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3	3
	Hz	60	60	60	60	60	60	60	60	60	60	60
	Minimum Circuit Ampacity	54	56	58	26	27	28	19	20	20	20	20
Unit Information	Minimum Overcurrent Protection Device Size	70	70	70	30	30	35	25	25	25	25	25
	Maximum Overcurrent Protection Device Size	80	80	90	40	40	40	25	30	30	30	30
	No.	1	1	1	1	1	1	1	1	1	1	1
Compressor Motor	Volts	208/230	208/230	208/230	460	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	10	10	10	10	10	10	10	10	10	10	10
	Amps (RLA), Comp. 1	32.6	32.6	32.6	14.8	14.8	14.8	11.1	11.1	11.1	11.1	11.1
Condenser Motor	Amps (LRA), Comp. 1	240	240	240	130	130	130	93.7	93.7	93.7	93.7	93.7
	No.	2	2	2	2	2	2	2	2	2	2	2
	Volts	208/230	208/230	208/230	460	460	460	575	575	575	575	575
	Phase	1	1	1	1	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
Evaporator Fan	Amps (FLA, each)	2.4	2.4	2.4	1.4	1.4	1.4	1	1	1	1	1
	Amps (LRA, each)	4.7	4.7	4.7	2.4	2.4	2.4	2.2	2.2	2.2	2.2	2.2
	No.	1	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	575	575	575	575	575
	Phase	3	3	3	3	3	3	3	3	3	3	3
Evaporator Fan	HP	2	2	2	2	3	3	2	3	3	3	3
	Amps (FLA, each)	7.9	10.1	12	3.9	5.1	6	2.5	3.5	3.5	3.5	3.5
	Amps (LRA, each)	45	74.5	74.5	22.5	38.1	38.1	19	20	20	20	20

ELECTRICAL DATA – RGEDZS SERIES							
		150ACA15 150ACA22 150ACF15 150ACF22	150ACB15 150ACB22 150ACG15 150ACG22	150ADA15 150ADA22 150ADF15 150ADF22	150ADB15 150ADB22 150ADG15 150ADG22	150AYA15 150AYA22	150AYB15 150AYB22
Unit Information	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	517-633	517-633
	Volts	208/230	208/230	460	460	575	575
	Phase	3	3	3	3	3	3
	Hz	60	60	60	60	60	60
	Minimum Circuit Ampacity	70	75	34	37	25	27
	Minimum Overcurrent Protection Device Size	80	90	40	40	30	30
	Maximum Overcurrent Protection Device Size	90	90	40	45	30	30
Compressor Motor	No.	2	2	2	2	2	2
	Volts	208/230	208/230	460	460	575	575
	Phase	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	6	6	6	6	6	6
	Amps (RLA), Comp. 1	22.4	22.4	10.6	10.6	7.7	7.7
	Amps (LRA), Comp. 1	164	164	100	100	78	78
	HP, Compressor 2	6	6	6	6	6	6
	Amps (RLA), Comp. 2	22.4	22.4	10.6	10.6	7.7	7.7
	Amps (LRA), Comp. 2	164	164	100	100	78	78
Condenser Motor	No.	2	2	2	2	2	2
	Volts	208/230	208/230	460	460	575	575
	Phase	1	1	1	1	1	1
	HP	3/4	3/4	3/4	3/4	3/4	3/4
	Amps (FLA, each)	4.2	4.2	2.3	2.3	1.6	1.6
	Amps (LRA, each)	10.1	10.1	4.9	4.9	3.4	3.4
Evaporator Fan	No.	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	575	575
	Phase	3	3	3	3	3	3
	HP	3	5	3	5	3	5
	Amps (FLA, each)	10.4	16	5.2	8	4.4	5.9
	Amps (LRA, each)	74.5	82	38.1	41	20	38

ELECTRICAL DATA – RGEDZT SERIES



		090ACF15 090ACF20	090ACG15 090ACG20 090ACH15 090ACH20	090ADF15 090ADF20	090ADG15 090ADG20 090ADH15 090ADH20
Unit Information	Unit Operating Voltage Range	187-253	187-253	414-506	414-506
	Volts	208/230	208/230	460	460
	Phase	3	3	3	3
	Hz	60	60	60	60
	Minimum Circuit Ampacity	41	44	17	19
	Minimum Overcurrent Protection Device Size	50	50	20	25
	Maximum Overcurrent Protection Device Size	60	60	25	25
Compressor Motor	No.	1	1	1	1
	Volts	208/230	208/230	460	460
	Phase	3	3	3	3
	RPM	3450	3450	3450	3450
	HP, Compressor 1	7	7	7	7
	Amps (RLA), Comp. 1	25.3	25.3	9.6	9.6
	Amps (LRA), Comp. 1	184	184	84	84
Condenser Motor	No.	2	2	2	2
	Volts	208/230	208/230	460	460
	Phase	1	1	1	1
	HP	1/5	1/5	1/5	1/5
	Amps (FLA, each)	1.2	1.2	0.8	0.8
	Amps (LRA, each)	2.3	2.3	1.4	1.4
Evaporator Fan	No.	1	1	1	1
	Volts	208/230	208/230	460	460
	Phase	3	3	3	3
	HP	2	3	2	3
	Amps (FLA, each)	6.6	9.1	3.2	4.6
	Amps (LRA, each)	22.5	74.5	22.5	38.1

ELECTRICAL DATA – RGEDZT SERIES							
		102ACF15 102ACF22	102ACG15 102ACG22	102ACH15 102ACH22	102ADF15 102ADF22	102ADG15 102ADG22	102ADH15 102ADH22
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506
	Volts	208/230	208/230	208/230	460	460	460
	Phase	3	3	3	3	3	3
	Hz	60	60	60	60	60	60
	Minimum Circuit Ampacity	46	48	51	21	22	24
	Minimum Overcurrent Protection Device Size	60	60	60	25	25	30
Compressor Motor	Maximum Overcurrent Protection Device Size	70	70	70	30	30	35
	No.	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460
	Phase	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2
Condenser Motor	Amps (RLA), Comp. 1	28.8	28.8	28.8	12.5	12.5	12.5
	Amps (LRA), Comp. 1	191	191	191	100	100	100
	No.	2	2	2	2	2	2
	Volts	208/230	208/230	208/230	460	460	460
	Phase	1	1	1	1	1	1
	HP	1/5	1/5	1/5	1/5	1/5	1/5
Evaporator Fan	Amps (FLA, each)	1.2	1.2	1.2	0.8	0.8	0.8
	Amps (LRA, each)	2.3	2.3	2.3	1.4	1.4	1.4
	No.	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460
	Phase	3	3	3	3	3	3
	HP	2	3	3	2	3	3
	Amps (FLA, each)	7	9.1	12	3.5	4.6	6
	Amps (LRA, each)	45	74.5	74.5	22.5	38.1	38.1

ELECTRICAL DATA – RGEDZT SERIES


		120ACF15 120ACF22	120ACG15 120ACG22	120ACH15 120ACH22	120ADF15 120ADF22	120ADG15 120ADG22	120ADH15 120ADH22
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506
	Volts	208/230	208/230	208/230	460	460	460
	Phase	3	3	3	3	3	3
	Hz	60	60	60	60	60	60
	Minimum Circuit Ampacity	54	56	58	26	27	28
	Minimum Overcurrent Protection Device Size	70	70	70	30	30	35
	Maximum Overcurrent Protection Device Size	80	80	90	40	40	30
Compressor Motor	No.	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460
	Phase	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	10	10	10	10	10	10
	Amps (RLA), Comp. 1	32.6	32.6	32.6	14.8	14.8	14.8
	Amps (LRA), Comp. 1	240	240	240	130	130	130
Condenser Motor	No.	2	2	2	2	2	2
	Volts	208/230	208/230	208/230	460	460	460
	Phase	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA, each)	2.4	2.4	2.4	1.4	1.4	1.4
	Amps (LRA, each)	4.7	4.7	4.7	2.4	2.4	2.4
Evaporator Fan	No.	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460
	Phase	3	3	3	3	3	3
	HP	2	2	2	2	3	3
	Amps (FLA, each)	7.9	10.1	12	3.9	5.1	6
	Amps (LRA, each)	45	74.5	74.5	22.5	38.1	38.1

ELECTRICAL DATA – RGEDZT SERIES					
		150ACF15 150ACF22	150ACG15 150ACG22	150ADF15 150ADF22	150ADG15 150ADG22
Unit Information	Unit Operating Voltage Range	187-253	187-253	414-506	414-506
	Volts	208/230	208/230	460	460
	Phase	3	3	3	3
	Hz	60	60	60	60
	Minimum Circuit Ampacity	70	75	34	37
	Minimum Overcurrent Protection Device Size	80	90	40	40
	Maximum Overcurrent Protection Device Size	90	90	40	45
Compressor Motor	No.	2	2	2	2
	Volts	208/230	208/230	460	460
	Phase	3	3	3	3
	RPM	3450	3450	3450	3450
	HP, Compressor 1	6	6	6	6
	Amps (RLA), Comp. 1	22.4	22.4	10.6	10.6
	Amps (LRA), Comp. 1	164	164	100	100
	HP, Compressor 2	6	6	6	6
	Amps (RLA), Comp. 2	22.4	22.4	10.6	10.6
	Amps (LRA), Comp. 2	164	164	100	100
Condenser Motor	No.	2	2	2	2
	Volts	208/230	208/230	460	460
	Phase	1	1	1	1
	HP	3/4	3/4	3/4	3/4
	Amps (FLA, each)	4.2	4.2	2.3	2.3
	Amps (LRA, each)	10.1	10.1	4.9	4.9
Evaporator Fan	No.	1	1	1	1
	Volts	208/230	208/230	460	460
	Phase	3	3	3	3
	HP	3	5	3	5
	Amps (FLA, each)	10.4	16	5.2	8
	Amps (LRA, each)	74.5	82	38.1	41

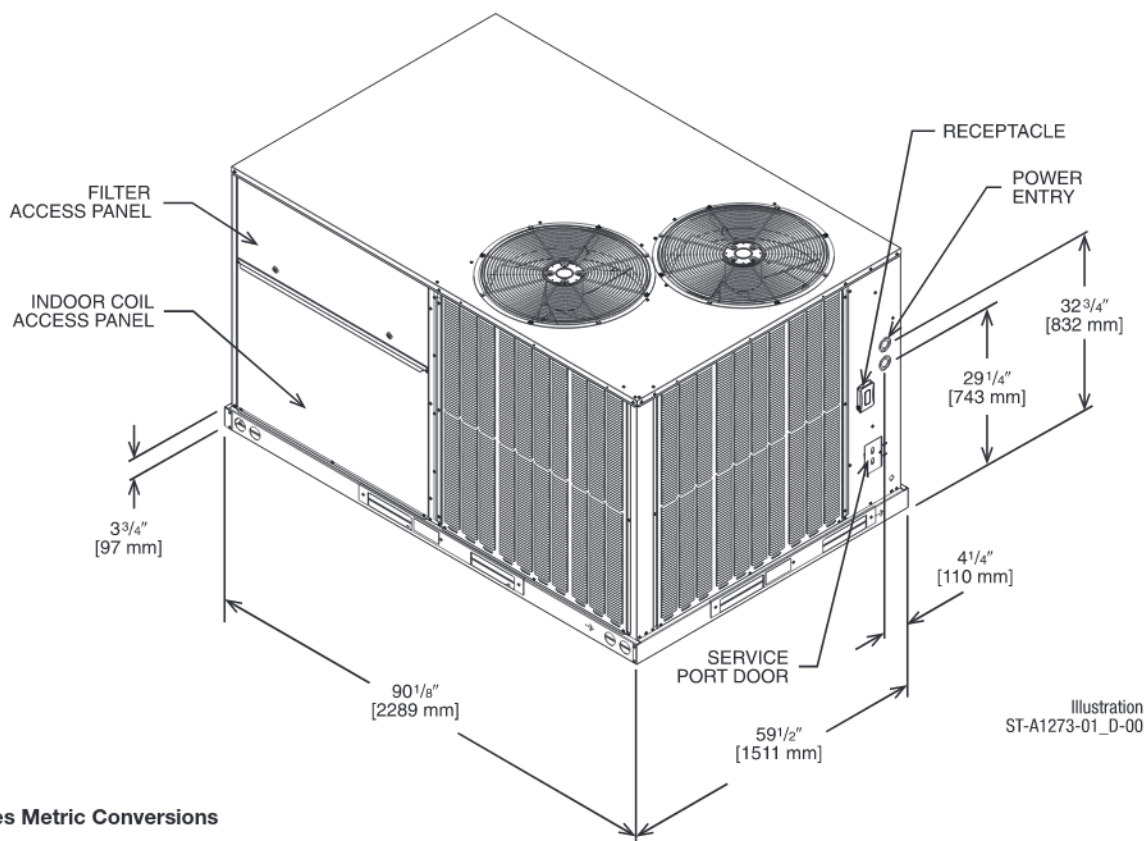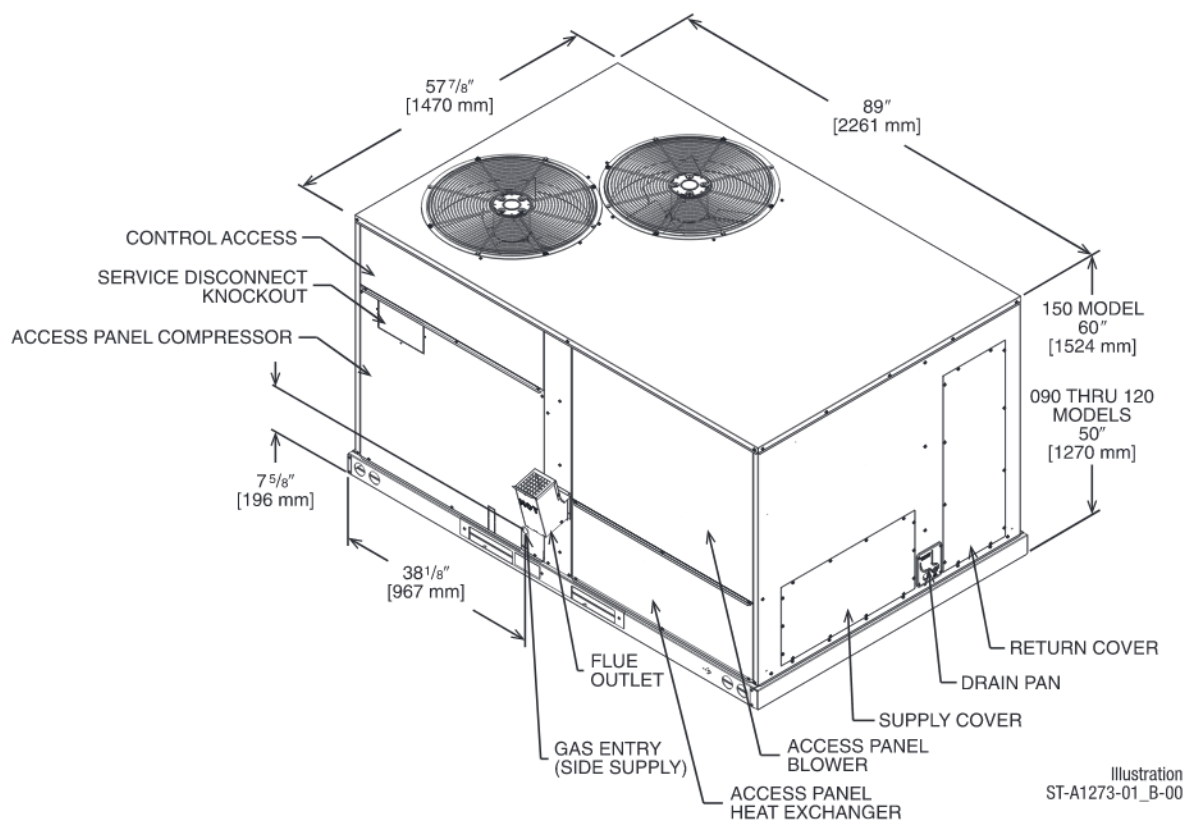


[] Designates Metric Conversions

SUPPLY AND RETURN DIMENSIONS FOR HORIZONTAL APPLICATIONS

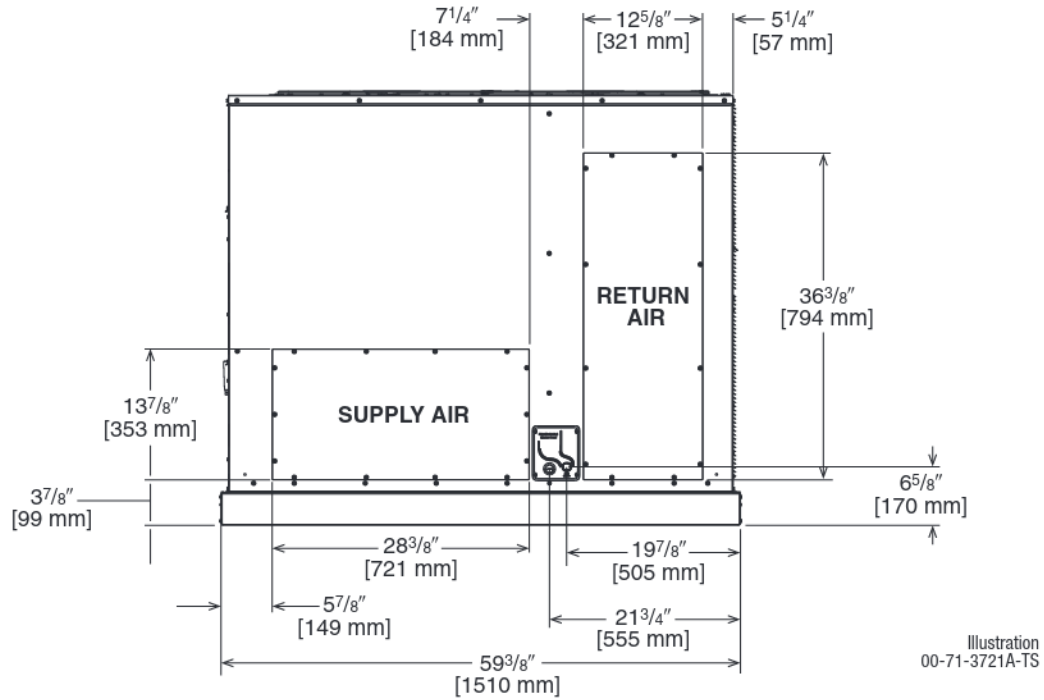

SUPPLY AND RETURN DIMENSIONS FOR DOWNFLOW APPLICATIONS

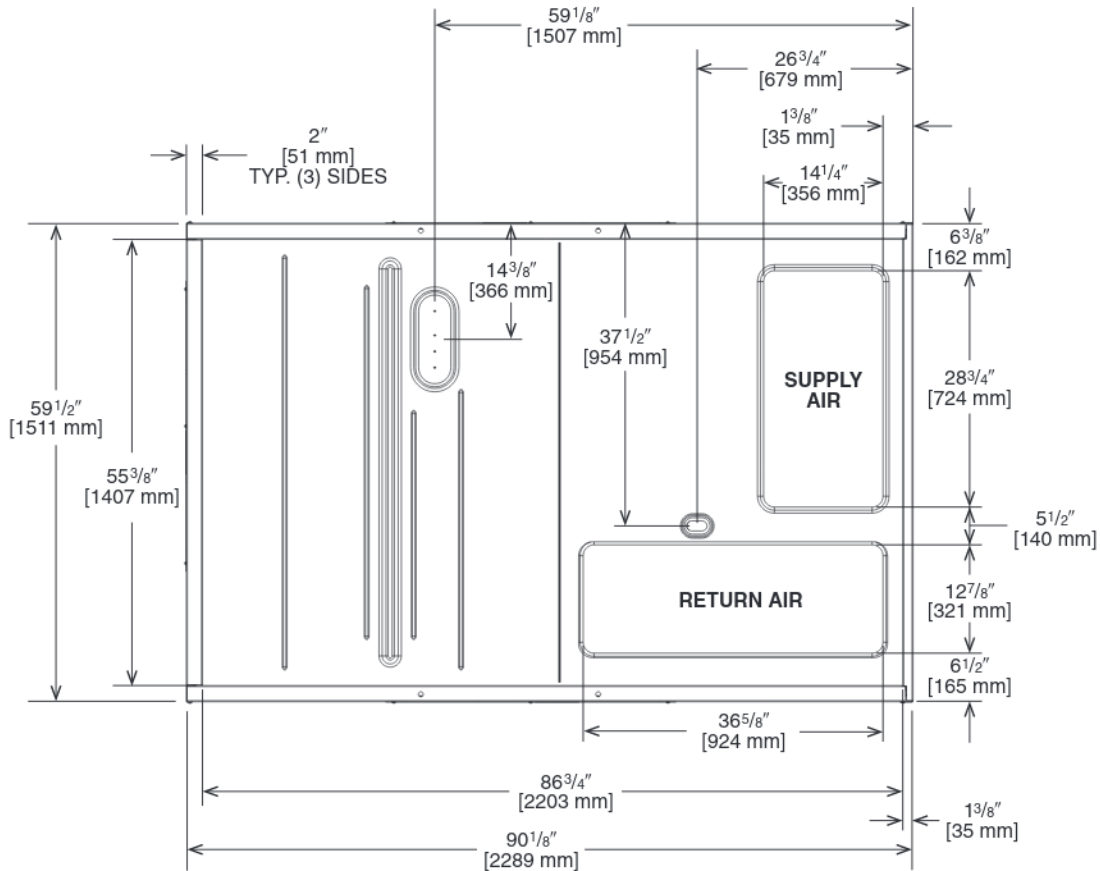

[] Designates Metric Conversions

WEIGHTS

Capacity Tons [kW]	Corner Weights by Percentage			
	A	B	C	D
7.5-12.5 [21.1-44.0]	26%	34%	17%	23%

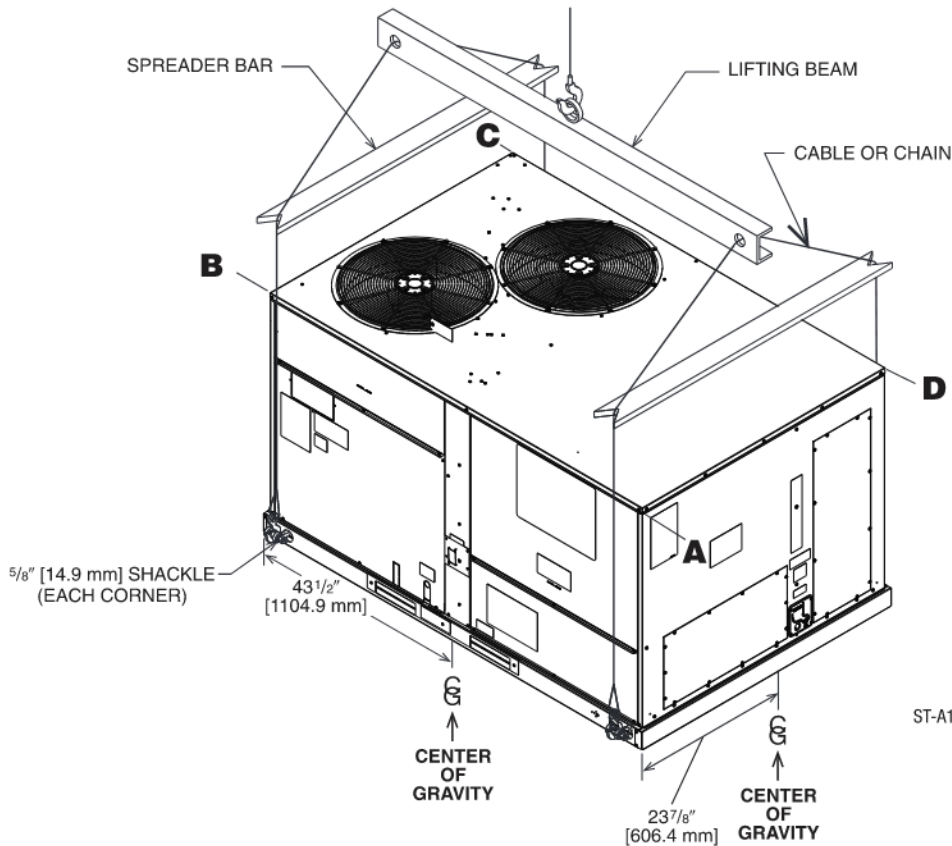


Illustration
ST-A1273-01_J-00

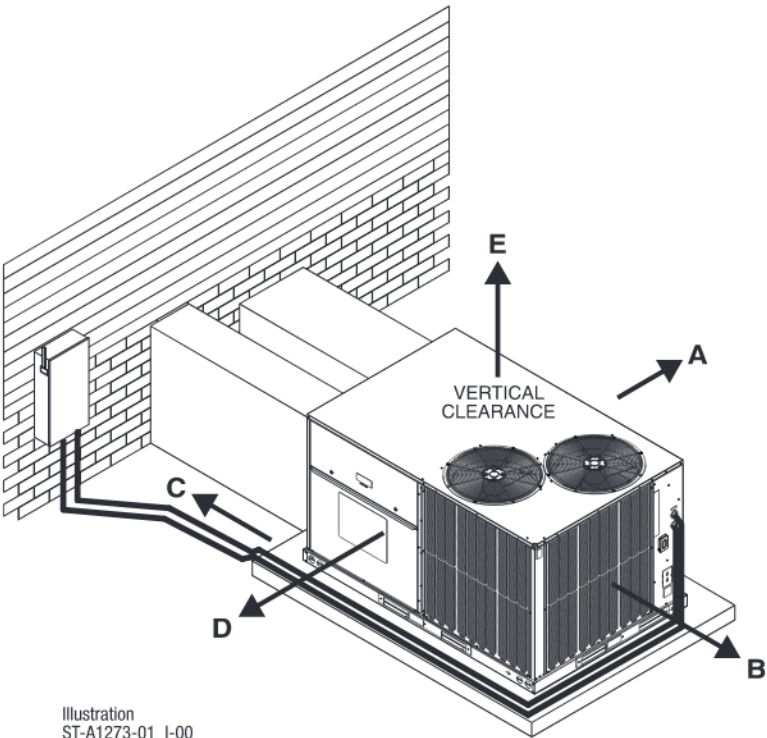


Illustration
ST-A1273-01_J-00

CLEARANCES

The following minimum clearances must be observed for proper unit performance and serviceability.

RECOMMENDED CLEARANCE In. [mm]	LOCATION
48 [1219]	A - FRONT
24 [609]	B - CONDENSER END
48 [1219] ①	C - DUCT END
24 [609] ②	D - FILTER SIDE
60 [1524]	E - ABOVE

① 18" [457 mm] MINIMUM IF DRAINPAN WILL NOT BE REMOVED.

② 48" [1219 mm] MINIMUM IF ECONOMIZER IS INSTALLED.

[] Designates Metric Conversions

FIELD-INSTALLED ACCESSORY EQUIPMENT

Accessory Description	Model Number	Shipping Weight Lbs. [kg]	Installed Weight Lbs. [kg]	Factory Installation Available?
Economizer w/Single Enthalpy (Downflow)	RXRD-01MDDAM3	86 [39.0]	57 [25.9]	Yes
Economizer w/Single Enthalpy (Horizontal)	RXRD-01MDHAM3	84 [38.1]	55 [24.9]	No
Economizer-w/Single Enthalpy (Downflow) DDC	RXRD-01MDDBM3	86 [39.0]	57 [25.9]	Yes
Economizer w/Single Enthalpy (Horizontal) DDC	RXRD-01MDHBM3	84 [38.1]	55 [24.9]	No
Dual Enthalpy Kit	RXRX-BV01	1 [.5]	1 [.5]	No
Dual Enthalpy Kit DDC	RXRX-BV02	1 [.5]	1 [.5]	No
Carbon Dioxide Sensor (Wall Mount)	RXRX-AR02	3 [1.4]	2 [1.0]	No
Power Exhaust	RXRX-CDF01C	58 [26.3]	48 [21.8]	No
Power Exhaust	RXRX-CDF01D	50 [22.7]	44 [20.0]	No
Manual Fresh Air Damper	RXRF-ADA1	15 [6.8]	12 [5.4]	No
Motorized Fresh Air Damper	RXRF-ADB1	38 [17.2]	31 [14.06]	No
Motorized Fresh Air Damper (DDC)	RXRF-ADC1	38 [17.2]	31 [14.06]	No
Roofcurb, 14"	RXKG-DDD14	109 [49.4]	104 [47.2]	No
Roofcurb, 24"	RXKG-DDD24	145 [65.8]	140 [63.5]	No
Roofcurb Adapter*	RXRX-DDCAE	235 [106.6]	215 [97.5]	No
Concentric Diffuser 7.5/8.5 Ton Flush	RXRN-AEF2000	30 [13.6]	25 [11.3]	No
Concentric Diffuser 10.0 Ton Flush	RXRN-AEF3415	250 [113.4]	130 [59]	No
Concentric Diffuser 12.5 Ton Flush	RXRN-AEF3618	275 [124.7]	170 [77.1]	No
Concentric Diffuser 7.5/8.5 Ton Drop	RXRN-AED2000	35 [15.9]	30 [13.6]	No
Concentric Diffuser 10.0 Ton Drop	RXRN-AED3415	270 [122.5]	160 [72.6]	No
Concentric Diffuser 12.5 Ton Drop	RXRN-AED3618	300 [136.1]	180 [81.6]	No
Concentric Adapter 7.5/8.5 Ton Drop	RXMC-DD01	25 [11.3]	20 [9.1]	No
Concentric Adapter 10 Ton Drop	RXMC-DD02	75 [34]	65 [29.5]	No
Concentric Adapter 12.5 Ton Drop	RXMC-DD03	75 [34]	65 [29.5]	No
Outdoor Coil Louver Kit - GED-090/102/120	RXRX-ADD04A	52 [23.6]	47 [21.3]	Yes
Outdoor Coil Louver Kit - GED-150	RXRX-ADD04B	43 [19.5]	39 [17.7]	Yes
Unwired Convenience Outlet	RXRX-BN01	2 [1.0]	1.5 [.7]	Yes
Unfused Service Disconnect	RXRX-BP01	10 [4.5]	9 [4.1]	Yes
Comfort Alert (1 Per Compressor)	RXRX-AZ02	3 [1.5]	2 [0.9]	Yes
BACnet Communication Card	RXRX-AY01	1 [0.5]	1 [0.5]	No
LonWorks Communication Card	RXRX-AY02	1 [0.5]	1 [0.5]	No
Room Humidity Sensor	RHC-ZNS4	1 [0.5]	1 [0.5]	No
Room Temperature and Relative Humidity Sensor	RHC-ZNS5	1 [0.5]	1 [0.5]	No
Low-Ambient Control Kit	RXRZ-A04	4 [1.8]	3 [1.4]	Yes
Freeze Stat Kit	RXRX-AM01	2 [1.0]	1.5 [.7]	Yes
LP Kit	RXGJ-FP39	2 [1.0]	0 [.0]	No
Flue Diverter	RXRX-DFG04	5 [2.3]	4 [1.8]	No
Variable Frequency Drive Kit	RXRX-AC02	9.1 [4.1]	7.6 [3.4]	No
	RXRX-AC03	11.7 [5.3]	10.2 [4.6]	No
	RXRX-AC05	11.7 [5.3]	10.2 [4.6]	No
	RXRX-AD02	9.4 [4.3]	7.9 [3.6]	No
	RXRX-AD03	12.3 [5.6]	10.8 [4.9]	No
	RXRX-AD05	12.3 [5.6]	10.8 [4.9]	No
	RXRX-CC02	9.1 [4.1]	7.6 [3.4]	No
	RXRX-CC03	11.7 [5.3]	10.2 [4.6]	No
	RXRX-CC05	11.7 [5.3]	10.2 [4.6]	No
	RXRX-CD02	9.4 [4.3]	7.9 [3.6]	No
	RXRX-CD03	12.3 [5.6]	10.8 [4.9]	No
	RXRX-CD05	12.3 [5.6]	10.8 [4.9]	No
MERV 8 Filter 7.5 - 10 Ton	RXMF-M08A22020	2.0 [0.9]	1 [0.45]	No
MERV 8 Filter 12.5 Ton	RXMF-M08A22520	2.0 [0.9]	1 [0.45]	No
MERV 13 Filter 7.5 - 10 Ton	RXMF-M13A22020	2.0 [0.9]	1 [0.45]	No
MERV 13 Filter 12.5 Ton	RXMF-M13A22520	2.0 [0.9]	1 [0.45]	No

NOTICE: Please refer to conversion kit index provided with the unit for LP conversion kit.

*This adapter converts to "B" series units 1st generation.

[] Designates Metric Conversions

FLUSH MOUNT ROOM TEMPERATURE SENSORS FOR NETWORKED DDC APPLICATIONS



ROOM TEMPERATURE SENSOR with TIMED OVERRIDE BUTTON

RHC-ZNS1

10k Ω room temperature sensor transmits room temperature to DDC system. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.



ROOM TEMPERATURE SENSOR with TIMED OVERRIDE BUTTON and STATUS INDICATOR

RHC-ZNS2


10k Ω room temperature sensor transmits room temperature to DDC system. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time. Status Indicator Light transmits ALARM flash code to occupied space.



ROOM TEMPERATURE SENSOR with SETPOINT ADJUSTMENT and TIMED OVERRIDE BUTTON

RHC-ZNS3


10k Ω room temperature sensor with setpoint adjustment transmits room temperature to DDC system along with desired occupied room temperature setpoint. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.

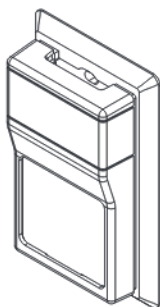

ROOM HUMIDITY SENSOR

RHC-ZNS4

Transmits room relative humidity to DDC System.

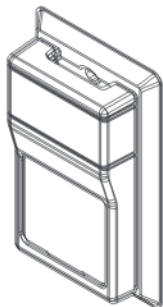

ROOM TEMPERATURE AND RELATIVE HUMIDITY SENSOR

RHC-ZNS5


Transmits room temperature and relative humidity to DDC System.

COMMUNICATION CARDS



BACnet® COMMUNICATION CARD RXRX-AY01

The field installed BACnet® Communication Card allows the RTU-C unit controller to communicate with a third party building management system that supports the BACnet Application Specific Controller device profile. The BACnet® Communication Module plugs onto the unit RTU-C controller and allows communication between the RTU-C and the BACnet MSTP network.



LonWorks® COMMUNICATION CARD RXRX-AY02

The field installed LonWorks® Communication Card allows the RTU-C unit controller to communicate with a third party building management system that supports the LonMark Space Comfort Controller (SCC) functional profile or LonMark Discharge Air Controller (DAC) functional profile. The LonMark Communication Module plugs onto the RTU-C controller and allows communication between the RTU-C and a LonWorks Network.

NON-DDC ECONOMIZER FOR DOWNFLOW DUCT INSTALLATION

Use to Select Field-Installed Options Only

RXRD-01MDDAM3—Single Enthalpy (Outdoor)

RXXR-BV01—Dual Enthalpy Upgrade Kit

RXXR-AR02—Optional Wall-Mounted CO₂ Sensor

- Features **Honeywell JADE™** Digital Controls
- Available Factory Installed or Field Accessory
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Ultra Low Leak Dampers meet California Title 24 requirements and ASHRAE 90.1 2013
- AMCA 511 Certified Class 1A Leakage—1" WG of differential pressure tested to AMCA Standard 500-D
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin Electrical Connections
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO₂ Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Down-flow Duct Application.
- Field Installed Power Exhaust Available
- Fault detections and diagnostics

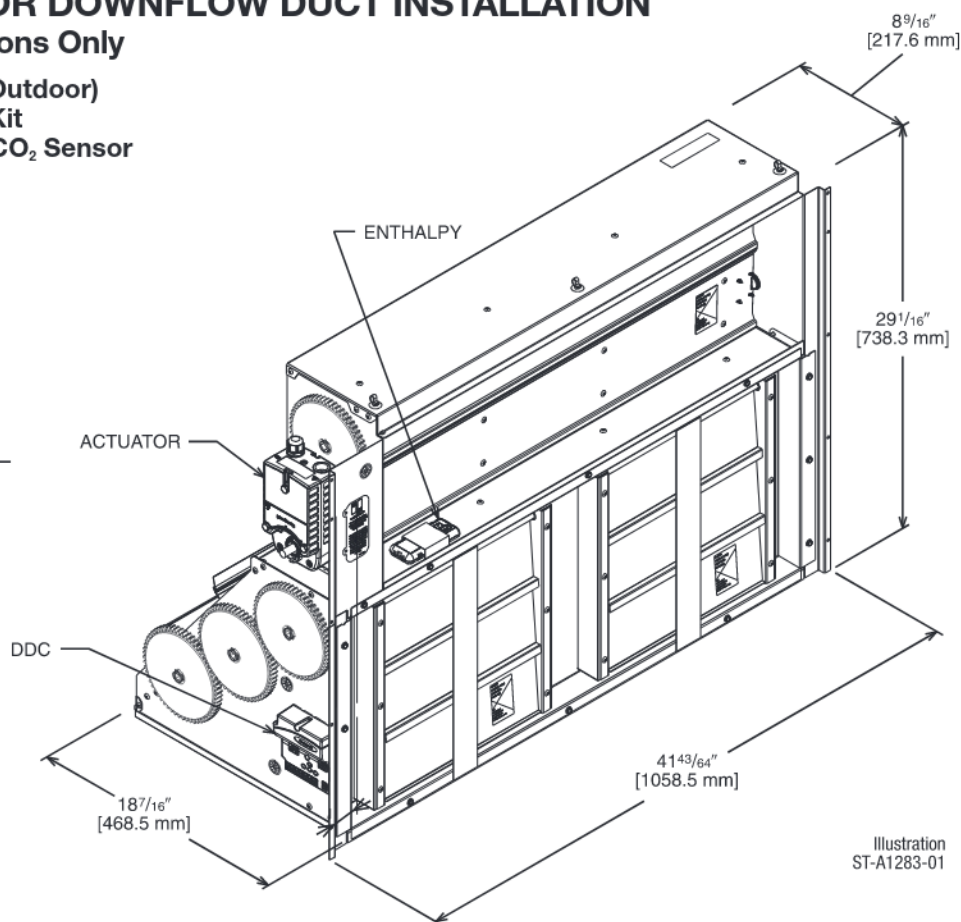


Illustration
ST-A1283-01

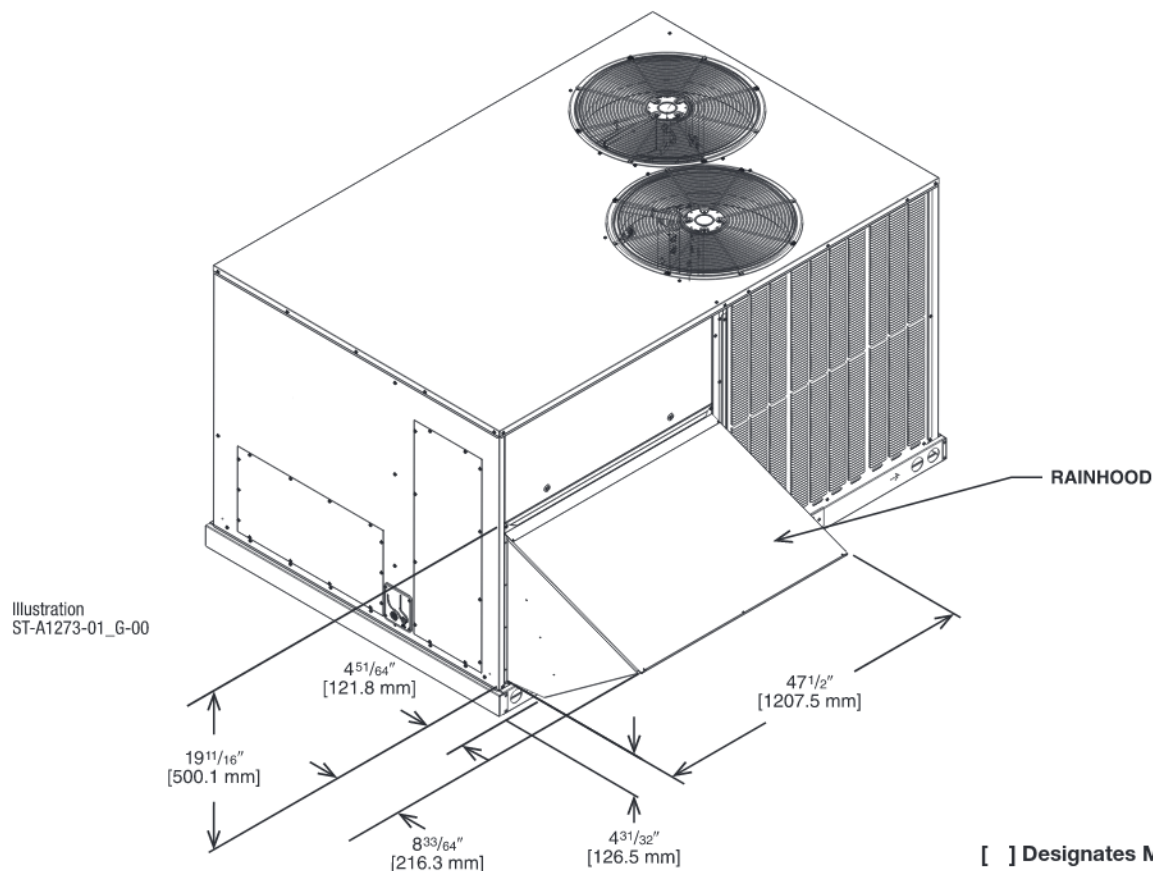


Illustration
ST-A1273-01_G-00

[] Designates Metric Conversions

NON-DDC ECONOMIZER FOR HORIZONTAL DUCT INSTALLATION



Field Installed Only

RXRD-01MDHAM3—Single Enthalpy (Outdoor)

RXXR-BV01—Dual Enthalpy Upgrade Kit

RXXR-AR02—Wall-mounted CO₂ Sensor

- Features **Honeywell JADE™** Digital Controls
- Available as a Field Installed Accessory Only
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Ultra Low Leak Dampers meet California Title 24 requirements and ASHRAE 90.1 2013
- Slip-In Design for Easy Installation
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO₂ Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Horizontal Duct Application
- Field Installed Power Exhaust Available

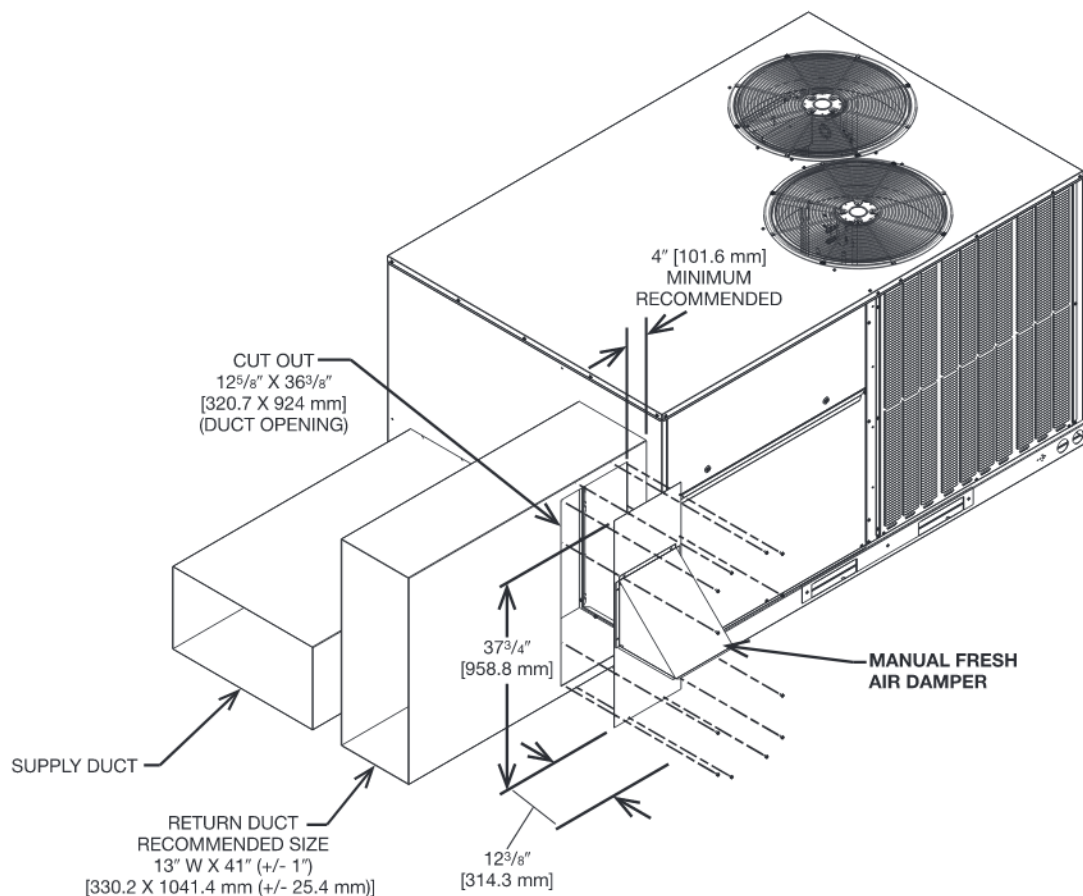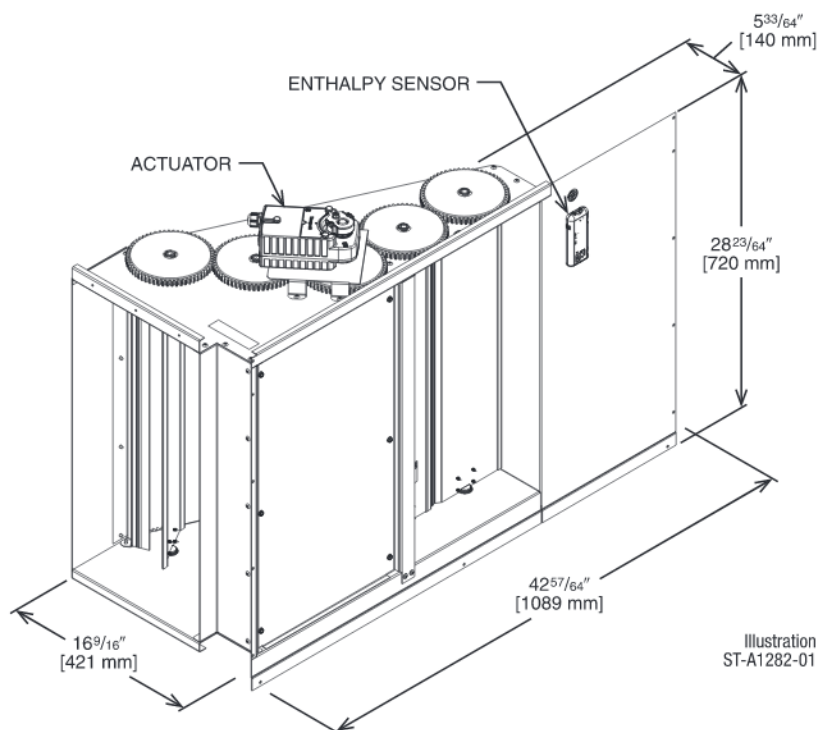

[] Designates Metric Conversions

DDC—ECONOMIZER FOR DOWNFLOW DUCT INSTALLATION



Use to Select Field Installed Options Only

RXRD-01MDDBM3—Single Enthalpy (Outdoor)

RXRX-BV02—Dual Enthalpy Upgrade Kit

RXRX-AR02—Optional Wall-Mounted CO₂ Sensor

- Features **Honeywell** Controls
- Available Factory Installed or Field Accessory
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Ultra Low Leak Dampers meet California Title 24 requirements and ASHRAE 90.1 2013
- Slip-In Design for Easy Installation
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO₂ Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Downflow Duct Application.
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is Available from Prostock.
- Field Installed Power Exhaust Available
- Prewired for Smoke Detector
- If connected to a Building Automation System (BAS), all economizer functions can be viewed on the (BAS), or 16 x 2 LCD screen
- If connected to thermostat, all economizer functions can be viewed on 16 x 2 LCD screen

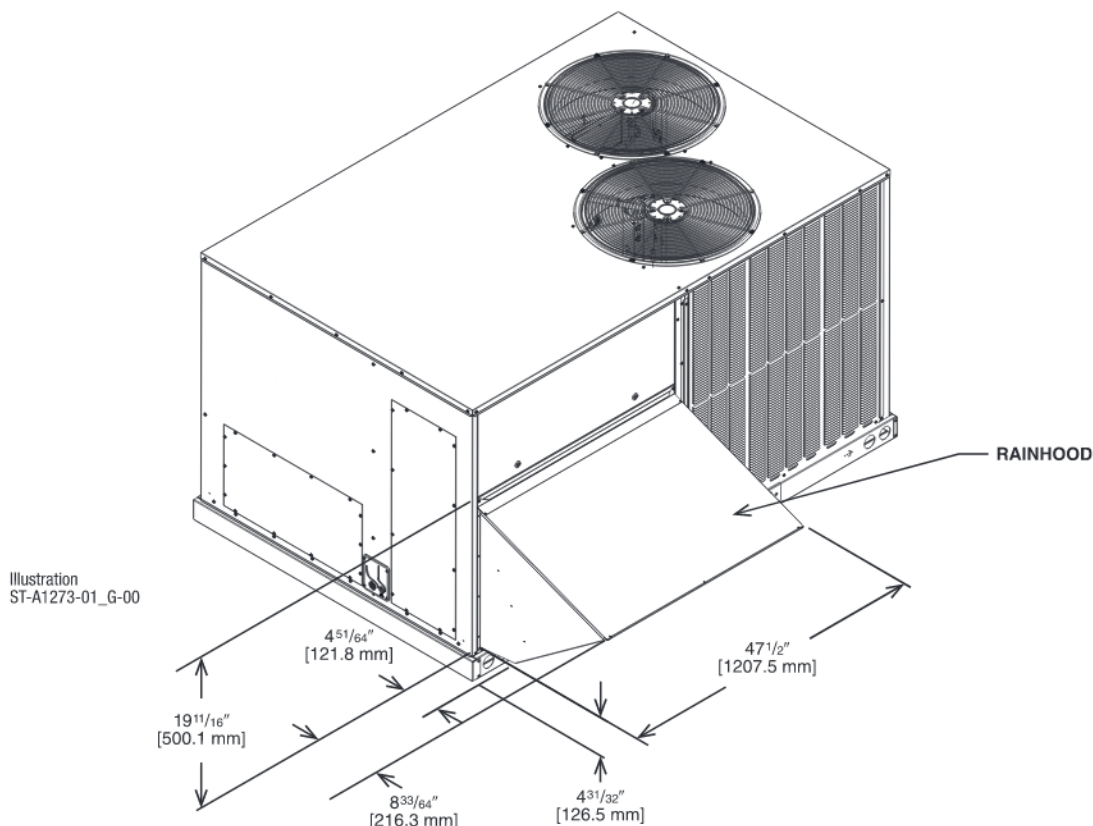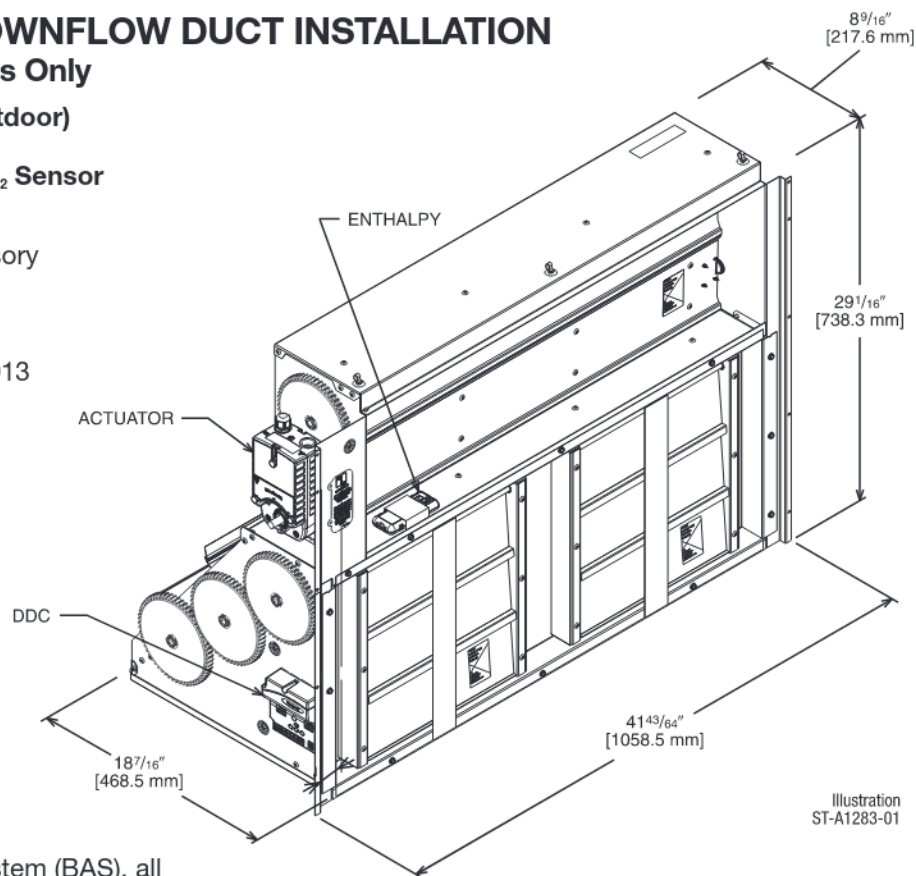

[] Designates Metric Conversions

DDC—ECONOMIZER FOR HORIZONTAL DUCT INSTALLATION



Field Installed Only

RXRD-01MDHBM3—Single Enthalpy (Outdoor)

RXXR-BV02—Dual Enthalpy Upgrade Kit

RXXR-AR02—Wall-mounted CO₂ Sensor

- Features **Honeywell** Controls
- Available as a Field Installed Accessory Only
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Ultra Low Leak Dampers meet California Title 24 requirements and ASHRAE 90.1 2013
- Slip-In Design for Easy Installation
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO₂ Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Horizontal Duct Application
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is Available from Prostock
- Field Installed Power Exhaust Available
- If connected to a Building Automation System (BAS), all economizer functions can be viewed on the (BAS), or 16 x 2 LCD screen
- If connected to thermostat, all economizer functions can be viewed on 16 x 2 LCD screen

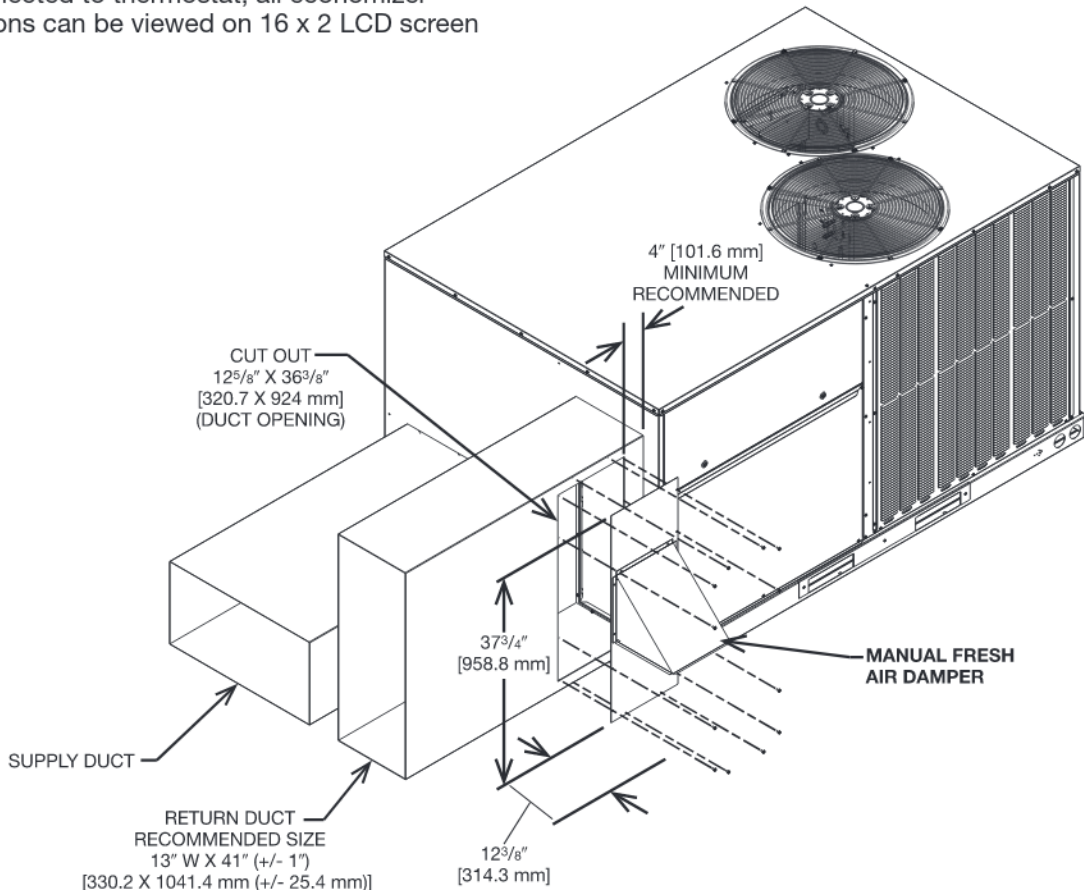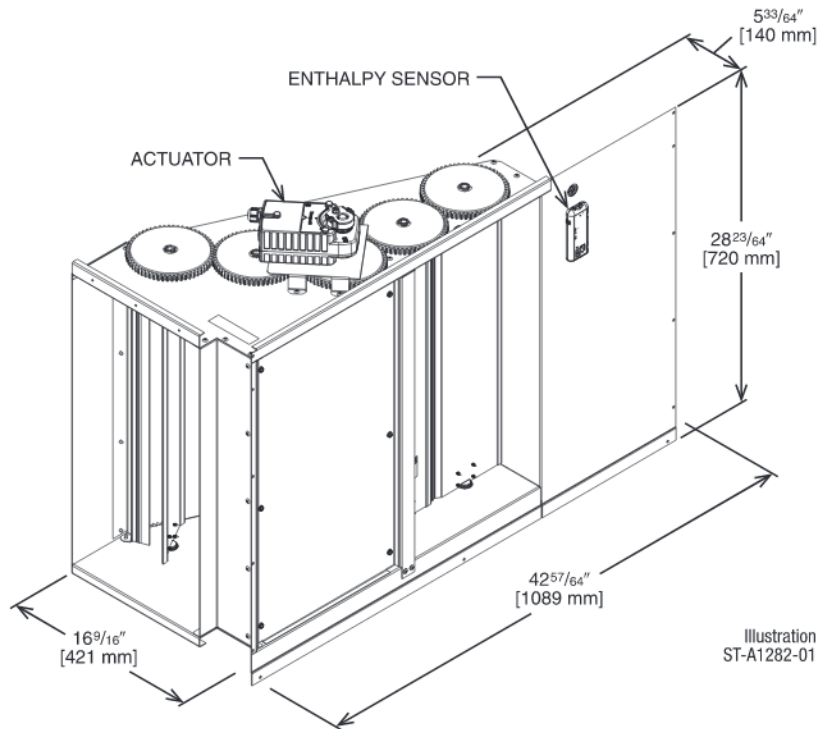


[] Designates Metric Conversions

POWER EXHAUST KIT FOR RXRD-01MDDAM3, RXRD-01MDDBM3,
RXRD-01MDHAM3, RXRD-01MDHBM3 ECONOMIZERS


RXXR-CDF01 (C, D, or Y*)

*Voltage Code

VERTICAL AIRFLOW

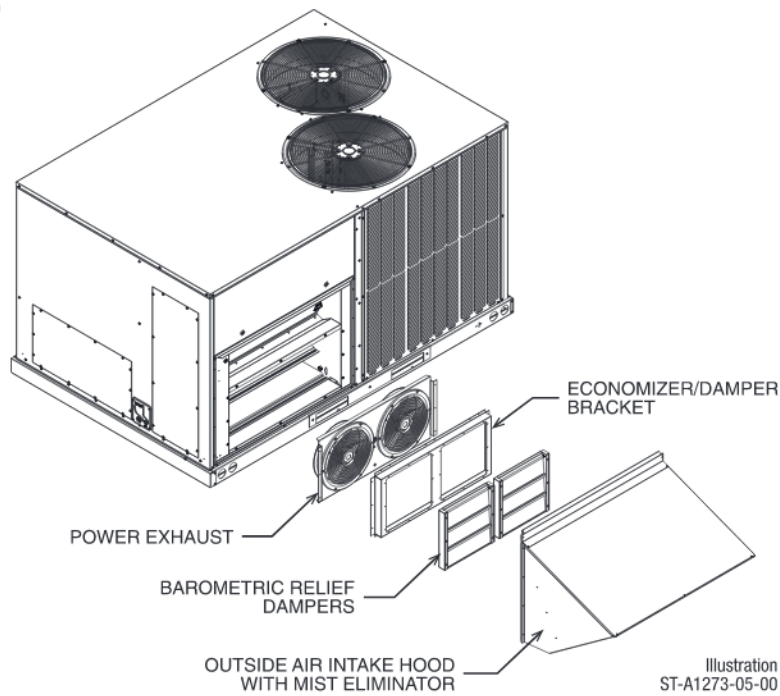

HORIZONTAL AIRFLOW

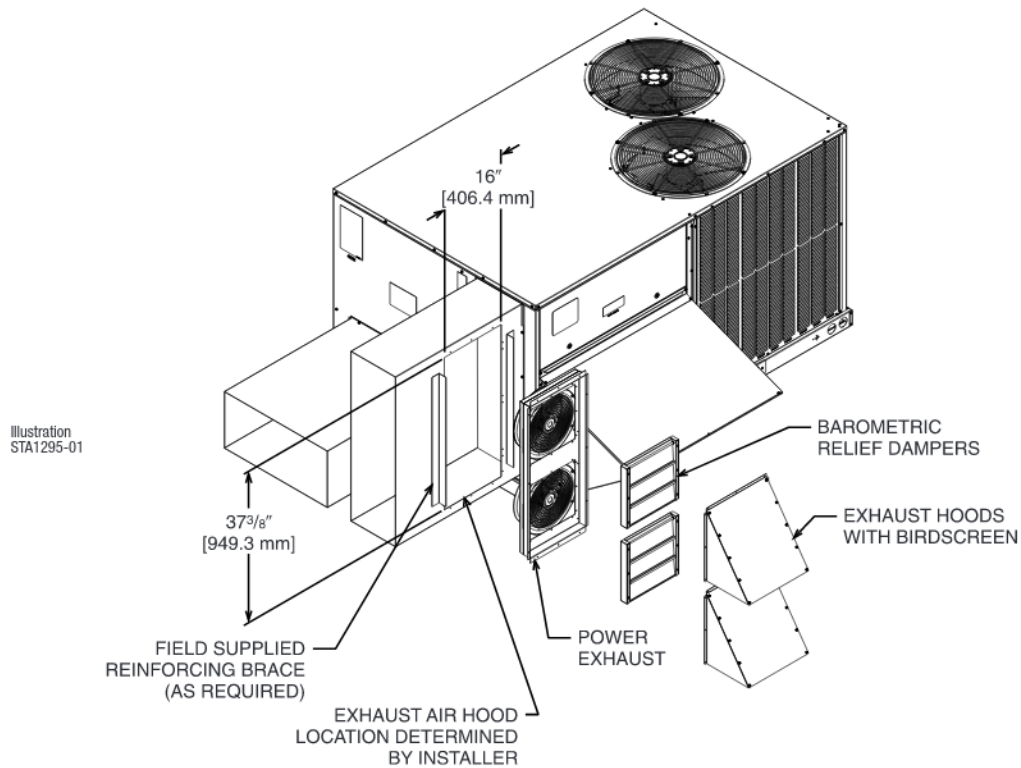

Model No.	No. of Fans	Volts	Phase	HP (ea.)	CFM [L/s]*	RPM	FLA (ea.)	LRA (ea.)
RXXR-CDF01C	2	208-230	1	0.47	2200	3000	1.55	1.1
RXXR-CDF01D	2	460	3	0.40	1970	2750	0.51	1.9

*CFM is per fan at 0" w.c. external static pressure.

[] Designates Metric Conversions

FRESH AIR DAMPER

MOTORIZED DAMPER KIT RXRF-ADB1

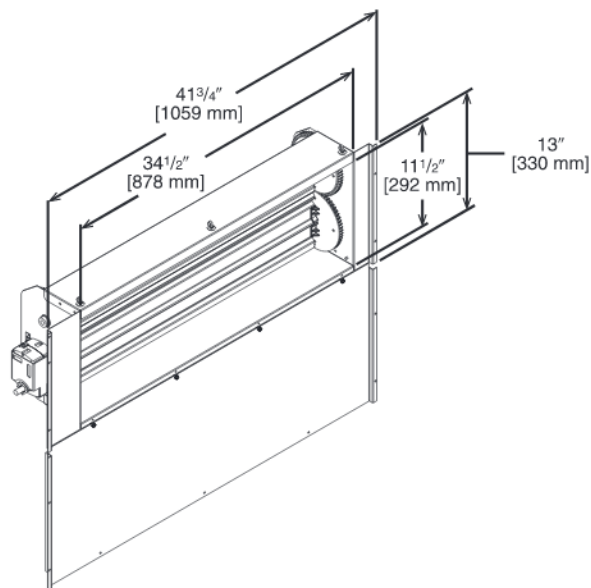


Illustration
ST-A1273-10-00

[] Designates Metric Conversions

MOTORIZED DAMPER KIT RXRX-ADC1 (Modulating Motor Kit with position feedback for DDC Models)

- Features **Honeywell** Controls
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Addition of Dual Enthalpy Upgrade Kit allows limited economizer function
- CO₂ Sensor Input Available for Demand Control Ventilation (DCV)
- All fresh air damper functions can be viewed at the RTU-C unit controller display
- If connected to a Building Automation System (BAS), all fresh air damper functions can be viewed on the (BAS), or 16 x 2 LCD screen
- If connected to thermostat, all fresh air damper functions can be viewed on 16 x 2 LCD screen

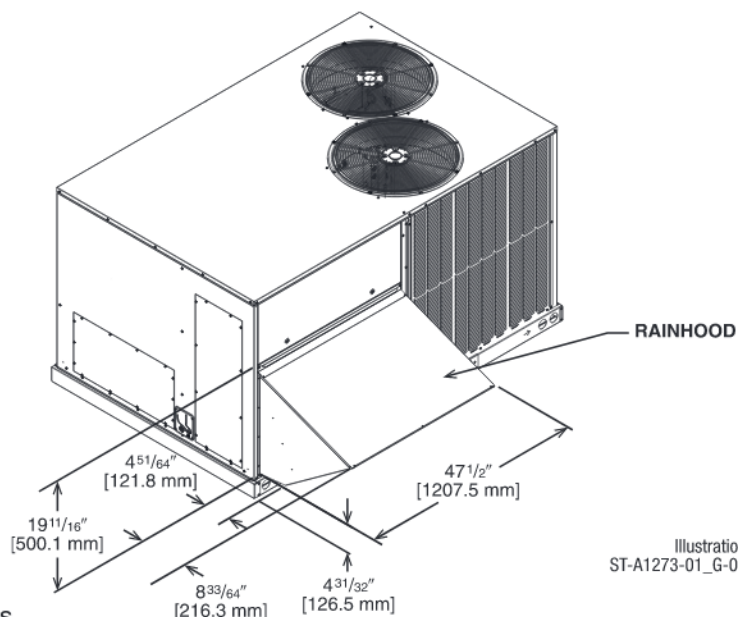


Illustration
ST-A1273-01_G-00

FRESH AIR DAMPER (Cont.)

AXRF-ADA1

DOWNFLOW APPLICATION

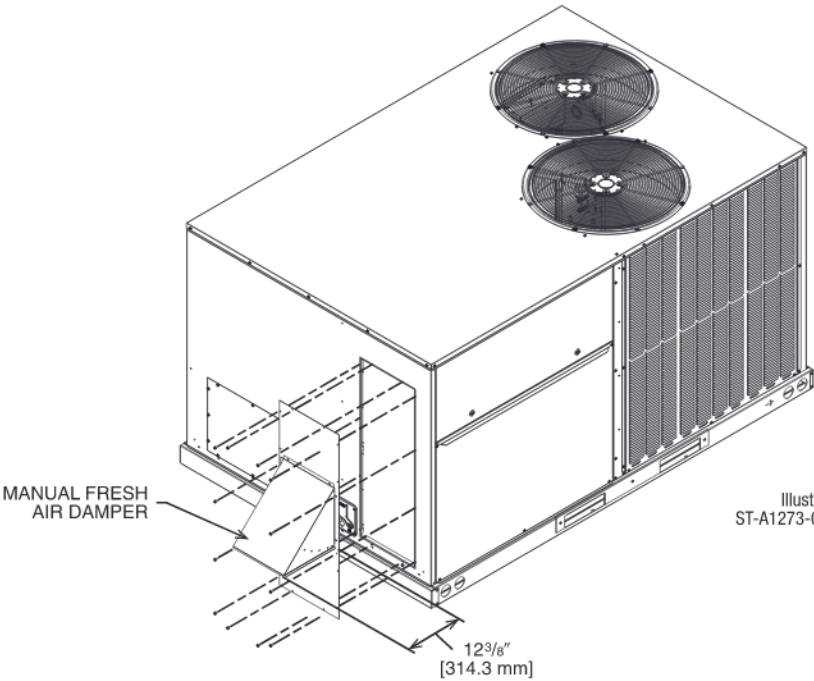


Illustration
ST-A1273-03-00

HORIZONTAL APPLICATION


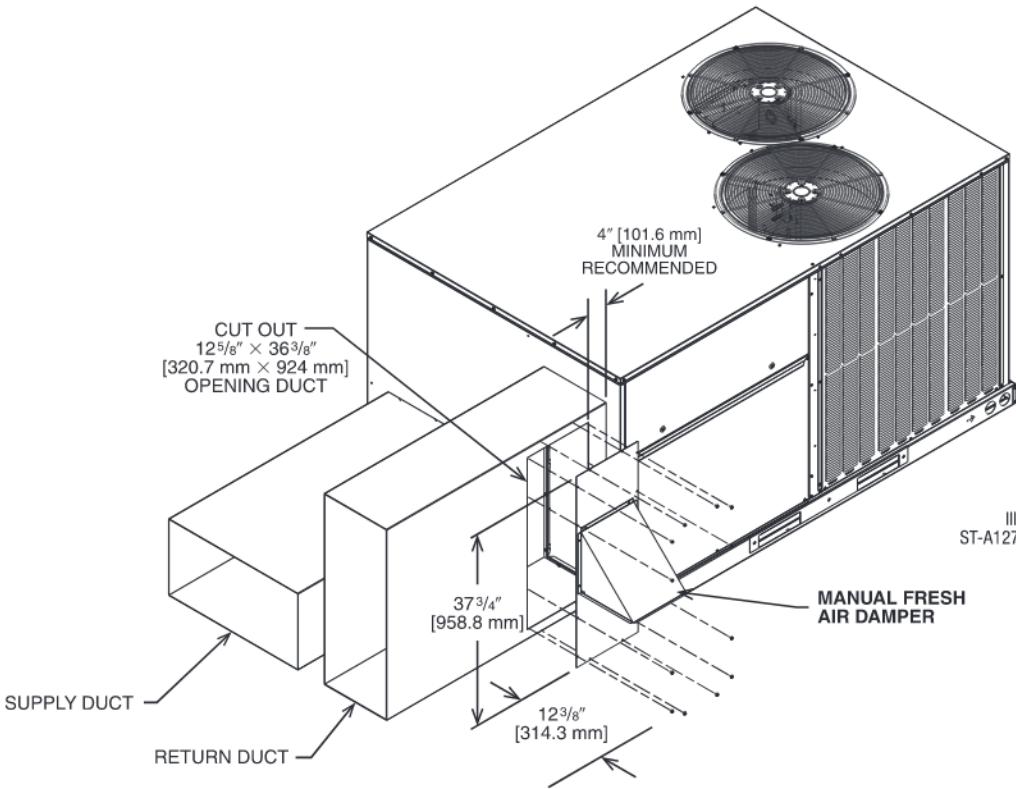


Illustration
ST-A1273-04-00

[] Designates Metric Conversions

ROOFCURBS (Full Perimeter)

- ClimateMaster's roofcurb design can be utilized on all 7.5-12.5 ton [26.4-44.0 kW] RGED- models.
- Two available heights (14" [356 mm] and 24" [610 mm]) for ALL models.
- Quick assembly corners for simple and fast assembly.
- Opening provided in bottom pan to match the "Thru the Curb" electrical, gas piping, condensate, connection opening provided on the unit base pan.
- 1" [25 mm] x 4" [102 mm] Nailer provided.
- Sealing gasket (40' [12.2 m]) provided with Roofcurb.
- Packaged for easy field assembly.

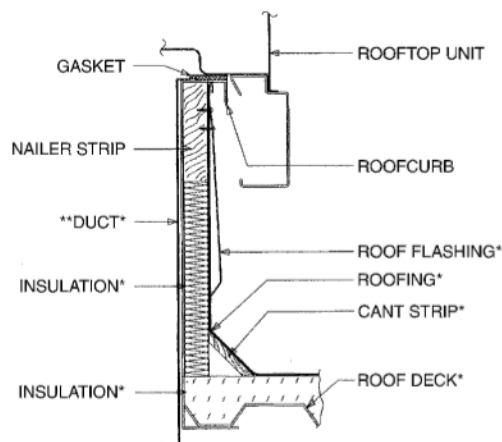

*BY CONTRACTOR

**FOR INSTALLATION OF DUCT AS SHOWN, USE RECOMMENDED DUCT SIZES FROM ROOFCURB INSTALLATION INSTRUCTIONS. FOR DUCT FLANGE ATTACHMENT TO UNIT, SEE UNIT INSTALLATION INSTRUCTIONS FOR RECOMMENDED DUCT SIZES.

Illustration
ST-A0743-02

View	Roofcurb Model	Height of Curb
A	RXKG-DDD14	14" [356 mm]
A	RXKG-DDD24	24" [610 mm]

ROOFCURB INSTALLATION


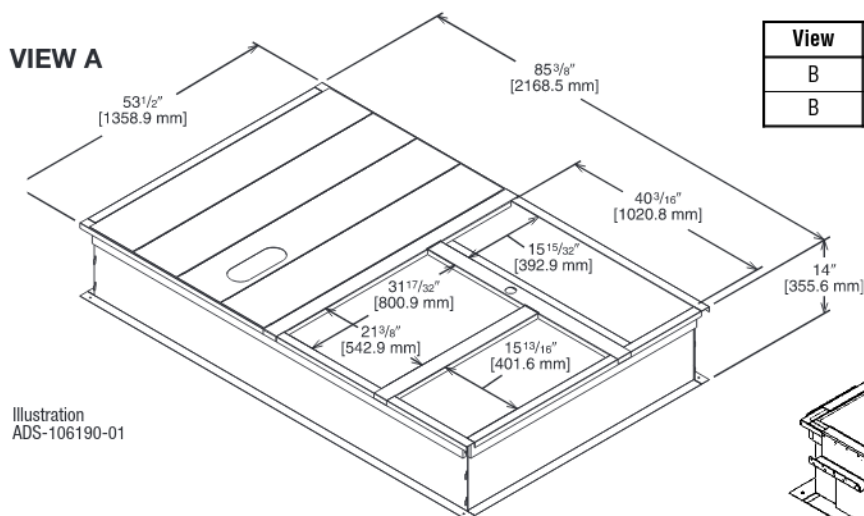


Illustration
ADS-106190-01

View	Roofcurb Model	Dimensions
B	RKKG-SD14	85.375" x 53.5" x 14.0"
B	RKKG-SD24	85.375" x 53.5" x 24.0"

WELDED ROOFCURB VIEW B

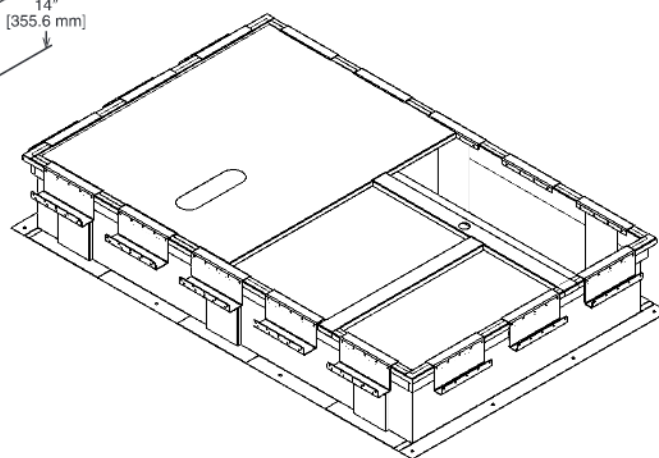

- State of Florida Approved: Approval Number FL 26981.1 for Technical Evaluation Report TER-20-28788 certifies the HVAC Unit and mounting methods for high wind resistance are compliant per Florida Building Code.
- OSHPD Approved: State of California Product Approval Number OSP-06660-TEMP00 for Technical Evaluation Report 1700876-CR-001-RO certifies the HVAC Unit and Mircrometl Welded Roof Curb is earthquake resistance compliant and approved for use per International Code Council – Evaluation Service AC156, IBC, AND CBC building code standards.

[] Designates Metric Conversions




ROOFCURB ADAPTERS (Cont.)

RXRX-DDCAE

Illustration
ADS-106176-01
SHEET 2

APPROXIMATE STATIC PRESSURE DROP

@2,000 = 0.06" w.g.
@3,000 = 0.12" w.g.
@4,000 = 0.22" w.g.
@5,000 = 0.36" w.g.

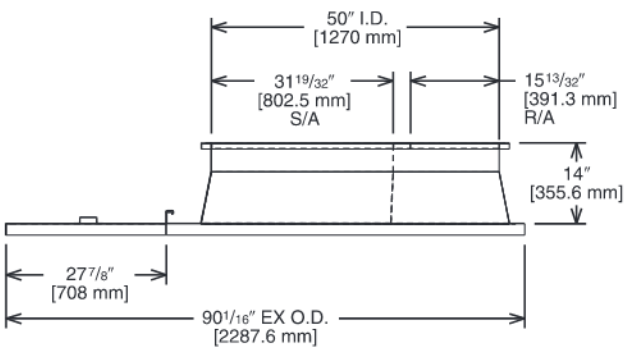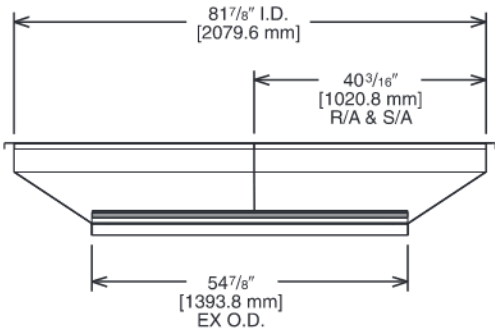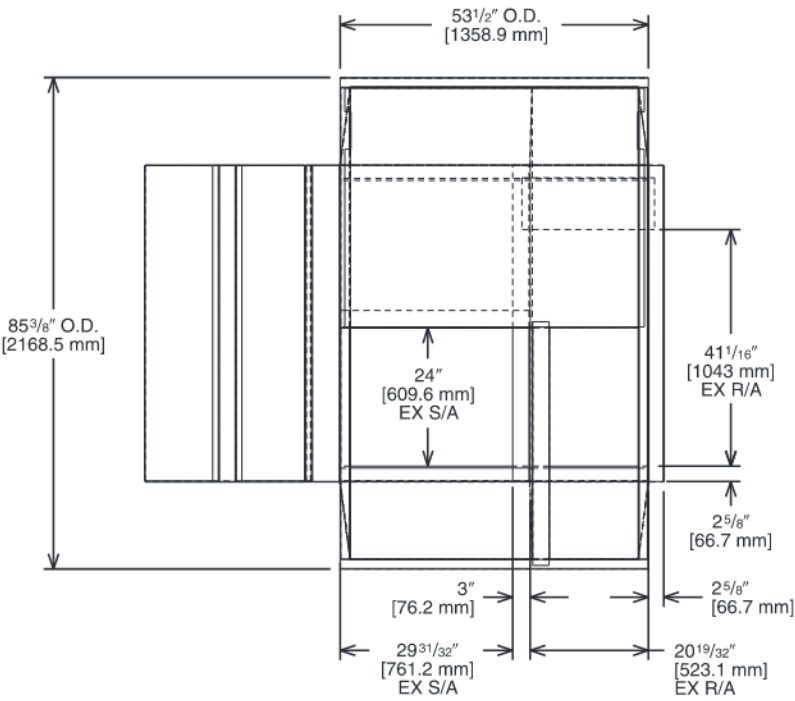

TOP VIEW


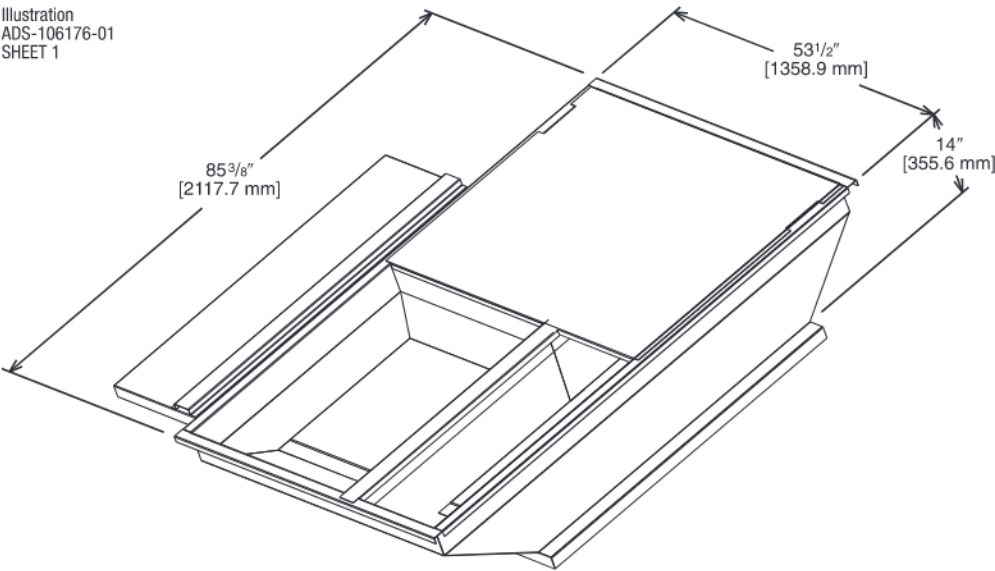


Illustration
ADS-106176-01
SHEET 1

[] Designates Metric Conversions

CONCENTRIC DIFFUSER APPLICATION

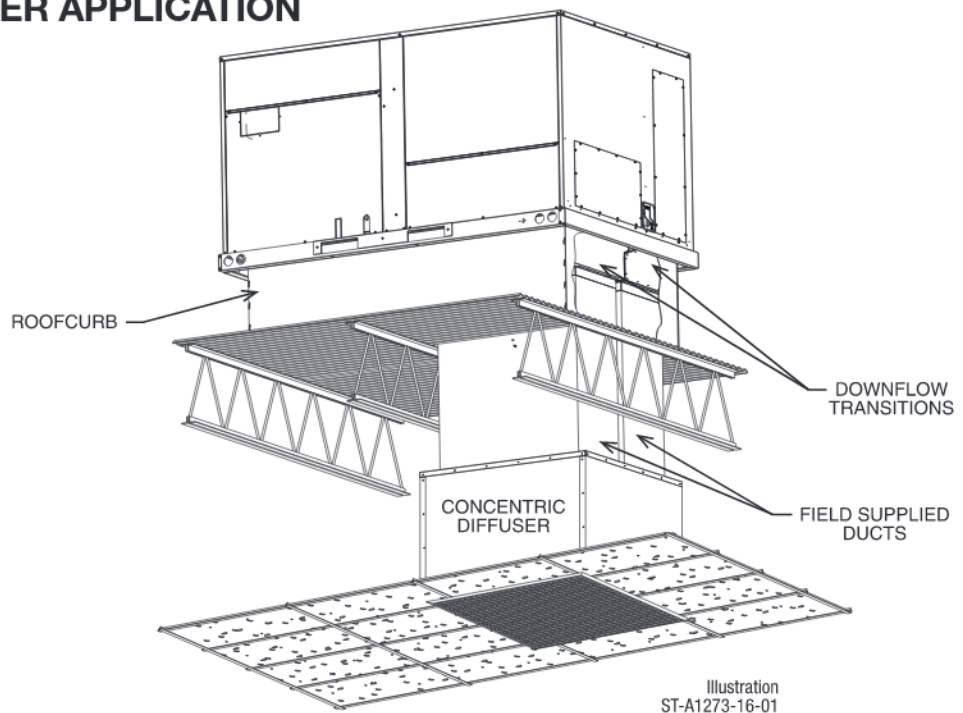

DOWNFLOW TRANSITION DRAWINGS

RXMC-DDO2

- Used with AEF3415 or AED3415 Concentric Diffusers.




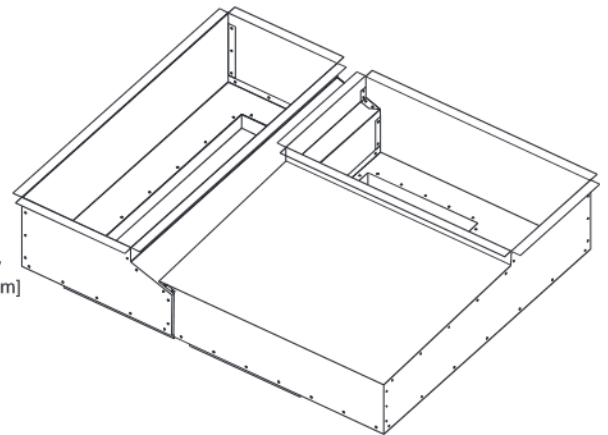


Illustration
ADS-106193-02

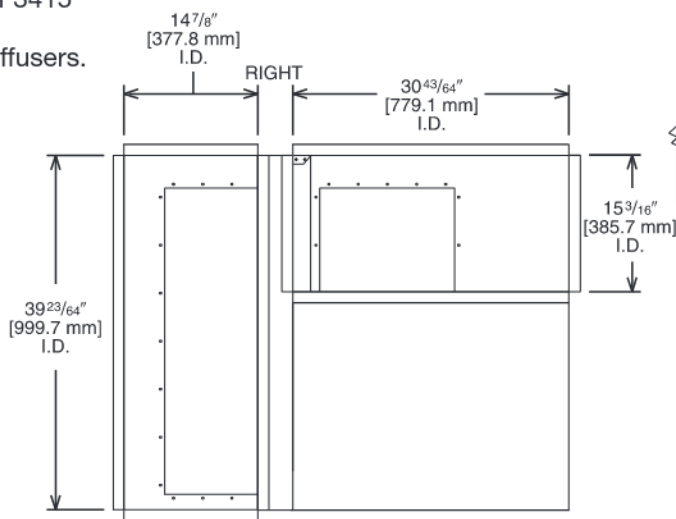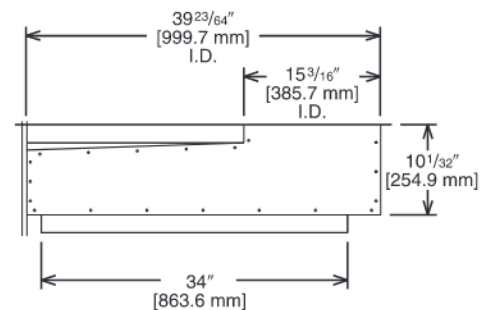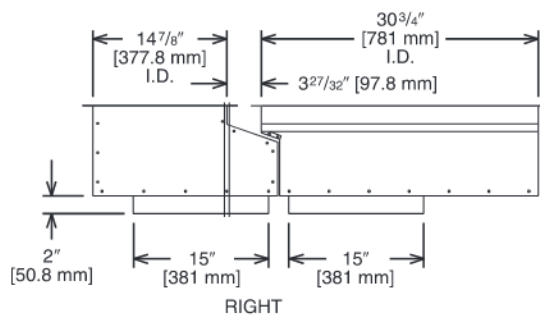

[] Designates Metric Conversions

DOWNFLOW TRANSITION DRAWINGS

RXMC-DD03

- Used with AEF3618
or AED3618
Concentric Diffusers.




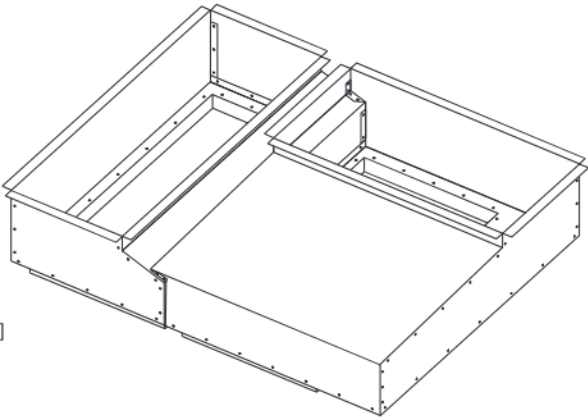


Illustration
ADS-106193-03

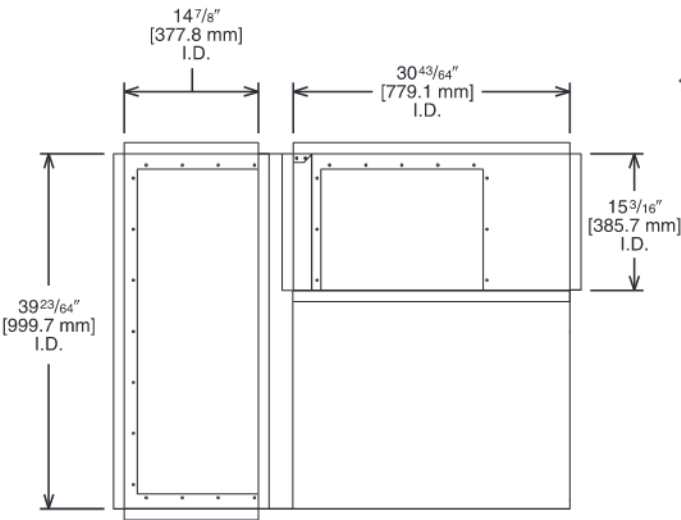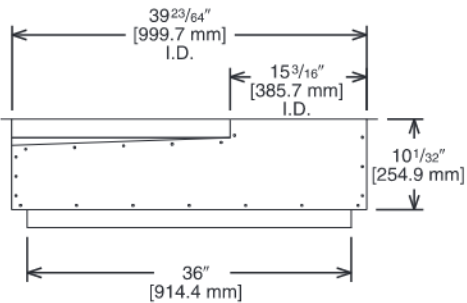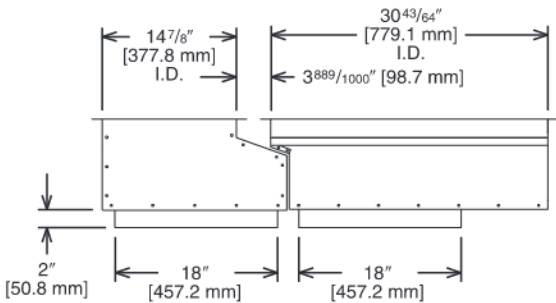

[] Designates Metric Conversions

DOWNFLOW TRANSITION DRAWINGS

RXMC-DD01

- Used with AEF2000
or AED2000
Concentric Diffusers.

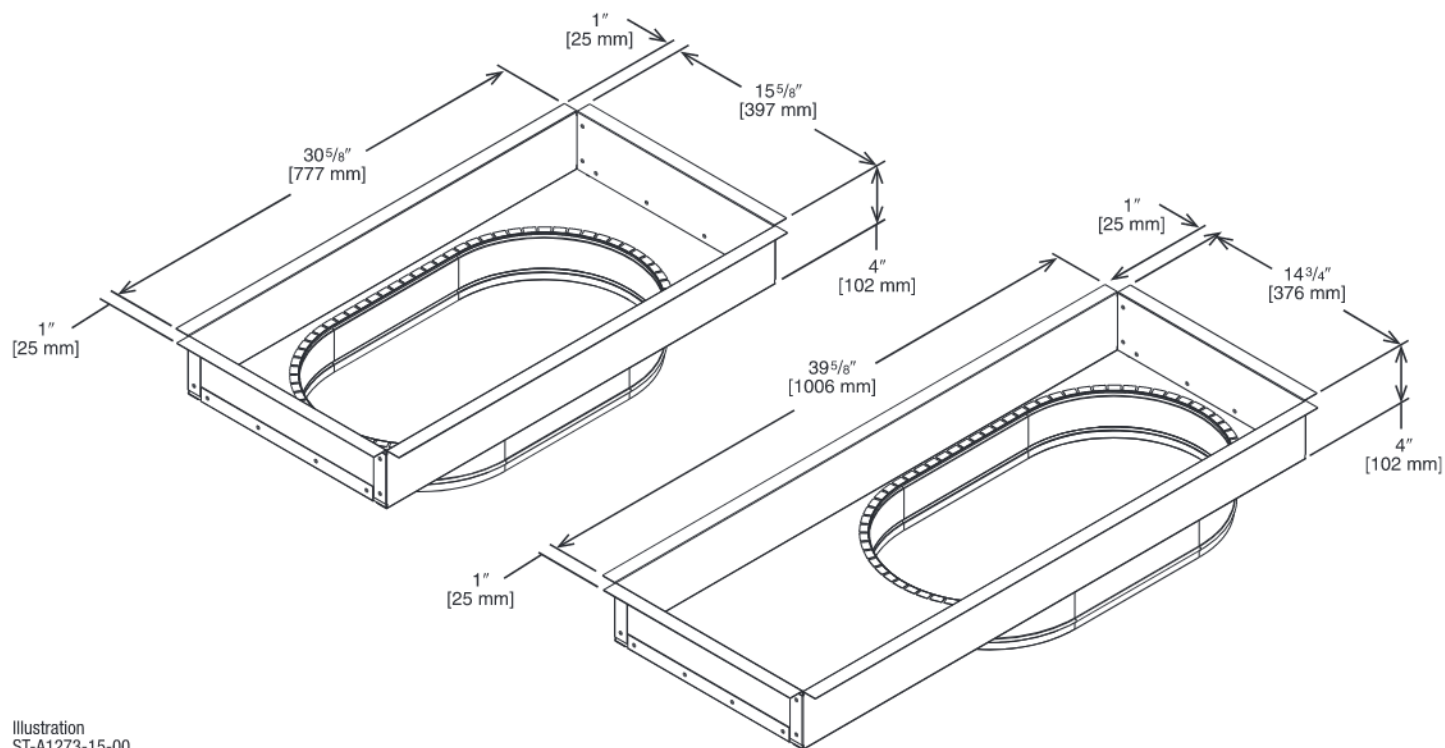


Illustration
ST-A1273-15-00


[] Designates Metric Conversions

CONCENTRIC DIFFUSER—STEP DOWN

RXRN-AED2000 (7.5 & 8.5 Ton [26.4 & 29.9 kW] Models)

For Use With Downflow Transition (RXMC-DD01)
and 20" [508 mm] Round Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

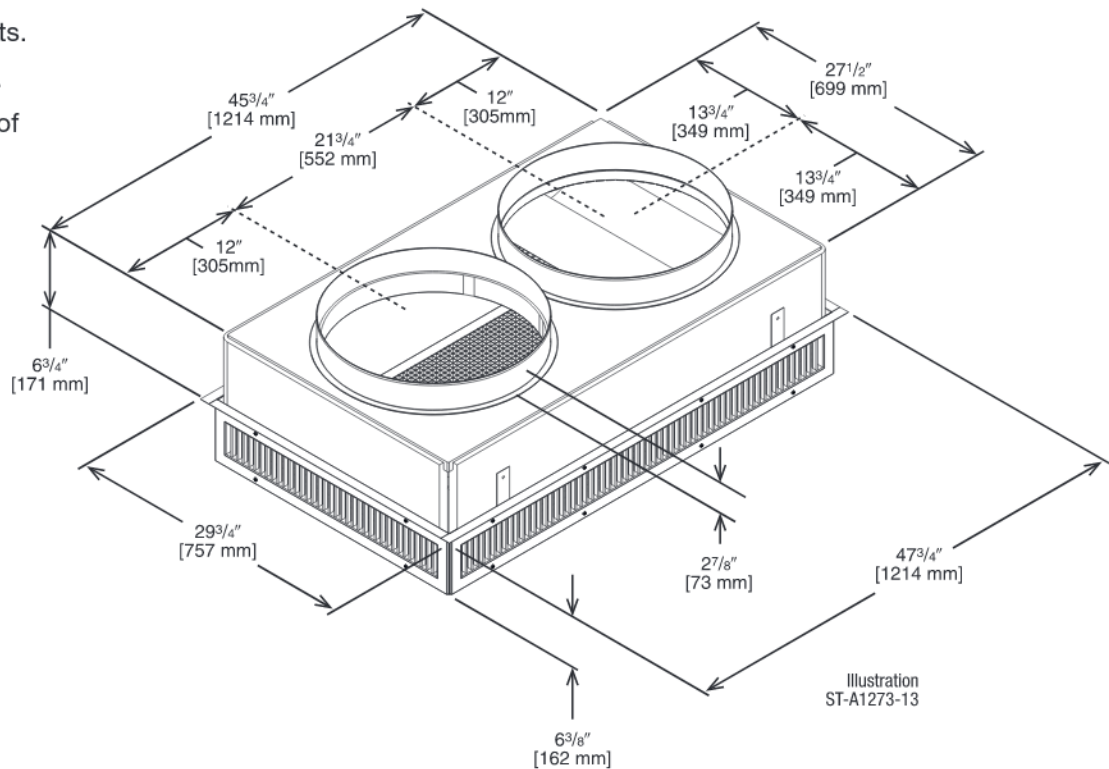

ENGINEERING DATA^①

Model No.	Flow Rate CFM [L/s]	Throw ^② ^③ Feet [m]	Neck Velocity fpm [m/s]	Noise Level ^④ (dbA)
RXRN-AED2000	2600 [1222]	22-39 [6.7-11.9]	669 [3.4]	32
	2800 [1316]	23-40 [7.1-12.2]	720 [3.7]	38
	3000 [1410]	25-42 [7.6-12.8]	772 [3.9]	40
	3200 [1504]	26-43 [7.9-13.1]	823 [4.2]	41
	3400 [1598]	27-45 [8.2-13.7]	874 [4.4]	42
	3600 [1692]	30-50 [9.1-15.2]	925.5 [4.7]	45
	3800 [1786]	32-53 [9.8-16.2]	976.8 [4.9]	48
	4000 [1880]	34-56 [10.4-17.1]	1028.1 [5.2]	50

NOTES: ^① All data is based on the air diffusion council guidelines.
^② Throw data is based on 75 FPM Terminal Velocities using isothermal air.
^③ Throw is based on diffuser blades being directed in a straight pattern.
^④ Actual noise levels may vary due to duct design and do not include transmitted unit noise.
Adequate duct attenuation must be provided to reduce sound output from the unit.

[] Designates Metric Conversions

CONCENTRIC DIFFUSER—STEP DOWN 15" x 34" [381 x 836 mm]

RXRN-AED3415 (8.5 & 10 Ton [29.9 kW & 35.2] Models)

For Use With Downflow Transition (RXMC-DD02)
and 15" x 34" [381 x 836 mm]
Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

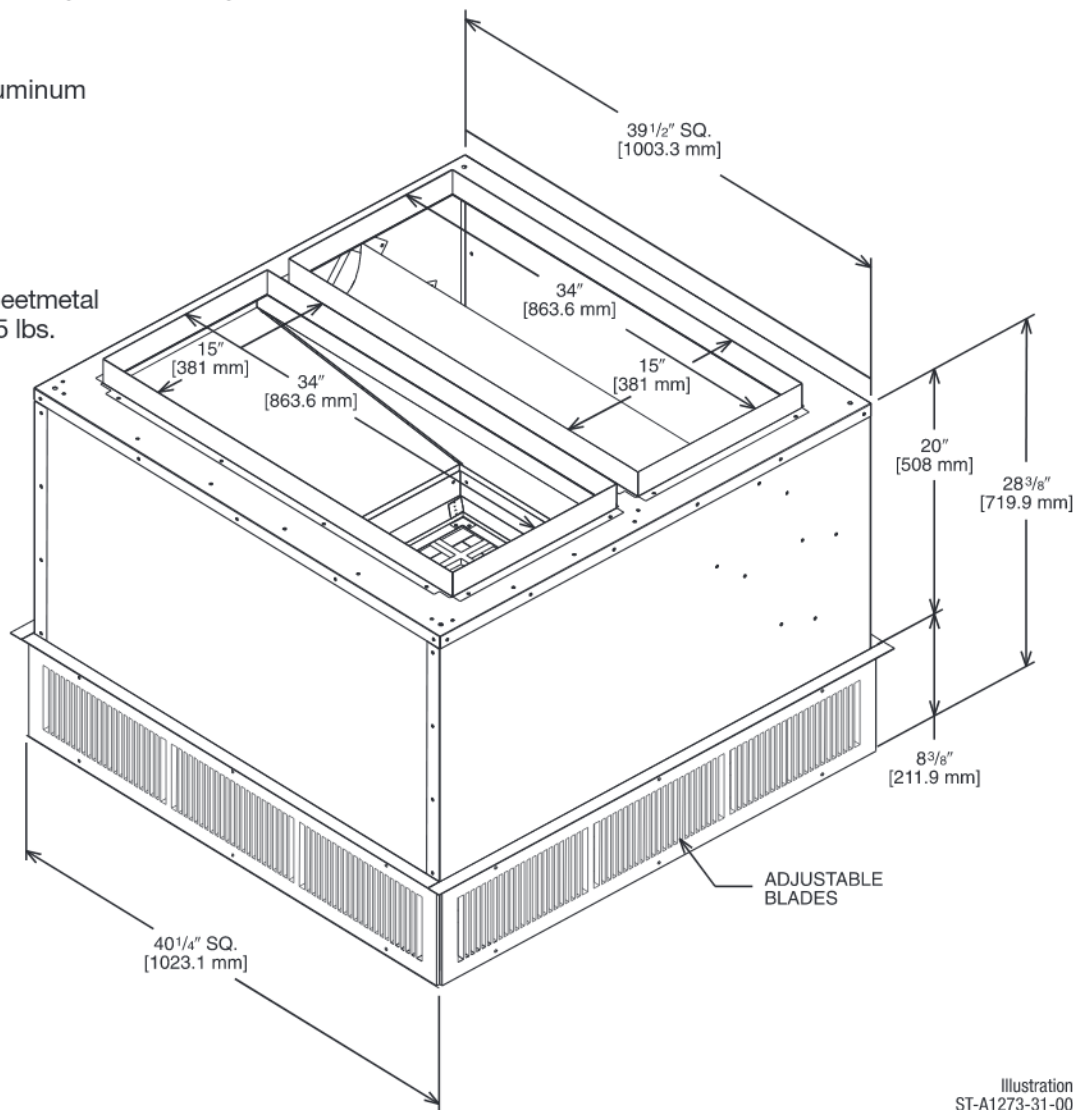


Illustration
ST-A1273-31-00

ENGINEERING DATA^①

Model No.	Flow Rate CFM [L/s]	Throw ^② ^③ Feet [m]	Neck Velocity fpm [m/s]	Noise Level ^④ (dba)
RXRN-AED3415	3600 [1692]	26-53 [7.9-16.2]	851 [4.3]	27
	3800 [1786]	27-55 [8.2-16.8]	898 [4.5]	29
	4000 [1880]	29-58 [8.8-17.7]	946 [4.8]	30
	4200 [1974]	31-61 [9.4-18.6]	993 [5.1]	32
	4400 [2068]	32-64 [9.8-19.5]	1040 [5.3]	33
	4600 [2162]	34-66 [10.4-20.1]	1087.5 [5.5]	35

NOTES: ① All data is based on the air diffusion council guidelines.

② Throw data is based on 75 FPM Terminal Velocities using isothermal air.

③ Throw is based on diffuser blades being directed in a straight pattern.

④ Actual noise levels may vary due to duct design and do not include transmitted unit noise.
Adequate duct attenuation must be provided to reduce sound output from the unit.

[] Designates Metric Conversions

CONCENTRIC DIFFUSER—STEP DOWN
18" x 36" [457 x 914 mm]

RXRN-AED3618 (12.5 & 15 Ton [44.0 & 52.8 kW] Models)

For Use With Downflow Transition (RXMC-DD03)
and 18" x 36" [457 x 914 mm]
Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

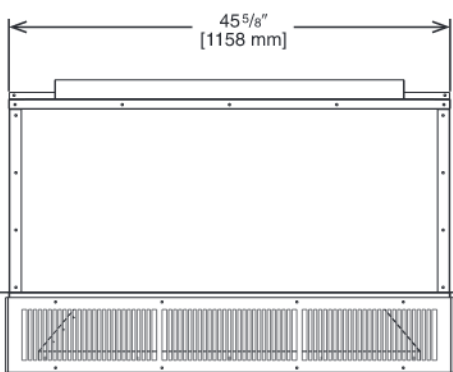
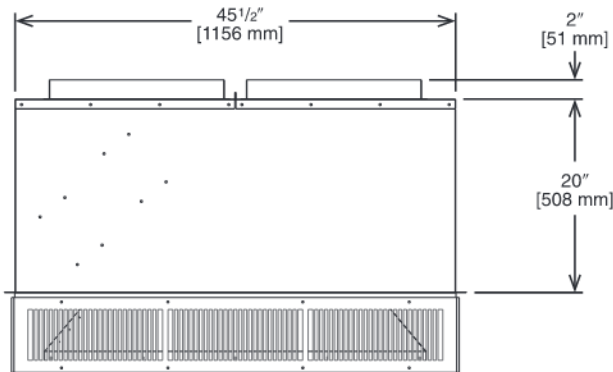
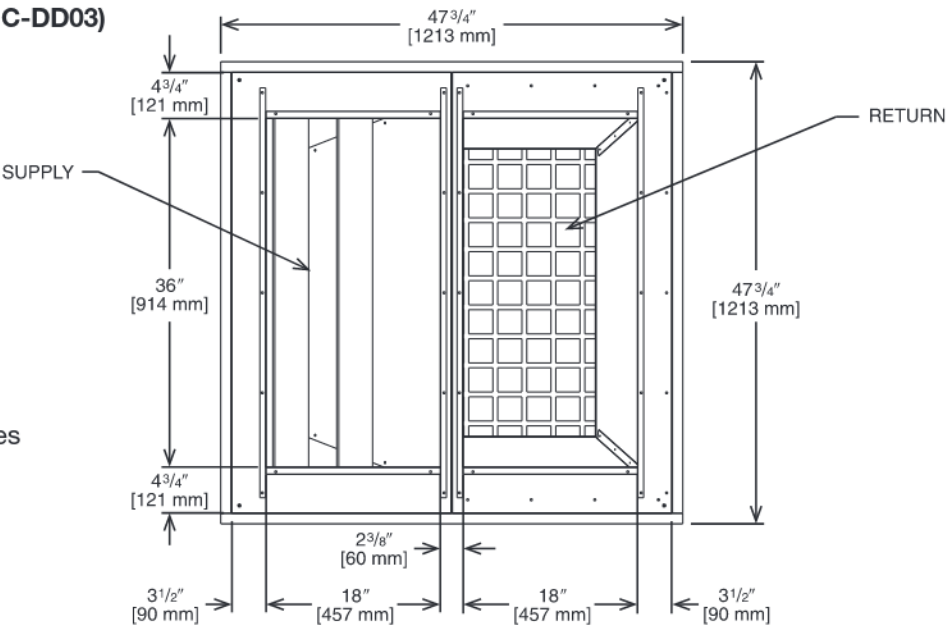


Illustration
ST-A1273-11-00

ENGINEERING DATA^①

Model No.	Flow Rate CFM [L/s]	Throw ^② ^③ Feet [m]	Neck Velocity fpm [m/s]	Noise Level ^④ (dB)
RXRN-AED3618	4400 [2068]	29-55 [8.8-16.8]	841 [4.3]	26
	4600 [2162]	31-57 [9.4-17.4]	875 [4.4]	28
	4800 [2256]	32-60 [9.8-18.3]	915 [4.6]	29
	5000 [2350]	33-62 [10.1-18.9]	951 [4.8]	30
	5200 [2444]	34-65 [10.4-19.8]	988 [5.1]	31
	5400 [2538]	36-67 [10.9-20.4]	1025 [5.2]	32

NOTES: ① All data is based on the air diffusion council guidelines.
② Throw data is based on 75 FPM Terminal Velocities using isothermal air.
③ Throw is based on diffuser blades being directed in a straight pattern.
④ Actual noise levels may vary due to duct design and do not include transmitted unit noise.
Adequate duct attenuation must be provided to reduce sound output from the unit.

[] Designates Metric Conversions

FLUSH MOUNT CONCENTRIC DIFFUSER—FLUSH

RXRX-AEF2000 (7.5 & 8.5 Ton [26.4 & 29.9 kW] Models)

For Use With Downflow Transition (RXMC-DD01)
20" [508 mm] Round Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

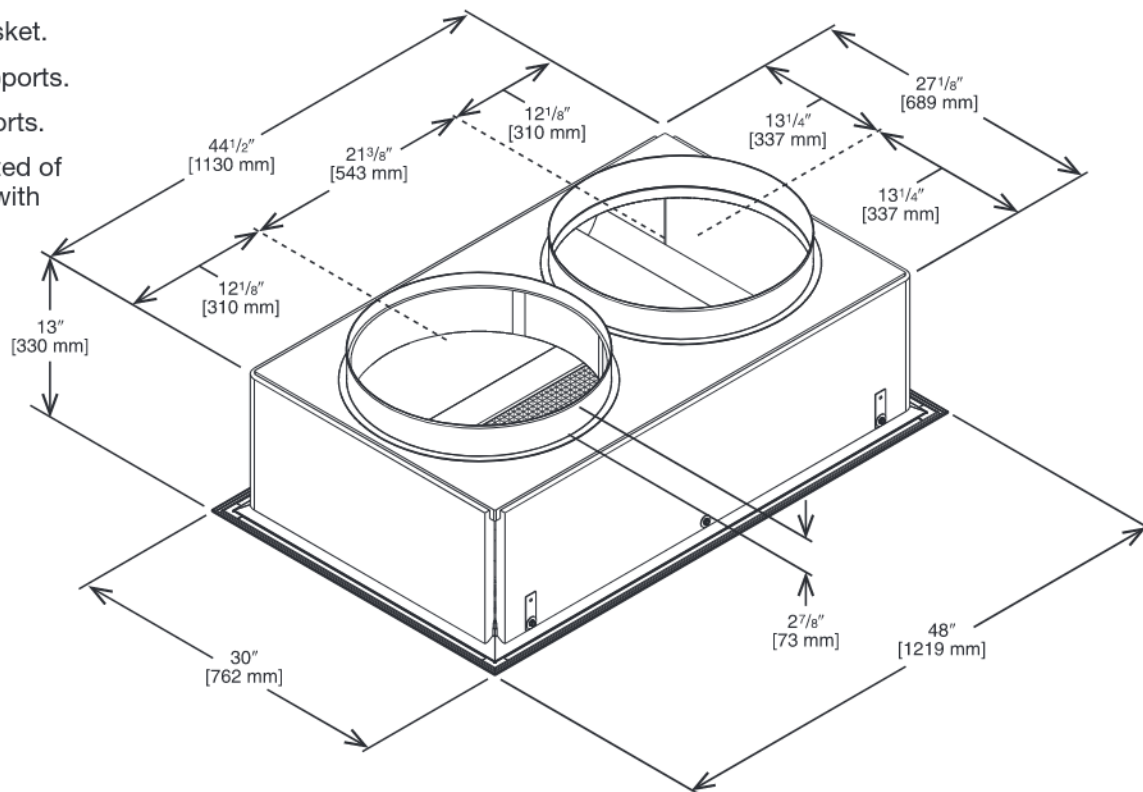


Illustration
ST-A1273-14-00

ENGINEERING DATA^①

Model No.	Flow Rate CFM [L/s]	Throw ^{② ③} Feet [m]	Neck Velocity fpm [m/s]	Noise Level ^④ (dbA)
RXRN-AEF2000	2600 [1222]	17-24 [5.2-7.3]	663 [3.4]	30
	2800 [1316]	18-28 [5.5-8.5]	714 [3.6]	35
	3000 [1410]	20-30 [6.1-9.1]	765 [3.9]	35
	3200 [1504]	22-33 [6.7-10.1]	816 [4.1]	40
	3400 [1598]	23-37 [7-11.3]	867 [4.4]	40
	3600 [1692]	25-38 [7.6-11.6]	918 [4.7]	43
	3800 [1786]	26-39 [7.9-11.9]	969 [4.9]	45
	4000 [1880]	27-40 [8.2-12.2]	1020 [5.2]	48

NOTES: ① All data is based on the air diffusion council guidelines.

② Throw data is based on 75 FPM Terminal Velocities using isothermal air.

③ Throw is based on diffuser blades being directed in a straight pattern.

④ Actual noise levels may vary due to duct design and do not include transmitted unit noise.
Adequate duct attenuation must be provided to reduce sound output from the unit.

[] Designates Metric Conversions

CONCENTRIC DIFFUSER – FLUSH 18" x 36" [457 x 914 mm]

RXRN-AEF3618 (12.5 & 15 Ton [44.0 & 52.8 kW] Models)

For Use With Downflow Transition (RXMC-DD03)

18" x 36" [457 x 914 mm]

Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

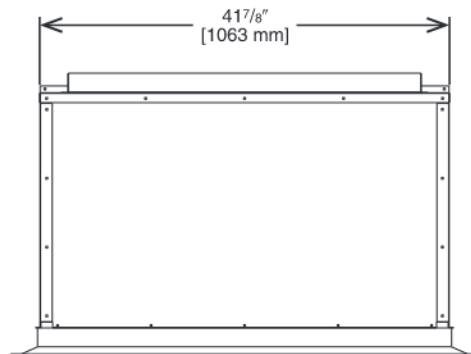
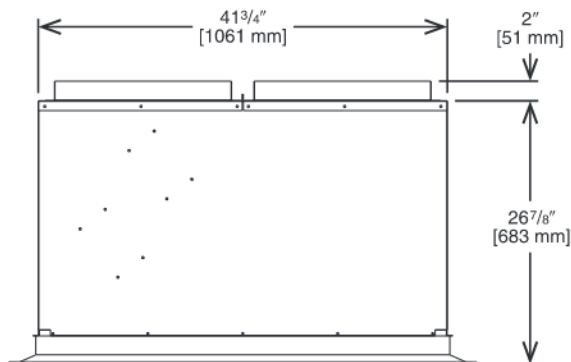
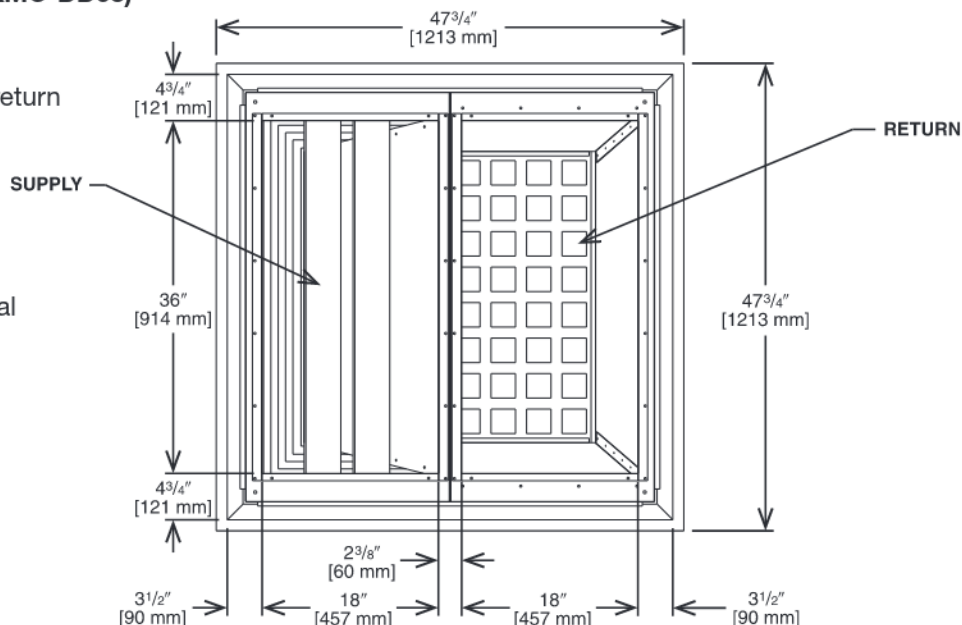


Illustration
ST-A1273-12-00

ENGINEERING DATA^①

Model No.	Flow Rate CFM [L/s]	Throw ^{② ③} Feet [m]	Neck Velocity fpm [m/s]	Noise Level ^④ (dbA)
RXRN-AEF3618	4400 [2068]	13-28 [4.1-8.5]	922 [47]	35
	4600 [2162]	14-30 [4.3-9.1]	962 [4.9]	37
	4800 [2256]	15-31 [4.6-9.4]	1002 [5.1]	39
	5000 [2350]	16-32 [4.9-9.8]	1043 [5.3]	40
	5200 [2444]	17-33 [5.2-10.1]	1083 [5.5]	42
	5400 [2538]	18-35 [5.5-10.7]	1123 [5.7]	43

NOTES: ① All data is based on the air diffusion council guidelines.

② Throw data is based on 75 FPM Terminal Velocities using isothermal air.

③ Throw is based on diffuser blades being directed in a straight pattern.

④ Actual noise levels may vary due to duct design and do not include transmitted unit noise.
Adequate duct attenuation must be provided to reduce sound output from the unit.

[] Designates Metric Conversions

Guide Specifications RGED — 090 - 150

You may copy this document directly into your building specification. This specification is written to comply with the 2016 version of the “master format” as published by the Construction Specification Institute. www.csinet.org.

GAS HEAT PACKAGED ROOFTOP

HVAC Guide Specifications

Size Range: 7 1/2 to 12 1/2 Nominal Tons

Section	Description
---------	-------------

23 06 80	Schedules for Decentralized HVAC Equipment
----------	--

23 06 80.13	Decentralized Unitary HVAC Equipment Schedule
-------------	---

23 06 80.13.A.	Rooftop unit schedule
----------------	-----------------------

1. Schedule is per the project specification requirements.

23 07 16	HVAC Equipment Insulation
----------	---------------------------

23 07 16.00.A.	Evaporator fan compartment:
----------------	-----------------------------

1. Interior cabinet surfaces shall be insulated with a minimum 1/2-in. thick, minimum 1.6 LB density, flexible fiberglass insulation bonded with foil face on the air side.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
3. Insulation shall also be mechanically fastened with welded pin and retainer washer.

23 07 16.00.B.	Gas heat compartment:
----------------	-----------------------

1. Aluminum foil-faced fiberglass insulation shall be used.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
3. Insulation shall also be mechanically fastened with welded pin and retainer washer.

23 09 13	Instrumentation and Control Devices for HVAC
----------	--

23 09 13.23	Sensors and Transmitters:
-------------	---------------------------

23 09 13.23.A.	Thermostats
----------------	-------------

1. Thermostat must
 - a. energize both “W” and “G” when calling for heat.
 - b. have capability to energize 2 different stages of cooling, and 2 different stages of heating.
 - c. must include capability for occupancy scheduling.

23 09 33	Electric and Electronic Control System for HVAC
----------	---

23 09 33.00.A.	General:
----------------	----------

1. Shall be complete with self-contained low-voltage control circuit protected by a fuse on the 24-V transformer side (090-150 units have a resettable circuit breaker).
2. Shall utilize color-coded wiring.
3. Unit shall include self-contained low-voltage control circuit protected by a fuse on the 24-V transformer side with a resettable circuit breaker.
4. The heat exchanger shall be controlled by the Core Command microprocessor. See heat exchanger section of this specification.
5. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.

23 09 33.00.B.	Safeties:
----------------	-----------

1. Compressor over-temperature, over current.
2. Low-pressure switch.
 - a. Units shall have low pressure, loss of charge automatic reset device that will shut off compressor when tripped.
3. High-pressure switch.
 - a. Unit shall be equipped with high pressure switch manual reset device that will shut off compressor when tripped.
4. Automatic reset, motor thermal overload protector.
5. Heating section shall be provided with the following minimum protections:
 - a. High-temperature limit switches.
 - b. Induced draft motor pressure switch.
 - c. Flame rollout switch.
 - d. Flame proving controls.

23 09 93 Sequence of Operations for HVAC Controls

23 09 93.00 INSERT SEQUENCE OF OPERATION

23 41 13 Panel Air Filters

23 41 13.00.A. Standard filter section shall

1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
2. Unit shall use only one filter size. Multiple sizes are not acceptable.
3. Filter face velocity shall not exceed 365 fpm at nominal airflows.
4. Filters shall be accessible through an access panel with "no-tool" removal as described in the unit cabinet section of the specification (23 81 19.13.H).

23 81 19 Self-Contained Air Conditioners

23 81 19.13 Small Capacity Self-Contained Air Conditioners

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and gas combustion for heating duty.
2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
3. Unit shall use environmentally safe, R410A refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1-2007 and 2013 minimum efficiency requirements.
2. 3 phase units are Energy Star qualified.
3. Unit shall be rated in accordance with AHRI Standards 340/360.
4. Unit shall be designed to conform to ASHRAE 15.
5. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
6. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
7. Unit casing shall be capable of withstanding 1000-hour salt spray exposure per ASTM B117 (scribed specimen).
8. Unit shall be designed in accordance with ISO 9001:2015, and shall be manufactured in a facility registered by ISO 9001:2015.
9. Roof curb shall be designed to conform to NRCA Standards.
10. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
11. Unit shall be designed in accordance with UL Standard 1995, Fifth Ed. including tested to withstand rain.
12. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.

23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Lifted by crane requires either shipping top panel or spreader bars.
3. Unit shall only be stored or positioned in the upright position.

23 81 19.13.E. Project Conditions

1. As specified in the contract.

23 81 19.13.F. Operating Characteristics

1. Unit shall be capable of starting and running at 115°F (46°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 or 360 at ± 10% voltage.
2. Compressor with standard controls shall be capable of operation down to 50°F (10°C), ambient outdoor temperatures. Low ambient accessory kit is necessary if mechanically cooling at ambient temperatures to 0°F (-17.7°C).
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.
5. Unit shall be field convertible from vertical to horizontal configuration.
6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.

23 81 19.13.G. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

23 81 19.13.H. Unit Cabinet

1. Unit cabinet shall be constructed of galvanized steel.
2. Unit cabinet exterior paint shall be: pre-painted steel.
3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 210 or 360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2-in. thick, 1.6 lb density, flexible fiberglass insulation, foil faced on the air side. Aluminum foil-faced fiberglass insulation shall be used in the gas heat compartment.
4. Base of unit shall have a location for thru-the-base gas and electrical connections standard.
5. Base Rail
 - a. Unit shall have base rails on a minimum of 4 sides.
 - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
 - c. Holes shall be provided in the base rail for moving the rooftop for fork truck.
 - d. Base rail shall be a minimum of 14 gauge thickness.
6. Condensate pan and connections:
 - a. Shall be a sloped condensate drain pan made of a non-corrosive material and be removable for cleaning.
 - b. Shall comply with ASHRAE Standard 62.
 - c. Shall use a 3/4" NPT drain connection, possible either through the bottom or side of the drain pan. Connection shall be made per manufacturer's recommendations.
 - d. Shall be able to be easily removed.
7. Top panel:
 - a. Shall be a single piece top panel over indoor section.
8. Gas Connections:
 - a. All gas piping connecting to unit gas valve shall enter the unit cabinet at a single location on side of unit (horizontal plane).
 - b. Thru-the-base capability
 - i. Standard unit shall have a thru-the-base gas-line location using a continuous raised, flange around opening in the basepan.
 - ii. No basepan penetration, other than those authorized by the manufacturer, is permitted.
9. Electrical Connections
 - a. All unit power wiring shall enter unit cabinet a a single, factory-prepared, continuous raised flange opening in the basepan.
 - b. Thru-the-base capability
 - i. Standard unit shall have a thru-the-base electrical location(s) using a raised, continuous raised flange opening in the basepan.
 - ii. No basepan penetration, other than those authorized by the manufacturer, is permitted.
10. Component access panels (standard)
 - a. Cabinet panels shall be easily opened for servicing.
 - b. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and filters shall have hinges with 1/4 turn fasteners.
 - c. 1/4 fasteners shall be permanently attached.

23 81 19.13.I. Gas Heat

1. General
 - a. Heat exchanger shall be an induced draft design. Positive pressure heat exchanger designs shall not be allowed.
 - b. Shall incorporate a direct-spark ignition system and redundant main gas valve.
 - c. Heat exchanger design shall allow combustion process condensate to gravity drain; maintenance to drain the gas heat exchanger shall not be required.
 - d. Gas supply pressure at the inlet to the rooftop unit gas valve must match that required by the manufacturer.
2. The heat exchanger shall be controlled by the Core Command microcompressor.
 - a. The Core Command board shall notify users of fault using two 7 segment displays.

3. Standard Heat Exchanger construction
 - a. Heat exchanger shall be of the tubular-section type constructed of a minimum of 20-gauge steel coated with a nominal 1.2 mil aluminum-silicone alloy for corrosion resistance.
 - b. Burners shall be of the in-shot type constructed of aluminum-coated steel.
 - c. Burners shall incorporate orifice for rated heat output up to 2,000 ft. (610m) elevation with a gas heating valve of 1050. Alternate orifices may be required depending on local gas heating valves and elevations.
 - d. Each heat exchanger tube shall contain tubulators for increased heating effectiveness.
4. Optional Stainless Steel Heat Exchanger construction
 - a. Use energy saving, direct-spark ignition system.
 - b. Use a redundant main gas valve.
 - c. Burners shall be of the in-shot type constructed of aluminum-coated steel.
 - d. All gas piping shall enter the unit cabinet at a single location on side of unit (horizontal plane).
 - e. The optional stainless steel heat exchanger shall be of the tubular-section type, constructed of a minimum of 20-gauge type 409 stainless steel.
 - f. Type 409 stainless steel shall be used in heat exchanger tubes.
 - g. Complete stainless steel heat exchanger allows for greater application flexibility.
5. Induced draft combustion motor and blower
 - a. Shall be a direct-drive, single inlet, forward-curved centrifugal type.
 - b. Shall be made from steel with a corrosion-resistant finish.
 - c. Shall be permanently lubricated sealed bearings.
 - d. Shall have inherent thermal overload protection.
 - e. Shall have an automatic reset feature.

23 81 19.13.J. Coils

1. Standard Aluminum/MicroChannel Coils:
 - a. Standard evaporator and condenser coils shall be aluminum.
 - b. Evaporator and condenser coils shall be leak tested to 150 psig, pressure tested to 400 psig, and qualified to UL 1995 burst test at 2,200 psi.

23 81 19.13.K. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:
 - a. TXV metering system shall prevent mal-distribution of two-phase refrigerant.
 - b. Refrigerant filter drier.
 - c. Service gauge connections on suction and discharge lines.
 - d. External pressure gauge ports access shall be located in front exterior of cabinet.
2. Compressors
 - a. Unit shall use one fully hermetic, 2- stage scroll compressor for each independent refrigeration circuit.
 - b. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
 - c. Compressors shall be internally protected from high discharge temperature conditions.
 - d. Compressors shall be protected from an over-temperature and over-amperage conditions by an internal, motor overload device.
 - e. Compressor shall be factory mounted on rubber grommets.
 - f. Compressor motors shall have internal line break thermal and current overload protection.
 - g. Crankcase heaters shall not be required for normal operating range.
 - h. Compressor shall have molded electrical plug.

23 81 19.13.L. Filter Section

1. Filters access is specified in the unit cabinet section of this specification.
2. Filters shall be held in place by filter tray, facilitating easy removal and installation.
3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
4. Filter face velocity shall not exceed 320 fpm at nominal airflows.
5. Filters shall be standard, commercially available sizes.
6. Only one size filter per unit is allowed.

23 81 19.13.M. Evaporator Fan and Motor

1. Evaporator fan motor:
 - a. Shall have permanently lubricated bearings
 - b. Shall have inherent automatic-reset thermal overload protection.
 - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
2. Belt-driven Evaporator Fan:
 - a. Belt drive shall include an adjustable-pitch motor pulley.
 - b. Shall use sealed, permanently lubricated ball-bearing type.
 - c. Blower fan shall be double-inlet type with forward-curved blades.
 - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

23 81 19.13.N. Condenser Fans and Motors

1. Condenser fan motors:
 - a. Shall be a totally enclosed motor.
 - b. Shall use permanently lubricated bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. Shall use a shaft-down design. Shaft-up designs including those with "rain-slinger devices" shall not be allowed.
2. Condenser Fans shall:
 - a. Shall be a direct-driven propeller type fan
 - b. Shall have aluminum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

23 81 19.13.O. Special Features

1. Integrated Economizers:
 - a. Integrated, gear-driven parallel modulating blade design type capable of simultaneous economizer and compressor operation.
 - b. Independent modules for vertical or horizontal return configurations shall be available. Vertical return modules shall be available as a factory installed option.
 - c. Damper blades shall be galvanized steel with metal gears. Plastic or composite blades on intake or return shall not be acceptable.
 - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
 - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - f. Shall be equipped with low-leakage dampers, not to exceed 2% leakage at 1 in. wg pressure differential.
 - g. Shall be capable of introducing up to 100% outdoor air.
 - h. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air.
 - i. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
 - j. Enthalpy sensor shall be provided as standard. Outdoor air sensor set point shall be adjustable and shall range from 40 to 100°F / 4 to 38°C. Additional sensor options shall be available as accessories.
 - k. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 70%, with a range of 0% to 100%.
 - l. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper set point.
 - m. Dampers shall be completely closed when the unit is in the unoccupied mode.
 - n. Economizer controller shall accept a 2-10Vdc CO2 sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor-air damper to provide ventilation based on the sensor input.
 - o. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 - p. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
 - q. Economizer wire harness will have provision for smoke detector.
2. Manual damper
 - a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 50% outdoor air for year round ventilation.

3. Liquid Propane (LP) Conversion Kit (sold separately)
 - a. Kit shall contain all the necessary hardware and instructions to convert a standard natural gas unit for use with liquefied propane, up to 2000 ft (610m) elevation.
4. Condenser Coil Hail Guard Assembly
 - a. Shall protect against damage from hail.
 - b. Shall be louvered style.
5. Unit-Mounted, Non-Fused Disconnect Switch:
 - a. Switch shall be factory-installed, internally mounted.
 - b. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
 - c. Shall be accessible from outside the unit.
 - d. Shall provide local shutdown and lockout capability.
6. Convenience Outlet:
 - a. Powered convenience outlet.
 - b. Outlet shall be powered from main line power to the rooftop unit.
 - c. Outlet shall be powered from line side or load side of disconnect by installing contractor, as required by code. If outlet is powered from load side of disconnect, unit electrical ratings shall be UL certified and rated for additional outlet amperage.
 - d. Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
 - e. Outlet shall include 15 amp GFI receptacles with independent fuse protection.
 - f. Voltage required to operate convenience outlet shall be provided by a factory-installed step-down transformer.
 - g. Outlet shall be accessible from outside the unit.
 - h. Non-Powered convenience outlet.
 - i. Outlet shall be powered from a separate 115-120v power source.
 - j. A transformer shall not be included.
 - k. Outlet shall be field-installed and internally mounted with easily accessible 115-v female receptacle.
 - l. Outlet shall include 15 amp GFI receptacle with independent fuse protection.
 - m. Outlet shall be accessible from outside the unit.
7. Flue Hood:
 - a. Flue discharge deflector shall direct unit exhaust vertically instead of horizontally.
8. Propeller Power Exhaust:
 - a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for vertical or horizontal return configurations shall be available.
 - c. Horizontal power exhaust is shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
9. Roof Curbs (Vertical):
 - a. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
 - b. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
10. Return Air Enthalpy Sensor:
 - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
11. Indoor Air Quality (CO2) Sensor:
 - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The set point shall have adjustment capability.

12. Smoke detectors:
 - a. Shall be a Four-Wire Controller and Detector.
 - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
 - c. Shall use magnet-activated test/reset sensor switches.
 - d. Shall have tool-less connection terminal access.
 - e. Shall have a recessed momentary switch for testing and resetting the detector.
 - f. Controller shall include:
 - i. One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel
 - ii. Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment
 - iii. One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station
 - iv. Capable of direct connection to two individual detector modules.
 - v. Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.
13. Barometric relief
 - a. Shall include damper, seals, hard-ware, and hoods to relieve excess building pressure.
 - b. Damper shall gravity-close upon shutdown.
14. Time Guard
 - a. Shall prevent compressor short cycling by providing a 5-minute delay (± 2 minutes) before restarting a compressor after shutdown for any reason.
 - b. One device shall be required per compressor.

BEFORE PURCHASING THIS APPLIANCE, READ IMPORTANT ENERGY COST AND EFFICIENCY INFORMATION AVAILABLE FROM YOUR RETAILER.

GENERAL TERMS OF LIMITED WARRANTY*

ClimateMaster will furnish a replacement for any part of this product which fails in normal use and service within the applicable periods stated, in accordance with the terms of the limited warranty.

***For complete details of the Limited and Conditional Warranties, including applicable terms and conditions, contact your local contractor or the Manufacturer for a copy of the product warranty certificate.**

Compressor	
3 Phase, Commercial Applications	Five (5) Years
Aluminized Heat Exchanger	
3 Phase, Commercial Applications	Ten (10) Years
Stainless Steel Heat Exchanger	
3 Phase, Commercial Applications	Twenty (20) Years
Parts	
3 Phase, Commercial Applications	One (1) Year

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.