

Genesis Ultra (GS) Series Submittal Data

Models GSH/V 015 - 070
60Hz - R22

English Language/I-P Units



Rev.: 22 May, 2009B



SUBMITTAL DATA - I-P UNITS

Unit Designation: _____

Job Name: _____

Architect: _____

Engineer: _____

Contractor: _____

PERFORMANCE DATA

Cooling Capacity: _____ Btuh

EER: _____

Heating Capacity: _____ Btuh

COP: _____

Ambient Air Temp: _____ °F

Entering Water Temp (Clg): _____ °F

Entering Air Temp (Clg): _____ °F

Entering Water Temp (Htg): _____ °F

Entering Air Temp (Htg): _____ °F

Airflow: _____ CFM

Fan Speed or Motor/RPM/Turns: _____

Operating Weight: _____ (lb)

ELECTRICAL DATA

Power Supply: _____ Volts _____ Phase _____ Hz

Minimum Circuit Ampacity: _____

Maximum Overcurrent Protection: _____

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com.



LC210

Rev.: 22 May, 2009B

Genesis Ultra (GS) Series Submittal Data

Models GSH/V 015 - 070
60Hz - R22

English Language/S-I Units



Rev.: 22 May, 2009B



SUBMITTAL DATA - S-I UNITS

Unit Designation: _____

Job Name: _____

Architect: _____

Engineer: _____

Contractor: _____

PERFORMANCE DATA

Cooling Capacity: _____ kW

EER: _____

Heating Capacity: _____ kW

COP: _____

Ambient Air Temp: _____ °C

Entering Water Temp (Clg): _____ °C

Entering Air Temp (Clg): _____ °C

Entering Water Temp (Htg): _____ °C

Entering Air Temp (Htg): _____ °C

Airflow: _____ l/s

Fan Speed or Motor/RPM/Turns: _____

Operating Weight: _____ (kg)

ELECTRICAL DATA

Power Supply: _____ Volts _____ Phase _____ Hz

Minimum Circuit Ampacity: _____

Maximum Overcurrent Protection: _____

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at climatemaster.com.



LC210

Rev.: 22 May, 2009B



Table of Contents

	*Page Number
Unit Features	4
Selection Procedure	5
GS Series Nomenclature	7
Performance Data - ARI/ASHRAE/ISO 13256-1	8
Performance Data Selection Notes	9
Performance Data - GS H/V/D 015	10
Performance Data - GS H/V/D 018	11
Performance Data - GS H/V/D 024	12
Performance Data - GS H/V/D 030	13
Performance Data - GS H/V/D 036	14
Performance Data - GS H/V/D 042	15
Performance Data - GS H/V/D 048	16
Performance Data - GS H/V/D 060	17
Performance Data - GS H/V/D 070	18
Performance Data Correction Tables	19
Blower Performance Data Standard Unit - No Reheat	20
Blower Performance Data Units With ClimaDry	21
Physical Data and Corner Weights	22 & 23
GS - Horizontal Dimensional Data	24 & 25
GS - Vertical Upflow Dimensional Data	26 & 27
GS - Vertical Downflow Dimensional Data	28 & 29
Electrical Data - Standard Units	30
Electrical Data - Units with Secondary Pump or ClimaDry Reheat	31
GS Series Wiring Diagram Matrix	32
Typical Wiring Diagram Single Phase GS Units With CXM Controller	33
Typical Wiring Diagram Single Phase GS Units With DXM Controller	34
Typical Wiring Diagram Three Phase 208/230V GS Units With CXM Controller	35
Typical Wiring Diagram Three Phase 208/230V GS Units With DXM Controller	36
Typical Wiring Diagram Three Phase 460/575V GS Units With CXM Controller	37
Typical Wiring Diagram Three Phase 460/575V GS Units With DXM Controller	38
Typical Wiring Diagram Three Phase 460/575V GS Units With CXM & LON Controller	39
Typical Wiring Diagram Three Phase 460/575V GS Units With DXM & LON Controller	40
Typical Wiring Diagram Three Phase 460/575V GS Units With CXM & MPC Controller	41
Typical Wiring Diagram Three Phase 460/575V GS Units With DXM & MPC Controller	42
Genesis Ultra (GS) Series 60Hz Engineering Specifications	43
Revision History	50

*Document page number is shown next to part number (e.g. LC210 - 3 = page 3). Since not all pages are typically used in the submittals process, the page number in the lower right corner can still be used (page ____ of ____).

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



THE GENESIS ULTRA (GS) SERIES

The GS series offers ultra high efficiency with advanced features, extremely quiet operation and application flexibility at competitive prices. As ClimateMaster's highest efficiency R-22 refrigerant units, the GS series, exceeds ASHRAE 90.1 efficiencies.

Available in sizes 1-1/4 ton (4.4 kW) through 6 tons (21.1 kW) with multiple cabinet options (vertical upflow, vertical downflow and horizontal) the GS series offers a wide range of units for most any installation. The GS has an extended range refrigerant circuit, capable of ground loop (geothermal) applications as well as water loop (boiler-tower) applications. Standard features are many. Microprocessor controls, galvanized steel cabinet, polyester powder coat paint and TXV refrigerant metering device are just some of the features of the flexible GS series.

ClimateMaster's exclusive double isolation compressor mounting system makes the GS series the quietest unit on the market. Compressors are mounted on vibration isolation springs to a heavy gauge mounting plate, which is then isolated from the cabinet base with rubber grommets for maximized vibration/sound attenuation. Options such ClimaDry™ Modulating Reheat e-coated air coil, DDC controls, internal pump and factory-installed water solenoid valves allow customized design solutions.

The GS Series water-source heat pumps are designed to meet the challenges of today's HVAC demands with a high efficiency, high value solution.

UNIT FEATURES

- Sizes 015 (1-1/4 ton, 4.4 kW) through 070 (6 tons, 21.1 kW)
- Copeland scroll compressors (rotary on sizes 015 and 018)
- Exceeds ASHRAE 90.1 efficiencies
- Galvanized steel construction with polyester powder coat paint
- Unique double isolation compressor mounting with vibration isolation springs for quiet operation
- Insulated divider and separate compressor/air handler compartments
- TXV metering device
- Extended range (20 to 120°F, -6.7 to 48.9°C) operation
- Microprocessor controls standard (optional DXM and/or DDC controls)
- LonWorks, BACnet, Modbus and Johnson N2 compatibility options for DDC controls
- Field convertible discharge air arrangement for horizontal units
- Factory-mounted hanger brackets for horizontal units
- Internally trapped condensate drain line (vertical units only)
- Flush securely-mounted corner post water connections (no backup wrench required)
- Unit Performance Sentinel performance monitoring system
- Eight Safeties Standard
- Wide variety of options including ClimaDry modulating reheat, e-coated air coils and internal pumps



Selection Procedure

Reference Calculations

Heating	Cooling	
$LWT = EWT - \frac{HE}{GPM \times 500}$	$LWT = EWT + \frac{HR}{GPM \times 500}$	$LC = TC - SC$
$LAT = EAT + \frac{HC}{CFM \times 1.08}$	$LAT (DB) = EAT (DB) - \frac{SC}{CFM \times 1.08}$	$S/T = \frac{SC}{TC}$

Legend and Glossary of Abbreviations

BTUH = BTU(British Thermal Unit) per hour	HWC = hot water generator (desuperheater) capacity, Mbtuh
CFM = airflow, cubic feet/minute	IPT = internal pipe thread
COP = coefficient of performance = BTUH output/BTUH input	KW = total power unit input, kilowatts
DB = dry bulb temperature (°F)	LAT = leaving air temperature, °F
EAT = entering air temperature, Fahrenheit (dry bulb/wet bulb)	LC = latent cooling capacity, BTUH
EER = energy efficiency ratio = BTUH output/Watt input	LWT = leaving water temperature, °F
EPT = external pipe thread	MBTUH = 1000 BTU per hour
ESP = external static pressure (inches w.g.)	S/T = sensible to total cooling ratio
EWT = entering water temperature	SC = sensible cooling capacity, BTUH
GPM = water flow in U.S. gallons/minute	TC = total cooling capacity, BTUH
HE = total heat of extraction, BTUH	WB = wet bulb temperature (°F)
HC = air heating capacity, BTUH	WPD = waterside pressure drop (psi & ft. of hd.)
HR = total heat of rejection, BTUH	

Conversion Table - to convert inch-pound (English) to SI (Metric)

Air Flow	Water Flow	Ext Static Pressure	Water Pressure Drop
Airflow (L/s) = CFM x 0.472	Water Flow (L/s) = gpm x 0.0631	ESP (Pa) = ESP (in of wg) x 249	PD (kPa) = PD (ft of hd) x 2.99



Selection Procedure

- Step 1 Determine the actual heating and cooling loads at the desired dry bulb and wet bulb conditions.
- Step 2 Obtain the following design parameters: Entering water temperature, water flow rate in GPM, air flow in CFM, water flow pressure drop and design wet and dry bulb temperatures. Air flow CFM should be between 300 and 450 CFM per ton. Unit water pressure drop should be kept as close as possible to each other to make water balancing easier. Go to the appropriate tables and find the proper indicated water flow and water temperature.
- Step 3 Select a unit based on total and sensible cooling conditions. Select a unit which is closest to, but no larger than, the actual cooling load.
- Step 4 Enter tables at the design water flow and water temperature. Read the total and sensible cooling capacities (Note: interpolation is permissible, extrapolation is not).
- Step 5 Read the heating capacity. If it exceeds the design criteria it is acceptable. It is quite normal for Water-Source Heat Pumps to be selected on cooling capacity only since the heating output is usually greater than the cooling capacity.
- Step 6 Determine the correction factors associated with the variable factors of dry bulb and wet bulb.

Corrected Total Cooling =
tabulated total cooling x wet bulb correction.
Corrected Sensible Cooling =
tabulated sensible cooling x wet/dry bulb correction.
- Step 7 Compare the corrected capacities to the load requirements. Normally if the capacities are within 10% of the loads, the equipment is acceptable. It is better to undersize than oversize, as undersizing improves humidity control, reduces sound levels and extends the life of the equipment.
- Step 8 When completed, calculate water temperature rise and assess the selection. If the units selected are not within 10% of the load calculations, then review what effect changing the GPM, water temperature and/or air flow and air temperature would have on the corrected capacities. If the desired capacity cannot be achieved, select the next larger or smaller unit and repeat the procedure. Remember, when in doubt, undersize slightly for best performance.

Example Equipment Selection For Cooling

Step 1 Load Determination:

Assume we have determined that the appropriate cooling load at the desired dry bulb 80°F and wet bulb 65°F conditions is as follows:

Total Cooling 23,100 BTUH
Sensible Cooling 17,500 BTUH
Entering Air Temp ... 80°F Dry Bulb / 65°F Wet Bulb

Step 2 Design Conditions:

Similarly, we have also obtained the following design parameters:

Entering Water Temp 90°F
Water Flow (Based upon 12°F rise in temp.) 4.5 GPM
Air Flow 700 CFM

Step 3, 4 & 5 HP Selection:

After making our preliminary selection (GSH024), we enter the tables at design water flow and water temperature and read Total Cooling, Sens. Cooling and Heat of Rej. capacities:

Total Cooling 24,900 BTUH
Sensible Cooling 17,800 BTUH
Heat of Rejection 31,400 BTUH

Step 6 & 7 Entering Air and Airflow Corrections:

Next, we determine our correction factors.

	<u>Table</u>	<u>Ent Air</u>	<u>Air Flow</u>	<u>Corrected</u>
Corrected Total Cooling =	24,900	x 0.940	x 0.957	= 22,400
Corrected Sens Cooling =	17,800	x 1.106	x 0.917	= 18,683
Corrected Heat of Reject =	31,400	x 0.949	x 0.964	= 28,726


Step 8 Water Temperature Rise Calculation & Assessment:

Actual Temperature Rise 12.8°F

When we compare the Corrected Total Cooling and Corrected Sensible Cooling figures with our load requirements stated in Step 1, we discover that our selection is within +/- 10% of our sensible load requirement. Furthermore, we see that our Corrected Total Cooling figure is slightly undersized, as recommended, when compared to the actual load



GS Series Nomenclature

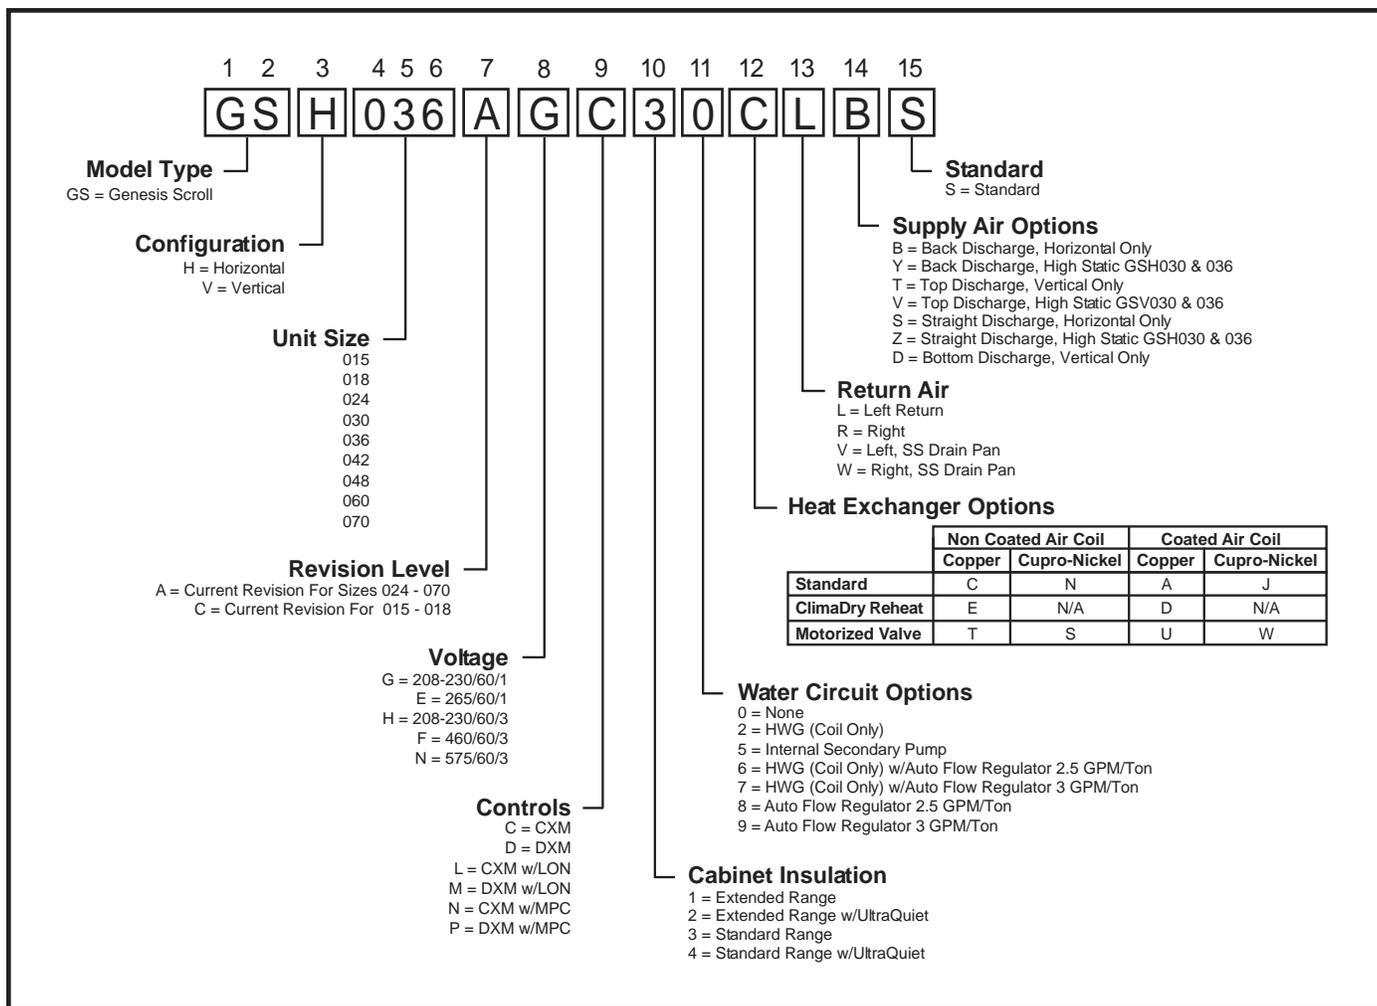

Rev.: 05 Nov, 2008B

GS Series 60Hz - R22 Submittal Data Eng/I-P



Performance Data ARI/ASHRAE/ISO 13256-1

ASHRAE/ARI/ISO 13256-1. English (IP) Units

Model	Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
	Cooling 86°F		Heating 68°F		Cooling 59°F		Heating 50°F		Cooling 77°F		Heating 32°F	
	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP
GSH/V015	14,100	16.0	16,300	5.3	15,600	23.9	12,900	4.1	14,900	18.5	11,200	3.8
GSH/V018	17,100	14.8	20,900	5.0	19,000	22.7	16,000	4.1	18,300	16.7	13,200	3.6
GSH/V024	24,200	14.9	31,000	4.8	26,500	21.2	23,500	4.0	26,000	17.1	19,200	3.6
GSH/V030	28,900	15.1	35,000	4.8	31,100	21.4	27,200	4.0	30,700	16.9	22,200	3.6
GSH/V036	33,800	14.9	40,400	4.6	36,000	20.7	32,900	4.0	35,800	16.4	26,700	3.4
GSH/V042	41,000	14.5	49,800	4.8	45,400	20.3	39,000	4.0	43,300	16.0	32,700	3.7
GSH/V048	45,800	14.6	54,100	4.9	49,000	19.9	43,300	4.0	48,900	16.4	36,900	3.7
GSH/V060	56,800	13.4	74,900	4.7	59,600	17.7	58,900	3.6	59,400	14.6	48,700	3.8
GSH/V070	63,700	12.4	78,300	4.5	70,000	16.8	62,900	3.8	67,100	13.4	53,400	3.6

Cooling capacities based upon 80.6°F DB, 66.2°F WB entering air temperature
 Heating capacities based upon 68°F DB, 59°F WB entering air temperature
 All air flow is rated on high speed
 All ratings based upon operation at lower voltage of dual voltage rated models

ASHRAE/ARI/ISO 13256-1. Metric (SI) Units

Model	Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
	Cooling 30°C		Heating 20°C		Cooling 15°C		Heating 10°C		Cooling 25°C		Heating 0°C	
	Capacity Watts	EER W/W	Capacity Watts	COP	Capacity Watts	EER W/W	Capacity Watts	COP	Capacity Watts	EER W/W	Capacity Watts	COP
GSH/V015	4,131	4.7	4,776	5.3	4,571	7.0	3,780	4.1	4,366	5.4	3,282	3.8
GSH/V018	5,010	4.3	6,124	5.0	5,567	6.7	4,688	4.1	5,362	4.9	3,868	3.6
GSH/V024	7,091	4.4	8,819	4.8	7,764	6.2	6,886	4.0	7,618	5.0	5,626	3.6
GSH/V030	8,468	4.4	10,255	4.8	9,112	6.3	7,790	4.0	8,995	5.0	6,505	3.6
GSH/V036	9,903	4.4	11,837	4.6	10,548	6.1	9,640	4.0	10,468	4.8	7,823	3.4
GSH/V042	12,013	4.2	14,591	4.8	13,302	5.9	11,423	4.0	12,687	4.7	9,581	3.7
GSH/V048	13,419	4.3	15,851	4.9	14,357	5.8	12,687	4.0	14,328	4.8	10,812	3.7
GSH/V060	16,642	3.9	21,946	4.7	17,463	5.2	17,258	3.6	17,409	4.3	14,269	3.8
GSH/V070	18,664	3.6	22,942	4.5	20,510	4.9	18,430	3.8	19,660	3.9	15,646	3.6

Cooling capacities based upon 27°C DB, 19°C WB entering air temperature
 Heating capacities based upon 20°C DB, 15°C WB entering air temperature
 All air flow is rated on high speed
 All ratings based upon operation at lower voltage of dual voltage rated models



Performance Data Selection Notes

For operation in the shaded area when water is used in lieu of an anti-freeze solution, the LWT (Leaving Water Temperature) must be calculated. Flow must be maintained to a level such that the LWT is maintained above 40°F [4.4°C] when the JW3 jumper is not clipped (see example below). This is due to the potential of the refrigerant temperature being as low as 32°F [0°C] with 40°F [4.4°C] LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.

Example:

At 50°F EWT (Entering Water Temperature) and 1.5 gpm/ton, a 3 ton unit has a HE of 22,500 Btuh. To calculate LWT, rearrange the formula for HE as follows:

HE = TD x GPM x 500, where HE = Heat of Extraction (Btuh); TD = temperature difference (EWT - LWT) and GPM = U.S. Gallons per Minute.

$$TD = HE / (GPM \times 500)$$

$$TD = 22,500 / (1.5 \times 500)$$

$$TD = 30^\circ\text{F}$$

$$LWT = EWT - TD$$

$$LWT = 50 - 20 = 30^\circ\text{F}$$

In this example, as long as the EWT does not fall below 50°F, the system will operate as designed. For EWTs below 50°F, higher flow rates will be required (open loop systems, for example, require at least 2 gpm/ton when EWT is below 50°F).

67°F			Heating - EAT 70°F				
kW	HR	EER	HC	kW	HE	LAT	COP
Recommended			9.2	0.84	6.4	87.1	3.21
0.56	19.9	31.0	10.1	0.86	7.2	88.7	3.45
0.53	19.9	33.0	10.6	0.87	7.6	89.6	3.57
0.53	20.0	33.6	10.8	0.87	7.8	90.0	3.63
0.61	19.5	27.7	11.6	0.88	8.6	91.5	3.85
0.57	19.6	30.3	12.2	0.89	9.1	92.6	4.00
0.55	19.7	31.4	12.5	0.90	9.4	93.1	4.08
0.61	19.1	24.1	13.2	0.91	10.1	94.5	4.18
0.57		26.8	13.9	0.91	10.8	95.8	4.30
0.55			14.3	0.92	11.1	97.0	4.42

GS Series 60Hz - R22 Submittal Data Eng/I-P



Performance Data GS H/V/D 015

500 CFM Nominal (Rated) Airflow

Performance capacities shown in thousands of Btuh

*WPD Adder for Motorized Valve, GS H/V/D 015 (Cv = 10.3, MOPD = 150 psi)			EWT °F	GPM	*WPD		Cooling - EAT 80/67°F					Heating - EAT 70°F					
					PSI	FT	TC	SC	Sens/Tot Ratio	kW	HR	EER	HC	kW	HE	LAT	COP
			20	3.8	1.3	3.1	Operation Not Recommended					9.2	0.84	6.4	87.1	3.21	
GPM	WPD Adder		30	1.8	0.3	0.8	17.3	12.2	0.71	0.56	19.9	31.0	10.1	0.86	7.2	88.7	3.45
	PSI	FT		2.8	0.8	1.8	17.5	12.2	0.70	0.53	19.9	33.0	10.6	0.87	7.6	89.6	3.57
	1.8	0.03		0.07	3.8	1.3	3.0	17.7	12.2	0.69	0.53	20.0	33.6	10.8	0.87	7.8	90.0
2.8	0.07	0.17	40	1.8	0.3	0.8	16.8	12.0	0.71	0.61	19.5	27.7	11.6	0.88	8.6	91.5	3.85
				2.8	0.7	1.7	17.2	12.2	0.71	0.57	19.6	30.3	12.2	0.89	9.1	92.6	4.00
				3.8	1.3	2.9	17.3	12.2	0.71	0.55	19.7	31.4	12.5	0.90	9.4	93.1	4.08
3.8	0.14	0.31	50	1.8	0.3	0.8	16.3	11.7	0.72	0.68	19.1	24.1	13.2	0.91	10.1	94.5	4.27
				2.8	0.7	1.7	16.7	11.9	0.72	0.62	19.2	26.8	13.9	0.91	10.8	95.8	4.46
				3.8	1.2	2.8	16.9	12.0	0.71	0.60	19.3	28.1	14.3	0.92	11.1	96.4	4.56
			60	1.8	0.3	0.7	15.7	11.3	0.72	0.76	18.5	20.6	14.9	0.92	11.7	97.5	4.71
				2.8	0.7	1.6	16.1	11.6	0.72	0.70	18.6	23.1	15.7	0.93	12.5	99.1	4.93
				3.8	1.2	2.7	16.3	11.7	0.72	0.67	18.6	24.4	16.1	0.94	12.9	99.9	5.05
			70	1.8	0.3	0.7	14.9	10.9	0.73	0.86	17.9	17.4	16.6	0.94	13.4	100.7	5.16
				2.8	0.7	1.5	15.5	11.2	0.72	0.79	18.0	19.6	17.5	0.95	14.3	102.5	5.41
				3.8	1.1	2.7	15.7	11.3	0.72	0.76	18.0	20.8	18.1	0.96	14.8	103.5	5.54
			80	1.8	0.3	0.7	14.2	10.6	0.75	0.97	17.6	14.7	18.3	0.96	15.0	103.9	5.60
				2.8	0.6	1.5	14.7	10.8	0.73	0.89	17.7	16.5	19.4	0.97	16.1	106.0	5.89
				3.8	1.1	2.6	15.0	10.9	0.73	0.85	17.7	17.5	20.0	0.97	16.7	107.1	6.04
			90	1.8	0.3	0.7	13.3	10.4	0.78	1.08	17.3	12.3	20.1	0.97	16.7	107.2	6.05
				2.8	0.6	1.4	13.9	10.5	0.76	1.00	17.4	13.9	21.3	0.98	18.0	109.5	6.36
				3.8	1.1	2.5	14.2	10.6	0.75	0.96	17.4	14.7	22.0	0.99	18.6	110.7	6.52
			100	1.8	0.3	0.6	12.3	10.2	0.83	1.19	16.9	10.3	Operation Not Recommended				
				2.8	0.6	1.4	13.0	10.3	0.79	1.12	16.9	11.6					
				3.8	1.0	2.4	13.3	10.4	0.78	1.08	16.9	12.3					
			110	1.8	0.3	0.6	11.3	10.1	0.89	1.31	16.5	8.6	Operation Not Recommended				
				2.8	0.6	1.3	12.0	10.2	0.85	1.24	16.4	9.7					
				3.8	1.0	2.3	12.3	10.2	0.83	1.20	16.3	10.3					

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 ARI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for ARI/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.

GS Series 60Hz - R22 Submittal Data Eng/I-P



Performance Data GS H/V/D 018

600 CFM Nominal (Rated) Airflow

Performance capacities shown in thousands of Btu/h

*WPD Adder for Motorized Valve, GS H/V/D 018 (Cv = 10.3, MOPD = 150 psi)			EWT °F	GPM	*WPD		Cooling - EAT 80/67°F					Heating - EAT 70°F					
					PSI	FT	TC	SC	Sens/ Tot Ratio	kW	HR	EER	HC	kW	HE	LAT	COP
			20	4.5	1.8	4.2	Operation Not Recommended					12.1	1.12	8.2	88.6	3.17	
GPM	WPD Adder		30	2.2	0.5	1.2	22.1	14.7	0.66	0.80	24.0	27.5	13.2	1.14	9.3	90.4	3.40
	PSI	FT		3.5	1.1	2.6	22.3	14.7	0.66	0.76	24.1	29.5	13.9	1.16	9.9	91.4	3.52
2.2	0.05	0.11		4.5	1.8	4.1	22.4	14.7	0.66	0.75	24.2	30.0	14.1	1.16	10.2	91.8	3.57
3.5	0.12	0.27	40	2.2	0.5	1.1	21.7	14.7	0.68	0.88	23.6	24.6	15.2	1.18	11.2	93.4	3.77
4.5	0.19	0.44		3.5	1.1	2.5	22.1	14.7	0.67	0.81	23.7	27.1	16.0	1.20	11.9	94.7	3.92
				4.5	1.7	3.9	22.2	14.7	0.66	0.79	23.8	27.9	16.4	1.21	12.2	95.2	3.98
			50	2.2	0.5	1.1	21.0	14.6	0.69	0.98	23.3	21.4	17.2	1.22	13.1	96.6	4.13
				3.5	1.1	2.5	21.6	14.7	0.68	0.90	23.3	24.0	18.2	1.24	14.0	98.1	4.31
				4.5	1.7	3.8	21.7	14.7	0.68	0.87	23.3	25.0	18.6	1.25	14.4	98.8	4.38
			60	2.2	0.5	1.0	20.2	14.3	0.71	1.09	23.2	18.4	19.3	1.26	15.0	99.9	4.49
				3.5	1.0	2.4	20.9	14.5	0.70	1.00	23.2	20.9	20.5	1.28	16.1	101.6	4.69
				4.5	1.6	3.7	21.1	14.6	0.69	0.97	23.2	21.8	21.0	1.29	16.6	102.4	4.77
			70	2.2	0.4	1.0	19.3	13.9	0.72	1.22	23.0	15.8	21.5	1.30	17.0	103.1	4.84
				3.5	1.0	2.3	20.0	14.2	0.71	1.12	23.1	17.9	22.8	1.32	18.3	105.2	5.06
				4.5	1.5	3.6	20.3	14.3	0.71	1.08	23.1	18.8	23.4	1.33	18.8	106.0	5.14
			80	2.2	0.4	1.0	18.3	13.5	0.74	1.36	22.6	13.5	23.6	1.34	19.1	106.5	5.18
				3.5	1.0	2.2	19.1	13.8	0.73	1.25	22.6	15.3	25.1	1.36	20.5	108.8	5.41
				4.5	1.5	3.5	19.4	14.0	0.72	1.21	22.5	16.0	25.7	1.37	21.1	109.7	5.51
			90	2.2	0.4	0.9	17.2	12.9	0.75	1.49	22.1	11.5	25.8	1.37	21.1	109.8	5.51
				3.5	0.9	2.1	18.0	13.3	0.74	1.39	22.1	13.0	27.4	1.40	22.6	112.3	5.76
				4.5	1.4	3.3	18.3	13.5	0.74	1.35	22.0	13.6	28.1	1.40	23.3	113.3	5.85
			100	2.2	0.4	0.9	16.1	12.2	0.76	1.63	21.5	9.8	Operation Not Recommended				
				3.5	0.9	2.1	16.9	12.7	0.75	1.53	21.4	11.0					
				4.5	1.4	3.2	17.2	12.9	0.75	1.49	21.3	11.6					
			110	2.2	0.4	0.9	14.9	11.5	0.77	1.77	20.9	8.4					
				3.5	0.9	2.0	15.7	12.0	0.76	1.67	20.8	9.4					
				4.5	1.3	3.1	16.1	12.2	0.76	1.63	20.7	9.8					

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 ARI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for ARI/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.

GS Series 60Hz - R22 Submittal Data Eng/I-P



Performance Data GS H/V/D 024

800 CFM Nominal (Rated) Airflow

Performance capacities shown in thousands of Btuh

*WPD Adder for Motorized Valve, GS H/V/D 024 (Cv = 10.3, MOPD = 150 psi)			EWT °F	GPM	*WPD		Cooling - EAT 80/67°F					Heating - EAT 70°F					
					PSI	FT	TC	SC	Sens/Tot Ratio	kW	HR	EER	HC	kW	HE	LAT	COP
			20	6.0	1.7	3.9	Operation Not Recommended					16.2	1.59	10.8	88.7	2.99	
GPM	WPD Adder		30	3.0	0.4	0.9	30.6	21.2	0.69	0.94	33.8	32.6	19.2	1.65	13.6	92.3	3.42
	PSI	FT		4.5	0.9	2.1	30.9	21.2	0.69	0.91	34.0	34.1	19.4	1.65	13.7	92.4	3.44
3.0	0.08	0.20		6.0	1.6	3.8	31.1	21.2	0.68	0.87	34.1	35.6	19.5	1.65	13.9	92.6	3.47
4.5	0.19	0.44	40	3.0	0.4	0.9	29.7	20.6	0.69	1.12	33.5	26.5	21.9	1.70	16.1	95.3	3.77
				4.5	0.9	2.1	30.0	20.6	0.69	1.08	33.7	27.8	22.2	1.71	16.3	95.6	3.80
6.0	0.34	0.78	40	6.0	1.6	3.7	30.2	20.6	0.68	1.04	33.8	29.2	22.5	1.72	16.6	96.0	3.83
				50	3.0	0.4	0.9	28.8	20.0	0.69	1.31	33.3	22.0	24.5	1.75	18.5	98.3
4.5	0.19	0.44	50		4.5	0.9	2.0	29.1	20.0	0.69	1.25	33.3	23.2	24.9	1.77	18.9	98.9
				6.0	1.6	3.6	29.3	20.0	0.68	1.20	33.4	24.4	25.4	1.79	19.3	99.4	4.16
3.0	0.08	0.20	60	3.0	0.4	0.9	27.5	19.6	0.71	1.46	32.4	18.8	27.1	1.82	20.9	101.4	4.38
				4.5	0.8	1.9	27.7	19.6	0.71	1.39	32.4	19.9	27.9	1.84	21.6	102.3	4.44
4.5	0.19	0.44	60	6.0	1.5	3.5	28.0	19.7	0.70	1.32	32.5	21.2	28.7	1.87	22.3	103.2	4.49
				70	3.0	0.4	0.8	26.1	19.3	0.74	1.61	31.6	16.2	29.7	1.88	23.3	104.4
6.0	0.34	0.78	70		4.5	0.8	1.9	26.3	19.3	0.73	1.53	31.6	17.3	30.8	1.92	24.3	105.7
				6.0	1.5	3.4	26.6	19.4	0.73	1.44	31.5	18.4	32.0	1.95	25.3	107.0	4.80
3.0	0.08	0.20	80	3.0	0.3	0.8	25.4	18.5	0.73	1.81	31.6	14.0	32.4	1.95	25.7	107.4	4.87
				4.5	0.8	1.8	25.6	18.6	0.72	1.72	31.5	14.9	33.6	1.99	26.8	108.9	4.96
4.5	0.19	0.44	80	6.0	1.4	3.2	25.9	18.6	0.72	1.62	31.4	15.9	34.9	2.03	28.0	110.4	5.04
				90	3.0	0.3	0.8	24.7	17.7	0.72	2.01	31.6	12.3	35.0	2.01	28.1	110.5
6.0	0.34	0.78	90		4.5	0.8	1.7	24.9	17.8	0.71	1.91	31.4	13.1	36.4	2.06	29.4	112.1
				6.0	1.4	3.1	25.2	17.9	0.71	1.80	31.3	14.0	37.8	2.11	30.6	113.8	5.25
3.0	0.08	0.20	100	3.0	0.3	0.7	23.3	17.2	0.74	2.26	31.0	10.3	Operation Not Recommended				
				4.5	0.7	1.7	23.6	17.3	0.73	2.14	30.9	11.0					
6.0	1.3	3.0	23.8	17.3	0.73	2.02	30.7	11.8									
4.5	0.19	0.44	110	3.0	0.3	0.7	22.0	16.7	0.76	2.50	30.5	8.8	Operation Not Recommended				
				4.5	0.7	1.6	22.2	16.7	0.75	2.37	30.3	9.3					
6.0	1.3	2.9	22.4	16.8	0.75	2.24	30.0	10.0									

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 ARI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for ARI/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.

GS Series 60Hz - R22 Submittal Data Eng/I-P



Performance Data GS H/V/D 030

1000 CFM Nominal (Rated) Airflow

Performance capacities shown in thousands of Btu/h

*WPD Adder for Motorized Valve, GS H/V/D 030 (Cv = 10.3, MOPD = 150 psi)			EWT °F	GPM	*WPD		Cooling - EAT 80/67°F					Heating - EAT 70°F					
					PSI	FT	TC	SC	Sens/ Tot Ratio	kW	HR	EER	HC	kW	HE	LAT	COP
			20	7.5	2.7	6.2	Operation Not Recommended					18.6	1.88	12.2	87.2	2.91	
GPM	WPD Adder		30	3.7	0.6	1.4	35.8	24.4	0.68	1.22	39.9	29.2	20.7	1.92	14.1	89.1	3.15
	PSI	FT		5.5	1.4	3.2	35.9	24.3	0.68	1.18	40.0	30.5	21.6	1.92	15.1	90.0	3.30
3.7	0.13	0.30		7.5	2.6	6.0	36.1	24.1	0.67	1.14	40.0	31.8	22.6	1.92	16.1	90.9	3.45
5.5	0.29	0.66	40	3.7	0.6	1.4	34.7	24.2	0.70	1.41	39.5	24.6	24.1	1.98	17.4	92.4	3.58
7.5	0.53	1.22		5.5	1.3	3.1	34.8	24.0	0.69	1.36	39.5	25.6	24.9	1.98	18.2	93.1	3.68
				7.5	2.5	5.8	35.0	23.9	0.68	1.31	39.5	26.8	25.7	1.99	18.9	93.8	3.79
			50	3.7	0.6	1.3	33.6	23.9	0.71	1.60	39.1	21.0	27.6	2.03	20.7	95.6	3.99
				5.5	1.3	3.0	33.8	23.8	0.71	1.54	39.0	22.0	28.2	2.05	21.2	96.1	4.04
				7.5	2.4	5.6	33.9	23.8	0.70	1.48	39.0	23.0	28.8	2.06	21.8	96.6	4.09
			60	3.7	0.6	1.3	32.5	23.2	0.71	1.73	38.4	18.7	31.1	2.09	24.0	98.8	4.37
				5.5	1.3	2.9	32.6	23.1	0.71	1.66	38.3	19.7	32.0	2.11	24.8	99.6	4.45
				7.5	2.4	5.4	32.8	23.1	0.70	1.58	38.2	20.7	32.9	2.13	25.6	100.4	4.52
			70	3.7	0.5	1.3	31.3	22.4	0.72	1.87	37.7	16.8	34.6	2.14	27.3	102.0	4.73
				5.5	1.2	2.8	31.5	22.5	0.71	1.78	37.6	17.7	35.8	2.17	28.4	103.1	4.83
				7.5	2.3	5.3	31.7	22.5	0.71	1.69	37.5	18.8	37.0	2.20	29.5	104.2	4.92
			80	3.7	0.5	1.2	30.2	22.4	0.74	2.08	37.3	14.5	38.0	2.22	30.5	105.2	5.02
				5.5	1.2	2.7	30.4	22.4	0.74	1.98	37.2	15.4	39.1	2.25	31.4	106.2	5.10
				7.5	2.2	5.1	30.6	22.5	0.73	1.89	37.1	16.3	40.2	2.28	32.4	107.2	5.17
			90	3.7	0.5	1.2	29.2	22.4	0.77	2.30	37.0	12.7	41.5	2.30	33.7	108.4	5.29
				5.5	1.1	2.6	29.4	22.4	0.76	2.19	36.8	13.4	42.5	2.33	34.5	109.3	5.34
				7.5	2.1	4.9	29.6	22.5	0.76	2.08	36.7	14.2	43.5	2.36	35.4	110.3	5.40
			100	3.7	0.5	1.1	27.5	21.2	0.77	2.49	36.0	11.0	Operation Not Recommended				
				5.5	1.1	2.5	27.7	21.3	0.77	2.38	35.8	11.7					
				7.5	2.0	4.7	27.9	21.3	0.76	2.26	35.6	12.3					
			110	3.7	0.5	1.1	25.8	20.1	0.78	2.69	35.0	9.6					
				5.5	1.1	2.4	26.0	20.1	0.77	2.57	34.8	10.1					
				7.5	2.0	4.5	26.2	20.2	0.77	2.44	34.5	10.7					

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 ARI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for ARI/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.

GS Series 60Hz - R22 Submittal Data Eng/I-P



Performance Data GS H/V/D 036

1150 CFM Nominal (Rated) Airflow

Performance capacities shown in thousands of Btuh

*WPD Adder for Motorized Valve, GS H/V/D 036 (Cv = 10.3, MOPD = 150 psi)			EWT °F	GPM	*WPD		Cooling - EAT 80/67°F					Heating - EAT 70°F					
					PSI	FT	TC	SC	Sens/Tot Ratio	kW	HR	EER	HC	kW	HE	LAT	COP
			20	9.0	4.9	11.2	Operation Not Recommended					22.9	2.23	15.3	88.4	3.01	
GPM	WPD Adder		30	4.5	1.6	3.7	40.2	29.2	0.73	1.38	44.9	29.0	25.9	2.30	18.1	90.9	3.30
	PSI	FT		7.0	3.2	7.3	41.0	29.5	0.72	1.33	45.5	30.9	26.3	2.31	18.4	91.1	3.33
4.5	0.19	0.44		9.0	4.7	10.9	41.9	29.8	0.71	1.27	46.2	32.9	26.6	2.32	18.7	91.4	3.36
			40	4.5	1.5	3.5	38.9	28.5	0.73	1.60	44.4	24.4	29.6	2.40	21.4	93.8	3.61
7.0	0.46	1.07		7.0	3.1	7.1	39.8	28.8	0.72	1.54	45.0	25.9	29.9	2.40	21.7	94.1	3.65
				9.0	4.6	10.6	40.6	29.0	0.72	1.48	45.6	27.5	30.3	2.41	22.1	94.4	3.69
			50	4.5	1.5	3.4	37.7	27.9	0.74	1.81	43.9	20.8	33.2	2.50	24.7	96.7	3.89
				7.0	3.0	6.9	38.5	28.1	0.73	1.75	44.5	22.1	33.6	2.50	25.1	97.1	3.95
				9.0	4.4	10.2	39.3	28.3	0.72	1.68	45.0	23.4	34.0	2.49	25.5	97.4	4.00
			60	4.5	1.4	3.3	36.6	28.0	0.77	1.98	43.4	18.5	36.9	2.57	28.1	99.7	4.20
				7.0	2.9	6.7	37.4	28.1	0.75	1.91	43.9	19.6	37.5	2.58	28.7	100.2	4.26
				9.0	4.3	9.9	38.2	28.3	0.74	1.85	44.5	20.7	38.2	2.59	29.3	100.7	4.32
			70	4.5	1.4	3.2	35.5	28.1	0.79	2.15	42.8	16.5	40.5	2.64	31.5	102.6	4.50
				7.0	2.8	6.5	36.3	28.2	0.78	2.08	43.4	17.5	41.4	2.67	32.3	103.3	4.55
				9.0	4.1	9.6	37.1	28.2	0.76	2.01	44.0	18.5	42.3	2.69	33.1	104.1	4.61
			80	4.5	1.3	3.1	34.2	27.1	0.79	2.39	42.3	14.3	44.2	2.71	34.9	105.5	4.77
				7.0	2.7	6.2	35.0	27.2	0.78	2.31	42.9	15.2	45.0	2.75	35.7	106.3	4.80
				9.0	4.0	9.3	35.8	27.2	0.76	2.23	43.4	16.0	45.9	2.79	36.4	107.0	4.83
			90	4.5	1.3	3.0	32.9	26.1	0.79	2.62	41.9	12.6	47.8	2.78	38.3	108.5	5.04
				7.0	2.6	6.0	33.7	26.2	0.78	2.54	42.3	13.3	48.7	2.83	39.0	109.2	5.04
				9.0	3.9	8.9	34.4	26.2	0.76	2.45	42.8	14.0	49.5	2.88	39.7	109.9	5.04
			100	4.5	1.3	2.9	30.9	26.2	0.85	2.94	40.9	10.5	Operation Not Recommended				
				7.0	2.5	5.8	31.6	26.3	0.83	2.85	41.3	11.1					
			9.0	3.7	8.6	32.3	26.3	0.82	2.75	41.6	11.7						
			110	4.5	1.2	2.8	28.8	26.4	0.92	3.26	39.9	8.8	Operation Not Recommended				
				7.0	2.4	5.6	29.5	26.4	0.90	3.16	40.2	9.3					
			9.0	3.6	8.3	30.1	26.5	0.88	3.05	40.5	9.9						

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 ARI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for ARI/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas..

GS Series 60Hz - R22 Submittal Data Eng/I-P



Performance Data GS H/V/D 042

1400 CFM Nominal (Rated) Airflow

Performance capacities shown in thousands of Btu/h

*WPD Adder for Motorized Valve, GS H/V/D 042 (Cv = 10.3, MOPD = 150 psi)			EWT °F	GPM	*WPD		Cooling - EAT 80/67°F					Heating - EAT 70°F					
					PSI	FT	TC	SC	Sens/ Tot Ratio	kW	HR	EER	HC	kW	HE	LAT	COP
			20	10.5	6.2	14.3	Operation Not Recommended					27.2	2.60	18.4	88.0	3.08	
GPM	WPD Adder		30	5.2	2.0	4.6	51.7	36.7	0.71	1.73	57.6	29.9	31.3	2.65	22.3	90.7	3.47
	PSI	FT		9.0	4.7	10.9	52.1	36.8	0.71	1.68	57.9	31.1	31.9	2.67	22.8	91.1	3.51
	5.2	0.25		0.59	10.5	6.0	13.9	52.6	36.9	0.70	1.63	58.2	32.4	32.5	2.68	23.3	91.5
9.0	0.76	1.76	40	5.2	1.9	4.5	49.7	35.7	0.72	2.01	56.5	24.7	35.9	2.73	26.6	93.7	3.85
10.5	1.04	2.40		9.0	4.6	10.6	50.1	35.8	0.71	1.94	56.7	25.8	36.9	2.77	27.4	94.4	3.91
				10.5	5.8	13.5	50.5	35.9	0.71	1.88	57.0	26.9	37.8	2.80	28.3	95.0	3.96
			50	5.2	1.9	4.3	47.7	34.7	0.73	2.29	55.5	20.8	40.4	2.82	30.8	96.7	4.21
				9.0	4.4	10.2	48.1	34.8	0.72	2.21	55.6	21.8	41.8	2.87	32.0	97.7	4.27
				10.5	5.6	13.0	48.5	34.9	0.72	2.13	55.8	22.8	43.2	2.92	33.2	98.6	4.34
			60	5.2	1.8	4.2	46.3	33.8	0.73	2.52	54.9	18.3	45.0	2.90	35.1	99.7	4.55
				9.0	4.3	9.9	46.6	33.9	0.73	2.42	54.9	19.3	46.4	2.94	36.3	100.7	4.62
				10.5	5.5	12.6	47.0	34.1	0.72	2.31	54.9	20.3	47.8	2.99	37.6	101.6	4.68
			70	5.2	1.8	4.0	44.8	32.9	0.73	2.75	54.2	16.3	49.5	2.98	39.4	102.8	4.87
				9.0	4.1	9.6	45.2	33.1	0.73	2.63	54.1	17.2	50.9	3.02	40.6	103.7	4.94
				10.5	5.3	12.2	45.5	33.2	0.73	2.50	54.0	18.2	52.3	3.07	41.9	104.6	5.00
			80	5.2	1.7	3.9	42.5	31.9	0.75	3.06	53.0	13.9	54.1	3.06	43.6	105.8	5.17
				9.0	4.0	9.3	42.9	32.0	0.75	2.92	52.8	14.7	55.7	3.13	45.1	106.9	5.23
				10.5	5.1	11.8	43.2	32.2	0.74	2.78	52.7	15.6	57.4	3.19	46.5	108.0	5.28
			90	5.2	1.6	3.8	40.3	30.8	0.76	3.37	51.8	12.0	58.6	3.15	47.9	108.8	5.46
				9.0	3.9	8.9	40.6	31.0	0.76	3.21	51.6	12.7	60.5	3.23	49.5	110.0	5.50
				10.5	4.9	11.4	40.9	31.1	0.76	3.06	51.4	13.4	62.5	3.31	51.2	111.3	5.53
			100	5.2	1.6	3.6	38.3	30.2	0.79	3.76	51.1	10.2	Operation Not Recommended				
				9.0	3.7	8.6	38.6	30.3	0.79	3.59	50.8	10.8					
				10.5	4.7	11.0	38.9	30.5	0.78	3.42	50.6	11.4					
			110	5.2	1.5	3.5	36.3	29.6	0.81	4.16	50.5	8.7	Operation Not Recommended				
				9.0	3.6	8.3	36.6	29.7	0.81	3.97	50.1	9.2					
				10.5	4.6	10.5	36.9	29.9	0.81	3.78	49.8	9.8					

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 ARI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for ARI/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.

GS Series 60Hz - R22 Submittal Data Eng/I-P



Performance Data GS H/V/D 048

1600 CFM Nominal (Rated) Airflow

Performance capacities shown in thousands of Btuh

*WPD Adder for Motorized Valve, GS H/V/D 048 (Cv = 10.3, MOPD = 150 psi)			EWT °F	GPM	*WPD		Cooling - EAT 80/67°F					Heating - EAT 70°F					
					PSI	FT	TC	SC	Sens/Tot Ratio	kW	HR	EER	HC	kW	HE	LAT	COP
			20	12.0	7.6	17.6	Operation Not Recommended					31.4	2.95	21.3	88.2	3.12	
GPM	WPD Adder		30	6.0	2.5	5.8	55.5	38.9	0.70	2.00	62.3	27.7	35.7	2.98	25.5	90.7	3.51
	PSI	FT		9.0	4.7	10.9	55.9	38.7	0.69	1.93	62.5	29.0	36.3	3.01	26.0	91.0	3.53
6.0	0.34	0.78		12.0	7.4	17.1	56.4	38.5	0.68	1.85	62.7	30.5	36.9	3.04	26.5	91.4	3.56
9.0	0.76	1.76	40	6.0	2.4	5.6	53.9	38.2	0.71	2.30	61.7	23.5	40.2	3.07	29.7	93.3	3.84
12.0	1.36	3.14		9.0	4.6	10.6	54.3	38.0	0.70	2.21	61.8	24.6	41.0	3.09	30.5	93.7	3.90
				12.0	7.2	16.6	54.7	37.8	0.69	2.12	61.9	25.8	41.9	3.11	31.3	94.2	3.95
			50	6.0	2.3	5.4	52.3	37.5	0.72	2.59	61.1	20.2	44.7	3.15	33.9	95.9	4.15
				9.0	4.4	10.2	52.7	37.3	0.71	2.49	61.2	21.1	45.8	3.16	35.0	96.5	4.24
				12.0	7.0	16.1	53.0	37.1	0.70	2.40	61.2	22.1	46.8	3.17	36.0	97.1	4.33
			60	6.0	2.3	5.2	51.3	37.2	0.72	2.83	61.0	18.1	48.7	3.24	37.6	98.2	4.40
				9.0	4.3	9.9	51.6	37.0	0.72	2.73	60.9	18.9	50.3	3.25	39.2	99.1	4.53
				12.0	6.7	15.6	52.0	36.9	0.71	2.62	60.9	19.8	52.0	3.27	40.8	100.1	4.66
			70	6.0	2.2	5.1	50.3	36.9	0.73	3.07	60.8	16.4	52.6	3.32	41.3	100.5	4.64
				9.0	4.1	9.6	50.6	36.8	0.73	2.96	60.7	17.1	54.9	3.35	43.5	101.8	4.81
				12.0	6.5	15.1	50.9	36.6	0.72	2.85	60.6	17.9	57.1	3.37	45.6	103.0	4.97
			80	6.0	2.1	4.9	48.4	36.0	0.74	3.39	60.0	14.3	56.6	3.41	45.0	102.8	4.87
				9.0	4.0	9.3	48.7	35.8	0.74	3.26	59.8	14.9	58.6	3.43	47.0	103.9	5.02
				12.0	6.3	14.6	49.0	35.7	0.73	3.14	59.7	15.6	60.7	3.44	48.9	105.1	5.16
			90	6.0	2.0	4.7	46.5	35.0	0.75	3.71	59.2	12.6	60.6	3.49	48.7	105.1	5.08
				9.0	3.9	8.9	46.8	34.9	0.75	3.57	59.0	13.1	62.4	3.51	50.4	106.1	5.22
				12.0	6.1	14.0	47.1	34.8	0.74	3.43	58.8	13.7	64.2	3.52	52.2	107.2	5.35
			100	6.0	2.0	4.5	44.8	34.6	0.77	4.14	59.0	10.8	Operation Not Recommended				
				9.0	3.7	8.6	45.1	34.5	0.77	3.99	58.7	11.3					
				12.0	5.9	13.5	45.4	34.4	0.76	3.84	58.4	11.8					
			110	6.0	1.9	4.4	43.1	34.2	0.79	4.58	58.7	9.4	Operation Not Recommended				
				9.0	3.6	8.3	43.4	34.1	0.79	4.41	58.4	9.8					
				12.0	5.6	13.0	43.6	34.0	0.78	4.24	58.1	10.3					

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 ARI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for ARI/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.

GS Series 60Hz - R22 Submittal Data Eng/I-P



Performance Data GS H/V/D 060

2000 CFM Nominal (Rated) Airflow

Performance capacities shown in thousands of Btuh

*WPD Adder for Motorized Valve, GS H/V/D 060 (Cv = 8.9, MOPD = 150 psi)			EWT °F	GPM	*WPD		Cooling - EAT 80/67°F					Heating - EAT 70°F					
					PSI	FT	TC	SC	Sens/ Tot Ratio	kW	HR	EER	HC	kW	HE	LAT	COP
			20	15.0	5.1	11.8	Operation Not Recommended					41.5	3.99	27.9	89.2	3.05	
GPM	WPD Adder		30	7.5	1.6	3.6	68.0	46.8	0.69	2.73	77.4	24.9	43.8	4.05	30.0	90.3	3.17
	PSI	FT		11.3	3.1	7.1	68.2	46.4	0.68	2.68	77.4	25.5	46.1	4.09	32.2	91.4	3.31
7.5	0.71	1.64		15.0	4.9	11.4	68.4	46.1	0.67	2.63	77.4	26.0	48.5	4.13	34.4	92.4	3.44
11.3	1.61	3.72	40	7.5	1.5	3.5	65.8	46.1	0.70	3.15	76.5	20.9	51.3	4.25	36.8	93.7	3.54
				11.3	3.0	6.9	66.0	45.8	0.69	3.07	76.5	21.5	53.3	4.28	38.7	94.7	3.65
15.0	2.84	6.56		15.0	4.8	11.1	66.3	45.5	0.69	2.99	76.5	22.1	55.3	4.32	40.6	95.6	3.75
			50	7.5	1.5	3.4	63.5	45.5	0.72	3.58	75.7	17.8	58.7	4.44	43.5	97.2	3.87
				11.3	2.9	6.7	63.8	45.2	0.71	3.47	75.6	18.4	60.4	4.48	45.2	98.0	3.96
				15.0	4.6	10.7	64.1	44.8	0.70	3.36	75.5	19.1	62.2	4.51	46.8	98.8	4.04
60	2.8	6.5	60	7.5	1.4	3.3	62.6	45.3	0.72	3.90	75.9	16.0	66.1	4.64	50.3	100.6	4.18
				11.3	2.8	6.5	62.9	44.9	0.71	3.74	75.7	16.8	68.5	4.67	52.6	101.7	4.30
				15.0	4.5	10.4	63.2	44.6	0.70	3.58	75.4	17.7	71.0	4.71	54.9	102.9	4.42
70	2.7	6.3	70	7.5	1.4	3.2	61.7	45.0	0.73	4.23	76.1	14.6	73.5	4.83	57.0	104.0	4.46
				11.3	2.7	6.3	62.0	44.7	0.72	4.02	75.7	15.4	76.6	4.87	60.0	105.5	4.61
				15.0	4.3	10.0	62.4	44.3	0.71	3.80	75.4	16.4	79.7	4.90	63.0	106.9	4.77
80	2.6	6.1	80	7.5	1.3	3.1	58.7	44.2	0.75	4.70	74.8	12.5	80.9	5.03	63.7	107.5	4.71
				11.3	2.6	6.1	59.2	43.8	0.74	4.46	74.4	13.3	83.8	5.05	66.6	108.8	4.86
				15.0	4.2	9.7	59.7	43.5	0.73	4.22	74.1	14.1	86.7	5.07	69.4	110.1	5.01
90	2.5	5.9	90	7.5	1.3	3.0	55.8	43.4	0.78	5.17	73.4	10.8	88.3	5.23	70.5	110.9	4.95
				11.3	2.5	5.9	56.4	43.0	0.76	4.90	73.1	11.5	91.0	5.24	73.1	112.1	5.09
				15.0	4.1	9.4	56.9	42.7	0.75	4.64	72.8	12.3	93.7	5.25	75.8	113.4	5.23
100	2.4	5.6	100	7.5	1.2	2.9	54.4	42.9	0.79	5.72	73.9	9.5	Operation Not Recommended				
				11.3	2.4	5.6	54.8	42.6	0.78	5.43	73.3	10.1					
				15.0	3.9	9.0	55.3	42.2	0.76	5.14	72.8	10.7					
110	2.4	5.4	110	7.5	1.2	2.8	52.9	42.5	0.80	6.28	74.4	8.4	Operation Not Recommended				
				11.3	2.4	5.4	53.3	42.1	0.79	5.96	73.6	8.9					
				15.0	3.8	8.7	53.6	41.8	0.78	5.64	72.8	9.5					

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 ARI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for ARI/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.

GS Series 60Hz - R22 Submittal Data Eng/I-P



Performance Data GS H/V/D 070

2300 CFM Nominal (Rated) Airflow

Performance capacities shown in thousands of Btuh

*WPD Adder for Motorized Valve, GS H/V/D 070 (Cv = 8.9, MOPD = 150 psi)			EWT °F	GPM	*WPD		Cooling - EAT 80/67°F					Heating - EAT 70°F					
					PSI	FT	TC	SC	Sens/Tot Ratio	kW	HR	EER	HC	kW	HE	LAT	COP
			20	18.0	6.9	15.9	Operation Not Recommended					45.7	4.51	30.3	88.4	2.97	
GPM	WPD Adder		30	9.0	2.1	4.9	75.8	55.5	0.73	3.30	87.1	22.9	48.3	4.47	33.1	89.5	3.17
	PSI	FT		13.5	4.2	9.6	76.2	54.8	0.72	3.17	87.0	24.0	50.8	4.52	35.4	90.5	3.30
9.0	1.02	2.36		18.0	6.7	15.4	76.6	54.1	0.71	3.04	86.9	25.2	53.3	4.58	37.7	91.5	3.42
13.5	2.30	5.31	40	9.0	2.1	4.8	73.4	54.2	0.74	3.76	86.3	19.5	56.0	4.64	40.2	92.5	3.54
18.0	4.09	9.45		13.5	4.0	9.3	73.8	53.5	0.73	3.61	86.1	20.4	58.1	4.67	42.2	93.4	3.64
				18.0	6.5	15.0	74.2	52.9	0.71	3.46	86.0	21.4	60.3	4.71	44.2	94.3	3.75
			50	9.0	2.0	4.6	71.1	52.9	0.74	4.23	85.5	16.8	63.6	4.81	47.3	95.6	3.88
				13.5	3.9	9.0	71.4	52.3	0.73	4.06	85.3	17.6	65.4	4.83	49.0	96.3	3.97
				18.0	6.3	14.5	71.8	51.7	0.72	3.89	85.1	18.5	67.2	4.85	50.7	97.1	4.06
			60	9.0	1.9	4.5	70.2	52.1	0.74	4.62	86.0	15.2	71.3	4.98	54.3	98.7	4.20
				13.5	3.8	8.7	70.7	51.9	0.73	4.43	85.8	15.9	73.2	5.02	56.0	99.5	4.27
				18.0	6.1	14.0	71.2	51.6	0.72	4.25	85.7	16.8	75.0	5.07	57.7	100.2	4.34
			70	9.0	1.9	4.3	69.3	51.3	0.74	5.02	86.4	13.8	79.0	5.15	61.4	101.8	4.50
				13.5	3.7	8.4	70.0	51.4	0.73	4.81	86.4	14.5	80.9	5.22	63.1	102.6	4.55
				18.0	5.9	13.6	70.7	51.6	0.73	4.61	86.4	15.3	82.8	5.29	64.8	103.3	4.59
			80	9.0	1.8	4.2	66.2	49.6	0.75	5.51	85.0	12.0	86.4	5.40	68.0	104.8	4.69
				13.5	3.5	8.2	66.9	49.8	0.74	5.28	84.9	12.7	87.6	5.42	69.1	105.3	4.74
				18.0	5.7	13.1	67.6	50.0	0.74	5.06	84.8	13.4	88.8	5.45	70.2	105.7	4.78
			90	9.0	1.7	4.0	63.2	48.0	0.76	6.00	83.6	10.5	93.9	5.65	74.6	107.8	4.87
				13.5	3.4	7.9	63.8	48.2	0.76	5.76	83.4	11.1	94.3	5.63	75.1	108.0	4.91
				18.0	5.5	12.7	64.4	48.3	0.75	5.51	83.2	11.7	94.8	5.61	75.6	108.1	4.95
			100	9.0	1.7	3.9	60.4	47.4	0.78	6.68	83.2	9.1	Operation Not Recommended				
				13.5	3.3	7.6	61.0	47.6	0.78	6.40	82.9	9.5					
				18.0	5.3	12.2	61.6	47.7	0.77	6.13	82.6	10.1					
			110	9.0	1.6	3.7	57.7	46.8	0.81	7.35	82.8	7.9					
				13.5	3.2	7.3	58.3	46.9	0.81	7.05	82.3	8.3					
				18.0	5.1	11.7	58.9	47.1	0.80	6.75	81.9	8.7					

Interpolation is permissible; extrapolation is not.
 All entering air conditions are 80°F DB and 67°F WB in cooling, and 70°F DB in heating.
 ARI/ISO certified conditions are 80.6°F DB and 66.2°F WB in cooling and 68°F DB in heating.
 Table does not reflect fan or pump power corrections for ARI/ISO conditions.
 All performance is based upon the lower voltage of dual voltage rated units.
 Performance stated is at the rated power supply; performance may vary as the power supply varies from the rated.
 Operation below 40°F EWT is based upon a 15% antifreeze solution.
 Operation below 60°F EWT requires optional insulated water/refrigerant circuit.
 See performance correction tables for operating conditions other than those listed above.
 See Performance Data Selection Notes for operation in the shaded areas.



Performance Data Correction Tables

Air Flow Correction Table

Airflow	Cooling				Heating		
	% of Rated	Total Capacity	Sensible Capacity	Power	Heat of Rejection	Heating Capacity	Power
75%	0.914	0.834	0.987	0.929	0.968	1.091	0.936
81%	0.936	0.876	0.990	0.946	0.976	1.068	0.952
88%	0.957	0.917	0.994	0.964	0.984	1.045	0.968
94%	0.979	0.959	0.997	0.982	0.992	1.023	0.984
100%	1.000	1.000	1.000	1.000	1.000	1.000	1.000
106%	1.021	1.041	1.003	1.018	1.008	0.977	1.016
113%	1.043	1.083	1.006	1.036	1.016	0.955	1.032

Entering Air Correction Table

Heating			
Entering Air DB°F	Heating Capacity	Power	Heat of Extraction
60	1.019	0.896	1.054
65	1.010	0.948	1.028
68	1.004	0.980	1.011
70	1.000	1.000	1.000
75	0.997	1.059	0.979
80	0.993	1.118	0.957

Cooling										
Entering Air WB°F	Total Capacity	Sensible Cooling Capacity Multiplier - Entering DB °F							Power	Heat of Rejection
		70	75	80	80.6	85	90	95		
60	0.881	0.943	1.067	1.192	1.240	*	*	*	0.983	0.899
65	0.940	0.797	0.952	1.106	1.125	1.261	*	*	0.991	0.949
66.2	0.976	0.693	0.868	1.043	1.063	1.217	*	*	0.997	0.980
67	1.000	0.624	0.812	1.000	1.023	1.188	1.343	1.352	1.000	1.000
70	1.012		0.697	0.820	0.835	0.944	1.067	1.257	1.002	1.010
75	1.024			0.637	0.658	0.817	0.983	1.159	1.005	1.019

* = Sensible capacity equals total capacity
 ARI/ISO/ASHRAE 13256-1 uses entering air conditions of Cooling - 80.6°F DB/66.2°F WB, 1 and Heating - 68°F DB/59°F WB entering air temperature

Antifreeze Correction Table

Antifreeze Type	Antifreeze %	Cooling			Heating		WPD Corr. Fct. EWT 30°F
		EWT 90°F			EWT 30°F		
		Total Cap	Sens Cap	Power	Htg Cap	Power	
Water	0	1.000	1.000	1.000	1.000	1.000	1.000
Propylene Glycol	5	0.995	0.995	1.003	0.989	0.997	1.070
	15	0.986	0.986	1.009	0.968	0.990	1.210
	25	0.978	0.978	1.014	0.947	0.983	1.360
Methanol	5	0.997	0.997	1.002	0.989	0.997	1.070
	15	0.990	0.990	1.007	0.968	0.990	1.160
	25	0.982	0.982	1.012	0.949	0.984	1.220
Ethanol	5	0.998	0.998	1.002	0.981	0.994	1.140
	15	0.994	0.994	1.005	0.944	0.983	1.300
	25	0.986	0.986	1.009	0.917	0.974	1.360
Ethylene Glycol	5	0.998	0.998	1.002	0.993	0.998	1.040
	15	0.994	0.994	1.004	0.980	0.994	1.120
	25	0.988	0.988	1.008	0.966	0.990	1.200

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.

GS Series 60Hz - R22 Submittal Data Eng/I-P



Blower Performance Data Standard Unit - No Reheat

Airflow in CFM with wet coil and clean air filter.

Model	Fan Speed	Rated Airflow	MIN CFM	Airflow (cfm) at External Static Pressure (in. wg)															
				0.00	0.05	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.60	0.70	0.80	0.90	1.00
GSH/V 015	HI	500	375	880	860	840	830	820	800	780	750	730	690	660	610				
	MED	500	375	770	760	750	740	720	710	690	670	640	620	600	520				
	LOW	500	375	660	660	660	650	640	630	620	600	580	550	520	460				
GSH/V 018	HI	600	450	880	860	840	830	820	800	780	750	730	690	660	610				
	MED	600	450	770	760	750	740	720	710	690	670	640	620	600	520				
	LOW	600	450	660	660	660	650	640	630	620	600	580	550	520	460				
GSH/V 024	HI	800	600	1130	1110	1090	1060	1040	1010	980	950	920	880	840	720				
	MED	800	600	950	940	930	920	910	880	860	820	790	760	730					
	LOW	800	600	880	870	860	840	830	810	800	770	730	700	660					
GSH/V 030	HI	1000	750	1260	1230	1200	1180	1160	1120	1090	1050	1000	970	930	850				
	MED	1000	750	1180	1150	1120	1090	1070	1030	1000	970	950	910	870					
	LOW	1000	750	1040	1020	1000	980	960	930	910	870	840	820	790					
GSH/V 030	HS HI	1000	750	1400	1360	1320	1280	1250	1220	1200	1150	1110	1070	1020	940	850			
	HS MED	1000	750	1260	1240	1220	1190	1170	1130	1100	1070	1040	990	950					
	HS LOW	1000	750	1170	1150	1130	1100	1080	1050	1020	990	960	930	900					
GSH/V 036	HI	1150	900	1400	1360	1320	1280	1250	1220	1200	1150	1110	1070	1020	940				
	MED	1150	900	1260	1240	1220	1190	1170	1130	1100	1070	1040	990	950					
	LOW	1150	900	1170	1150	1130	1100	1080	1050	1020	990	960	930	900					
GSH/V 036	HS HI	1150	900	1790	1760	1730	1700	1660	1630	1590	1550	1510	1470	1440	1370	1270	1120		
	HS MED	1150	900	1510	1490	1470	1450	1420	1400	1380	1350	1320	1300	1270	1180	1070			
	HS LOW	1150	900	1110	1100	1090	1080	1060	1050	1040									
GSH/V 042	HI	1400	1050				1670	1630	1600	1570	1540	1510	1440	1380	1290	1130			
	MED	1400	1050	1610	1580	1550	1510	1480	1450	1420	1390	1360	1320	1270					
	LOW	1400	1050	1270	1260	1250	1240	1220	1210	1190	1160	1120	1080						
GSH/V 048	HI	1600	1200				2010	2000	1940	1880	1830	1780	1690	1610	1540	1310			
	MED	1600	1200	1950	1910	1870	1820	1780	1740	1700	1670	1630	1570	1520	1410	1310			
	LOW	1600	1200	1470	1460	1450	1440	1430	1410	1380	1360	1330	1280	1220					
GSH/V 060	HI	2000	1500					2270	2230	2200	2170	2140	2110	2040	1970	1870	1720	1640	
	MED	2000	1500	2260	2240	2220	2190	2170	2140	2110	2100	2080	2050	2020	1960	1870	1760	1660	1550
	LOW	2000	1500	2050	2030	2010	1990	1970	1950	1930	1910	1880	1850	1830	1780	1700	1650	1570	
GSH/V 070	HI	2300	1725					2460	2430	2390	2340	2310	2280	2230	2180	1990	1860	1740	
	MED	2300	1725	2530	2500	2470	2450	2420	2400	2370	2340	2310	2280	2260	2200	2100	1890	1740	
	LOW	2300	1725	2270	2260	2250	2240	2230	2210	2180	2160	2140	2120	2100	2040	1900	1790		

Black areas denote ESP where operation is not recommended

Units factory shipped on medium speed (Size 015 on low), other speeds require field selection

All airflow is rated at lowest Voltage if unit is dual Voltage rated, e.g. 208V for 208-230V units

All units ARI/ISO/ASHRAE 13256-1 rated on high fan speed (Size 015 rated on medium speed)

Performance stated is at the rated power supply, performance may vary as the power supply varies from the rated.

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



**Blower Performance Data
Units With ClimaDry**

Coil Face Velocity FPM	GSH/V with Reheat ESP Loss					
	GSH/V 015, 018 In. of Water	GSH/V 024, 030 In. of Water	GSH/V 036 In. of Water	GSH/V 042, 048 In. of Water	GSH/V 060 In. of Water	GSH/V 070 In. of Water
200	0.040	0.037	0.033	0.031	0.028	0.026
250	0.059	0.052	0.046	0.042	0.038	0.034
300	0.088	0.077	0.066	0.059	0.051	0.044
350	0.131	0.113	0.096	0.085	0.073	0.061
400	0.203	0.181	0.160	0.145	0.131	0.117
450	0.258	0.242	0.226	0.215	0.205	0.194
500	0.375	0.360	0.345	0.335	0.326	0.316

For GS units with ClimaDry Reheat coil applications, calculate face velocity of the entering air. From the table above, find ESP for Reheat application. The loss includes wet coil loss.

Example:

Reheat coil loss can be determined from the above table. Coil velocity (FPM) = Airflow (CFM) / Face Area (sq. ft.)

- 1) GSH036 has a face area of 3.88 sq. ft. (see physical data table).
- 2) At 1,100 cfm, coil velocity (FPM) = 1,100 / 3.88 = 284 FPM
- 3) From above table, it will be necessary to subtract 0.061 from the blower performance ESP.
- 4) On medium speed, the GSH036 (without reheat - see blower table) can deliver 1,100 CFM at 0.30 in. wg. with the standard PSC motor; with the reheat coil, it now delivers 1,063 CFM at 0.30 in. wg. or 1,100 CFM at 0.24 in. wg.
- 5) If the decrease in airflow is acceptable, no changes are necessary. Otherwise, high speed fan should be used to overcome the pressure drop of the reheat coil.

GS Series 60Hz - R22 Submittal Data Eng/I-P



Physical Data

Model	015	018	024	030	036	042	048	060	070
Compressor (1 Each)	Rotary			Scroll					
Factory Charge R22 (oz) [kg]	44 [1.25]	44 [1.25]	48 [1.36]	48 [1.36]	60 [1.70]	74 [2.10]	74 [2.10]	102 [2.89]	104 [2.95]
PSC Fan Motor & Blower (3 Speeds)									
Fan Motor (hp) [W]	1/6 [124]	1/6 [124]	1/5 [150]	1/3 [250]	1/2 [373]	1/2 [373]	3/4 [560]	3/4 [560]	1 [746]
Blower Wheel Size (dia x w) - (in) [mm]	9 x 7 [229 x 178]	9 x 7 [229 x 178]	9 x 7 [229 x 178]	9 x 7 [229 x 178]	9 x 7 [229 x 178]	10 x 10 [254 x 254]	10 x 10 [254 x 254]	11 x 10 [279 x 254]	11 x 10 [279 x 254]
Water Connection Size									
IPT (in)	3/4	3/4	3/4	3/4	3/4	1	1	1	1
Coax Volume									
Volume (US Gallons) [liters]	0.56 [2.12]	0.56 [2.12]	0.76 [2.88]	0.76 [2.88]	0.92 [3.48]	0.92 [3.48]	0.92 [3.48]	1.56 [5.91]	1.56 [5.91]
Vertical Upflow									
Air Coil Dimensions (h x w) - (in) [mm]	20 x 20 [508 x 508]	20 x 20 [508 x 508]	24 x 20 [610 x 508]	24 x 20 [610 x 508]	28 x 20 [711 x 508]	28 x 25 [711 x 635]	28 x 25 [711 x 635]	32 x 25 [813 x 635]	36 x 25 [914 x 635]
Standard Filter - 1" [25.4mm] Throwaway, qty (in) [mm]	20 x 24 [508 x 610]	20 x 24 [508 x 610]	24 x 24 [610 x 610]	24 x 24 [610 x 610]	2 - 14 x 24 [356 x 610]	2 - 14 x 30 [356 x 762]	2 - 14 x 30 [356 x 762]	2 - 10 x 30, 1 - 12 x 30 [254 x 762], [305 x 762]	3 - 12 x 30 [305 x 762]
Weight - Operating, (lbs) [kg]	174 [79]	184 [84]	250 [114]	252 [115]	266 [121]	323 [147]	327 [149]	416 [189]	443 [201]
Weight - Packaged, (lbs) [kg]	184 [84]	194 [88]	260 [118]	262 [119]	276 [126]	333 [151]	337 [154]	426 [194]	453 [206]
Horizontal									
Air Coil Dimensions (h x w) - (in) [mm]	18 x 22 [457 x 559]	18 x 22 [457 x 559]	18 x 27 [457 x 686]	18 x 27 [457 x 686]	18 x 31 [457 x 787]	20 x 35 [508 x 889]	20 x 35 [508 x 889]	20 x 40 [508 x 1016]	20 x 45 [508 x 1143]
Standard Filter - 1" [25.4mm] Throwaway, qty (in) [mm]	18 x 24 [457 x 610]	18 x 24 [457 x 610]	2 - 18 x 18 [457 x 457]	2 - 18 x 18 [457 x 457]	2 - 18 x 18 [457 x 457]	1 - 12 x 20, 1 - 20 x 25 [305 x 508], [508 x 635]	1 - 12 x 20, 1 - 20 x 25 [305 x 508], [508 x 635]	1 - 18 x 20, 1 - 20 x 24 [457 x 508], [508 x 610]	2 - 24 x 20 [610 x 508]
Weight - Operating, (lbs) [kg]	179 [81]	189 [86]	250 [114]	252 [115]	266 [121]	323 [147]	327 [149]	416 [189]	443 [201]
Weight - Packaged, (lbs) [kg]	189 [86]	199 [91]	260 [118]	262 [119]	276 [126]	333 [151]	337 [154]	426 [194]	453 [206]

All units have grommet or spring compressor mountings, and 1/2" [12.2mm] & 3/4" [19mm] electrical knockouts.

Unit Maximum Water Working Pressure	
Options	Max Pressure PSIG [kPa]
Base Unit	450 [3,100]
Internal Secondary Pump (ISP)	145 [999]
ClimaDry	145 [999]
Internal Motorized Water Valve (WMV)	300 [2,067]
Internal Auto Flow Valve	450 [3,100]

Use the lowest maximum pressure rating when multiple options are combined.



Corner Weights for GSH Series Units

Model		Total	Left-Front*	Right-Front*	Left-Back*	Right-Back*
GSH015	Lbs	174	48.5	38	47.5	40
	kg	78.93	22	17.24	21.55	18.14
GSH018	Lbs	184	51	41	50	42
	kg	83.46	23.13	18.60	22.68	19.05
GSH024	Lbs	250	68	56	68	58
	kg	113.40	30.84	25.40	30.84	26.31
GSH030	Lbs	252	69.5	56	68	58.5
	kg	114.31	31.52	25.40	30.84	26.54
GSH036	Lbs	266	72.5	59.5	72.5	61.5
	kg	120.66	32.89	26.99	32.89	27.90
GSH042	Lbs	323	88	72	88	75
	kg	146.51	39.92	32.66	39.92	34.02
GSH048	Lbs	327	89	73	89	76
	kg	148.32	40.37	33.11	40.37	34.47
GSH060	Lbs	416	113.5	93	113	96.5
	kg	188.69	51.48	42.18	51.26	43.77
GSH070	Lbs	443	123	132	142	46
	kg	200.94	55.79	59.87	64.41	20.87

*Front is control box end.

GS Series 60Hz - R22 Submittal Data Eng/I-P



GS - Horizontal Dimensional Data

Horizontal Model		Overall Cabinet		
		A Width	B Length	C Height
015 - 018	in	22.4	53.2	19.3
	cm	56.8	135.1	49.0
024 - 030	in	22.4	62.2	19.3
	cm	56.8	158.0	49.0
036	in	22.4	62.2	19.3
	cm	56.8	158.0	49.0
042 - 048	in	25.4	71.2	21.3
	cm	64.5	180.8	54.1
060	in	25.4	76.2	21.3
	cm	64.5	193.5	54.1
070	in	25.4	81.2	21.3
	cm	64.5	206.2	54.1

Notes:

1. While clear access to all removable panels is not required, installer should take care to comply with all building codes and allow adequate clearance for future field service.
2. Horizontal units shipped with filter bracket only. This bracket should be removed for return duct connection
3. Discharge flange and hanger brackets are factory installed.
4. Condensate is 3/4" IPT.
5. Blower service panel requires 2' service access.
6. Blower service access is through back panel on straight discharge unit or through panel opposite air coil on back discharge units.

Legend:

- CAP = Control Access Panel
 BSP = Blower Service Panel
 CSP = Compressor Access Panel
 ASP = Alternative Service Panel





Horizontal Model		Electrical Knockouts		
		J 1/2"	K 1/2"	L 3/4"
		Low Voltage	External Pump	Power Supply
015 - 018	in	5.7	9.7	12.2
	cm	14.5	24.6	31.0
024 - 030	in	5.7	9.7	12.2
	cm	14.5	24.6	31.0
036	in	5.7	9.7	12.2
	cm	14.5	24.6	31.0
042 - 048	in	8.1	11.7	14.2
	cm	20.6	29.7	36.1
060	in	8.1	11.7	14.2
	cm	20.6	29.7	36.1
070	in	8.1	11.7	14.2
	cm	20.6	29.7	36.1

Horizontal Model		Water Connections						
		1	2	3	4	5		
		Loop In D	Loop Out E	HWG In F	HWG Out G	H	Water Loop IPT	HWG IPT
015 - 018	in	2.4	5.4	13.9	16.9	0.6	3/4"	1/2"
	cm	6.1	13.7	35.3	42.9	1.5		
024 - 030	in	2.4	5.4	13.9	16.9	0.6	3/4"	1/2"
	cm	6.1	13.7	35.3	42.9	1.5		
036	in	2.4	5.4	13.9	16.9	0.6	3/4"	1/2"
	cm	6.1	13.7	35.3	42.9	1.5		
042 - 048	in	2.4	5.4	15.9	18.9	0.6	1"	1/2"
	cm	6.1	13.7	40.4	48.0	1.5		
060	in	2.4	5.4	15.9	18.9	0.6	1"	1/2"
	cm	6.1	13.7	40.4	48.0	1.5		
070	in	2.4	5.4	15.9	18.9	0.6	1"	1/2"
	cm	6.1	13.7	40.4	48.0	1.5		

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.

GS - Horizontal Dimensional Data

Horizontal Model		Discharge Connection Duct Flange Installed (+/- 0.10 in, +/- 2.5mm)					Return Connection Using Return Air Opening				
		M	N	O Supply Height	P Supply Width	Q	R	S Return Width	T Return Height	U	V
015 - 018	in cm	5.0 12.7	6.8 17.3	10.4 26.4	9.3 23.6	5.0 12.7	2.1 5.3	23.1 58.7	17.3 43.9	2.2 5.6	1.0 2.5
024 - 030	in cm	5.0 12.7	6.8 17.3	10.4 26.4	9.3 23.6	5.0 12.7	2.1 5.3	28.1 71.4	17.3 43.9	6.3 16.0	1.0 2.5
036	in cm	5.0 12.7	6.8 17.3	10.4 26.4	9.3 23.6	5.0 12.7	2.1 5.3	32.1 81.5	17.3 43.9	2.2 5.6	1.0 2.5
042 - 048	in cm	5.8 14.7	5.0 12.7	13.6 34.5	13.3 33.8	4.2 14.7	2.9 7.4	36.1 91.7	19.3 49.0	2.2 5.6	1.0 2.5
060	in cm	5.8 14.7	5.0 12.7	13.6 34.5	13.3 33.8	4.2 14.7	2.9 7.4	41.1 104.4	19.3 49.0	2.2 5.6	1.0 2.5
070	in cm	5.8 14.7	5.0 12.7	13.6 34.5	13.3 33.8	4.2 14.7	2.9 7.4	46.1 117.1	19.3 49.0	2.2 5.6	1.0 2.5

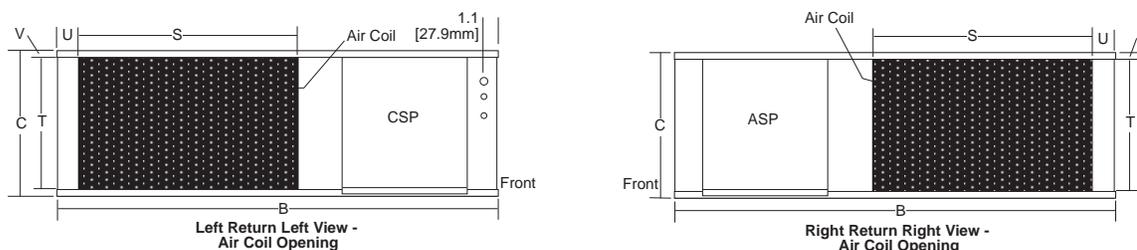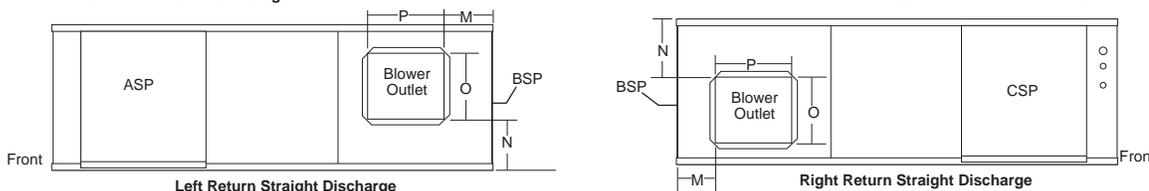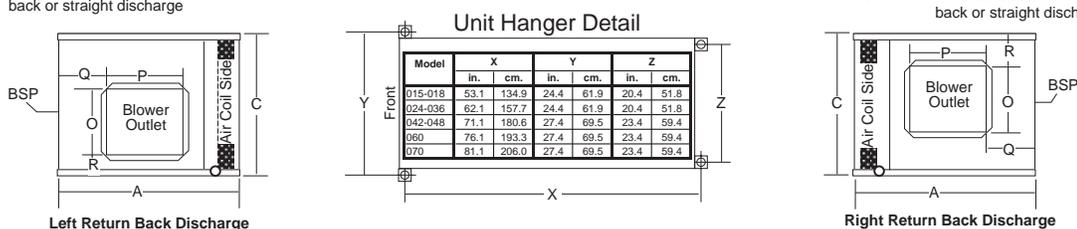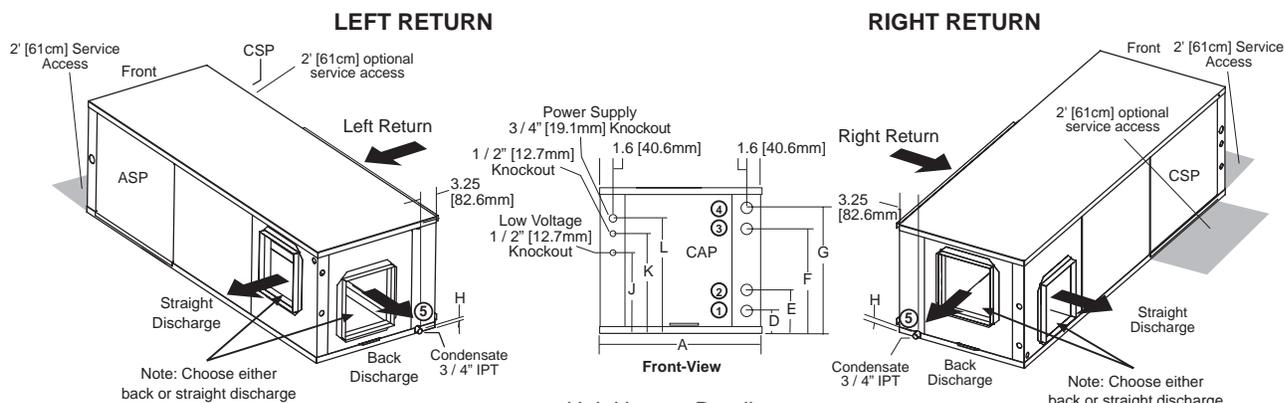

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



GS - Vertical Upflow Dimensional Data

Vertical Model		Overall Cabinet		
		A Width	B Depth	C Height
015 - 018	in cm	22.4 56.8	25.6 65.1	40.4 102.6
024 - 030	in cm	22.4 56.8	25.6 65.1	44.4 112.8
036	in cm	22.4 56.8	25.6 65.1	48.4 122.9
042 - 048	in cm	25.4 64.5	30.6 77.8	50.4 128.0
060	in cm	25.4 64.5	30.6 77.8	54.4 138.2
070	in cm	25.4 64.5	30.6 77.8	58.4 148.3

Vertical Model		Water Connections						
		1	2	3	4	5		
		Loop In D	Loop Out E	HWG In F	HWG Out G	H	Water Loop IPT	HWG IPT
015 - 018	in cm	2.4 6.1	5.4 13.7	13.9 35.3	16.9 42.9	9.8 24.9	3/4"	1/2"
024 - 030	in cm	2.4 6.1	5.4 13.7	13.9 35.3	16.9 42.9	9.8 24.9	3/4"	1/2"
036	in cm	2.4 6.1	5.4 13.7	13.9 35.3	16.9 42.9	9.8 24.9	3/4"	1/2"
042 - 048	in cm	2.4 6.1	5.4 13.7	15.9 40.4	18.9 48.0	10.8 27.4	1"	1/2"
060	in cm	2.4 6.1	5.4 13.7	15.9 40.4	18.9 48.0	10.8 27.4	1"	1/2"
070	in cm	2.4 6.1	5.4 13.7	15.9 40.4	18.9 48.0	10.8 27.4	1"	1/2"

Vertical Model		Electrical Knockouts		
		J 1/2"	K 1/2"	L 3/4"
		Low Voltage	External Pump	Power Supply
015 - 018	in cm	6.0 15.2	9.5 24.1	12.0 30.5
024 - 030	in cm	6.0 15.2	9.5 24.1	12.0 30.5
036	in cm	6.0 15.2	9.5 24.1	12.0 30.5
042 - 048	in cm	8.0 20.3	11.5 29.2	14.0 35.6
060	in cm	8.0 20.3	11.5 29.2	14.0 35.6
070	in cm	8.0 20.3	11.5 29.2	14.0 35.6

Notes:

1. While clear access to all removable panels is not required, installer should take care to comply with all building codes and allow adequate clearance for future field service.
2. Front & Side access is preferred for service access. However, all components may be serviced from the front access panel if side access is not available.
3. Discharge flange is field installed.
4. Condensate is 3/4" IPT PVC and is switchable from front to side.


Legend:

CAP = Control Access Panel
 BSP = Blower Service Panel
 CSP = Compressor Access Panel
 ASP = Alternative Service Panel




GS - Vertical Upflow Dimensional Data


Vertical Model		Discharge Connection Duct Flange Installed (+/- 0.10 in, +/- 2.5mm)					Return Connection Using Return Air Opening			
		M	N	O Supply Width	P Supply Depth	Q	R	S Return Depth	T Return Height	U
015 - 018	in	7.2	5.8	14.0	14.0	4.3	1.8	22.3	18.2	1.6
	cm	18.3	14.7	35.6	35.6	10.9	4.6	56.6	46.2	4.1
024 - 030	in	7.2	5.8	14.0	14.0	4.3	1.8	22.3	22.2	1.6
	cm	18.3	14.7	35.6	35.6	10.9	4.6	56.6	56.4	4.1
036	in	7.2	5.8	14.0	14.0	4.3	1.8	22.3	26.2	1.6
	cm	18.3	14.7	35.6	35.6	10.9	4.6	56.6	65.5	4.1
042 - 048	in	6.2	6.3	18.0	18.0	5.1	1.5	27.8	26.2	1.5
	cm	15.7	16.0	45.7	45.7	13.0	3.8	70.6	66.5	3.8
060	in	6.2	6.3	18.0	18.0	5.1	1.5	27.8	30.2	1.5
	cm	15.7	16.0	45.7	45.7	13.0	3.8	70.6	76.7	3.8
070	in	6.2	6.3	18.0	18.0	5.1	1.5	27.8	34.2	1.5
	cm	15.7	16.0	45.7	45.7	13.1	3.8	70.6	86.9	3.8




Top View-Right Return




Top View-Left Return

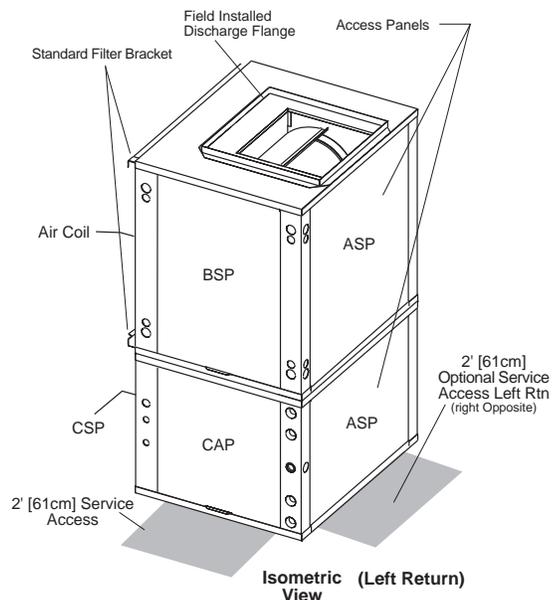


Isometric (Left Return) View

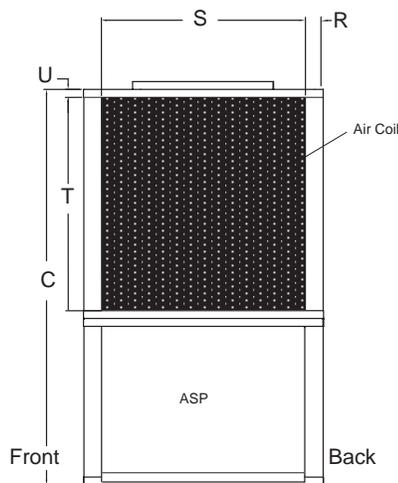

Right Return Right View - Air Coil Opening

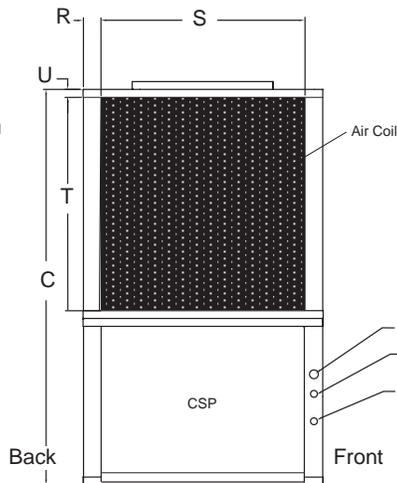

Left Return Left View - Air Coil Opening

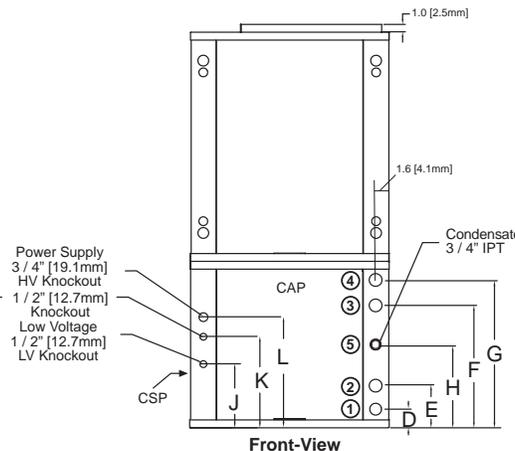

Front-View

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.

GS Series 60Hz - R22 Submittal Data Eng/I-P



GS - Vertical Downflow Dimensional Data

Vertical Downflow Model		Overall Cabinet		
		A Width	B Depth	C Height
015 - 018	in cm	22.4 56.8	25.6 65.1	44.6 113.3
024 - 030	in cm	22.4 56.8	25.6 65.1	48.6 123.4
036	in cm	22.4 56.8	25.6 65.1	52.6 133.6
042 - 048	in cm	25.4 64.5	30.6 77.8	54.6 138.7
060	in cm	25.4 64.5	30.6 77.8	58.6 148.8
070	in cm	25.4 64.5	30.6 77.8	62.6 159.0

Vertical Downflow Model		Water Connections						
		1	2	3	4	5	Water Loop IPT	HWG IPT
		Loop In D	Loop Out E	HWG In F	HWG Out G	H		
015 - 018	in cm	16.9 42.9	13.9 35.3	5.4 13.7	2.4 6.1	3.5 8.9	3/4"	1/2"
024 - 030	in cm	16.9 42.9	13.9 35.3	5.4 13.7	2.4 6.1	3.5 8.9	3/4"	1/2"
036	in cm	16.9 42.9	13.9 35.3	5.4 13.7	2.4 6.1	3.5 8.9	3/4"	1/2"
042 - 048	in cm	18.9 48.0	15.9 40.4	5.4 13.7	2.4 6.1	3.5 8.9	1"	1/2"
060	in cm	18.9 48.0	15.9 40.4	5.4 13.7	2.4 6.1	3.5 8.9	1"	1/2"
070	in cm	18.9 48.0	15.9 40.4	5.4 13.7	2.4 6.1	3.5 8.9	1"	1/2"

Vertical Downflow Model		Electrical Knockouts		
		J 1/2"	K 1/2"	L 3/4"
		Low Voltage	External Pump	Power Supply
015 - 018	in cm	13.6 34.5	9.7 24.6	7.2 18.3
024 - 030	in cm	13.6 34.5	9.7 24.6	7.2 18.3
036	in cm	13.6 34.5	9.7 24.6	7.2 18.3
042 - 048	in cm	13.1 33.3	9.7 24.6	7.2 18.3
060	in cm	13.1 33.3	9.7 24.6	7.2 18.3
070	in cm	13.1 33.3	9.7 24.6	7.2 18.3

Notes:

1. While clear access to all removable panels is not required, installer should take care to comply with all building codes and allow adequate clearance for future field service.
2. Front & Side access is preferred for service access. However, all components may be serviced from the front access panel if side access is not available.
3. Downflow unit does not have discharge flange, and is rated for zero clearance installation.
4. Condensate is 3/4" IPT PVC and is switchable from front to side.

Legend:







- CAP = Control Access Panel
- BSP = Blower Service Panel
- CSP = Compressor Access Panel
- ASP = Alternative Service Panel

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



GS - Vertical Downflow Dimensional Data

Vertical Downflow Model		Discharge Connection Duct Flange Installed (+/- 0.10 in, +/- 2.5mm)					Return Connection Using Return Air Opening			
		M	N	O Supply Width	P Supply Depth	Q	R	S Return Depth	T Return Height	U
015 - 018	in	6.1	8.2	10.4	9.3	11.0	2.2	21.1	20.2	20.4
	cm	15.4	20.8	26.4	23.5	27.9	5.6	53.6	51.3	51.8
024 - 030	in	6.1	8.2	10.4	9.3	11.0	2.2	21.1	24.2	20.4
	cm	15.4	20.8	26.4	23.5	27.9	5.6	53.6	61.5	51.8
036	in	6.1	8.2	10.4	9.3	11.0	2.2	21.1	28.2	20.4
	cm	15.4	20.8	26.4	23.5	27.9	5.6	53.6	71.6	51.8
042 - 048	in	7.2	8.7	13.6	13.3	10.5	2.2	26.1	28.2	22.4
	cm	18.3	22.1	34.4	34.4	26.7	5.6	66.3	71.6	56.9
060	in	7.2	8.7	13.6	13.3	10.5	2.2	26.1	32.2	22.4
	cm	18.3	22.1	34.4	33.7	26.7	5.6	66.3	81.8	56.9
070	in	7.2	8.7	13.6	13.3	10.5	2.2	26.1	36.2	22.4
	cm	18.3	22.1	34.4	33.7	26.7	5.6	66.3	91.9	56.9

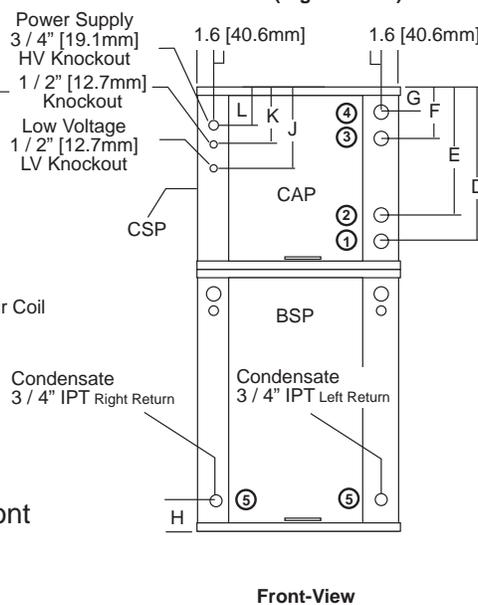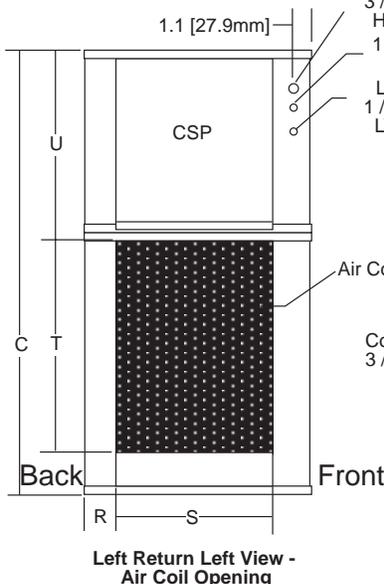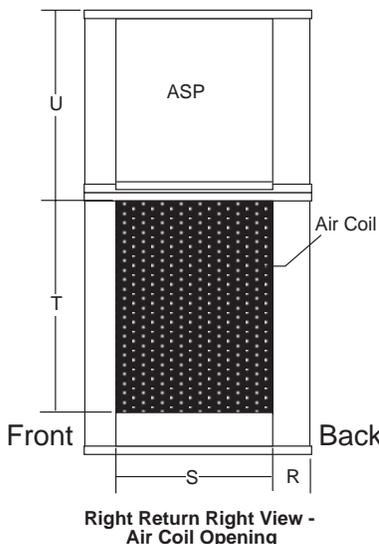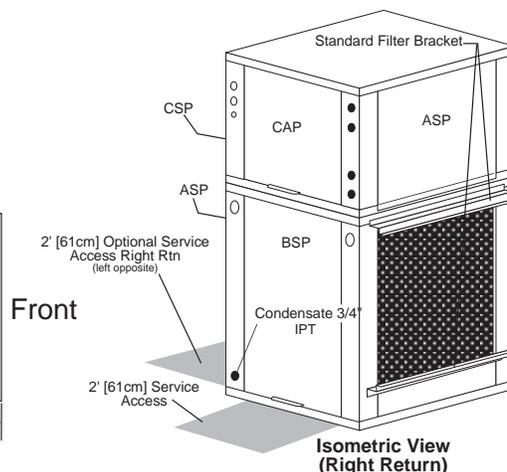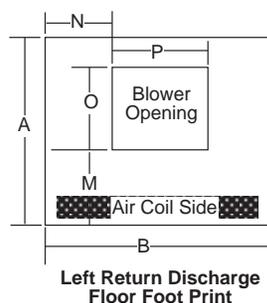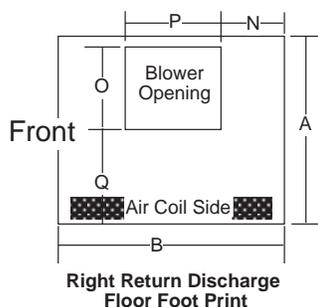

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.

GS Series 60Hz - R22 Submittal Data Eng/I-P



Electrical Data Standard Units

All GS Units								Standard GS Units		
Model	Voltage Code	Voltage	Min/Max Voltage	Compressor			Fan Motor FLA	Total Unit FLA	Min Circuit Amp	Max Fuse/HACR
				QTY	RLA	LRA				
GSH/V 015	G	208-230/60/1	197/254	1	4.9	26.3	1.0	7.1	8.6	15
	E	265/60/1	239/292	1	4.4	28.0	0.9	5.7	6.9	15
GSH/V 018	G	208-230/60/1	197/254	1	7.1	38.0	1.0	8.7	10.6	15
	E	265/60/1	239/292	1	5.5	32.0	0.9	6.7	8.2	15
GSH/V 024	G	208-230/60/1	197/254	1	10.9	54.0	1.1	11.4	14.0	20
	E	265/60/1	239/292	1	9.0	55.0	0.9	9.6	11.8	20
	H	208-230/60/3	197/254	1	7.1	45.0	1.1	8.2	10.0	15
	F	460/60/3	414/506	1	3.5	22.4	0.6	4.1	5.0	15
GSH/V 030	G	208-230/60/1	197/254	1	12.2	67.0	1.3	13.5	16.6	25
	E	265/60/1	239/292	1	10.9	56.0	1.6	12.5	15.2	25
	H	208-230/60/3	197/254	1	7.7	55.0	1.3	9.0	10.9	15
	F	460/60/3	414/506	1	3.8	27.0	0.9	4.7	5.7	15
GSH/V 030 High Static	G	208-230/60/1	197/254	1	12.2	67.0	1.8	14.0	17.1	25
	E	265/60/1	239/292	1	10.9	56.0	2.0	12.9	15.6	25
	H	208-230/60/3	197/254	1	7.7	55.0	1.8	9.5	11.4	15
	F	460/60/3	414/506	1	3.8	27.0	1.3	5.1	6.1	15
GSH/V 036	G	208-230/60/1	197/254	1	13.5	73.0	1.8	15.3	18.7	30
	E	265/60/1	239/292	1	12.8	71.0	2.0	14.8	18.0	30
	H	208-230/60/3	197/254	1	9.6	63.0	1.8	11.4	13.8	20
	F	460/60/3	414/506	1	4.5	31.0	1.3	5.8	6.9	15
GSH/V 036 High Static	G	208-230/60/1	197/254	1	13.5	73.0	3.0	16.5	19.9	30
	E	265/60/1	239/292	1	12.8	71.0	2.7	15.5	18.7	30
	H	208-230/60/3	197/254	1	9.6	63.0	3.0	12.6	15.0	20
	F	460/60/3	414/506	1	4.5	31.0	1.7	6.2	7.3	15
GSH/V 042	G	208-230/60/1	197/254	1	16.5	95.0	1.9	18.4	22.5	35
	H	208-230/60/3	197/254	1	10.3	77.0	1.9	12.2	14.8	25
	F	460/60/3	414/506	1	5.1	39.0	1.0	6.1	7.4	15
	N	575/60/3	518/633	1	4.2	31.0	0.8	5.0	6.1	15
GSH/V 048	G	208-230/60/1	197/254	1	18.3	109.0	3.0	21.3	25.9	40
	H	208-230/60/3	197/254	1	12.4	88.0	3.0	15.4	18.5	30
	F	460/60/3	414/506	1	6.4	44.0	1.7	8.1	9.7	15
	N	575/60/3	518/633	1	4.8	34.0	1.4	6.2	7.4	15
GSH/V 060	G	208-230/60/1	197/254	1	25.0	148.0	3.4	28.4	34.7	50
	H	208-230/60/3	197/254	1	17.3	123.0	3.4	20.7	25.0	40
	F	460/60/3	414/506	1	6.7	49.5	1.8	8.5	10.2	15
	N	575/60/3	518/633	1	5.8	40.0	1.4	7.2	8.7	15
GSH/V 070	G	208-230/60/1	197/254	1	28.8	148.0	4.9	33.7	40.9	60
	H	208-230/60/3	197/254	1	17.3	137.0	4.9	22.2	26.5	40
	F	460/60/3	414/506	1	9.0	62.0	2.5	11.5	13.8	20
	N	575/60/3	518/633	1	6.6	49.0	1.9	8.5	10.2	15

HACR circuit breaker in USA only
All fuses Class RK-5

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



Electrical Data
Units with Secondary Pump or ClimaDry Reheat

All GS Units				GS Units with ClimaDry				GS Units with Secondary Pump			
Model	Voltage Code	Voltage	Min/Max Voltage	Reheat Pump FLA	Total Unit FLA	Min Circuit Amp	Max Fuse/HACR	Pump FLA	Total Unit FLA	Min Circuit Amp	Max Fuse/HACR
GSH/V 015	G	208-230/60/1	197/254	0.8	6.7	7.9	15	0.43	6.3	7.6	15
	E	265/60/1	239/292	0.7	6.0	7.1	15	N/A	N/A	N/A	N/A
GSH/V 018	G	208-230/60/1	197/254	0.8	8.9	10.7	15	0.43	8.5	10.3	15
	E	265/60/1	239/292	0.7	7.1	8.5	15	N/A	N/A	N/A	N/A
GSH/V 024	G	208-230/60/1	197/254	0.8	12.8	15.5	25	0.43	12.4	15.2	20
	E	265/60/1	239/292	0.7	10.6	12.9	20	N/A	N/A	N/A	N/A
	H	208-230/60/3	197/254	0.8	9.0	10.8	20	0.43	8.6	10.4	15
GSH/V 030	F*	460/60/3*	414/506	0.7	4.8	5.7	15	N/A	N/A	N/A	N/A
	G	208-230/60/1	197/254	0.8	14.3	17.4	25	0.8	14.3	17.4	25
	E	265/60/1	239/292	0.7	13.2	15.9	25	0.7	13.2	15.9	25
	H	208-230/60/3	197/254	0.8	9.8	11.7	15	0.8	9.8	11.7	15
GSH/V 030 High Static	F*	460/60/3*	414/506	0.7	5.4	6.4	15	0.7	5.4	6.4	15
	G	208-230/60/1	197/254	0.8	14.8	17.9	30	0.8	14.8	17.9	30
	E	265/60/1	239/292	0.7	13.6	16.3	25	0.7	13.6	16.3	25
	H	208-230/60/3	197/254	0.8	10.3	12.2	15	0.8	10.3	12.2	15
GSH/V 036	F*	460/60/3*	414/506	0.7	5.8	6.8	15	0.7	5.8	6.8	15
	G	208-230/60/1	197/254	0.8	16.1	19.5	30	0.8	16.1	19.5	30
	E	265/60/1	239/292	0.7	15.5	18.7	30	0.7	15.5	18.7	30
	H	208-230/60/3	197/254	0.8	12.2	14.6	20	0.8	12.2	14.6	20
GSH/V 036 High Static	F*	460/60/3*	414/506	0.7	6.5	7.6	15	0.7	6.5	7.6	15
	G	208-230/60/1	197/254	0.8	17.3	20.7	30	0.8	17.3	20.7	30
	E	265/60/1	239/292	0.7	16.2	19.4	30	0.7	16.2	19.4	30
	H	208-230/60/3	197/254	0.8	13.4	15.8	25	0.8	13.4	15.8	25
GSH/V 042	F*	460/60/3*	414/506	0.7	6.9	8.0	15	0.7	6.9	8.0	15
	G	208-230/60/1	197/254	0.8	19.2	23.3	35	0.8	19.2	23.3	35
	H	208-230/60/3	197/254	0.8	13.0	15.6	25	0.8	13.0	15.6	25
	N	575/60/3	518/633	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
GSH/V 048	F*	460/60/3*	414/506	1.07	6.8	8.1	15	0.7	6.8	8.1	15
	G	208-230/60/1	197/254	1.07	22.4	26.9	45	0.8	22.1	26.7	40
	H	208-230/60/3	197/254	1.07	16.5	19.6	30	0.8	16.2	19.3	30
	N	575/60/3	518/633	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
GSH/V 060	F*	460/60/3*	414/506	1.07	9.2	10.8	15	0.7	8.8	10.4	15
	G	208-230/60/1	197/254	1.07	29.5	35.7	60	1.07	29.5	35.7	60
	H	208-230/60/3	197/254	1.07	21.8	26.1	40	1.07	21.8	26.1	40
	N	575/60/3	518/633	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
GSH/V 070	F*	460/60/3*	414/506	1.07	9.6	11.2	15	1.07	9.6	11.2	15
	G	208-230/60/1	197/254	1.07	34.8	42.0	70	1.07	34.8	42.0	70
	H	208-230/60/3	197/254	1.07	23.3	27.6	40	1.07	23.3	27.6	40
	N	575/60/3	518/633	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

HACR circuit breaker in USA only.
All fuses Class RK-5

*** NEUTRAL CONNECTION REQUIRED! All F Voltage (460 vac) units with ClimaDry/internal secondary circulators require a four wire power supply with neutral. Reheat pumps/internal secondary circulators are rated 265 vac and are wired between one hot leg and neutral.**

GS Series 60Hz - R22 Submittal Data Eng/I-P




GS Series Wiring Diagram Matrix

Only CXM and DXM diagrams, with a representative diagram of LON and MPC Options are presented in this submittal. Other diagrams can be located online at climatemaster.com using the part numbers presented below.

Model	Refrigerant	Wiring Diagram Part Number	Electrical	Control	DDC	Agency
GS Series Single Phase	R22	96B0006N01	208-230/60/1, 265/60/1, 220-240/50/1	CXM	-	ETL
	R22 & R407C	96B0006N06			-	CE
	R22	96B0006N03			LON	ETL
	R22	96B0006N09			MPC	ETL
	R22 & R407C	96B0006N11			MPC	CE
	R22	96B0006N02		DXM	-	ETL
	R22 & R407C	96B0006N05			-	CE
	R22	96B0006N04			LON	ETL
	R22	96B0006N10			MPC	ETL
	R22	96B0006N30			ClimaDry®	ETL
GS Series Three Phase (230 Style)	R22	96B0007N01	208-230/60/3, 220-240/50/3	CXM	-	ETL
	R22	96B0007N03			LON	ETL
	R22	96B0007N06			MPC	ETL
	R22	96B0007N02		DXM	-	ETL
	R22	96B0007N04			LON	ETL
	R22	96B0007N07			MPC	ETL
GS Series Three Phase (460 Style)	R22	96B0008N01	460/60/3, 575/60/3, 380-420/50/3	CXM	-	ETL
	R22 & R407C	96B0008N06			-	CE
	R22	96B0008N03			LON	ETL
	R22	96B0008N08			MPC	ETL
	R22	96B0008N02		DXM	-	ETL
	R22 & R407C	96B0008N05			-	CE
	R22	96B0008N04			LON	ETL
	R22	96B0008N09			MPC	ETL


All wiring diagrams available at climatemaster.com. R407C submittals will only contain CE Mark wiring diagrams

Typical Wiring Diagram Single Phase GS Units With CXM Controller

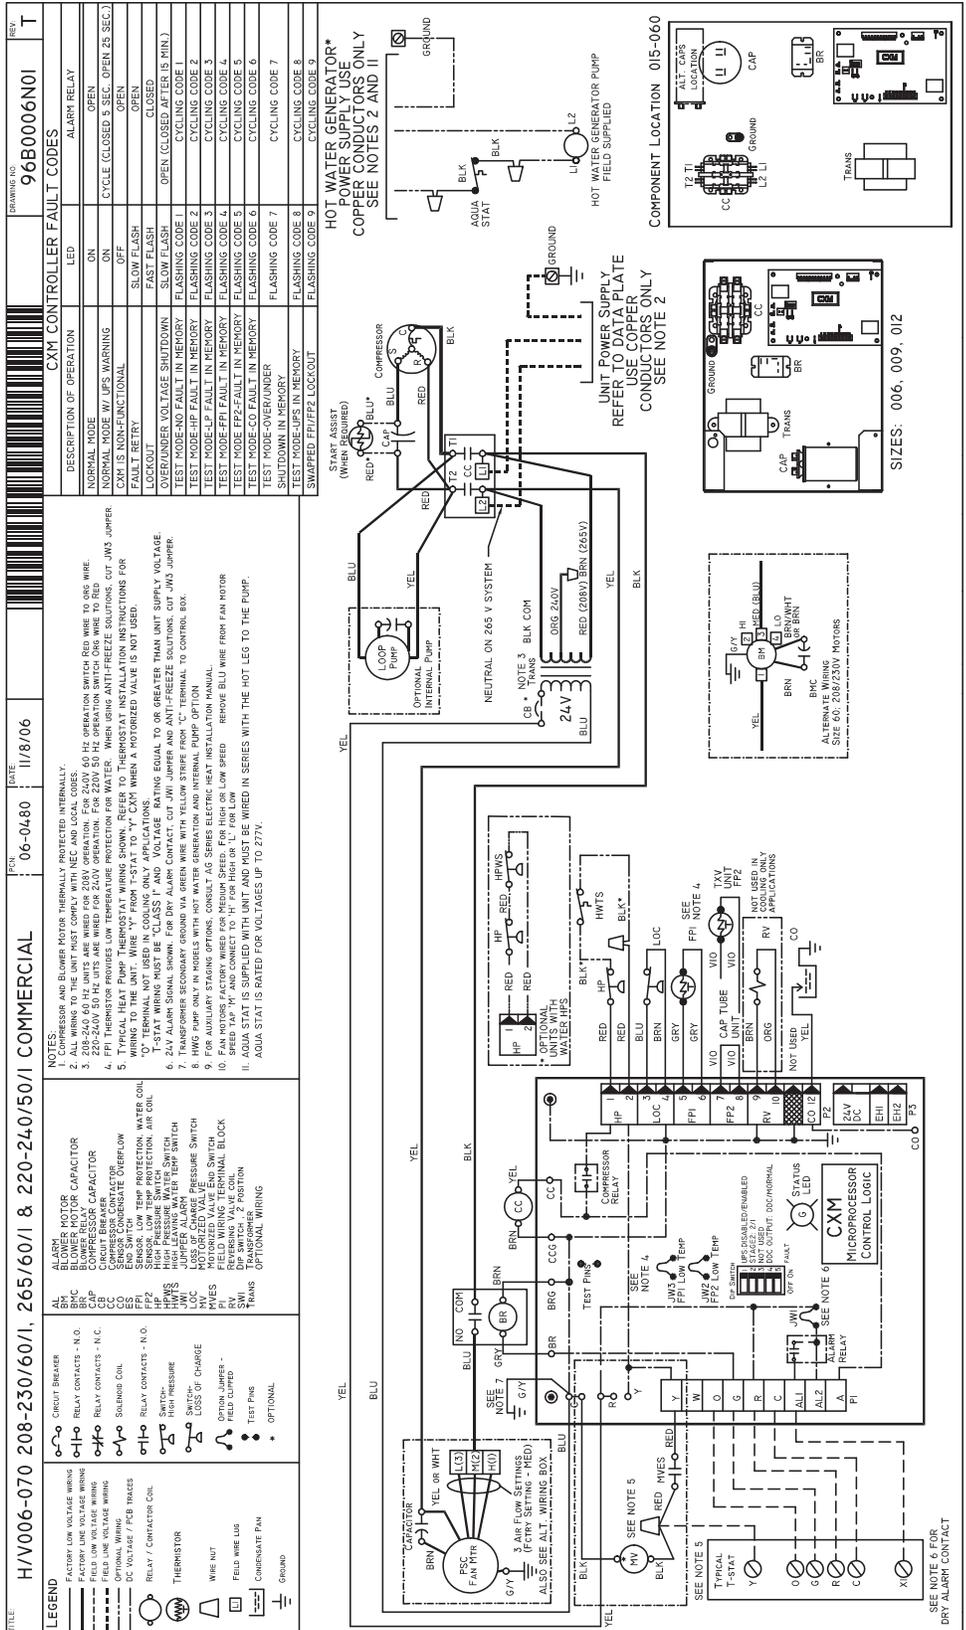

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.

Typical Wiring Diagram Three Phase 208/230V GS Units With CXM Controller

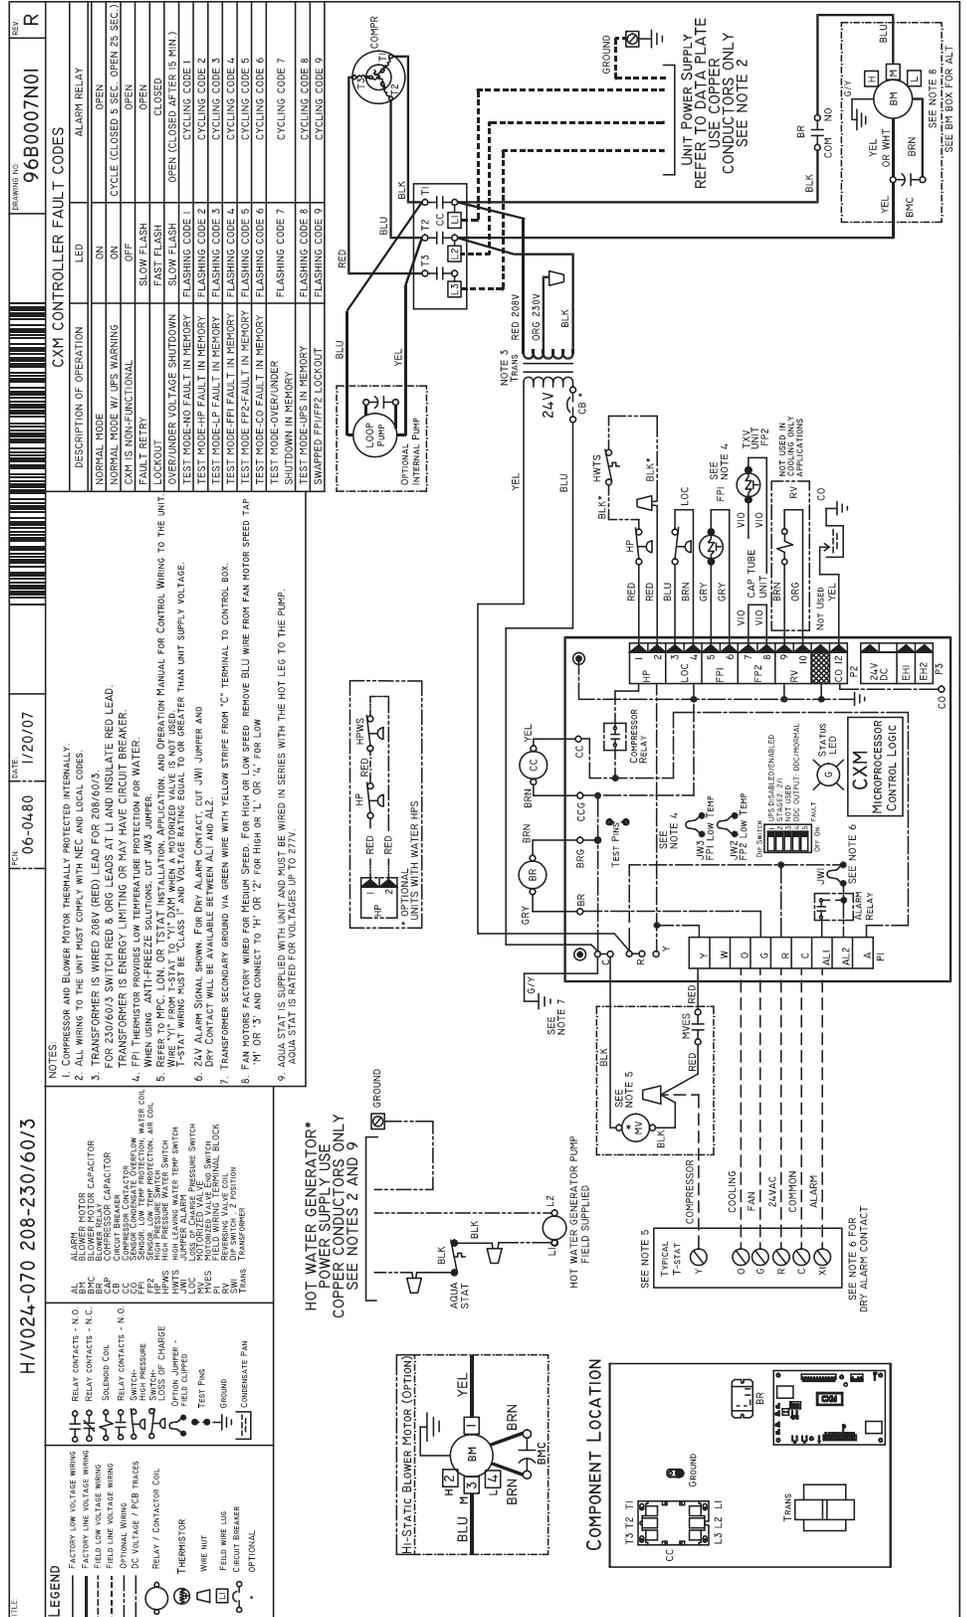










Typical Wiring Diagram Three Phase 208/230V GS Units With DXM Controller

OPERATION	STATUS LED (ON/OFF)	TEST LED (ON/OFF)	FAULT LED (ON/OFF)	ALARM RELAY (ON/OFF)
NORMAL MODE	ON	OFF	OFF	OFF
DXM IS NON-FUNCTIONAL	OFF	ON	ON	OPEN
TEST MODE	ON	ON	OFF	OFF
NORMAL MODE	OFF	OFF	OFF	OFF
EMERGENCY SHUT DOWN	OFF	OFF	ON	OFF
INVALID T-STAT INPUTS	OFF	OFF	ON	OFF
SWAPPED PH/PPZ LOCKOUT	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 1	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 2	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 3	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 4	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 5	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 6	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 7	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 8	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 9	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 10	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 11	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 12	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 13	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 14	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 15	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 16	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 17	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 18	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 19	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 20	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 21	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 22	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 23	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 24	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 25	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 26	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 27	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 28	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 29	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 30	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 31	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 32	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 33	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 34	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 35	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 36	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 37	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 38	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 39	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 40	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 41	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 42	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 43	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 44	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 45	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 46	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 47	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 48	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 49	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 50	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 51	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 52	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 53	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 54	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 55	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 56	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 57	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 58	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 59	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 60	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 61	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 62	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 63	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 64	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 65	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 66	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 67	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 68	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 69	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 70	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 71	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 72	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 73	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 74	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 75	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 76	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 77	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 78	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 79	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 80	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 81	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 82	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 83	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 84	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 85	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 86	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 87	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 88	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 89	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 90	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 91	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 92	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 93	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 94	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 95	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 96	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 97	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 98	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 99	OFF	OFF	ON	OFF
HP FAULT 7 (LOCKOUT) NOTE 100	OFF	OFF	ON	OFF

NOTES:
 1. COMPRESSOR THERMALLY PROTECTED INTERNALLY.
 2. ALL WIRING TO THE UNIT MUST COMPLY WITH NEC AND LOCAL CODES.
 3. FOR 230/60HZ SWITCH RED & ORG LEADS AT LI INSULATE RED LEAD TRANSFORMER IS ENERGY LIMITING OR MAY HAVE CIRCUIT BREAKER.
 4. FPI THERMISTOR PROVIDES LOW TEMPERATURE PROTECTION FOR WATER. WHEN USING ANTI-FREEZE SOLUTIONS, CUT JMS JUMPER.
 5. FOR CONTROL WIRING TO THE UNIT, WHEN A MOTORIZED VALVE IS NOT USED WIRE "Y" FROM T-STAT TO "Y1" DXM WHEN A MOTORIZED VALVE IS USED HEAT 7 COOL. THERMOSTATS NOT COMPATIBLE WITH MOTORIZED WATER VALVE AND DRY CONTACT WILL BE AVAILABLE BETWEEN ALL AND AL. JUMPER FOR SECONDARY GROUND VIA GREEN WIRE WITH YELLOW STRIPE FROM "C" TERMINAL TO CONTROL BOX.
 6. 24V ALARM SIGNAL SHOWN FOR DRY ALARM CONTACT. CUT JMS JUMPER AND DRY CONTACT WILL BE AVAILABLE BETWEEN ALL AND AL. JUMPER FOR SECONDARY GROUND VIA GREEN WIRE WITH YELLOW STRIPE FROM "C" TERMINAL TO CONTROL BOX.
 7. TRANSFORMER SECONDARY GROUND VIA GREEN WIRE WITH YELLOW STRIPE FROM "C" TERMINAL TO CONTROL BOX.
 8. FLOWER MOTOR IS FACTORY WIRE FOR MEDIUM AND HIGH SPEEDS. FOR ANY OTHER COMBINATION OF SPEEDS, AT THE MOTOR ATTACH BLACK WIRE AND THE BLUE WIRE TO THE LOWER OF THE TWO DESIRED SPEED TAPS.

ALARM RELAY CONTACTS
 BLU BLOWER MOTOR
 BNC BLOWER MOTOR CAPACITOR
 CAP COMPRESSOR CAPACITOR
 CB CIRCUIT BREAKER
 CCH CRANKCASE HEATER
 CO CONDENSATE OVERFLOW SENSOR
 COF CONDENSATE OVERFLOW FLOW SENSOR
 FPI FLOW PROTECTION INLET SENSOR
 FPH HIGH PRESSURE WATER SWITCH
 HPWS HIGH PRESSURE WATER SWITCH
 HWS HIGH PRESSURE WATER SWITCH
 JMS JUMPER
 JWC MOTORIZED WATER VALVE
 MVS MOTORIZED VALVE
 PIV MOTORIZED VALVE END SWITCH
 PVS MOTORIZED VALVE END SWITCH
 RVS REVERSING VALVE SOLENOID TRANSFORMER

LEGEND
 FIELD LINE VOLTAGE WIRING
 FIELD LOW VOLTAGE WIRING
 PRINTED CIRCUIT TRACE
 OPTIONAL WIRING
 RELAY / CONTACTOR COIL
 THERMISTOR
 CONDENSATE PAN
 CIRCUIT BREAKER
 SOLENOID COIL
 RELAY CONTACTS - N.O.
 TEMPERATURE SWITCH
 SWITCH-LOSS OF CHARGE
 GROUND
 WIRE NUT
 OPTIONAL

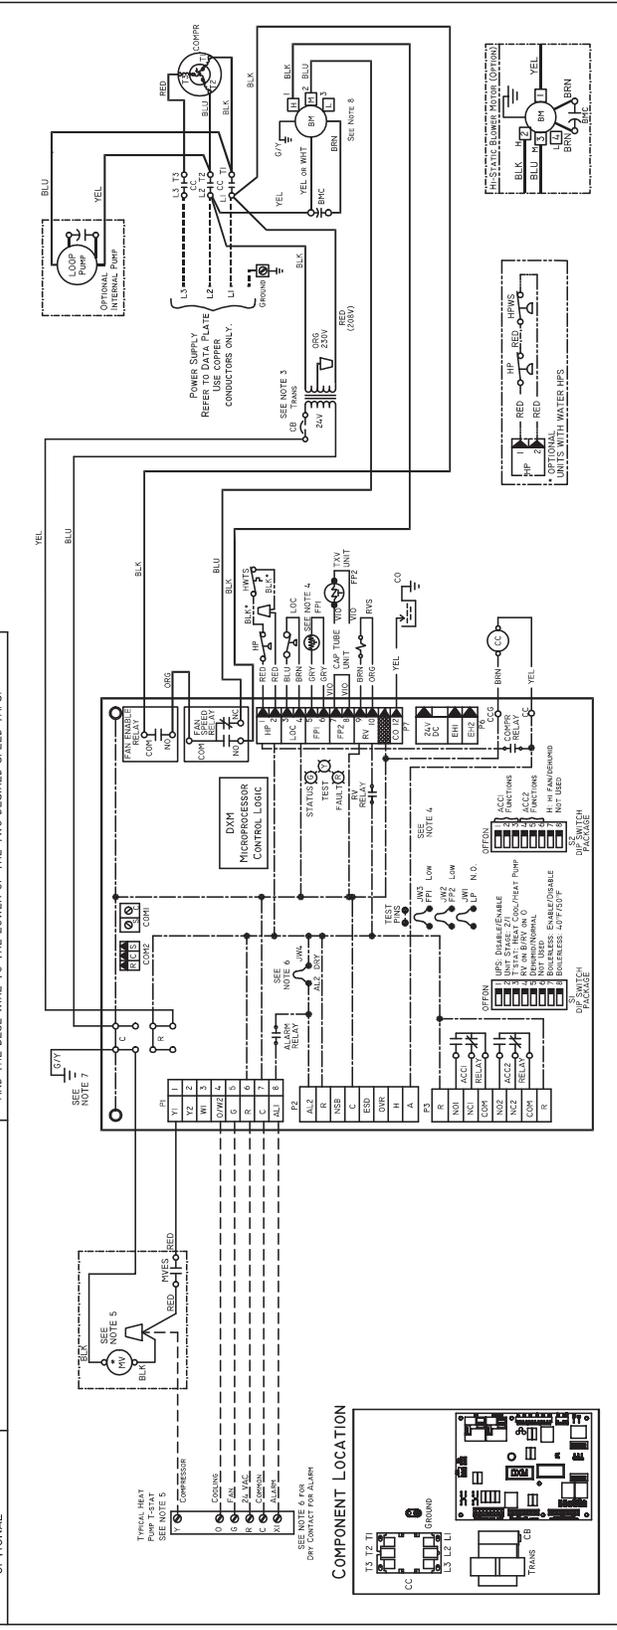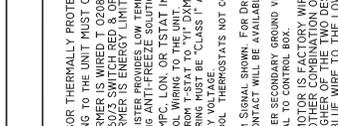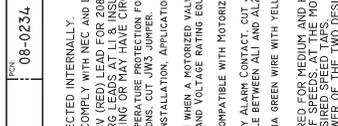

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.

Typical Wiring Diagram Three Phase 460/575V GS Units With CXM Controller

TITLE: H/V024-070 460/60/3, 575/60/3, 380-420/50/3 CXM DATE: 6/25/08 REV: 96B0008N01 R	<p>NOTES:</p> <ol style="list-style-type: none"> COMPRESSOR AND BLOWER MOTOR THERMALLY PROTECTED INTERNALLY. ALL WIRING TO THE UNIT MUST COMPLY WITH NEC AND LOCAL CODES. TRANSFORMER MUST BE RATED FOR THE UNIT'S FULL LOAD CURRENT. TRANSFORMER IS ENERGY LIMITING OR MAY HAVE CIRCUIT BREAKER. WIRE FROM T1 START TO T2 DPM WHICH A ROTOR WINDING IS NOT USED. WIRE FROM T3 TO T4 DPM WHICH A ROTOR WINDING IS NOT USED. 24V ALARM SIGNAL SHOWN FOR DRY ALARM CONTACT. CUT JUMPER AND DRY CONTACT WILL BE AVAILABLE BETWEEN ALI AND ALZ. BLOWER MOTOR FACTORY WIRED FOR MEDIUM SPEED. FOR HIGH OR LOW SPEED REMOVE BLU WIRE FROM FAN MOTOR SPEED TAP. FOR HIGH SPEED REMOVE BRN WIRE FROM BRN WIRE TAP. FOR LOW SPEED REMOVE BLU WIRE FROM BRN WIRE TAP. FOR BLOWER MOTORS WITH LEADS, FOR MEDIUM OR LOW SPEED DISCONNECT BLK WIRE FROM BRN. CONNECT BLK AND GRN WIRE TOGETHER. CONNECT RED FOR LOW OR BLU FOR MEDIUM TAP. BLOWER MOTOR FACTORY WIRED TO HIGH SPEED. FOR LOW SPEED REMOVE BLU WIRE FROM EXISTING SPEED TAP AND CONNECT TO LOW SPEED TAP. FOR HIGH SPEED REMOVE BRN WIRE FROM EXISTING SPEED TAP AND CONNECT TO HIGH SPEED TAP. CONNECT BLU WIRE TO HIGH SPEED TAP. TAPE OFF UNCONNECTED END OF BRN JUMPER. 	<p>LEGEND</p> <p>RELAY / CONTACTOR COIL FACTORY WINDING WIRING FIELD WINDING WIRING FIELD LINE VOLTAGE WIRING DC VOLTAGE / PCB TRACES</p> <p>RELAY / CONTACTOR COIL THERMISTOR WIRE IN/OUT FIELD WIRE USE CIRCUIT BREAKER</p> <p>ALTERNATE WIRING ALI ALZ BRN BLK BLU BR CC CO C FFI FPI G HP JWI LOC L L1 L2 L3 L4 L5 P2 P3 P4 P5 P6 P7 P8 P9 P10 P11 P12 P13 P14 P15 P16 P17 P18 P19 P20 P21 P22 P23 P24 P25 P26 P27 P28 P29 P30 P31 P32 P33 P34 P35 P36 P37 P38 P39 P40 P41 P42 P43 P44 P45 P46 P47 P48 P49 P50 P51 P52 P53 P54 P55 P56 P57 P58 P59 P60 P61 P62 P63 P64 P65 P66 P67 P68 P69 P70 P71 P72 P73 P74 P75 P76 P77 P78 P79 P80 P81 P82 P83 P84 P85 P86 P87 P88 P89 P90 P91 P92 P93 P94 P95 P96 P97 P98 P99 P100</p>
--	---	---

COMPONENT LOCATION

WIRING DIAGRAM


FAULT CODES

DESCRIPTION OF OPERATION	LED	ALARM RELAY
NORMAL MODE	ON	OPEN
NORMAL MODE W/ UPS WARNING	ON	CYCLE (CLOSED 5 SEC. OPEN 20 SEC.)
CXAM IS NON-FUNCTIONAL	OFF	OPEN
FAULT RETRY	SLOW FLASH	CLOSED
OVERVOLTAGE SHUTDOWN	SLOW FLASH	OPEN (CLOSED AFTER 15 MIN.)
FAST FLASH	FAST FLASH	CLOSED
TEST MODE-HP FAULT IN MEMORY	FLASHING CODE 1	CYCLING CODE 1
TEST MODE-FPI FAULT IN MEMORY	FLASHING CODE 2	CYCLING CODE 2
TEST MODE-FPI FAULT IN MEMORY	FLASHING CODE 3	CYCLING CODE 3
TEST MODE-FPI FAULT IN MEMORY	FLASHING CODE 4	CYCLING CODE 4
TEST MODE-FPI FAULT IN MEMORY	FLASHING CODE 5	CYCLING CODE 5
TEST MODE-FPI FAULT IN MEMORY	FLASHING CODE 6	CYCLING CODE 6
TEST MODE-FPI FAULT IN MEMORY	FLASHING CODE 7	CYCLING CODE 7
TEST MODE-FPI FAULT IN MEMORY	FLASHING CODE 8	CYCLING CODE 8
TEST MODE-FPI FAULT IN MEMORY	FLASHING CODE 9	CYCLING CODE 9

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.




Typical Wiring Diagram Three Phase 460/575V GS Units With DXM Controller

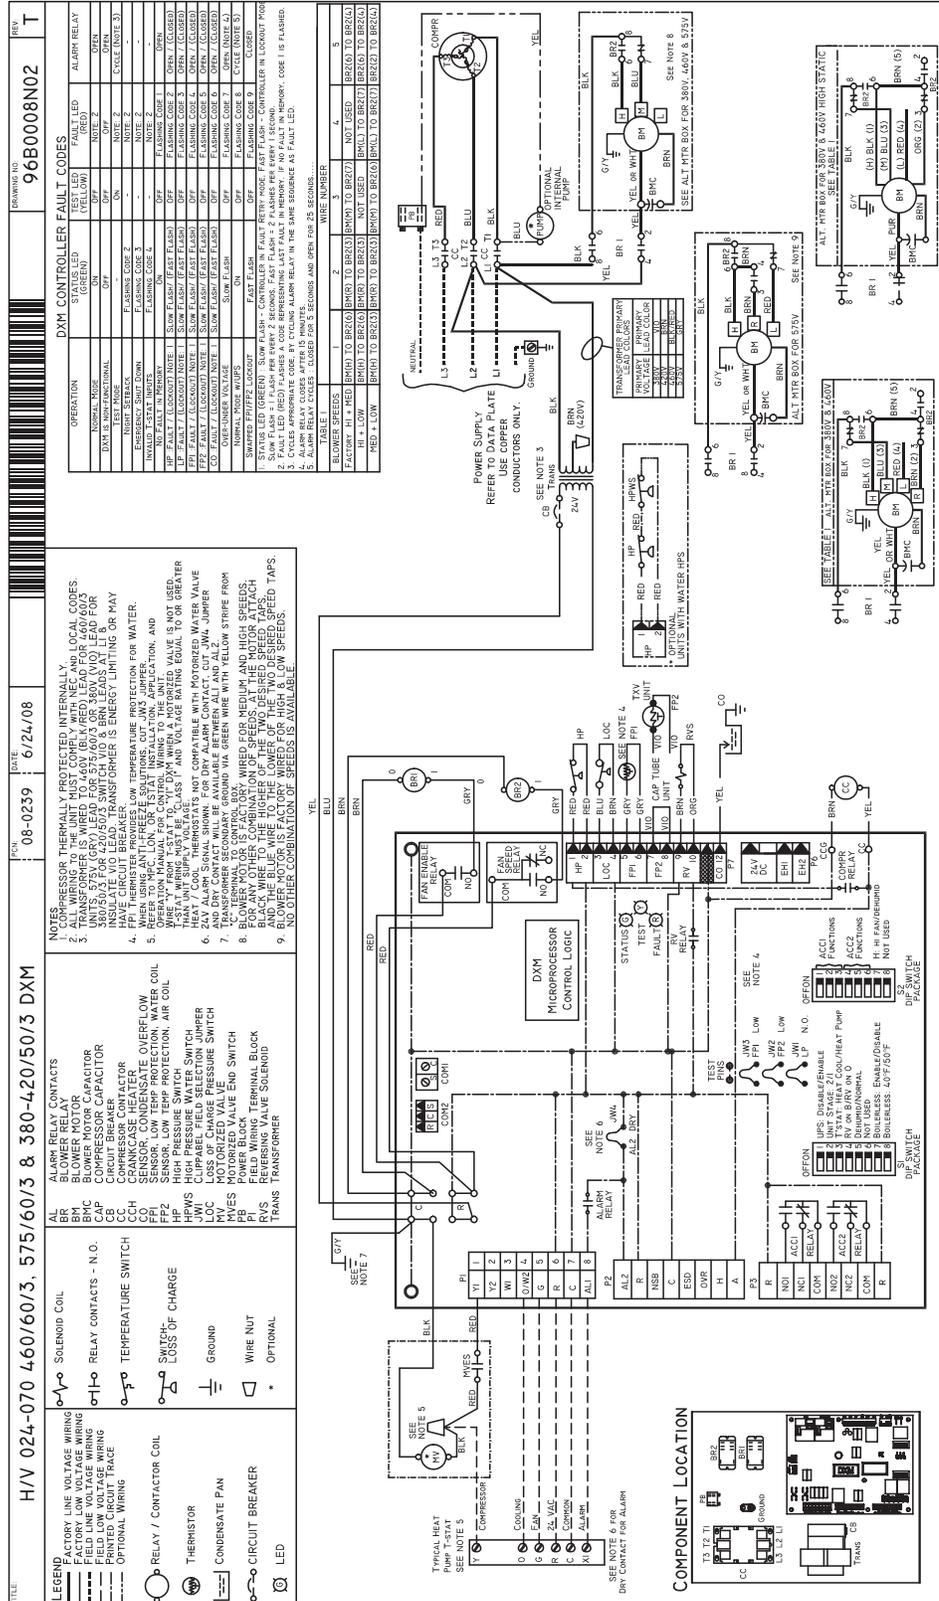

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



Typical Wiring Diagram Three Phase 460/575V GS Units With DXM & LON Controller

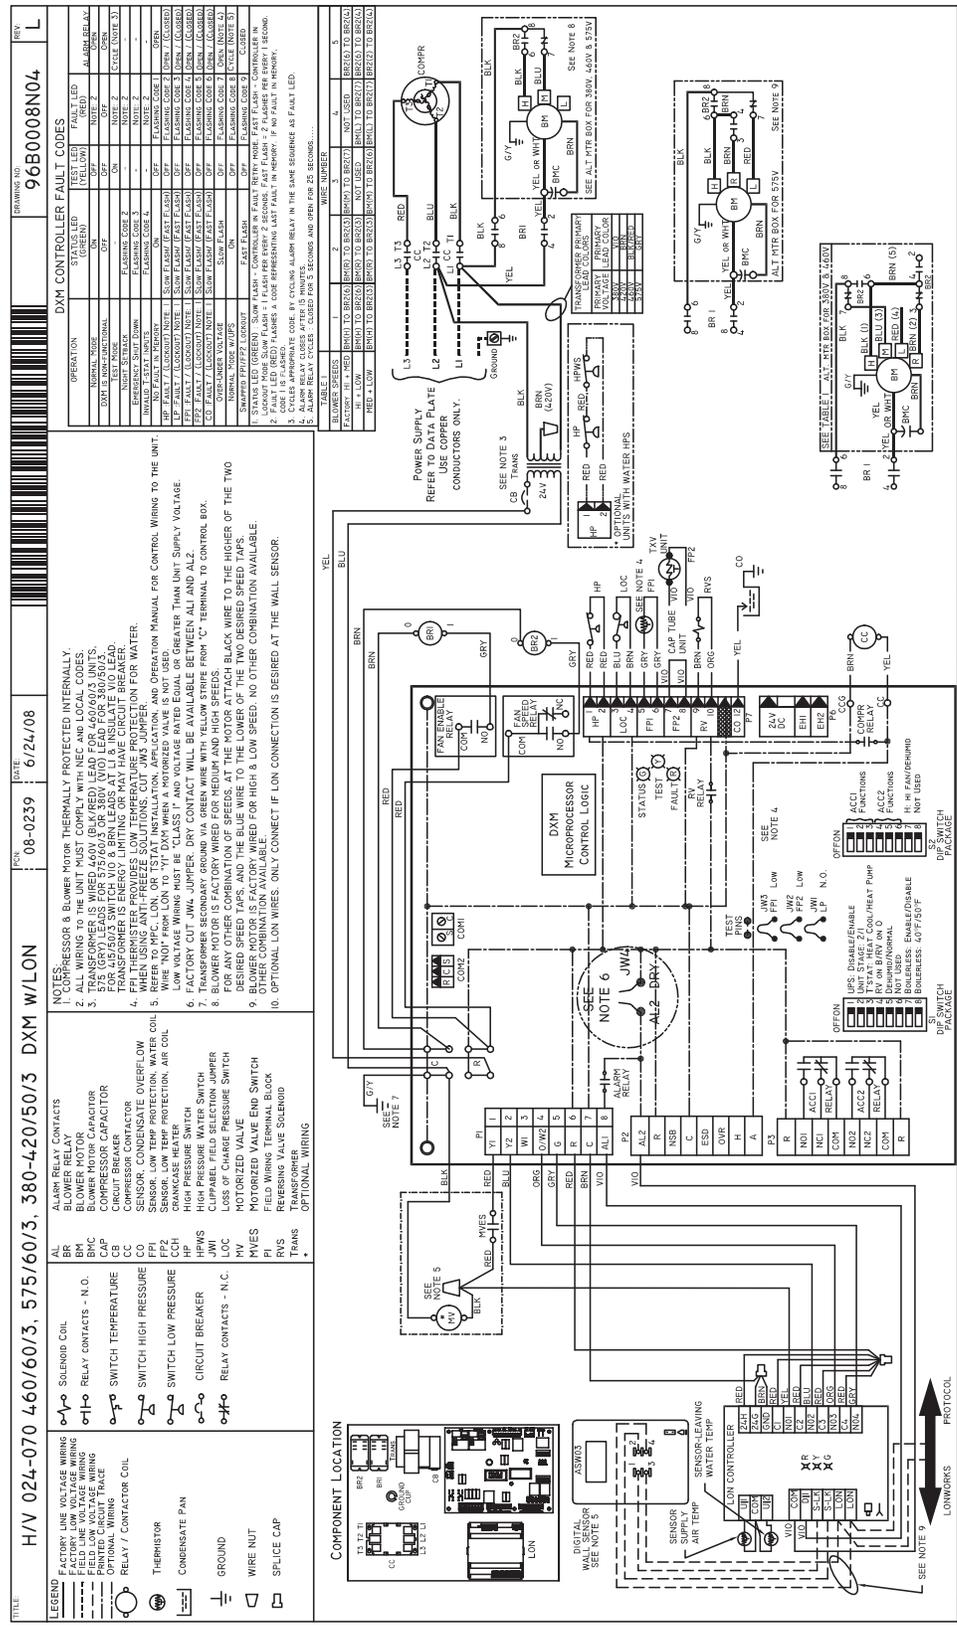

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



Genesis Ultra (GS) Series 60Hz Engineering Specifications Rev.: 04/02/07 Page 1

General:

Furnish and install ClimateMaster "Genesis" Water Source Heat Pumps, as indicated on the plans. Equipment shall be completely assembled, piped and internally wired. Capacities and characteristics as listed in the schedule and the specifications that follow.

Horizontal / Vertical Water Source Heat Pumps:

Units shall be supplied completely factory built for an entering water temperature range from 20° to 110°F (-6.7° to 43.3°C) as standard. Equivalent units from other manufacturers can be proposed provided approval to bid is given 10 days prior to bid closing. All equipment listed in this section must be rated and certified in accordance with American Refrigeration Institute / International Standards Organization (ARI / ISO) and Environmental Testing Laboratories for United States and Canada (ETL-US-C). The units shall have ARI / ISO and ETL-US-C labels. All units shall be fully quality tested by factory run testing under normal operating conditions and water flow rates as described herein. Quality control system shall automatically perform via computer: triple leak check, pressure tests, evacuate and accurately charge system, perform detailed heating and cooling mode tests, and quality cross check all operational and test conditions to pass/fail data base. Detailed report card will ship with each unit displaying all test performance data. Note: If unit fails on any cross check, system shall not be allowed unit to ship. Serial numbers will be recorded by factory and furnished to contractor on report card for ease of unit warranty status. **Units tested without water flow are not acceptable.**

Basic Construction:

Horizontal Units shall have one of the following air flow arrangements: Left Inlet/Straight (Right) Discharge; Right Inlet/Straight (Left) Discharge; Left Inlet/Back Discharge; or Right Inlet/Back Discharge as shown on the plans. Units must have the ability to be field convertible from straight to back or back to straight discharge with no additional parts or unit structure modification. Horizontal units will have factory installed hanger brackets with rubber isolation grommets packaged separately.

Vertical Units shall have one of the following air flow arrangements: Left Return/Top Discharge, Right Return/Top Discharge, Left Return/Bottom Discharge, Right Return/Bottom Discharge as shown on the plans.

If units with these arrangements are not used, the contractor is responsible for any extra costs incurred by other trades. All units (horizontal and vertical) must have a minimum of three access panels for serviceability of compressor compartment. **Units having only one access panel to compressor/heat exchangers/expansion device/refrigerant piping shall not be acceptable.**

The heat pumps shall be fabricated from heavy gauge galvanized steel. All interior surfaces shall be lined with 1/2 inch (12.7mm) thick, dual density, 1-3/4 lb/ft³ (28 kg/m³) acoustic type glass fiber insulation. Insulation placement shall be designed in a manner that will eliminate any exposed edges to prevent the introduction of glass fibers into the air stream.

Vertical heat pumps shall be fabricated from heavy gauge galvanized steel with powder coat paint finish. The color will be Polar Ice. Both sides of the steel shall be painted for added protection.

Standard cabinet panel insulation must meet NFPA 90A requirements, air erosion and mold growth limits of UL-181, stringent fungal resistance test per ASTM-C1071 and ASTM G21, and shall meet zero level bacteria growth per ASTM G22. **Unit insulation must meet these stringent requirements or unit(s) will not be accepted.**

All horizontal units to have factory installed 1" (25.4mm) discharge air duct collars, 1" (25.4mm) filter rails with 1" (25.4mm) filters factory installed, and factory installed unit-mounting brackets. Vertical units to have field installed discharge air duct collar, shipped loose and 1" (25.4mm) filter rails with 1" (25.4mm) filters factory installed. **If units with these factory installed provisions are not used, the contractor is responsible for any extra costs to field install these provisions, and/or the extra costs for his sub-contractor to install these provisions.**

All units must have an insulated panel separating the fan compartment from the compressor compartment. Units with the compressor in the air stream are not acceptable. Units shall have a factory installed 1 inch (25.4mm) wide filter bracket for filter removal from either side. Units shall have a 1 inch (25.4mm) thick throwaway type glass fiber filter. The contractor shall purchase one spare set of filters and replace factory shipped filters on completion of start-up. Filters shall be standard sizes. If units utilize non-standard filter sizes then the contractor shall provide 12 spare filters for each unit.

Cabinets shall have separate holes and knockouts for entrance of line voltage and low voltage control wiring. All factory-installed wiring passing through factory knockouts and openings shall be protected from sheet metal edges at openings by plastic ferrules. Supply and return water connections shall be copper IPT fittings, and shall be securely mounted flush to the cabinet corner post allowing for connection to a flexible hose without the use of a back-up wrench. **Water connections that protrude through the cabinet or require the use of a backup wrench shall not be allowed.** All water connections and electrical knockouts must be in the compressor compartment corner post as to not interfere with the serviceability of unit. **Contractor shall be responsible for**

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



Genesis Ultra (GS) Series 60Hz

Engineering Specifications Rev.: 04/02/07 Page 2

any extra costs involved in the installation of units that do not have this feature. Contractor must ensure that units can be easily removed for servicing and coordinate locations of electrical conduit and lights with the electrical contractor.

Option: Contractor shall install 2-inch (50.8mm) filter brackets and 2 inch(50.8mm) glass fiber throwaway filters on all units.

Option: UltraQuiet package shall consist of a discharge muffler (except rotary compressors) and high technology sound attenuating material that is strategically applied to the compressor and air handling compartment casings and fan scroll in addition to the standard ClimaQuiet system design, to further dampen and attenuate sound transmissions.

Option: The unit will be supplied with cupro nickel coaxial water to refrigerant heat exchanger.

Option: The unit will be supplied with internally factory mounted two-way water valve for variable speed pumping requirements. A factory-mounted or field-installed high pressure switch shall be installed in the water piping to disable compressor operation in the event water pressures build due to water freezing in the piping system.

Option: The unit will be supplied with internally factory mounted automatic water flow regulators.

Option: The unit will be supplied with internally mounted secondary pump for primary/secondary applications, specifically one-pipe systems.

Option: The unit shall be supplied with extended range Insulation option, which adds closed cell insulation to internal water lines, and provides insulation on suction side refrigeration tubing including refrigerant to water heat exchanger.

Option: The unit shall be supplied with a hot water generator (desuperheater).

Option: The refrigerant to air heat exchanger shall be "electro-coated" with a low cure cathodic epoxy material a minimum of 0.4 mils thick (0.4 – 1.5 mils range) on all surfaces. The black colored coating shall provide a minimum of 1000 hours salt spray protection per ASTM B117-97 on all galvanized end plates and copper tubing, and a minimum of 2000 hours of salt spray on all aluminum fins. The material shall be formulated without the inclusion of any heavy metals and shall exhibit a pencil hardness of 2H (ASTM D3363-92A), crosshatch adhesion of 4B-5B (ASTM D3359-95), and impact resistance of 160 in-lbs (184 kg-cm) direct (ASTM D2794-93).

*Option: Unit shall include ClimaDry reheat option. Only modulating reheat that will adjust capacity based upon supply air temperature to provide "neutral" (72°F, 22.2°C) constant air temperature will be accepted. "Neutral" supply air temperature shall be provided regardless of entering loop water temperatures (above 55°F, 12.8°C) or refrigerant condensing pressures. Control of reheat must be accomplished via a humidistat or dehumidistat contact closure. Refrigerant circuit must be ARI certified. Approved equal manufacturers may provide pre-engineered integrated modulating hot gas reheat within the unit cabinet, or the installing contractor in conjunction with the "approved equal" unit manufacturer can provide for approval (during the submittal phase) an engineered system consisting of: a duct mounted hot water coil, small circulating pump, modulating control valve, and associated piping using the discharge condenser water off of the unit as the heating medium. All design costs and costs of field installed items including additional power wiring to pump, and control wiring to and from pump and control valve to unit shall be borne by mechanical contractor. **Refrigerant circuits that are not ARI certified when the reheat option is applied will not be accepted. (See ClimaDry submittal for more details and unit availability.)***

Fan and Motor Assembly:

Blower shall have inlet rings to allow removal of wheel and motor from one side without removing housing. Units shall have a direct-drive centrifugal fan. The fan motor shall be 3-speed (2-speed for 575V), permanently lubricated, PSC type, with internal thermal overload protection. Units supplied without permanently lubricated motors must provide external oilers for easy service. The fan motor on small and medium size units (015-048) shall be isolated from the fan housing by a torsionally flexible motor mounting system with rubber type grommets to inhibit vibration induced high noise levels associated with "hard wire belly band" motor mounting. The fan motor on larger units (060 & 070) shall be isolated with flexible rubber type isolation grommets only. The fan and motor assembly must be capable of overcoming the external static pressures as shown on the schedule. Airflow / Static pressure rating of the unit shall be based on a wet coil and a clean filter in place. **Ratings based on a dry coil and / or no filter, or on an ESP less than 0.25 in w.g. (6.35 mm w.g.) shall NOT be acceptable.**

Option: High static motor (models GSH030, GSH036, GSV030, GSV036).

Refrigerant Circuit:

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.

Genesis Ultra (GS) Series 60Hz Engineering Specifications Rev.: 04/02/07 Page 3

Units shall have a sealed refrigerant circuit including a high efficiency scroll or rotary compressor designed for heat pump operation, a thermostatic expansion valve for refrigerant metering, an enhanced corrugated aluminum lanced fin and rifled copper tube refrigerant to air heat exchanger, reversing valve, coaxial (tube in tube) refrigerant to water heat exchanger, and safety controls including a high pressure switch, low pressure switch (loss of charge), water coil low temperature sensor, and air coil low temperature sensor. Access fittings shall be factory installed on high and low pressure refrigerant lines to facilitate field service. Activation of any safety device shall prevent compressor operation via a microprocessor lockout circuit. The lockout circuit shall be reset at the thermostat or at the contractor supplied disconnect switch. **Units that cannot be reset at the thermostat shall not be acceptable.**

Hermetic compressors shall be internally sprung. The compressor shall have a dual level vibration isolation system. The compressor will be mounted on computer selected vibration isolation springs to a large heavy gauge compressor mounting tray plate, which is then isolated from the cabinet base with rubber grommets for maximized vibration attenuation. Compressor shall have thermal overload protection. Compressor shall be located in an insulated compartment away from air stream to minimize sound transmission.

Refrigerant to air heat exchangers shall utilize enhanced corrugated lanced aluminum fins and rifled copper tube construction rated to withstand 450 PSIG (3101 kPa) refrigerant working pressure. Refrigerant to water heat exchangers shall be of copper inner water tube and steel refrigerant outer tube design, rated to withstand 450 PSIG (3101 kPa) working refrigerant pressure and 450 PSIG (3101 kPa) working water pressure. The refrigerant to water heat exchanger shall be "electro-coated" with a low cure cathodic epoxy material a minimum of 0.4 mils thick (0.4 – 1.5 mils range) on all surfaces. The black colored coating shall provide a minimum of 1000 hours salt spray protection per ASTM B117-97 on all external steel and copper tubing. The material shall be formulated without the inclusion of any heavy metals and shall exhibit a pencil hardness of 2H (ASTM D3363-92A), crosshatch adhesion of 4B-5B (ASTM D3359-95), and impact resistance of 160 in-lbs (184 kg-cm) direct (ASTM D2794-93).

Refrigerant metering shall be accomplished by thermostatic expansion valve only. Expansion valves shall be dual port balanced types with external equalizer for optimum refrigerant metering. Units shall be designed and tested for operating ranges of entering water temperatures from 20° to 110°F (-6.7° to 43.3°C). Reversing valve shall be four-way solenoid activated refrigerant valve, which shall default to heating mode should the solenoid fail to function. If the reversing valve solenoid defaults to cooling mode, an additional low temperature thermostat must be provided to prevent over-cooling an already cold room.

Drain Pan:

The drain pan shall be constructed of galvanized steel and have a powder coat paint application to further inhibit corrosion. This corrosion protection system shall meet the stringent 1000 hour salt spray test per ASTM B117. If plastic type material is used, it must be HDPE (High Density Polyethylene) to avoid thermal cycling shock stress failure over the lifetime of the unit. Stainless Steel materials are also acceptable. Drain pan shall be fully insulated. Drain outlet shall be located at pan as to allow complete and unobstructed drainage of condensate. Drain outlet for horizontal units shall be connected from pan directly to IPT fitting.

No hidden internal tubing extensions from pan outlet extending to unit casing (that can create drainage problems) will be accepted. The unit as standard will be supplied with solid-state electronic condensate overflow protection. **Mechanical float switches will NOT be accepted.**

Vertical units shall be furnished with a PVC slip condensate drain connection and an internal factory installed condensate trap. **If units without an internal trap are used, the contractor is responsible for any extra costs to field install these provisions, and/or the extra costs for his sub-contractor to install these provisions.**

Electrical:

A control box shall be located within the unit compressor compartment and shall contain a 50VA transformer, 24 volt activated, 2 or 3 pole compressor contactor, terminal block for thermostat wiring and solid-state controller for complete unit operation. Reversing valve and fan motor wiring shall be routed through this electronic controller. Units shall be name-plated for use with time delay fuses or HACR circuit breakers. Unit controls shall be 24 Volt and provide heating or cooling as required by the remote thermostat / sensor.

Solid State Control System (CXM):

Units shall have a solid-state control system. **Units utilizing electro-mechanical control shall not be acceptable.** The control system microprocessor board shall be specifically designed to protect against building electrical system noise contamination, EMI, and RFI interference. The control system shall interface with a heat pump type thermostat. The control system shall have the following features:

- a. Anti-short cycle time delay on compressor operation.

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



Genesis Ultra (GS) Series 60Hz

Engineering Specifications Rev.: 04/02/07 Page 4

- b. Random start on power up mode.
- c. Low voltage protection.
- d. High voltage protection.
- e. Unit shutdown on high or low refrigerant pressures.
- f. Unit shutdown on low water temperature.
- g. Condensate overflow electronic protection.
- h. Option to reset unit at thermostat or disconnect.
- i. Automatic intelligent reset. Unit shall automatically reset the unit 5 minutes after trip if the fault has cleared. If a fault occurs 3 times sequentially without thermostat meeting temperature, then lockout requiring manual reset will occur.
- j. Ability to defeat time delays for servicing.
- k. Light emitting diode (LED) on circuit board to indicate high pressure, low pressure, low voltage, high voltage, low water/air temperature cut-out, condensate overflow, and control voltage status.
- l. The low-pressure switch shall not be monitored for the first 120 seconds after a compressor start command to prevent nuisance safety trips.
- m. 24V output to cycle a motorized water valve or other device with compressor contactor.
- n. Unit Performance Sentinel (UPS). The UPS warns when the heat pump is running inefficiently.
- o. Water coil low temperature sensing (selectable for water or anti-freeze).
- p. Air coil low temperature sensing.

NOTE: Units not providing the 8 safety protections of anti-short cycle, low voltage, high voltage, high refrigerant pressure, low pressure (loss of charge), air coil low temperature cut-out, water coil low temperature cut-out, and condensate overflow protections will not be accepted.

Option: Enhanced solid state control system (DXM)

This control system features two stage control of cooling and two stage control of heating modes for exacting temperature and dehumidification purposes.

This control system coupled with a multi-stage thermostat will better dehumidify room air by automatically running the heat pump's fan at lower speed on the first stage of cooling thereby implementing low sensible heat ratio cooling. On the need for higher cooling performance the system will activate the second stage of cooling and automatically switch the fan to the higher fan speed setting. This system may be further enhanced with a humidistat. **Units not having automatic low sensible heat ratio cooling will not be accepted;** as an alternate a hot gas reheat coil may be provided with control system for automatic activation.

Control shall have all of the above mentioned features of the CXM control system along with the following expanded features:

- a. Removable thermostat connector.
- b. Night setback control.
- c. Random start on return from night setback.
- d. Minimized reversing valve operation (Unit control logic shall only switch the reversing valve when cooling is demanded for the first time. The reversing valve shall be held in this position until the first call for heating, ensuring quiet operation and increased valve life.).
- e. Override temperature control with 2-hour (adjustable) timer for room occupant to override setback temperature at the thermostat.
- f. Dry contact night setback output for digital night setback thermostats.
- g. Ability to work with heat pump or heat/cool (Y, W) type thermostats.
- h. Ability to work with heat pump thermostats using O or B reversing valve control.
- i. Emergency shutdown contacts.
- j. Boilerless system heat control at low loop water temperature.
- k. Ability to allow up to 3 units to be controlled by one thermostat.
- l. Relay to operate an external damper.
- m. Ability to automatically change fan speed from multistage thermostat.
- n. Relay to start system pump.
- o. 75 VA control transformer. Control transformer shall have load side short circuit and overload protection via a built in circuit breaker.

Remote Service Sentinel (CXM/DXM):

Solid state control system shall communicate with thermostat to display (at the thermostat) the unit status, fault status, and specific fault condition, as well as retrieve previously stored fault that caused unit shutdown. The Remote Service Sentinel allows

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



Genesis Ultra (GS) Series 60Hz Engineering Specifications Rev.: 04/02/07 Page 5

building maintenance personnel or service personnel to diagnose unit from the wall thermostat. The control board shall provide a signal to the thermostat fault light, indicating a lockout. Upon cycling the G (fan) input 3 times within a 60 second time period, the fault light shall display the specific code as indicated by a sequence of flashes. A detailed flashing code shall be provided at the thermostat LED to display unit status and specific fault status such as over/under voltage fault, high pressure fault, low pressure fault, low water temperature fault, condensate overflow fault, etc. **Units that do not provide this remote service sentinel shall not be acceptable.**

Option: Lonworks interface system

Units shall have all the features listed above (either CXM or DXM) and the control board will be supplied with a LONWORKS interface board, which is LONMark certified. This will permit all units to be daisy chained via a 2-wire twisted pair shielded cable. The following points must be available at a central or remote computer location:

- a. Space temperature
- b. Leaving water temperature
- c. Discharge air temperature
- d. Command of space temperature setpoint
- e. Cooling status
- f. Heating status
- g. Low temperature sensor alarm
- h. Low pressure sensor alarm
- i. High pressure switch alarm
- j. Condensate sensor alarm
- k. Hi/low voltage alarm
- l. Fan "ON/AUTO" position of space thermostat as specified above
- m. Unoccupied / occupied command
- n. Cooling command
- o. Heating command
- p. Fan "ON / AUTO" command
- q. Fault reset command
- r. Itemized fault code revealing reason for specific shutdown fault (any one of 7)

This option also provides the upgraded 75VA control transformer with load side short circuit and overload protection via a built in circuit breaker.

Option: MPC (Multiple Protocol Control) interface system

Units shall have all the features listed above (either CXM or DXM) and the control board will be supplied with a Multiple Protocol interface board. Available protocols are BACnet MS/TP, Modbus, or Johnson Controls N2. The choice of protocol shall be field selectable/changeable via the use of a simple selector switch. Protocol selection shall not require any additional programming or special external hardware or software tools. This will permit all units to be daisy chain connected by a 2-wire twisted pair shielded cable. The following points must be available at a central or remote computer location:

- a. Space temperature
- b. Leaving water temperature
- c. Discharge air temperature
- d. Command of space temperature setpoint
- e. Cooling status
- f. Heating status
- g. Low temperature sensor alarm
- h. Low pressure sensor alarm
- i. High pressure switch alarm
- j. Condensate overflow alarm
- k. Hi/low voltage alarm
- l. Fan "ON/AUTO" position of space thermostat as specified above
- m. Unoccupied / occupied command
- n. Cooling command
- o. Heating command
- p. Fan "ON / AUTO" command
- q. Fault reset command
- r. Itemized fault code revealing reason for specific shutdown fault (any one of 7)



Genesis Ultra (GS) Series 60Hz Engineering Specifications Rev.: 04/02/07 Page 5

This option also provides the upgraded 75VA control transformer with load side short circuit and overload protection via a built in circuit breaker.

Warranty:

Climate Master shall warranty equipment for a period of 12 months from start up or 18 months from shipping (which ever occurs first).

Option: Extended 4-year compressor warranty covers compressor for a total of 5 years.

Option: Extended 4-year refrigeration circuit warranty covers coils, reversing valve, expansion valve and compressor for a total of 5 years.

Option: Extended 4-year control board warranty covers the CXM/DXM control board for a total of 5 years.

FIELD INSTALLED OPTIONS

Hose Kits:

All units 120000 BTUH (35 kW) and below shall be connected with hoses. The hoses shall be 2 feet (61cm) long, braided stainless steel; fire rated hoses complete with adapters. Only fire rated hoses will be accepted.

Valves:

The following valves are available and will be shipped loose:

- Ball valve; bronze material, standard port full flow design, IPT connections.
- Ball valve with memory stop and PT Port; standard port full flow design, IPT connections.
- "Y" strainer with cap; bronze material, IPT connections.
- "Y" strainer with blowdown valve; bronze material, IPT connections.
- Motorized water valve; slow acting, 24v, IPT connections.

Hose Kit Assemblies:

The following assemblies ship with the valves already assembled to the hose described:

- Supply and return hoses having ball valve with PT port.
- Supply hose having ball valve with PT port; return hose having automatic flow regulator valve (Measureflo) with PT ports, and ball valve.
- Supply hose having "Y" strainer with blowdown valve, and ball valve with PT port; return hose having automatic flow regulator (Measureflo) with PT ports, and ball valve.

Thermostats:

The thermostat shall be a ClimateMaster mechanical or electronic type thermostat as selected below with the described features:

- Single Stage Standard Manual Changeover (ATM11C01)**
Thermostat shall be a single-stage, vertical mount, manual changeover with HEAT-OFF-COOL system switch and fan ON-AUTO switch. Thermostat shall have a mechanical temperature indicator and set point indication. Thermostat shall only require 4 wires for connection. Mercury bulb thermostats are not acceptable.
- Single Stage Digital Manual Changeover with Two-Speed Fan Control (ATM11C03) – DXM and PSC Fan required**
Thermostat shall be a single-stage, digital, manual changeover with HEAT-OFF-COOL system switch, fan ON-AUTO switch, and fan LO-HI switch. Thermostat shall have an LCD display with temperature and set-point(s) in °F or °C. The Thermostat shall provide permanent memory of set-point(s) without batteries. A fault LED shall be provided to display specific fault condition. Thermostat shall come standard with remote temperature sensor, but may be operated with internal sensor if desired via installation of a jumper.
- Single Stage Digital Auto or Manual Changeover (ATA11U01)**
Thermostat shall be a single-stage, digital, auto or manual changeover with HEAT-OFF-COOL-AUTO system switch and fan ON-AUTO switch. Thermostat shall have an LCD display with temperature and set-point(s) in °F or °C. The Thermostat shall provide permanent memory of set-point(s) without batteries. A fault LED shall be provided to display specific fault condition. Thermostat shall provide temperature display offset for custom applications.
- Single Stage Digital Automatic Changeover with Two-Speed Fan Control (ATA11C04) – DXM and PSC Fan required**
Thermostat shall be a single-stage, digital, auto or manual changeover with HEAT-OFF-COOL-AUTO system switch, fan ON-AUTO switch, and fan LO-HI switch. Thermostat shall have an LCD display with temperature and set-point(s) in °F or °C. The Thermostat shall provide permanent memory of set-point(s) without batteries. A fault LED shall be provided to display specific fault condition. Thermostat shall come standard with remote temperature sensor, but may be operated with internal sensor if desired via installation of a jumper.

ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products. The latest version of this document is available at www.climatemaster.com.



Genesis Ultra (GS) Series 60Hz Engineering Specifications Rev.: 04/02/07 Page 5

- e. Multistage Digital Automatic Changeover (ATA22U01)
Thermostat shall be multi-stage (2H/2C), manual or automatic changeover with HEAT-OFF-COOL-AUTO system settings and fan ON-AUTO settings. Thermostat shall have an LCD display with temperature, set-point(s), mode, and status indication. The temperature indication shall be selectable for °F or °C. The thermostat shall provide permanent memory of set-point(s) without batteries. A fault LED shall be provided to indicate specific fault condition(s). Thermostat shall provide temperature display offset for custom applications. Thermostat shall allow unit to provide better dehumidification with optional DXM controller by automatically using lower fan speed on stage 1 cooling (higher latent cooling) as main cooling mode, and automatically shifting to high speed fan on stage 2 cooling.
- f. Single Stage Manual Changeover Programmable 5/2 Day (ATP11N01)
Thermostat shall be 5 day/2 day programmable (with up to 4 set points per day), single stage (1H/1C), manual changeover with HEAT-OFF-COOL system settings and fan ON-AUTO settings. Thermostat shall have an LCD display with temperature, set-point(s), mode, and status indication. The temperature indication shall be selectable for °F or °C. The thermostat shall provide permanent memory of set-point(s) without batteries. Thermostat shall provide convenient override feature to temporarily change set point.
- g. Multistage Automatic or Manual Changeover Programmable 5/2 Day (ATP21U01)
Thermostat shall be 5 day/2 day programmable (with up to 4 set points per day), multi-stage (2H/1C), automatic or manual changeover with HEAT-OFF-COOL-AUTO system settings and fan ON-AUTO settings. Thermostat shall have an LCD display with temperature, set-point(s), mode, and status indication. The temperature indication shall be selectable for °F or °C. The thermostat shall provide permanent memory of set-point(s) without batteries. Thermostat shall provide convenient override feature to temporarily change set point.
- h. Multistage Automatic or Manual Changeover Programmable 7 Day (ATP32U01)
Thermostat shall be 7 day programmable (with up to 4 set points per day), multi-stage (3H/2C), automatic or manual changeover with HEAT-OFF-COOL-AUTO system settings and fan ON-AUTO settings. Thermostat shall have a blue backlit dot matrix LCD display with temperature, set-points, mode, and status indication. The temperature indication shall be selectable for °F or °C. Time display shall be selectable for 12 or 24 hour clock. Fault identification shall be provided (when used with ClimateMaster CXM or DXM controls) to simplify troubleshooting by providing specific unit fault at the thermostat with red backlit LCD during unit lockout. The thermostat shall provide permanent memory of set-points without batteries. Thermostat shall provide heating set-point range limit, cooling set-point range limit, temperature display offset, keypad lockout, dead-band range setting, and inter-stage differential settings. Thermostat shall provide progressive recovery to anticipate time required to bring space temperature to the next programmed event. Thermostat shall provide an installer setup for configuring options and for setup of servicing contractor name and contact information. Thermostat shall allow the use of an accessory remote and/or outdoor temperature sensor (AST008). Thermostat navigation shall be accomplished via five buttons (up/down/right/left/select) with menu-driven selections for ease of use and programming.
- i. Multistage Automatic or Manual Changeover Programmable 7 Day with Humidity Control (ATP32U02)
Thermostat shall be 7 day programmable (with up to 4 set points per day), multi-stage (3H/2C), automatic or manual changeover with HEAT-OFF-COOL-AUTO system settings and fan ON-AUTO settings. Separate dehumidification and humidification set points shall be configurable for discreet outputs to a dehumidification option and/or an external humidifier. Installer configuration mode shall allow thermostat dehumidification mode to operate with ClimaDry reheat or with ECM fan dehumidification mode via settings changes. Thermostat shall have a blue backlit dot matrix LCD display with temperature, relative humidity, set-points, mode, and status indication. The temperature indication shall be selectable for °F or °C. Time display shall be selectable for 12 or 24 hour clock. Fault identification shall be provided (when used with ClimateMaster CXM or DXM controls) to simplify troubleshooting by providing specific unit fault at the thermostat with red backlit LCD during unit lockout. The thermostat shall provide permanent memory of set-points without batteries. Thermostat shall provide heating set-point range limit, cooling set-point range limit, temperature display offset, keypad lockout, dead-band range setting, and inter-stage differential settings. Thermostat shall provide progressive recovery to anticipate time required to bring space temperature to the next programmed event. Thermostat shall provide an installer setup for configuring options and for setup of servicing contractor name and contact information. Thermostat shall allow the use of an accessory remote and/or outdoor temperature sensor (AST008). Thermostat navigation shall be accomplished via five buttons (up/down/right/left/select) with menu-driven selections for ease of use and programming.

DDC Sensors:

ClimateMaster wall mounted DDC sensor to monitor room temperature and interfaces with optional interface system described above. Several types as described below:

- a. Sensor only with no display (LON and MPC).
- b. Sensor with override (LON only).
- c. Sensor with setpoint and adjustment override (MPC only).
- d. Sensor with setpoint and adjustment override, LCD display, status/fault indication (LON and MPC).

GS Series 60Hz - R22 Submittal Data Eng/I-P



Revision History

Date:	Item:	Action:
05/22/09	Big Book and Stand-Alone Submittals	Consolidated
17 Nov, 2008	Horizontal Dimensional Data Table	Data Corrected
26 Aug, 2008	Physical Data Table	Max Working Pressure Table Added
12 June, 2008	Wiring Diagram Matrix	ETL Information Added
30 May, 2008	MWV Pressure Drop Data	Updated
1 May, 2008	Electrical Data Tables	Added Asterisks
18 April, 2007	Blower Data	Updated Blower Data
18 April, 2007	Table of Contents	Added Table of Contents
18 April, 2007	Specifications	Updated Specifications with new Safety Agency
16 Nov, 2006	Electrical Data	Updated data
16 Nov, 2006	Dimensional Data	Updated dimensional data to new format
16 Nov, 2006	Performance Data/Blower Data	Added new rated voltage note
19 July, 2006	Specifications	Updated thermostat offering
19 July, 2006	Wiring Diagrams	Added pressure switch for motorized valve option
19 July, 2006	Electrical Data	Split reheat and secondary pump data, added high static data, updated compressor RLA and LRA
19 July, 2006	Performance Data	Added low temperature selection notes
23 Dec. 2005	Motorized Valves	Added Cv, MOPD, and WPD data
30 Nov, 2005	Tables	Updated all tables in new format
30 Nov, 2005	Dimensional Data	Added new unit drawings, horizontal weights, and installation notes
30 Nov, 2005	Physical Data	Added Coax volumes
30 Nov, 2005	ClimaDry	Added ClimaDry Corrections & Electrical Data
18 Aug, 2005	Specifications	Updated CXM verbiage; Added discharge muffler to UltraQuiet option
18 Aug, 2005	Correction Factors	Changed "Nominal" to "Rated"; removed CFM/ton column and associated note
18 Aug, 2005	Added Change Log	