



Commercial Case Study

A Tale of Two Buildings

The best of times is when operating costs are cut in half and customer satisfaction is up. That's the case with Steve Garrett, building owner, who has seen the difference a well-designed geothermal heating and cooling system can make in operating costs and occupant comfort. His two buildings, located on the same property in Oklahoma City, demonstrate the stark contrast in energy costs between the variable air volume (VAV) and the geothermal closed-loop system.

In 1987, the two-story Garrett Building #1 was built utilizing a VAV air handler system that included an air-cooled condenser, gas-fired boiler, electronic controls and an economizer to heat and cool approximately 15,000 square feet (1,390 square meters) of office space. The equipment is located on the roof.

Ten years later, Garrett constructed a nearly identical office building of approximately 20,000 square feet (1,860 square meters), but decided to use the closed-loop geothermal heat pump system recommended by his heating and cooling contractor. Not only did the geothermal heating and cooling system offer the highest energy efficiency, but the elimination of outdoor

or rooftop equipment meant that the equipment would not be exposed to the temperature extremes, dirt, and pollution of the harsh outdoor environment. For this reason, these systems require less maintenance than conventional systems and retain their high efficiency over the years. Since units are protected from weather, equipment life is extended and repairs are rare.

The Geothermal system installation began with a vertical loop grid located under the parking area.



A roof top brick room houses the conventional HVAC equipment.



Geothermal loop grid located under the parking area.

The loop field layout consists of 40 boreholes drilled approximately 250 feet (76 meters) deep on 20 foot (6 meter) centers each with 3/4 inch (19mm) diameter polyethylene high-density piping. Every loop zone of 10 bores has a short header manifold in the center. The loops are connected to a small central pump room that feeds the 16 ClimateMaster horizontal, ceiling-mounted units throughout the two-story building.

Both buildings are similar office facilities with cubical areas in the center surrounded by private offices and conference rooms on the perimeter. The similarity in the two buildings allows for a fair comparison in energy costs and load factors.

Average annual energy costs for building #2 (Geo) is \$0.96/sf. ft. (\$0.10/sq. meter); average annual energy costs for building #1 (VAV) is \$2.12/sq. ft. (\$0.23/sq. meter.).




Installation costs were notably comparable at \$128,700 for the geothermal system versus the \$100,000 for the VAV system in 1987. But, the VAV system cost did not take into account the expense of the rooftop brick equipment room and the lesser square footage. In addition, a \$30,000 upgrade to the VAV system was completed in '2001, which further bumped up costs for the conventional installation. In comparison, the geothermal system has already returned fifty percent (50%) of the initial investment via energy savings.

"The low maintenance and operating costs of the geothermal system makes financial sense for me as an owner and occupant of the building. Plus, you add that it's environmentally friendly and saves energy... going geothermal is the right choice," said Garrett, owner.

The Bigger Picture

The benefits of geothermal technology affect not just owner/occupants but also the environment and utilities. The earth-friendly nature of the technology offers a clean and green renewable energy source. With trace CO₂ emissions, the geothermal application helps protect the ozone layer. According to the US EPA, a typical 3-ton (10.5kW) residential GHP system produces an average of about one pound (0.45kg) less CO₂ per hour of use than a conventional system. Just 100,000 homes converted to GHPs would reduce annual CO₂ emissions by 125,000 tons (114,000,000kg) per year. And, with all the equipment underground and inside, the architectural design and environmental placement of a structure is preserved naturally.

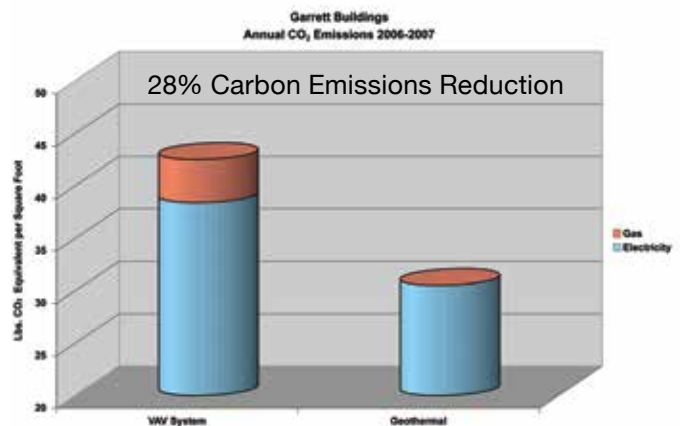

The Garrett Buildings Oklahoma City, OK




For utilities, the geothermal system offers solutions for leveling out peak demands and improving load factors. The electric utility load factor is a measure of how efficiently the power generation system is being utilized. A low load factor demonstrates more erratic usage. A high load factor customer is less costly to serve because the generation capacity required is more level throughout the year (less "peaks" and "valleys"). The geothermal system facilitates a much higher load factor than the conventional system creating a win-win for both the utility and the customer.

"After comparing the utility information of the two buildings, there's just no contest on the benefits of the geothermal system," said Garrett, building owner.


Energy efficiency, environmentally friendly and improved comfort levels all attest to the benefits of geothermal technology and what it offers to the world as a renewable energy source.

"If we had the opportunity to make one change that would provide the greatest effect on the concerns of the state of our nation's electrical power grid, dependency on foreign fuels and ozone depletion, choosing a geothermal heating and cooling system would be it."


Dan Ellis, President - ClimateMaster, Inc.

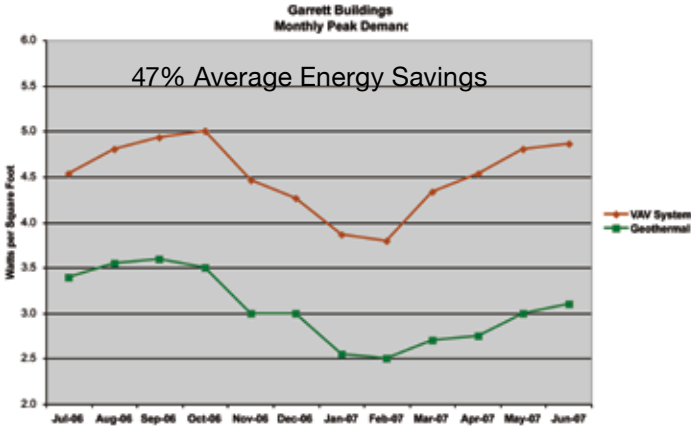

Analysis:
The Geo system has consistently lower peak demand all year as compared to the VAV system.

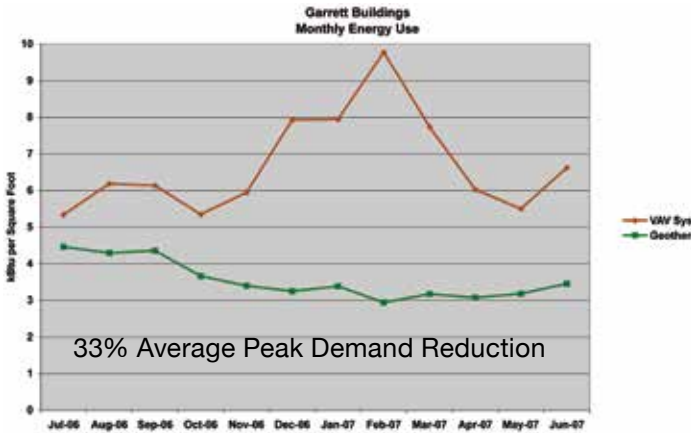

Analysis:
The Geo system uses substantially less energy each month than the VAV system.

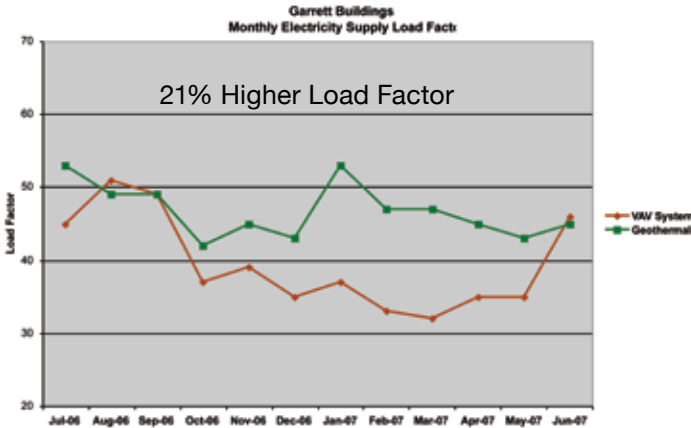

Analysis:
The electric utility load factor is a measure of how efficiently the power generation system is being utilized. A low load factor demonstrates more erratic usage. A high load factor customer is less costly to serve because the generation capacity required is more level throughout the year (less peaks and valleys). The geo system has a much higher load factor than the VAV system.



The Garrett Buildings

9701 Broadway Extension Oklahoma City, OK

Owner:

Steve Garrett

Contractor:

All Weather
Conditioning and Heating, Inc.
Oklahoma City, OK

Driller:

Air-O Heat & Air Conditioning
Lynn Vick
Stillwater, OK

Utility data:

Mike Newcomb of OG&E
Oklahoma City, OK

Manufacturer:

ClimateMaster, Inc.
www.climatemaster.com



ClimateMaster is the world's largest and most progressive manufacturer of geothermal heat pumps. The company is committed to innovation and dedicated to environmentally clean, economically sound and superbly comfortable home and business environments.

ClimateMaster has been designing and building equipment that enhances the environments we live and work in every day for more than 50 years. In addition to geothermal heat pumps, ClimateMaster offers the most extensive product line of water-source heat pumps for use in a wide variety of applications. ClimateMaster products are proudly built in the U.S.A.



ClimateMaster works continually to improve its products. As a result, the design and specifications of each product at the time for order may be changed without notice and may not be as described herein. Please contact ClimateMaster's Customer Service Department at 1-405-745-6000 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely ClimateMaster's opinion or commendation of its products.


CLIMATEMASTER
7300 S.W. 44th St.
Oklahoma City, OK 73179
Phone 405-745-6000
Fax 405-745-6058
climatemaster.com